



Purchasing Division

## Invitation for Bid

IFB-4853-21-DH

GRJM 21.5-G.95 Culvert Replacement

### **Responses Due:**

December 17, 2020 prior to 3:00pm

**Accepting Electronic Responses Only**

**Responses Only Submitted Through the Rocky Mountain E-Purchasing System (RMEPS)**

<https://www.rockymountainbidsystem.com/default.asp>

(Purchasing Representative does not have access or control of the vendor side of RMEPS. If website or other problems arise during response submission, vendor **MUST** contact RMEPS to resolve issue prior to the response deadline. 800-835-4603)

### **IMPORTANT NOTICE:**

Due to the recent developments with increased COVID-19 cases in Mesa County, public in-person bid openings are temporarily being suspended. Bid openings will still take place on their designated date and time virtually, and bid tabulations will still be posted for public view/access. Once the crisis has passed, public in-person bid openings will resume as normal. Attached is the virtual link and information to attend the bid opening. Public may addend through the link, or via phone.

### **Purchasing Representative:**

Duane Hoff Jr., Senior Buyer

[duaneh@gjcity.org](mailto:duaneh@gjcity.org)

970-244-1545

This document has been developed specifically to solicit competitive responses for this solicitation, and may not be the same as previous City of Grand Junction solicitations. All vendors are urged to thoroughly review this solicitation prior to responding. Submittal by **FAX, EMAIL or HARD COPY IS NOT ACCEPTABLE** for this solicitation.

# **Invitation for Bids**

## **Table of Contents**

Section 1	Instruction to Bidders
Section 2	General Contract Conditions
Section 3	Statement of Work
Section 4	Contractor's Bid Form
	Price Proposal/Bid Schedule Form
	Appendix
	Attachments

# 1. Instructions to Bidders

- 1.1. **Purpose:** The City of Grand Junction is soliciting competitive bids from qualified and interested companies for all labor, equipment, and materials required to replace the existing corrugated metal pipe at 21.5 Rd south of H Rd with a 60-inch HDPE culvert with concrete headwalls, wingwalls, and toewalls. All dimensions and scope of work should be verified by Contractors prior to submission of bids.

## **IFB Questions:**

Duane Hoff Jr., Senior Buyer

[duaneh@gjcity.org](mailto:duaneh@gjcity.org)

The City would like to remind all Contractors, Sub-Contractors, Vendors, Suppliers, Manufacturers, Service Providers, etc. that (with the exception of Pre-Bid or Site Visit Meetings) all questions, inquiries, comments, or communication pertaining to any formal solicitation (whether process, specifications, scope, etc.) must be directed (in writing) to the Purchasing Agent assigned to the project, or Purchasing Division. Direct communication with the City assigned Project Managers/Engineers is not appropriate for public procurement, and may result in disqualification.

- 1.2. **Mandatory Site Visit Meeting:** Prospective bidders are required to attend a mandatory site visit meeting on December 4, 2020 at 10:00am. Meeting location shall be at Pritchard Wash, located at 21 ½ Road just south of H Road. The purpose of this visit will be to inspect and to clarify the contents of this Invitation for Bids (IFB).
- 1.3. **The Owner:** The Owner is the City of Grand Junction, Colorado and is referred to throughout this Solicitation. The term Owner means the Owner or his authorized representative.
- 1.4. **Procurement Process:** Procurement processes shall be governed by the most current version of the City of Grand Junction [Purchasing Policy and Procedure Manual](#).
- 1.5. **Submission:** Each bid shall be submitted in electronic format only, and only through the Rocky Mountain E-Purchasing website (<https://www.rockymountainbidssystem.com/default.asp>). *This site offers both “free” and “paying” registration options that allow for full access of the Owner’s documents and for electronic submission of proposals. (Note: “free” registration may take up to 24 hours to process. Please Plan accordingly.)* Please view our “**Electronic Vendor Registration Guide**” at <http://www.gjcity.org/business-and-economic-development/bids/> for details. (Purchasing Representative does not have access or control of the vendor side of RMEPS. If website or other problems arise during response submission, vendor **MUST** contact RMEPS to resolve issue prior to the response deadline. **800-835-4603**)

Please join Solicitation Opening, IFB-4853-21-DH, GRJM 21.5-G.95 Culvert Replacement on GoToConnect from your computer using the Chrome browser. <https://my.jive.com/meet/351927605>

You can also dial in using your phone.

US: (571) 317-3116

Access Code: 351-927-605

- 1.6. **Modification and Withdrawal of Bids Before Opening.** Bids may be modified or withdrawn by an appropriate document stating such, duly executed and submitted to the place where Bids are to be submitted at any time prior to Bid Opening.
- 1.7. **Printed Form for Price Bid:** All Price Bids must be made upon the Price Bid Schedule attached, and should give the amounts both in words and in figures, and must be signed and acknowledged by the bidder.

The Offeror shall specify a unit price in figures for each pay item for which a quantity is given and shall provide the products (in numbers) of the respective unit prices and quantities in the Extended Amount column. The total Bid price shall be equal to the sum of all extended amount prices. When an item in the Price Bid Schedule provides a choice to be made by the Offeror, Offeror's choice shall be indicated in accordance with the specifications for that particular item and thereafter no further choice shall be permitted.

Where the unit of a pay item is lump sum, the lump sum amount shall be shown in the "extended amount" column and included in the summation of the total Bid.

All blank spaces in the Price Bid Schedule must be properly filled out.

Bids by corporations must be executed in the corporate name by the president or vice president or other corporate office accompanied by evidence of authority to sign. The corporate address and state of incorporation shall be shown below the signature.

Bids by partnerships must be executed in the partnership name and signed by a partner whose title must appear under the signature and the official address of the partnership must be shown below the signature.

All names must be typed or printed below the signature.

The Offeror's Bid shall contain an acknowledgement of receipt of all Addenda, the numbers of which shall be filled in on the Contractor's Bid Form.

The contact information to which communications regarding the Bid are to be directed must be shown.

- 1.8. **Exclusions:** No oral, telephonic, emailed, or facsimile bid will be considered
- 1.9. **Contract Documents:** The complete IFB and bidder's response compose the Contract Documents. Copies of bid documents can be obtained from the City Purchasing website, <http://www.gjcity.org/business-and-economic-development/bids/> .
- 1.10. **Additional Documents:** The July 2010 edition of the "City Standard Contract Documents for Capital Improvements Construction", Plans, Specifications and other Bid Documents are available for review or download on the Public Works &

Planning/Engineering page at [www.gjcity.org](http://www.gjcity.org). Electronic copies may be obtained on a CD format at the Department of Public Works and Planning at City Hall.

**1.11. Definitions and Terms:** See Article I, Section 3 of the General Contract Conditions in the *Standard Contract Documents for Capital Improvements Construction*.

**1.12. Examination of Specifications:** Bidders shall thoroughly examine and be familiar with the project Statement of Work. The failure or omission of any Offeror to receive or examine any form, addendum, or other document shall in no way relieve any Offeror from any obligation with respect to his bid. The submission of a bid shall be taken as evidence of compliance with this section. Prior to submitting a bid, each Offeror shall, at a minimum:

- a. Examine the *Contract Documents* thoroughly;
- b. Visit the site to familiarize themselves with local conditions that may in any manner affect cost, progress, or performance of the Work;
- c. Become familiar with federal, state, and local laws, ordinances, rules, and regulations that may in any manner affect cost, progress or performance of the Work;
- d. Study and carefully correlate Bidder's observations with the *Contract Documents*, and;
- e. Notify the Purchasing Agent of all conflicts, errors, ambiguities or discrepancies in or among the *Contract Documents* within the designated inquiry period.

On request, the Owner will provide each Offeror access to the site to conduct such investigations and tests as each Bidder deems necessary for submission of a Bid. It shall be the Offeror's responsibility to make or obtain any additional examinations, investigations, explorations, tests and studies and obtain any additional information and data which pertain to the physical conditions (including without limitation, surface, subsurface and underground utilities) at or contiguous to the site or otherwise which may affect cost, progress or performance of the work and which the Offeror deems necessary to determine its Bid for performing the work in accordance with the time, price and other terms and conditions of the Contract Documents. Location of any excavation or boring made by Offeror shall be subject to prior approval of Owner and applicable agencies. Offeror shall fill all holes, restore all pavements to match the existing structural section and shall clean up and restore the site to its former condition upon completion of such exploration. The Owner reserves the right to require the Offeror to execute an access agreement with the Owner prior to accessing the site.

The lands upon which the Work is to be performed, rights of way, and access thereto, and other lands designated for use by Contractor in performing the Work, are identified on the Drawings.

Information and data reflected in the *Contract Documents* with respect to underground utilities at or contiguous to the site are based upon information and data furnished to

the Owner and the Engineer by the owners of such underground utilities or others, and the Owner does not assume responsibility for the accuracy or completeness thereof, unless it is expressly provided otherwise in the *Contract Documents*.

By submission of a Bid, the Offeror shall be conclusively presumed to represent that the Offeror has complied with every requirement of these Instructions to Bidders, that the *Contract Documents* are not ambiguous and are sufficient in scope and detail to indicate and convey understanding of all terms and conditions for performance of the Work.

- 1.13. **Questions Regarding Statement of Work:** Any information relative to interpretation of Scope of Work or specifications shall be requested of the Purchasing Representative, in writing, in ample time, prior to the inquiry deadline.
- 1.14. **Addenda & Interpretations:** If it becomes necessary to revise any part of this solicitation, a written addendum will be posted electronically on the City's website at <http://www.gjcity.org/business-and-economic-development/bids/>. The Owner is not bound by any oral representations, clarifications, or changes made in the written specifications by Owner, unless such clarification or change is provided in written addendum form from the City Purchasing Representative.
- 1.15. **Taxes:** The Owner is exempt from State retail and Federal tax. The bid price must be net, exclusive of taxes.
- 1.16. **Sales and Use Taxes:** The Contractor and all Subcontractors are required to obtain exemption certificates from the Colorado Department of Revenue for sales and use taxes in accordance with the provisions of the General Contract Conditions. Bids shall reflect this method of accounting for sales and use taxes on materials, fixtures and equipment.
- 1.17. **Offers Binding 60 Days:** Unless additional time is required by the Owner, or otherwise specified, all formal offers submitted shall be binding for sixty (60) calendar days following opening date, unless the Bidder, upon request of the Purchasing Representative, agrees to an extension.
- 1.18. **Exceptions and Substitutions:** Bidders taking exception to the specifications and/or scope of work shall do so at their own risk. The Owner reserves the right to accept or reject any or all substitutions or alternatives. When offering substitutions and/or alternatives, Bidder must state these exceptions in the section pertaining to that area. Exception/substitution, if accepted, must meet or exceed the stated intent and/or specifications and/or scope of work. The absence of such a list shall indicate that the Bidder has not taken exceptions, and if awarded a contract, shall hold the Bidder responsible to perform in strict accordance with the specifications and/or scope of work contained herein.
- 1.19. **Collusion Clause:** Each bidder by submitting a bid certifies that it is not party to any collusive action or any action that may be in violation of the Sherman Antitrust Act. Any and all bids shall be rejected if there is evidence or reason for believing that collusion exists among bidders. The Owner may, or may not, accept future bids for the same services or commodities from participants in such collusion.

**1.20. Disqualification of Bidders:** A Bid will not be accepted from, nor shall a Contract be awarded to, any person, firm, or corporation that is in arrears to the Owner, upon debt or contract, or that has defaulted, as surety or otherwise, upon any obligation to the Owner, or that is deemed irresponsible or unreliable.

Bidders may be required to submit satisfactory evidence that they are responsible, have a practical knowledge of the project bid upon and that they have the necessary financial and other resources to complete the proposed Work.

Either of the following reasons, without limitation, shall be considered sufficient to disqualify a Bidder and Bid:

- a. More than one Bid is submitted for the same Work from an individual, firm, or corporation under the same or different name; and
- b. Evidence of collusion among Bidders. Any participant in such collusion shall not receive recognition as a Bidder for any future work of the Owner until such participant has been reinstated as a qualified bidder.

**1.21. Public Disclosure Record:** If the bidder has knowledge of their employee(s) or sub-contractors having an immediate family relationship with a City employee or elected official, the bidder must provide the Purchasing Representative with the name(s) of these individuals. These individuals are required to file an acceptable "Public Disclosure Record", a statement of financial interest, before conducting business with the City.

## **2. General Contract Conditions for Construction Projects**

**2.1. The Contract:** This Invitation for Bid, submitted documents, and any negotiations, when properly accepted by the City, shall constitute a contract equally binding between the City and Contractor. The contract represents the entire and integrated agreement between the parties hereto and supersedes all prior negotiations, representations, or agreements, either written or oral. The contract may be amended or modified with Change Orders, Field Orders, or Addendums.

**2.2. The Work:** The term Work includes all labor necessary to produce the construction required by the Contract Documents, and all materials and equipment incorporated or to be incorporated in such construction.

**2.3. Execution, Correlation, Intent, and Interpretations:** The Contract Documents shall be signed by the Owner (City) and Contractor. City will provide the contract. By executing the contract, the Contractor represents that he/she has visited the site, familiarized himself with the local conditions under which the Work is to be performed, and correlated his observations with the requirements of the Contract Documents. The Contract Documents are complementary, and what is required by any one, shall be as binding as if required by all. The intention of the documents is to include all labor, materials, equipment and other items necessary for the proper execution and completion of the scope of work as defined in the technical specifications and drawings contained

herein. All drawings, specifications and copies furnished by the City are, and shall remain, City property. They are not to be used on any other project, and with the exception of one contract set for each party to the contract, are to be returned to the owner on request at the completion of the work.

- 2.4. The Owner:** The Owner is the City of Grand Junction, Colorado and is referred to throughout the Contract Documents. The term Owner means the Owner or his authorized representative. The Owner shall, at all times, have access to the work wherever it is in preparation and progress. The Contractor shall provide facilities for such access. The Owner will make periodic visits to the site to familiarize himself generally with the progress and quality of work and to determine, in general, if the work is proceeding in accordance with the contract documents. Based on such observations and the Contractor's Application for Payment, the Owner will determine the amounts owing to the Contractor and will issue Certificates for Payment in such amounts, as provided in the contract. The Owner will have authority to reject work which does not conform to the Contract documents. Whenever, in his reasonable opinion, he considers it necessary or advisable to insure the proper implementation of the intent of the Contract Documents, he will have authority to require the Contractor to stop the work or any portion, or to require special inspection or testing of the work, whether or not such work can be then be fabricated, installed, or completed. The Owner will not be responsible for the acts or omissions of the Contractor, and sub-Contractor, or any of their agents or employees, or any other persons performing any of the work.
- 2.5. Contractor:** The Contractor is the person or organization identified as such in the Agreement and is referred to throughout the Contract Documents. The term Contractor means the Contractor or his authorized representative. The Contractor shall carefully study and compare the General Contract Conditions of the Contract, Specification and Drawings, Scope of Work, Addenda and Modifications and shall at once report to the Owner any error, inconsistency or omission he may discover. Contractor shall not be liable to the Owner for any damage resulting from such errors, inconsistencies or omissions. The Contractor shall not commence work without clarifying Drawings, Specifications, or Interpretations.
- 2.6. Sub-Contractors:** A sub-contractor is a person or organization who has a direct contract with the Contractor to perform any of the work at the site. The term sub-contractor is referred to throughout the contract documents and means a sub-contractor or his authorized representative.
- 2.7. Award of Sub-Contractors & Other Contracts for Portions of the Work:** Contractor shall submit with their bid response to the Owner, in writing for acceptance, a list of the names of the sub-contractors or other persons or organizations proposed for such portions of the work as may be designated in the proposal requirements, or, if none is so designated, the names of the sub-contractors proposed for the principal portions of the work. Prior to the award of the contract, the Owner shall notify the successful Contractor in writing if, after due investigation, has reasonable objection to any person or organization on such list. If, prior to the award of the contract, the Owner has a reasonable and substantial objection to any person or organization on such list, and refuses in writing to accept such person or organization, the successful Contractor may, prior to the award, withdraw their proposal without forfeiture of proposal security. If the



successful Contractor submits an acceptable substitute with an increase in the proposed price to cover the difference in cost occasioned by the substitution, the Owner may, at their discretion, accept the increased proposal or may disqualify the Contractor. If, after the award, the Owner refuses to accept any person or organization on such list, the Contractor shall submit an acceptable substitute and the contract sum shall be increased or decreased by the difference in cost occasioned by such substitution and an appropriate Change Order shall be issued. However, no increase in the contract sum shall be allowed for any such substitution unless the Contractor has acted promptly and responsively in submitting a name with respect thereto prior to the award.

- 2.8. Quantities of Work and Unit Price:** Materials or quantities stated as unit price items in the Bid are supplied only to give an indication of the general scope of the Work, and are as such, estimates only. The Owner does not expressly or by implication agree that the actual amount of Work or material will correspond therewith, and reserves the right after award to increase or decrease the quantity of any unit item of the Work without a change in the unit price except as set forth in Article VIII, Section 70 of the *General Contract Conditions*. The City also reserves the right to make changes in the Work (including the right to delete any bid item in its entirety or add additional bid items) as set forth in Article VIII, Sections 69 through 71 of the *General Contract Conditions*.
- 2.9. Substitutions:** The materials, products and equipment described in the *Solicitation Documents* shall be regarded as establishing a standard of required performance, function, dimension, appearance, or quality to be met by any proposed substitution. No substitution will be considered prior to receipt of Bids unless the Offeror submits a written request for approval to the City Purchasing Division at least ten (10) days prior to the date for receipt of Bids. Such requests for approval shall include the name of the material or equipment for which substitution is sought and a complete description of the proposed substitution including drawings, performance and test data, and other information necessary for evaluation, including samples if requested. The Offeror shall set forth changes in other materials, equipment, or other portions of the Work including changes of the work of other contracts, which incorporation of the proposed substitution would require to be included. The Owner's decision of approval or disapproval of a proposed substitution shall be final. If the Owner approves a proposed substitution before receipt of Bids, such approval will be set forth in an Addendum. Offerors shall not rely upon approvals made in any other manner.
- 2.10. Supervision and Construction Procedures:** The Contractor shall supervise and direct the work, using his best skill and attention. He shall be solely responsible for all construction means, methods, techniques, sequences and procedures and for coordinating all portions of the work under the contract.
- 2.11. Warranty:** The Contractor warrants to the Owner that all materials and equipment furnished under this contract will be new unless otherwise specified, and that all work will be of good quality, free from faults and defects and in conformance with the Contract Documents. All work not so conforming to these standards may be considered defective. If required by Owner, the Contractor shall furnish satisfactory evidence as to the kind and quality of materials and equipment. If within ten (10) days after written notice to the Contractor requesting such repairs or replacement, the Contractor should neglect to make or undertake with due diligence to the same, the City may make such repairs or

replacements. All indirect and direct costs of such correction or removal or replacement shall be at the Contractor's expense. The Contractor will also bear the expenses of making good all work of others destroyed or damaged by the correction, removal or replacement of his defective work.

- 2.12. Permits, Fees, & Notices:** The Contractor shall secure and pay for all permits, governmental fees and licenses necessary for the proper execution and completion of the work. The Contractor shall give all notices and comply with all laws, ordinances, rules, regulations and orders of any public authority bearing on the performance of the work. If the Contractor observes that any of the Contract Documents are at variance in any respect, he shall promptly notify the Owner in writing, and any necessary changes shall be adjusted by approximate modification. If the Contractor performs any work knowing it to be contrary to such laws, ordinances, rules and regulations, and without such notice to the Owner, he shall assume full responsibility and shall bear all costs attributable.
- 2.13. Responsibility for Those Performing the Work:** The Contractor shall be responsible to the Owner for the acts and omissions of all his employees and all sub-contractors, their agents and employees, and all other persons performing any of the work under a contract with the Contractor.
- 2.14. Use of the Site:** The Contractor shall confine operations at the site to areas permitted by law, ordinances, permits and the Contract Documents, and shall not unreasonably encumber the site with any materials or equipment.
- 2.15. Cleanup:** The Contractor at all times shall keep the premises free from accumulation of waste materials or rubbish caused by his operations. At the completion of work he shall remove all his waste materials and rubbish from and about the project, as well as all his tools, construction equipment, machinery and surplus materials.
- 2.16. Insurance:** The Contractor shall secure and maintain such insurance policies as will provide the coverage and contain other provisions specified in the General Contract Conditions, or as modified in the Special Contract Conditions.

The Contractor shall file a copy of the policies or Certificates of Insurance acceptable to the City with the Engineer within ten (10) Calendar Days after issuance of the Notice of Award. These Certificates of Insurance shall contain a provision that coverage afforded under the policies shall not be canceled unless at least thirty (30) Calendar Days prior written notice has been given to the City.

- 2.17. Indemnification:** The Contractor shall defend, indemnify and save harmless the Owner, and all its officers, employees, insurers, and self-insurance pool, from and against all liability, suits, actions, or other claims of any character, name and description brought for or on account of any injuries or damages received or sustained by any person, persons, or property on account of any negligent act or fault of the Contractor, or of any Contractor's agent, employee, sub-contractor or supplier in the execution of, or performance under, any contract which may result from proposal award. Contractor shall pay any judgment with cost which may be obtained against the Owner growing out of such injury or damages.

- 2.18. Miscellaneous Conditions: Material Availability:** Contractors must accept responsibility for verification of material availability, production schedules, and other pertinent data prior to submission of bid. It is the responsibility of the bidder to notify the Owner immediately if materials specified are discontinued, replaced, or not available for an extended period of time. **OSHA Standards:** All bidders agree and warrant that services performed in response to this invitation shall conform to the standards declared by the US Department of Labor under the Occupational Safety and Health Act of 1970 (OSHA). In the event the services do not conform to OSHA standards, the Owner may require the services to be redone at no additional expense to the Owner.
- 2.19. Time:** Time is of the essence with respect to the time of completion of the Project and any other milestones or deadline which are part of the Contract. It will be necessary for each Bidder to satisfy the City of its ability to complete the Work within the Contract Time set forth in the Contract Documents. The Contract Time is the period of time allotted in the Contract Documents for completion of the work. The date of commencement of the work is the date established in a Notice to Proceed. If there is no Notice to Proceed, it shall be the date of the Contract or such other date as may be established therein, or as established as entered on the Bid Form. The Date of Final Completion of the work is the date certified by the Owner when all construction, and all other work associated to include, but not be limited to: testing, QA/QC, receipt of required reports and/or forms, grant requirements (if applicable), punch list items, clean-up, receipt of drawings and/or as-builts, etc., is fully complete, and in accordance with the Contract Documents.
- 2.20. Progress & Completion:** The Contractor shall begin work on the date of commencement as defined in the Contract, and shall carry the work forward expeditiously with adequate forces and shall complete it within the contract time.
- 2.21. Payment & Completion:** The Contract Sum is stated in the Contract and is the total amount payable by the Owner to the Contractor for the performance of the work under the Contract Documents. Upon receipt of written notice that the work is ready for final inspection and acceptance and upon receipt of application for payment, the Owner's Project Manager will promptly make such inspection and, when he finds the work acceptable under the Contract Documents and the Contract fully performed, the Owner shall make payment in the manner provided in the Contract Documents.
- 2.22. Bid Bond:** Each Bid shall as a guaranty of good faith on the part of the Bidder be accompanied by a Bid Guaranty consisting of: a certified or cashier's check drawn on an approved national bank or trust company in the state of Colorado, and made payable without condition to the City; or a **Bid Bond** written by an approved corporate surety in favor of the City. The amount of the Bid Guaranty shall not be less than 5% of the total Bid amount. Once a Bid is accepted and a Contract is awarded, the apparent successful bidder has ten calendar days to enter into a contractor in the form prescribed and to furnish the bonds with a legally responsible and approved surety. Failure to do so will result in forfeiture of the Bid Guaranty to the City as Liquidated Damages.

Each bidder shall guaranty its total bid price for a period of sixty (60) Calendar Days from the date of the bid opening.

- 2.23. Performance & Payment Bonds:** Contractor shall furnish a Performance and a Payment Bond, each in an amount at least equal to that specified for the contract amount as security for the faithful performance and payment of all Contractor's obligations under the Contract Documents. These bonds shall remain in effect for the duration of the Warranty Period (as specified in the Special Conditions). Contractor shall also furnish other bonds that may be required by the Special Conditions. All bonds shall be in the forms prescribed by the Contract Documents and be executed by such sureties as (1) are licensed to conduct business in the State of Colorado and (2) are named in the current list of "Companies Holding Certificates of Authority as Acceptable Sureties on Federal Bonds and as Acceptable Reinsuring Companies" as published in Circular 570 (amended) by the Audit Staff, Bureau of Accounts, U.S. Treasury Department. All bonds signed by an agent must be accompanied by a certified copy of the Authority Act. If the surety on any bond furnished by the Contractor is declared bankrupt, or becomes insolvent, or its rights to do business in Colorado are terminated, or it ceases to meet the requirements of clauses (1) and (2) of this section, Contractor shall within five (5) days thereafter substitute another bond and surety, both of which shall be acceptable to the City.
- 2.24. Retention:** The Owner will deduct money from the partial payments in amounts considered necessary to protect the interest of the Owner and will retain this money until after completion of the entire contract. The amount to be retained from partial payments will be five (5) percent of the value of the completed work, and not greater than five (5) percent of the amount of the Contract. When the retainage has reached five (5) percent of the amount of the Contract no further retainage will be made and this amount will be retained until such time as final payment is made.
- 2.25. Liquidated Damages for Failure to Enter Into Contract:** Should the Successful Bidder fail or refuse to enter into the Contract within ten Calendar Days from the issuance of the Notice of Award, the City shall be entitled to collect the amount of such Bidder's Bid Guaranty as Liquidated Damages, not as a penalty but in consideration of the mutual release by the City and the Successful Bidder of all claims arising from the City's issuance of the Notice of Award and the Successful Bidder's failure to enter into the Contract and the costs to award the Contract to any other Bidder, to readvertise, or otherwise dispose of the Work as the City may determine best serves its interest.
- 2.26. Liquidated Damages for Failure to Meet Project Completion Schedule:** If the Contractor does not achieve Final Completion by the required date, whether by neglect, refusal or any other reason, the parties agree and stipulate that the Contractor shall pay liquidated damages to the City for each such day that final completion is late. As provided elsewhere, this provision does not apply for delays caused by the City. The date for Final Completion may be extended in writing by the Owner.

The Contractor agrees that as a part of the consideration for the City's awarding of this Contract liquidated damages in the daily amount of **\$1000.00** is reasonable and necessary to pay for the actual damages resulting from such delay. The parties agree that the real costs and injury to the City for such delay include hard to quantify items such as: additional engineering, inspection and oversight by the City and its agents; additional contract administration; inability to apply the efforts of those employees to the other work of the City; perceived inefficiency of the City; citizens having to deal with the

construction and the Work, rather than having the benefit of a completed Work, on time; inconvenience to the public; loss of reputation and community standing for the City during times when such things are very important and very difficult to maintain.

The Contractor must complete the Work and achieve final completion included under the Bid Schedule in the number of consecutive calendar days after the City gives its written Notice to Proceed. When the Contractor considers the entire Work ready for its intended use, Contractor shall certify in writing that the Work is fully complete. Final Completion date is the date by which the Contractor shall have fully completed all clean-up, and all items that were identified by the City in the inspection for final completion. Unless otherwise stated in the Special Conditions, for purposes of this liquidated damages clause, the Work shall not be finished and the Contract time shall continue to accrue until the City gives its written Final Acceptance.

If the Contractor shall fail to pay said liquidated damages promptly upon demand thereof after having failed to achieve Final Completion on time, the City shall first look to any retainage or other funds from which to pay said liquidated damages; if retainage or other liquid funds are not available to pay said liquidated damages amounts, the Surety on the Contractor's Performance Bond and Payment Bond shall pay such liquidated damages. In addition, the City may withhold all, or any part of, such liquidated damages from any payment otherwise due the Contractor.

Liquidated damages as provided do not include any sums to reimburse the City for extra costs which the City may become obligated to pay on other contracts which were delayed or extended because of the Contractor's failure to complete the Work within the Contract Time. Should the City incur additional costs because of delays or extensions to other contracts resulting from the Contractor's failure of timely performance, the Contractor agrees to pay these costs that the City incurs because of the Contractor's delay, and these payments are separate from and in addition to any liquidated damages.

The Contractor agrees that the City may use its own forces or hire other parties to obtain Final Completion of the work if the time of completion has elapsed and the Contractor is not diligently pursuing completion. In addition to the Liquidated Damages provided for, the Contractor agrees to reimburse the City for all expenses thus incurred.

**2.27. Contingency/Force Account/Minor Contract Revisions:** Contingency/Force Account/Minor Contract Revisions work will be authorized by the Owner's Project Manager and is defined as minor expenses to cover miscellaneous or unforeseen expenses related to the project. The expenses are not included in the Drawings, Specifications, or Scope of Work and are necessary to accomplish the scope of this contract. Contingency/Force Account/Minor Contract Revisions Authorization will be directed by the Owner through an approved form. Contingency/Force Account/Minor Contract Revisions funds are the property of the Owner and any Contingency/Force Account/Minor Contract Revisions funds, not required for project completion, shall remain the property of the Owner. Contractor is not entitled to any Contingency/Force Account/Minor Contract Revisions funds, that are not authorized by Owner or Owner's Project Manager.

**2.28. Protection of Persons & Property:** The Contractor shall comply with all applicable laws, ordinances, rules, regulations and orders of any public authority having jurisdiction

for the safety of persons or property or to protect them from damage, injury or loss. Contractor shall erect and maintain, as required by existing safeguards for safety and protection, and all reasonable precautions, including posting danger signs or other warnings against hazards promulgating safety regulations and notifying owners and users of adjacent utilities. When or where any direct or indirect damage or injury is done to public or private property by or on account of any act, omission, neglect, or misconduct by the Contractor in the execution of the work, or in consequence of the non-execution thereof by the Contractor, he shall restore, at his own expense, such property to a condition similar or equal to that existing before such damage or injury was done, by repairing, rebuilding, or otherwise restoring as may be directed, or it shall make good such damage or injury in an acceptable manner.

- 2.29. Changes in the Work:** The Owner, without invalidating the contract, may order changes in the work within the general scope of the contract consisting of additions, deletions or other revisions, the contract sum and the contract time being adjusted accordingly. All such changes in the work shall be authorized by Change Order and shall be executed under the applicable conditions of the contract documents. A Change Order is a written order to the Contractor signed by the Owner issued after the execution of the contract, authorizing a change in the work or an adjustment in the contract sum or the contract time. The contract sum and the contract time may be changed only by Change Order.
- 2.30. Claims for Additional Cost or Time:** If the Contractor wishes to make a claim for an increase in the contract sum or an extension in the contract time, he shall give the Owner written notice thereof within a reasonable time after the occurrence of the event giving rise to such claim. This notice shall be given by the Contractor before proceeding to execute the work, except in an emergency endangering life or property in which case the Contractor shall precede in accordance with the regulations on safety. No such claim shall be valid unless so made. Any change in the contract sum or contract time resulting from such claim shall be authorized by Change Order.
- 2.31. Minor Changes in the Work:** The Owner shall have authority to order minor changes in the work not involving an adjustment in the contract sum or an extension of the contract time and not inconsistent with the intent of the contract documents.
- 2.32. Field Orders:** The Owner may issue written Field Orders which interpret the Contract Documents in accordance with the specifications, or which order minor changes in the work in accordance with the agreement, without change in the contract sum or time. The Contractor shall carry out such Field Orders promptly.
- 2.33. Uncovering & Correction of Work:** The Contractor shall promptly correct all work rejected by the Owner as defective or as failing to conform to the contract documents whether observed before or after substantial completion and whether or not fabricated installed or competed. The Contractor shall bear all costs of correcting such rejected work, including the cost of the Owner's additional services thereby made necessary. If within one (1) year after the date of completion or within such longer period of time as may be prescribed by law or by the terms of any applicable special guarantee required by the contract documents, any of the work found to be defective or not in accordance with the contract documents, the Contractor shall correct it promptly after receipt of a written notice from the Owner to do so unless the Owner has previously given the

Contractor a written acceptance of such condition. The Owner shall give such notice promptly after discover of condition. All such defective or non-conforming work under the above paragraphs shall be removed from the site where necessary and the work shall be corrected to comply with the contract documents without cost to the Owner. The Contractor shall bear the cost of making good all work of separate Contractors destroyed or damaged by such removal or correction. If the Owner prefers to accept defective or non-conforming work, he may do so instead of requiring its removal and correction, in which case a Change Order will be issued to reflect an appropriate reduction in the payment or contract sum, or, if the amount is determined after final payment, it shall be paid by the Contractor.

- 2.30. Amendment:** No oral statement of any person shall modify or otherwise change, or affect the terms, conditions or specifications stated in the resulting contract. All amendments to the contract shall be made in writing by the Owner.
- 2.31. Assignment:** The Contractor shall not sell, assign, transfer or convey any contract resulting from this IFB, in whole or in part, without the prior written approval from the Owner.
- 2.32. Compliance with Laws:** Bids must comply with all Federal, State, County and local laws governing or covering this type of service and the fulfillment of all ADA (Americans with Disabilities Act) requirements.
- 2.33. Confidentiality:** All information disclosed by the Owner to the Contractor for the purpose of the work to be done or information that comes to the attention of the Contractor during the course of performing such work is to be kept strictly confidential.
- 2.34. Conflict of Interest:** No public official and/or City/County employee shall have interest in any contract resulting from this IFB.
- 2.35. Contract Termination:** This contract shall remain in effect until any of the following occurs: (1) contract expires; (2) completion of services; (3) acceptance of services or, (4) for convenience terminated by either party with a written *Notice of Cancellation* stating therein the reasons for such cancellation and the effective date of cancellation.
- 2.36. Employment Discrimination:** During the performance of any services per agreement with the Owner, the Contractor, by submitting a Bid, agrees to the following conditions:
  - 2.36.1.** The Contractor shall not discriminate against any employee or applicant for employment because of race, religion, color, sex, age, handicap, or national origin except when such condition is a legitimate occupational qualification reasonably necessary for the normal operations of the Contractor. The Contractor agrees to post in conspicuous places, visible to employees and applicants for employment, notices setting forth the provisions of this nondiscrimination clause.
  - 2.36.2.** The Contractor, in all solicitations or advertisements for employees placed by or on behalf of the Contractor, shall state that such Contractor is an Equal Opportunity Employer.

- 2.36.3.** Notices, advertisements, and solicitations placed in accordance with federal law, rule, or regulation shall be deemed sufficient for the purpose of meeting the requirements of this section.
- 2.37. Affirmative Action:** In executing a Contract with the City, the Contractor agrees to comply with Affirmative Action and Equal Employment Opportunity regulations presented in the General Contract Conditions.
- 2.38. Immigration Reform and Control Act of 1986 and Immigration Compliance:** The Offeror certifies that it does not and will not during the performance of the contract employ illegal alien workers or otherwise violate the provisions of the Federal Immigration Reform and Control Act of 1986 and/or the immigration compliance requirements of State of Colorado C.R.S. § 8-17.5-101, *et.seq.* (House Bill 06-1343).
- 2.39. Ethics:** The Contractor shall not accept or offer gifts or anything of value nor enter into any business arrangement with any employee, official, or agent of the Owner.
- 2.40. Failure to Deliver:** In the event of failure of the Contractor to deliver services in accordance with the contract terms and conditions, the Owner, after due oral or written notice, may procure the services from other sources and hold the Contractor responsible for any costs resulting in additional purchase and administrative services. This remedy shall be in addition to any other remedies that the Owner may have.
- 2.41. Failure to Enforce:** Failure by the Owner at any time to enforce the provisions of the contract shall not be construed as a waiver of any such provisions. Such failure to enforce shall not affect the validity of the contract or any part thereof or the right of the Owner to enforce any provision at any time in accordance with its terms.
- 2.42. Force Majeure:** The Contractor shall not be held responsible for failure to perform the duties and responsibilities imposed by the contract due to legal strikes, fires, riots, rebellions, and acts of God beyond the control of the Contractor, unless otherwise specified in the contract.
- 2.43. Independent Contractor:** The Contractor shall be legally considered an Independent Contractor and neither the Contractor nor its employees shall, under any circumstances, be considered servants or agents of the Owner. The Owner shall be at no time legally responsible for any negligence or other wrongdoing by the Contractor, its servants, or agents. The Owner shall not withhold from the contract payments to the Contractor any federal or state unemployment taxes, federal or state income taxes, Social Security Tax or any other amounts for benefits to the Contractor. Further, the Owner shall not provide to the Contractor any insurance coverage or other benefits, including Workers' Compensation, normally provided by the Owner for its employees.
- 2.44. Nonconforming Terms and Conditions:** A bid that includes terms and conditions that do not conform to the terms and conditions of this Invitation for Bid is subject to rejection as non-responsive. The Owner reserves the right to permit the Contractor to withdraw nonconforming terms and conditions from its bid prior to a determination by the Owner of non-responsiveness based on the submission of nonconforming terms and conditions.



Items for non-responsiveness may include, but not be limited to:

- a. Submission of the Bid on forms other than those supplied by the City;
- b. Alteration, interlineation, erasure, or partial detachment of any part of the forms which are supplied herein;
- c. Inclusion of unauthorized additions conditional or alternate Bids or irregularities of any kind which may tend to make the Bid incomplete, indefinite, or ambiguous as to its meaning;
- d. Failure to acknowledge receipt of any or all issued Addenda;
- e. Failure to provide a unit price or a lump sum price, as appropriate, for each pay item listed except in the case of authorized alternative pay items;
- f. Failure to list the names of Subcontractors used in the Bid preparation as may be required in the Solicitation Documents;
- g. Submission of a Bid that, in the opinion of the Owner, is unbalanced so that each item does not reasonably carry its own proportion of cost or which contains inadequate or unreasonable prices for any item;
- h. Tying of the Bid with any other bid or contract; and
- i. Failure to calculate Bid prices as described herein.

**2.45. Evaluation of Bids and Offerors:** The Owner reserves the right to:

- reject any and all Bids,
- waive any and all informalities,
- take into account any prompt payment discounts offered by Bidder,
- negotiate final terms with the Successful Bidder,
- take into consideration past performance of previous awards/contracts with the Owner of any Contractor, Vendor, Firm, Supplier, or Service Provider in determining final award. and
- disregard any and all nonconforming, nonresponsive or conditional Bids.

Discrepancies between words and figures will be resolved in favor of words. Discrepancies between Unit Prices and Extended Prices will be resolved in favor of the Unit Prices. Discrepancies between the indicated sum of any column of figures and the correct sum thereof will be resolved in favor of the correct sum. The corrected extensions and totals will be shown in the tabulation of Bids.

The Owner may consider the qualifications and experience of Subcontractors and other persons and organizations (including those who are to furnish the principal items of material or equipment) proposed for those portions of the work as to which the identity of Subcontractors and other persons and organizations must be submitted. Operating costs, maintenance considerations performance data, and guarantees of materials and equipment may also be considered by the Owner.

The Owner will conduct such investigations as deemed necessary to assist in the evaluation of any Bid and to establish the responsibility, qualifications and financial ability of the Offeror, proposed Subcontractors and other persons and organizations to do the Work in accordance with the *Contract Documents* to the City's satisfaction within the Contract Time.

The Offeror shall furnish the Owner all information and data requested by the Owner to determine the ability of the Offeror to perform the Work. The Owner reserves the right to reject the Bid if the evidence submitted by, or investigation of such Offeror fails to satisfy the Owner that such Offeror is properly qualified to carry out the obligations of the Contract and to complete the Work contemplated therein.

By submitting a Bid, each Offeror authorizes the Owner to perform such investigation of the Offeror as the Owner deems necessary to establish the responsibility, qualifications and financial ability of the Offeror and, by its signature thereon, authorizes the Owner to obtain reference information concerning the Offeror and releases the party providing such information and the Owner from any and all liability to the Offeror as a result of such reference information so provided.

The Owner reserves the right to reject the Bid of any Offeror who does not pass any evaluation to the Owner's satisfaction.

If the Contract is to be awarded, it will be awarded to the Offeror who, by evaluation, the Owner determines will best meet the Owner's interests.

The Owner reserves the right to accept or reject the Work contained in any of the Price Bid Schedules or alternates, either in whole or in part.

**2.46. Award of Contract:** Unless otherwise indicated, a single award will be made for all the bid items in an individual bid schedule. In the event that the Work is contained in more than one Bid Schedule, the City may award Schedules individually or in combination. In the case of two Bid Schedules which are alternative to each other, only one of such alternative Schedules will be awarded. Within forty-five (45) Calendar Days of Bid Opening, the City will issue a Notice of Award to the Successful Bidder which will be accompanied by four (4) unsigned copies of the Contract and the Performance and Payment Bond forms. Within ten (10) Calendar Days thereafter, the Successful Bidder shall sign and deliver four (4) copies of the Contract, Performance Bond, Payment Bond and Certificates of Insurance to the City. Within ten (10) Calendar Days thereafter, the City will deliver two (2) fully executed counterparts of the Contract to the Contractor. No contract shall exist between the Successful Bidder and the City and the Successful Bidder shall have no rights at law or in equity until the Contract has been duly executed by the City.

The Successful Bidder's failure to sign and submit a Contract and other documents set forth in this Paragraph within the prescribed time shall be just cause of annulment of the award, and forfeiture of the Bid Guaranty. The award of Contract may then be made to the next qualified Bidder in the same manner as previously prescribed.

- 2.47. **Ownership:** All plans, prints, designs, concepts, etc., shall become the property of the Owner.
- 2.48. **Oral Statements:** No oral statement of any person shall modify or otherwise affect the terms, conditions, or specifications stated in this document and/or resulting agreement. All modifications to this request and any agreement must be made in writing by the Owner.
- 2.49. **Patents/Copyrights:** The Contractor agrees to protect the Owner from any claims involving infringements of patents and/or copyrights. In no event shall the Owner be liable to the Contractor for any/all suits arising on the grounds of patent(s)/copyright(s) infringement. Patent/copyright infringement shall null and void any agreement resulting from response to this IFB.
- 2.50. **Remedies:** The Contractor and Owner agree that both parties have all rights, duties, and remedies available as stated in the Uniform Commercial Code.
- 2.51. **Venue:** Any agreement as a result of responding to this IFB shall be deemed to have been made in, and shall be construed and interpreted in accordance with, the laws of the City of Grand Junction, Mesa County, Colorado.
- 2.52. **Expenses:** Expenses incurred in preparation, submission and presentation of this IFB are the responsibility of the company and cannot be charged to the Owner.
- 2.53. **Sovereign Immunity:** The Owner specifically reserves its right to sovereign immunity pursuant to Colorado State Law as a defense to any action arising in conjunction to this agreement.
- 2.54. **Non-Appropriation of Funds:** The contractual obligation of the Owner under this contract is contingent upon the availability of appropriated funds from this fiscal year budget as approved by the City Council or Board of County Commissioners from this fiscal year only. State of Colorado Statutes prohibit obligation of public funds beyond the fiscal year for which the budget was approved. Anticipated expenditures/obligations beyond the end of the current Owner's fiscal year budget shall be subject to budget approval. Any contract will be subject to and must contain a governmental non-appropriation of funds clause.
- 2.55. **Cooperative Purchasing:** Purchases as a result of this solicitation are primarily for the City/County. Other governmental entities may be extended the opportunity to utilize the resultant contract award with the agreement of the successful provider and the participating agencies. All participating entities will be required to abide by the specifications, terms, conditions and pricings established in this Bid. The quantities furnished in this bid document are for only the City/County. It does not include quantities

for any other jurisdiction. The City or County will be responsible only for the award for its jurisdiction. Other participating entities will place their own awards on their respective Purchase Orders through their purchasing office or use their purchasing card for purchase/payment as authorized or agreed upon between the provider and the individual entity. The City/County accepts no liability for payment of orders placed by other participating jurisdictions that choose to piggy-back on our solicitation. Orders placed by participating jurisdictions under the terms of this solicitation will indicate their specific delivery and invoicing instructions.

- 2.56. Keep Jobs in Colorado Act:** Contractor shall be responsible for ensuring compliance with Article 17 of Title 8, Colorado Revised Statutes requiring 80% Colorado labor to be employed on public works. Contractor shall, upon reasonable notice provided by the Owner, permit the Owner to inspect documentation of identification and residency required by C.R.S. §8-17-101(2)(a). If Contractor claims it is entitled to a waiver pursuant to C.R.S. §8-17-101(1), Contractor shall state that there is insufficient Colorado labor to perform the work such that compliance with Article 17 would create an undue burden that would substantially prevent a project from proceeding to completion, and shall include evidence demonstrating the insufficiency and undue burden in its response.

Unless expressly granted a waiver by the Owner pursuant to C.R.S. §8-17-101(1), Contractor shall be responsible for ensuring compliance with Article 17 of Title 8, Colorado Revised Statutes requiring 80% Colorado labor to be employed on public works. Contractor shall, upon reasonable notice provided by the Owner, permit the Owner to inspect documentation of identification and residency required by C.R.S. §8-17-101(2)(a).

**2.56.1.** "Public project" is defined as:

- (a) any construction, alteration, repair, demolition, or improvement of any land, building, structure, facility, road, highway, bridge, or other public improvement suitable for and intended for use in the promotion of the public health, welfare, or safety and any maintenance programs for the upkeep of such projects
- (b) for which appropriate or expenditure of moneys may be reasonably expected to be \$500,000.00 or more in the aggregate for any fiscal year
- (c) except any project that receives federal moneys.

### **3. Statement of Work**

- 3.1. GENERAL:** The work request is for the replacement of the existing corrugated metal pipe at 21.5 Rd south of H Rd with a 60-inch HDPE culvert with concrete headwalls, wingwalls, and toewalls. The replacement will include Geotextile Fabric, Aggregate Base Course, HDPE pipe, Reinforced concrete walls, and Asphalt placement.
- 3.2. PROJECT DESCRIPTION:** The project includes 100 linear feet of 60-inch HDPE pipe with 12-inch-thick concrete headwalls and wingwalls and 8-inch-thick toewalls on each end of the culvert. All dimensions and scope of work should be verified by Contractors prior to submission of bids.

### 3.3. SPECIAL CONDITIONS & PROVISIONS:

**3.3.1 Mandatory Site Visit Meeting:** Prospective bidders are required to attend a mandatory site visit meeting on December 4, 2020 at 10:00am. Meeting location shall be at Pritchard Wash, located at 21 ½ Road just south of H Road. The purpose of this visit will be to inspect and to clarify the contents of this Invitation for Bids (IFB).

#### 3.3.2 QUESTIONS REGARDING SOLICIATION PROCESS/SCOPE OF WORK:

Duane Hoff Jr., Senior Buyer  
City of Grand Junction  
[duaneh@gjcity.org](mailto:duaneh@gjcity.org)

**3.3.3 Project Manager:** The Project Manager for the Project is Kirsten Armbruster, Project Engineer, who can be reached at (970) 244-1421. During Construction, all notices, letters, submittals, and other communications directed to the City shall be addressed and mailed or delivered to:

City of Grand Junction  
Department of Public Works and Planning  
Attn: Kirsten Armbruster, Project Manager  
250 North Fifth Street  
Grand Junction, CO 81501

**3.3.4 Affirmative Action:** The Contractor is not required to submit a written Affirmative Action Program for the Project.

**3.3.5 Pricing:** Pricing shall be all inclusive to include but not be limited to: all labor, equipment, supplies, materials, freight (F.O.B. Destination – Freight Pre-paid and Allowed to each site), travel, mobilization costs, fuel, set-up and take down costs, and full-time inspection costs, and all other costs related to the successful completion of the project.

The Owner shall not pay nor be liable for any other additional costs including but not limited to: taxes, shipping charges, insurance, interest, penalties, termination payments, attorney fees, liquidated damages, etc.

**3.3.6 Freight/Shipping:** All freight/shipping shall be F.O.B. Destination – Freight Pre-Paid and Allowed to the project site(s), Grand Junction, CO.

Contractor must meet all federal, state, and local rules, regulations, and requirements for providing such services.

**3.3.7 Contract:** A binding contract shall consist of: (1) the IFB and any amendments thereto, (2) the bidder's response (bid) to the IFB, (3) clarification of the bid, if any, and (4) the City's Purchasing Department's acceptance of the bid by "Notice of Award" or by "Purchase Order". All Exhibits and Attachments included In the IFB shall be incorporated into the contract by reference.

A. The contract expresses the complete agreement of the parties and,

performance shall be governed solely by the specifications and requirements contained therein.

B. Any change to the contract, whether by modification and/or supplementation, must be accomplished by a formal contract amendment signed and approved by and between the duly authorized representative of the bidder and the City Purchasing Division or by a modified Purchase Order prior to the effective date of such modification. The bidder expressly and explicitly understands and agrees that no other method and/or no other document, including acts and oral communications by or from any person, shall be used or construed as an amendment or modification to the contract.

**3.3.8 Time of Completion:** The scheduled time of Completion for the Project is 90 Calendar Days from the starting date specified in the Notice to Proceed.

Completion is achieved when site cleanup and all punch list items (resulting from the final inspection) have been completed. Completion shall have the meaning set forth in Article I, Section 3 (Definitions and Terms) of the General Contract Conditions.

**3.3.9 Working Days and Hours:** The working days and hours shall be as stated in the General Contract Conditions or as mutually agreed upon in the preconstruction meeting with the following exception:

All work shall be performed Monday - Friday between the hours of 7:00 AM to 5:00 PM.

**3.3.10 Licenses and Permits:** Contractor is responsible for obtaining all necessary licenses and permits required for Construction, at Contractors expense. See Section 2.12. Contractor shall supply to Owner all copies of finalized permits.

**3.3.11 Permits:** The following permits are required for the Project and will be obtained by the City at no cost to the Contractor:

None

The following permits are required for the Project and shall be obtained and paid for by the Contractor, with the costs included in the total bid price for the Project:

None

**3.3.12 City Furnished Materials:** The City will furnish the following materials for the Project:

None

**3.3.13 Project Newsletters:** A newsletter for the Project will be prepared and distributed by the City. It will include general information about the Project including interruptions in utility services, street closures, parking restrictions, project schedule, and the names and telephone numbers of the contacts for the City and Contractor. The newsletter will be mailed approximately one week before the Contractor commences work.

**3.3.14 Project Sign:** Project signs, if any, will be furnished and installed by the City.

- 3.3.15 Authorized Representatives of the City:** Those authorized to represent the City shall include Purchasing Agent, Engineers, and Inspectors employed by the City, only.
- 3.3.16 Stockpiling Materials and Equipment:** All stockpiling/storage shall be in accordance with General Contract Condition Section 51.
- 3.3.17 Traffic Control:** The Contractor shall provide and maintain traffic control in accordance with the approved Traffic Control Plan and the Manual on Uniform Traffic Control Devices. A Traffic Control Plan shall be prepared by the Contractor and reviewed by the City two days prior to the pre-construction meeting.
- 3.3.18 Clean-Up:** The Contractor is responsible for cleaning up all loose materials that have been deposited or swept into gutters, and onto sidewalks and driveways as a result of sidewalk operations. The costs for all clean-up work shall be considered incidental and will not be paid for separately.
- 3.3.19 Quality Control Testing:** Supplier shall perform quality control testing on concrete. The City will perform all other necessary QA/QC.
- 3.3.20 Schedule of Submittals:** Contractor shall deliver these submittals at least two days prior to the pre-construction meeting:
- Traffic Control Plans
  - Project Schedule
- 3.3.21 Uranium Mill Tailings:** It is anticipated that radioactive mill tailings will not be encountered on this Project.
- 3.3.22 Fugitive Petroleum or Other Contamination:** It is anticipated that soil contamination from fugitive petroleum or other contaminants will not be encountered with the Project.
- 3.3.23 Excess Material:** All excess materials shall be disposed in accordance with General Contract Condition Section 50.
- 3.3.24 Existing Utilities and Structures:** Utilities were not potholed during design of this project. The location of existing utilities and structures shown on the Plans is approximate with the information gathered during design. It is the responsibility of the Contractor to pothole/locate and protect all structures and utilities in accordance with General Contract Condition Section 37.
- 3.3.25 Incidental Items:** Any item of work not specifically identified or paid for directly, but which is necessary for the satisfactory completion of any paid items of work, will be considered as incidental to those items, and will be included in the cost of those items.
- 3.3.26 Survey:** The Contractor shall give the City survey crew a minimum of 72 hours' notice for all requested survey.

### 3.3.27 Work to be Performed by the City (Prior to Construction):

- Sign removal and relocation (if any)

**3.3.28 Existing Concrete Sidewalks, Pans, Fillets, Curbs and Gutters:** The existing sidewalks, pans, fillets, curb and gutter are in good serviceable condition. In most instances the installation of new sidewalk and pavement will be adjacent to existing concrete. The Contractor will need to protect all concrete adjacent to construction. If the concrete is damaged during construction the Contractor will be responsible for its replacement at no cost to the City. The Contractor, the City Project Inspector, and/or the City Project Manager will walk and record any concrete that is deemed to be damaged before construction has started.

**3.3.29 ACI Concrete and Flatwork Finisher and Technician:** Hand finishing concrete will be permitted only when performed under the direct supervision of a craftsman holding the following certificate: ACI Concrete Flatwork Finisher and Technician (ACICFFT) or other Flatwork Finisher certification program approved by the City Engineering Manager.

## 3.4. SCOPE OF WORK:

### **STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION:**

The *City of Grand Junction Standard Specifications for Road and Bridge Construction* are hereby modified or supplemented for this Project by the following modifications to *The Standard Specifications for Road and Bridge Construction*, State Department of Highways, Division of Highways, State of Colorado:

### **SP-1 SECTION 211 – DEWATERING**

Section 211 of the Standard Specifications is hereby added for this project as follows:

**Structure and Riprap Dewatering.** The contractor shall be responsible for all dewatering on the project. It is anticipated that substantial dewater will be required on this project. The dewatering processes shall follow these specifications:

*Prior to the preconstruction conference the Contractor shall submit their dewatering plan to the Engineer and Owner to communicate the Contractors intent in regard to dewatering to achieve the required performance contained in these specifications. Submittal of a dewatering plan shall not be interpreted as an acceptance or approval by the Owner or Engineer of the Contractor's dewatering plan. The dewatering plan shall include at a minimum:*

1. Major components of the dewatering system including size, location, spacing and details of major dewatering features the Contractor anticipates utilizing.
2. Contingency plans for equipment or power failure.
3. Procedures for verification that water levels have been lowered to the specified levels prior to trench or structure excavation and installation.
4. Location of dewatering disposal or discharge locations and the capacity to accept dewatering discharge. Provide a contingency plan for higher than anticipated flows



when capacity of planned discharge and disposal locations may conceivably be exceeded.

5. Location and details of Best Management Practices (BMP's)
6. Agreements with entities accepting discharges
7. All permits obtained by the Contractor including any permit conditions and approvals for the discharge of water generated during the execution of the Work.
8. Other permits required for construction or operation of the dewatering system including the drilling of wells, temporary power drops, etc.

**Structure dewatering construction requirements:**

1. The construction dewatering permit and water quality shall conform Section 7 of the General Contract Conditions of the City of Grand Junction.
2. Dewatering discharge to or across adjacent canals, drains, right-of-way, and private property outside of the designated limits of construction shall not be allowed unless the Contractor has obtained written approval from agency or property owner having jurisdiction. Provide Agreements with dewatering plan submittal as described above
3. Furnish, install and prepare for operation, all necessary machinery, appliances and equipment to maintain all structure excavations free from water during construction.
4. Contractor shall provide temporary power sources for all dewatering equipment that requires a power source.
5. Dewater and dispose of water in such a manner that it does not cause injury to public or private property, or to cause a nuisance or a menace to the general public.
6. The Contractor will be responsible for devising a system to achieve the required level of dewatering. It is anticipated that this system may incorporate wells, well points, interception trenches, sumps, etc. In addition, design and provide dewatering conveyance system to an approved disposal location. The Contractor shall submit details of this plan as described above.
7. Draw and maintain static water level to at least three feet (3') below the bottom of the excavation prior to excavating below the water table to maintain the undisturbed state of the foundation soils and allow placement of bedding material and backfill to the required density.
8. Remove all groundwater, seepage, stormwater and other water that accumulates in the excavation during construction. All structure excavations shall be kept free of water during construction or until otherwise requested by the Contractor and approved by the Engineer.
9. Prevent softening of the bottom of excavations and the formation of "quick" conditions or "boils" during excavation. The occurrence of such conditions will require over-excavation and subsequent backfilling of soils meeting the requirements of the CDOT Specifications at no additional cost to the Owner.
10. Additional cost for trench bottom stabilization resulting from inadequate dewatering and non-compliance with the performance specifications included herein, as determined by the Engineer, will be incidental to the work.
11. Compact native soil at the bottom of the excavation prior to placing bedding in accordance with the CDOT specifications and of these specifications.
12. Control surface runoff to prevent entry or collection of water in excavations.
13. Install and operate a dewatering system so that adjacent structures or property are not endangered by the reduction in the groundwater level.

14. Monitor discharge from dewatering operations for changes in visual or odor components indicating the presence of contaminants including, but not limited to, gasoline and pesticides and other hazardous materials and toxins.
15. Cease dewatering operations and notify Engineer and regulatory agencies immediately upon observation of conditions that may indicate the presence of hazardous contaminants in the dewatering discharge or excavation.

**Observation Requirements:**

1. Contractor's superintendent shall routinely observe conditions in excavations where dewatering is being performed on a daily basis to verify performance requirements are being met and that conditions in the excavation are in accordance with the Contract Documents.
2. Notify Engineer of any observations that may jeopardize the Work or is not in accordance with the Contract Documents.
3. Prior to advancing the structure excavation below the pre-construction groundwater level, the Contractor shall excavate a test pit or install another form of groundwater measurement. Water levels in the test pit shall be measured and recorded and the information provided to the Engineer. Measured water levels must show that the groundwater has been lowered to the minimum level stated herein. If monitoring shows that the specified level of dewatering has not been achieved, cease construction of the affected work and continue dewatering or modify dewatering activities until the specified level of dewatering is achieved at no additional cost to the Owner.

**Dewatering Discharge:**

1. Comply with all State & Federal requirements
2. Water quality shall conform to Section 7 of the General Contract Conditions of the City of Grand Junction
3. Work required to comply with water quality and permit requirements are considered incidental and additional payment will not be made for this Work.

**Termination:**

1. Allow groundwater to return to static level after excavations are backfilled as necessary to prevent floatation of constructed improvements.
2. Prevent disturbance of the compacted backfill and prevent flotation or movement of installed structure.
3. Remove or abandon all temporary improvements associated with the dewatering system in accordance with these specifications and any applicable state and federal rules and regulations.
4. Provide surface restoration as required to repair/replace any surface impacted by dewatering activities to a condition as good or better than preconstruction conditions at no additional cost to the Owner. Surface rehabilitation performed as a result of dewatering activities is considered incidental and no additional payment will be made.
5. Comply with any dewatering termination requirements of any State and Federal permits.

## Measurement and Payment

### PAY ITEM

### PAY UNIT

Dewatering

Lump Sum

### **SP-2 SECTION 304 – AGGREGATE BASE COURSE**

Section 304 of the Standard Specifications is hereby revised for this project as follows:

**Subsection 304.01** shall include the following:

In areas of asphalt overlay where there is no curb and gutter and/or a drainage pan, the Contractor shall backfill the shoulder with Class-6 Aggregate Base Course immediately following the overlay. The shoulder shall have a slope of 12:1 or flatter and shall extend a maximum 4' from the edge of asphalt. The aggregate base course shall be brought level to the new pavement surface and compacted. An exception to this will be made in areas where shoulder material would extend into existing yards or landscaping adjacent to the roadway. In these locations, it will be necessary to provide materials that match the existing landscape.

### **SP-3 SECTION 401 – PLANT MIX PAVEMENTS - GENERAL**

#### **REVISION OF SECTION 401 PLANT MIX PAVEMENTS**

Section 401 of the Standard Specifications are hereby revised for this project as follows:

#### **401.01 Description.**

Add the following:

This work **shall** consist of providing a Hot Mix Asphalt (HMA) to be placed as shown on the plans, or as directed by the Owner. The Contractor shall be responsible for Process Control (PC) of the HMA; including the design, and control of the quality of the material incorporated into the project.

#### **401.02 Composition of Mixtures.**

Delete subparagraph (a) *Mix Design* and replace with the following:

A Job Mix Formula (JMF) design shall be submitted for each mixture required, at least 10 calendar days prior to placing any mix on the project, for acceptance by the Owner. JMF's previously approved by CDOT within the past six months may be utilized. The JMF design shall be determined using AASHTO T-312 or CP-L 5115 for the Method of Mixture Design. Grading ST, SX, and S shall be designed using 100mm molds. The job mix gradation shall be wholly within the Master Range Table in subsection 703.04 before the tolerances shown in Section 401 are applied.

Designs shall be developed and performed in a materials laboratory that meets the requirements set forth by AASHTO Materials Reference Laboratory (AMRL) for all testing procedures. The design shall be stamped and signed by a Professional Engineer licensed in the State of Colorado. In

addition, the Contractor shall submit, as part of the mixture design, laboratory data documents to verify the following:

- Gradation, specific gravity, source and description of individual aggregate and properties, and the final blend.
- Aggregate physical properties.
- Source and Grade of the Performance Graded Binder.
- Proposed Design Job Mix: aggregate and additive blending, final gradation, optimum binder content.
- Mixing and compaction temperatures used.
- Mixture properties shall be determined with a minimum of four binder contents.

The JMF for each mixture shall establish a single percentage of aggregate passing each required sieve size, a single percentage of asphalt cement to be added to the aggregate, and a single temperature for the mixture at the discharge point of the plant.

The Owner reserves the right to verify the asphalt supplier’s mix design for each JMF design utilizing materials produced and stockpiled. The asphalt supplier shall provide, at no cost, a sufficient quantity of each aggregate, mineral filler, Recycled Asphalt Pavement (RAP), and additive for the required laboratory tests, as well as all Certificates of Conformance/ Compliance at any time on any material used. The Asphalt Supplier shall provide copies of quality control testing results during the production of HMA used within one business day from the sampling date.

Mixture design of HMA shall meet the requirements of Table 403-1 and Table 403-2 in the Revision to Section 403. For mixes requiring a design gyration of 100 (ESALs greater than 3 million) the Project Special Conditions should be used. This gyration is not recommended for the majority of roads within Mesa County.

Delete subparagraph (b) *Mixtures Furnished to the Project* and replace with the following:

Production verification shall occur prior to, or during, the start of the project. Volumetric properties of the mix shall be verified by LabCAT Level C Certified Technicians. If the mix was produced for another project within the last 90 days, data from that project can be submitted for verification. All mixtures furnished for the project shall conform within the ranges of tolerance listed in Table 401.02A. The mix verification test reports shall be submitted to the Owner prior to mix placement.

**TABLE**  
**401.02A**  
**Production Mix**  
**Tolerances**

<u>Property</u>	<u>Tolerance</u>
<u>Asphalt Cement Content</u>	<u>± 0.3%</u>
<u>VMA</u>	<u>± 1.2%</u>
<u>Air Voids</u>	<u>± 1.2%</u>

Verification testing for binder content, gradation and physical properties shall be performed at the frequencies listed in Table 401.23-1.

There shall be no substitutions of materials allowed during production, unless approved in advance by the Owner. All substitutions will require checkpoint verification. If the checkpoint differs from the Job Mix Formula (JMF), a new mix design will be required. Upon request of the Owner, the binder grade may be changed by one available binder grade level without requiring a new mix design.

Should a change in the source of any material used in the production of HMA (aggregate, mineral filler, lime, or performance graded asphalt binder) occur, a one point verification test (at optimum binder content) of the mix must be performed to verify that the applicable criteria shown on Table 403-1 (HMA) and Table 403-2 (VMA) of Revision to Section 403 are still met. If this testing shows noncompliance, the Contractor shall establish a new job mix design and obtain approval by the Owner before the new HMA is used.

Add the following new subparagraphs:

(c) *Reclaimed Asphalt Pavement (RAP)*. RAP shall be allowed in HMA up to a maximum binder replacement of 23 percent, unless otherwise specified in the contract, and provided that all the specifications for the HMA are met. Fine Aggregate Angularity requirements shall apply only to the virgin fraction of the fine aggregate. RAP shall be of uniform quality and gradation with a maximum size no greater than the nominal aggregate size of the mix. RAP shall not contain clay balls, vegetable matter, or other deleterious substances.

The Contractor shall have an approved mix design for the amount of RAP to be used. The AC content of the RAP utilized in the Contractor RAP mix design shall be the average AC content determined in accordance with 1B or 1C, below, or alternatively, a minimum of five samples of the Contractors RAP stockpile may be sampled and the average AC content of the RAP be determined using AASHTO T-164, Method A or B, or in accordance with 1C below. The Contractor shall determine the total binder replaced by the binder in the RAP pursuant to the following equation:

$$\text{Total Binder Replaced} = (A \times B) \times 100/E$$

Where:

A = RAP % Binder Content \*

B = RAP % in Mix \*

E = Total Effective Binder Content \*

\* in decimal format (i.e. 2% is 0.02)

The Total Binder Replaced by the binder in the RAP shall not exceed 23 percent of the effective binder content of either the mix design or the produced mix.

The Contractor shall have an approved Quality Control (QC) Plan that details how the RAP will be processed and controlled. The QC plan shall address the following:

1. **RAP Processing Techniques.** This requires a schematic diagram and narrative that explains the processing (crushing, screening, and rejecting) and stockpile operation for this specific project.
2. **Control of RAP Asphalt Binder Content (AASHTO T-164, Method A or B).** RAP Asphalt Binder Content may also be determined in accordance with CP-L 5120, provided an RAP AC content correction factor is determined through correlation testing with AASHTO T-

164, Method A or B. The correction factor shall be determined by performing correlation testing on the first five samples of the RAP AC content, then at a frequency of one for every five AC content tests thereafter. The correction factor shall be determined by calculating the average difference in AC content between CP-L 5120 and AASHTO T-164, Method A or B, and applying the correction to the AC content determined in accordance with CP-L 5120 :

Frequency: 1 per 1000 tons of processed RAP material (minimum five tests)

3. (Alternate) The Contractor may propose a RAP asphalt content correction factor to be used in conjunction with CP-L 5120. The proposed CP-L 5120 RAP asphalt content correction factor shall be used with all RAP asphalt contents tested for the mixture design and quality control sampling and testing. The methodology of the proposed CP-L 5120 RAP asphalt content correction factor shall be outlined in detail in the approved RAP QC Plan. At a minimum, the proposed CP-L 5120 correction factor shall identify the principal source locations of the RAP aggregate, gradation of the material tested, and specific ignition oven serial number used in all the RAP asphalt content testing. The RAP source locations, material gradation, and specific equipment used shall substantiate the CP-L 5120 asphalt content correction factor used for the testing. The substantiation must be from data gathered from historical information or specific asphalt content correction data obtained from tests performed on similar virgin aggregate sources, virgin material gradations, and the specific equipment used.
4. Control of RAP Gradation (CP31 or AASHTO T-30):  
Frequency: 1 per 1000 tons of processed RAP material (minimum three tests, sampling from belt feed and not stockpile).
5. Process Control Charts shall be maintained for binder content and each screen listed in Table 401.2C, during addition of any RAP material to the stockpile. The Contractor shall maintain separate control charts for each RAP stockpile. The control charts shall be displayed and shall be made available, along with RAP AC extraction testing laboratory reports to the Engineer upon request.

The processed RAP must be 100 percent passing the 31.5 mm (1¼ inch) sieve. The aggregate obtained from the processed RAP shall be 100 percent passing the 25.0 mm (1 inch) sieve. The aggregate and binder obtained from the processed RAP shall be uniform in all the measured parameters in accordance with the following:

**Table 401.2C  
RAP Binder & Aggregate Uniformity Tolerances**

Element	Standard Deviation
Binder Content	0.5
% Passing ¾"	4.0
% Passing ½"	4.0
% Passing 3/8"	4.0
% Passing #4	4.0
% Passing #8	4.0
% Passing #30	3.0
% Passing #200	1.5

(d) *Warm Mix Asphalt (WMA) Technology.* The Contractor may choose to use a WMA Technology that is included on the CDOT approved products list (<https://www.codot.gov/business/apl/asphalt-warm-mix.html>).

WMA technologies (additive or foaming) used shall be identified on the mix design, indicating usage as a workability additive and/or anti-strip additive. WMA shall be submitted and approved by the Owner for use on a project.

The addition of WMA additives during production, including foaming, shall be controlled by a calibrated metering system interlocked with the plant's controls per the manufacturers' recommendation. Additives may be added at the asphalt terminal at the dosage rate recommended by the WMA technology provider. The foaming process mixes water and binder to create microscopic steam bubbles. Typical water injection rate is  $\leq 2\%$  of binder flow rate or per manufacturers' recommendation.

(e) *Anti-Strip Additives.* Anti-Strip shall be added into the HMA. Anti-Strip agents may be liquids (added to the binder), lime (added to the aggregates) or other products, and shall be submitted for approval by the Owner.

The minimum value for Tensile Strength Ratio (TSR) tested in accordance with Table 401.21-1 shall be 80% for the mix design and 70% during production.

There are various types of liquid Anti-Strips. Amine and Organo-silane type liquid Anti-Strip additives are physically mixed with the asphalt binder. Liquid Anti-Strip agents shall be added per the manufacture's recommendations. Typical product dosages are provided in Table 401.2E-1.

**TABLE 401.2E-1  
Liquid Anti-Strip Dosage Rates**

Type	Typical Dosage Rate
Amine	0.4% to 0.8%
Organo-silane	0.05% to 0.15%

WMA chemical products which display Anti-Stripping characteristics will be classified, and identified on the mix design, as a liquid Anti-Strip additive.

When a liquid Anti-Strip additive is used, the Contractor shall include the following information with the mix design submission:

- Information on the type of liquid Anti-Strip additive to be supplied, including product name, product manufacturer/supplier
- Additive rate
- TSR values for the treated mixes
- The proposed method for incorporating the additive into the plant produced mix

#### **401.03 Aggregates.**

Add the following:

The percentage of fractured faces shall be as shown in Table 403.1 of the Revision to Section 403.

Grading ST (3/8" nominal) mixes may be used for leveling, maintenance, bike paths, sidewalks and thin lift overlays. Grading SX (1/2" nominal) mixes shall be used on top and bottom lifts and for patching. Grading S (3/4" nominal) mixes may be used for bottom lifts.

#### **401.05 Hydrated Lime.**

Add the following:

When used in the HMA, hydrated lime shall be added at the rate of 1% by dry weight of the aggregate and shall be included in the amount of material passing the No. 200 sieve.

#### **401.06 Asphalt Cement.**

Revise the second paragraph to read as follows:

The asphalt cement shall meet the applicable requirements of subsection 702.01.

Add the following:

The Contractor shall provide to the Owner acceptable 'Certifications of Compliance' of each applicable asphalt binder grade from the supplier. Should testing or certificate show nonconformance with the specifications, the asphalt binder may be rejected. When production begins, the Contractor shall, upon request, provide to the Owner a one quart can of each specified asphalt binder for analysis. Additionally, the Contractor shall provide the refinery test results that pertain to the asphalt binders used during production.

Based on climatic conditions and reliability, binder grades approved for use in Mesa County are as follows in Table 401.06A-1:

**TABLE  
401.06A-1  
Recommended Performance Graded  
Binders**

<b>Condition</b>	<b>Non-modified Binder</b>	<b>Modified Binder</b>
Free flowing traffic loads and 300,000 to 1 million 18K ESAL	PG 64-22	
Free flowing traffic loads and 300,000 to 1 million 18K ESAL, plus above 6000 elevation	PG 58-28	
Slow moving or standing trucks, major street intersections and/or 10,000,000 18K ESAL		PG 76-28 (top lift only)



Binder grades other than those shown above shall not be used unless the proposed binder and the mix design are approved in writing by the OWNER. The asphalt cement shall meet the requirements of subsection 702.01

**401.07 Weather Limitations and Placement Temperatures.**

Revise as follows:

Surface temperatures shall be used to determine placement of APM. APM produced with documented WMA will be allowed a reduction in minimum surface temperatures for placement as provided in Table 401.07A-1. Ambient temperatures and other weather conditions shall be considered prior to placement.

**TABLE 401.07A-1  
Minimum Surface Temperatures for placement of APM**

Compacted Layer Thickness (in.)	Minimum Surface Temperature (°F)			
	Top Layer		Layers Below the Top Layer	
Product	APM	with WMA	APM	with WMA
<1½	60	50	50	40
1½ - <3	50	45	40	35
3 or more	45	40	35	35

If the Contractor modifies the placement and compaction processes when ambient temperatures are below minimum surface temperatures in Table 401.07A-1, they shall demonstrate to the Owner the required in-place density has been achieved. APM cooling software such as PaveCool, or MultiCool can be used to determine placement and compaction times available.

**401.08 Asphalt Mixing Plant.**

Delete the last paragraph of the subsection.

**401.09 Hauling Equipment.**

Add the following:

The Owner may reject any HMA which demonstrates it has been contaminated from a petroleum distillate release agent. The Owner may reject any uncovered HMA which demonstrates it has been impacted by contamination and/or weather.

**401.10 Asphalt Pavers.**

Delete the twelve paragraph and replace with the following:

Contractor shall submit for and receive approval of the screed control devices to be utilized on the paver prior to use for placing HMA on the project.

Add the following:

A Material Transfer Vehicle (MTV) or Material Transfer Device (MTD) may be required for placement of the HMA when specified in the contract documents. The MTV shall be a self-propelled unit with on board storage of material. An MTD is a non-self-propelled unit. Both MTV and MTD are capable of receiving material from trucks or from the ground, transferring the material from the unit to a paver hopper insert via a conveyor system.

#### **401.11 Tack Coat.**

Delete and replace with the following:

A tack coat shall be applied between pavement course and to all existing concrete and asphalt surfaces per Section 407. Tack coat is considered incidental to the cost of the HMA.

#### **401.15 Mixing.**

Add the following:

If a WMA technology (additive or foaming) is used, the discharge temperatures may be lowered during production at the discretion of the Contractor provided all specifications are achieved. Mix design is to indicate revised allowable discharge temperatures with WMA usage.

#### **401.16 Spreading and Finishing.**

Revise as follows:

Joints in the top layer of new pavement shall be located on lane lines unless otherwise shown on the plans. Longitudinal joints shall be minimized with wide paving pulls. Transverse joints shall be formed by cutting back on the previous run to expose the full depth of the course. Tack coat material shall be applied to contact surfaces of all joints before additional mixture is placed against the previously compacted material.

#### **401.17 Compaction.**

Revise as follows:

Equipment used for compaction of the HMA will be at the discretion of the Contractor. The number, weight, and type of rollers furnished shall be sufficient to obtain the required density and surface texture.

All joints shall be compacted to 92% of maximum theoretical specific gravity (Rice), taken six inches offset from the joint. The allowable variance shall be  $\pm 2\%$ . Joint density will be determined using nuclear density equipment.

Delete paragraphs six through eight, and paragraphs eleven to the end of the subsection and replace with the following:

Cores may be used to verify compaction results. The Contractor shall core the pavement, as required by the Owner; in accordance with AASHTO T 230, Method B, or for field calibration of nuclear

density equipment in accordance with the ASTM D 2950. At a minimum, cores for nuclear density equipment correlation shall be taken at the beginning of placement of each project or change of mixture materials or gradation, unless otherwise approved by the Engineer. If the correlation cores were produced for another project within the last 90 days, data from that project can be submitted for verification, if no change in materials or gradation has occurred. When cores are used, the Contractor shall provide all labor and equipment for the coring and repair of the holes.

Along forms, curbs, headers, walls, and all other places not accessible to the rollers, the mixture shall meet all project compaction specifications. Any mixture that is defective, shall be corrected to meet the project specifications at the expense of the Contractor.

#### **401.20 Surface Smoothness.**

Delete and replace with the following:

The finish transverse and longitudinal surface elevation of the pavement shall be measured using a 10-foot straightedge. Surface smoothness shall be verified following the finish roller pass. Surface variation shall not exceed 3/16 inch in 10 feet for full lane width paving. For patching, the variation shall not exceed 3/8 inch in 10 feet. The final pavement surface shall not vary from the specified cross section by more than one inch at any point. Transverse measurements for variations shall exclude breaks in the crown sections. If the surface tolerance exceeds 3/16" across transverse joints, measured in at least three locations, the Contractor shall make corrections to the joint before proceeding. All corrections shall be made at the Contractor's expense.

The final surface pavement adjacent to curb and gutter shall be finished from 1/8-inch to 3/8- inches above the lip for catch curb and shall not extend above the lip for spill curb.

The Contractor shall adjust all manholes, valve boxes, and survey range boxes 1/8 to 1/4- inch below final grade and adjusted to match the slope of the roadway. Valve boxes and manholes are to be maintained fully accessible at all times for emergency and maintenance operations. The cost of adjusting valve boxes, manholes, and survey range boxes shall be included in the work, unless otherwise specified. The Contractor shall be responsible for any cost incurred by the Owner to provide access to the covered manholes or valve boxes. Final adjustment of all utility access points shall be completed within seven days of from the time the HMA was placed.

Add the following new subsections:

#### **401.23 Testing and Inspection**

The Contractor shall assume full responsibility for controlling all operations and processes to meet the Specifications. The Contractor shall perform all tests necessary for process control purposes on all elements at the frequency listed in Table 401.23-1. The Contractor shall maintain a log of all process control testing. Test results that have sampling or testing errors shall not be used. Process control testing shall be performed at the expense of the Contractor.

Laboratories shall be accredited by AASHTO Materials Reference Laboratory (AMRL) for the tests being performed. Technicians obtaining samples and conducting compaction tests must have a LabCAT Level A certification. Technicians conducting tests of asphalt content and gradation must have a LabCAT Level B certification. Technicians performing volumetric testing must have a LabCAT Level C certification. Equivalent NICET certification for all technicians is acceptable.

When requested by the Owner, the Contractor shall submit a quality control plan that addresses production, sampling, testing, and qualifications of testing personnel, timing, and methods for making adjustments to meet the specifications. The Contractor will provide a process or schedule for making corrections for material that was placed but does not meet specifications as well as obtain a follow up sample immediately after corrective actions are taken to assess the adequacy of the corrections. In the event the follow-up process control sample also fails to meet Specification requirements; the Contractor shall cease production of the asphalt mixture until the problem is adequately resolved to the satisfaction of the Owner.

**TABLE  
401.23-1  
Minimum Materials Sampling and Testing  
for Process Control and Owners  
Acceptance**

Test	Standard	Minimum Frequency
Sampling	AASHTO T168, ASTM D 979 and ASTM D3665, CP 41	1/1000 tons or fraction thereof (not less than one test per day)
In-Place Density	AASHTO T 166, T 238, T 230, CP 81 (nuclear), CP 44 (coring)	One test for each 250 lineal feet per lane and one test per 1,000 lineal feet of joint per lift
Thickness (Core) (when called for in Project specs.)	ASTM D3549	One test for each 1000 lineal feet per lane
Air Voids & VMA	CP-L 5115 A.I. SP-2	1/1000 tons or fraction thereof (not less than one test per day)
Gradation	AASHTO T 27/T 11, CP 31	1/1000 tons or fraction thereof (not less than one test per day)
Hveem/Marshall Stability As Applicable	CP-L 5016	One per project per mix used
Binder Content	CP-L 5120, AASHTO T 164 or other methods agreed upon between Owner and Contractor	1/1000 tons or fraction thereof (not less than one test per day)
Maximum Theoretical Specific Gravity (Rice)	AASHTO T 209 (Rice), CP-L 51	1/1000 tons or fraction thereof (not less than one test per day)
Lottman Stripping, TSR & Dry Density	CP-L 5109	One per project per mix used.

Field control testing of dense graded asphalt mixes for the above tests shall meet the requirements of Table 403-1 and Table 403-2 in the Revision to Section 403.

#### **401.24 Acceptance**

If any materials furnished, or work performed, fails to meet the specification requirements, such deficiencies shall be documented and reported to the Owner. Copies of all process control tests shall be delivered to the Owner within one business day. Test results that cannot be completed within one day shall be provided to the Owner no later than three days after the sample was obtained.

Owners Acceptance (OA) test results, if any, and/or Process Control (PC) test results will be evaluated to determine acceptability. If the Contractor does not meet the project specifications, but acceptable work has been produced, the Owner shall determine the extent of the work to be accepted. If the Owner determines the work is not acceptable, the Contractor shall correct the work, as approved by the Owner, at the expense of the Contractor.

#### **SP-4 SECTION 403 – HOT MIX ASPHALT**

##### **REVISION OF SECTION 403 HOT MIX ASPHALT**

Section 403 of the Standard Specifications is hereby revised for this project as follows:

#### **403.02 Materials**

Delete and replace with the following:

The materials shall conform to the requirements of subsections 401.2 of the Revised Section 401 above.

The design mix for hot mix asphalt (HMA) shall conform to the following Table 403-1 and Table 403-2:

**Table 403-1  
Mixture Properties for Hot Mix Asphalt**

<b>Property</b>	<b>Test Method</b>	<b>Value</b>
Air Voids, percent at: N (design)	AASHTO T-132, CPL 5115	3.0 – 4.0
Lab Compaction (Revolutions): N (design)	CPL 5115	75
Hveem Stability, (Grading ST, SX & S only)	CPL 5106	28 min.
Aggregate Retained on the 4.75 mm (No. 4) Sieve for S, SX and SG, and on the 2.36mm (No. 8) Sieve for ST and SF with at least 2 Mechanically Induced fractured faces	CP 45	60% min.
Accelerated Moisture Susceptibility Tensile Strength Ratio (Lottman)(for S & SX mixes)	AASHTO T-283 Method B, CPL 5109 Method B	80 min.

Property	Test Method	Value
Minimum Dry Split Tensile Strength, kPa (psi)	CPL 5109 Method B	205 (30) min.
Voids in the Mineral Aggregate (VMA) % minimum	CP 48, AI-SP2	See Table 403-2
Voids Filled with Asphalt (VFA)	AI MS-2	65-80%
Dust to Asphalt Ratio:		
Fine Gradation	CP 50	0.6 – 1.2
Coarse Gradation		0.8 – 1.6
<p>Note: AI MS-2 = Asphalt Institute Manual Series 2</p> <p>Note: Mixes with gradations having less than 40% passing the 4.75 mm (No. 4) sieve shall be approached with caution because of constructability problems.</p> <p>Note: Gradations for mixes with a nominal maximum aggregate size of one-inch or larger are considered a coarse gradation if they pass below the maximum density line at the #4 screen.</p> <p>Gradations for mixes with a nominal maximum aggregate size of 3/4" to 3/8" are considered a coarse gradation if they pass below the maximum density line at the #8 screen.</p> <p>Gradations for mixes with a nominal maximum aggregate size of #4 or smaller are considered a coarse gradation if they pass below the maximum density line at the #16 screen.</p>		

**Table 403-2  
Minimum Voids in Mineral Aggregate (VMA)**

Nominal Maximum Size*, mm (inches)	3.5%	***Design Air Voids**	
		4.0%	4.5%
37.5 (1½)	11.6	11.7	11.8
25.0 (1)	12.6	12.7	12.8
19.0 (¾)	13.6	13.7	13.8
12.5 (½)	14.6	14.7	14.8
9.5 (⅜)	15.6	15.7	15.8
4.75 (No. 4)	16.6	16.7	16.8
<p>* The Nominal Maximum Size is defined as one sieve larger than the first sieve to retain more than 10%.</p> <p>** Interpolate specified VMA values for design air voids between those listed.</p> <p>*** Extrapolate specified VMA values for production air voids beyond those listed.</p>			

### 403.03 Construction Requirements

Delete the first paragraph and replace with the following:

The construction requirements shall be as prescribed in subsections 401.3 through 401.14 of the Revised Section 401 above.

**403.04 Method of Measurement**

Delete and replace with the following:

Hot Mix Asphalt will be measured by the ton or the square yard. Batch weights will not be permitted as a method of measurement when measured by the ton. The tonnage shall be the weight used in the accepted pavement.

**403.05 Basis of Payment**

Delete and replace with the following:

The accepted quantities of hot mix asphalt will be paid for in accordance with subsection 401.22, at the contract unit price per ton or square yard for the asphalt mixture.

Payment will be made under:

<b>Pay Item</b>	<b>Pay Unit</b>
Hot Mix Asphalt (Grading __)(PG__)	Ton
Hot Mix Asphalt (Grading __)(PG __)	Square Yard
Hot Mix Asphalt (Patching)	Square Yard

Aggregate, asphalt cement, asphalt recycling agent, additives, hydrated lime, tack coat, and all other work necessary to complete each hot mix asphalt items will not be paid for separately but shall be included in the unit price bid.

Excavation, preparation, and tack coat of areas to be patched will not be measured and paid for separately, but shall be included in the work.

**SP-5 SECTION 407 – PRIME COAT, TACK COAT, AND REJUVINATING AGENT**

**REVISION OF SECTION 407  
PRIME COAT, TACK COAT, AND REJUVENATING AGENT**

Section 407 of the Standard Specifications is hereby revised for this project as follows:

**407.01 Description**

Add the following:

Prior to placement of APM, a tack coat shall be applied to all existing concrete and asphalt surfaces.

**407.02 Asphalt Material.**

Add the following:

The tack coat shall meet the specification for emulsified asphalt, consisting of CSS-1h or SS-1h, and conform to AASHTO M208 or M140.

**407.07 Application of Asphalt Material.**

Add the following:

The tack coat shall be applied at the rates specified in Table 407-1. The surface receiving the tack coat shall be dry and clean, and dust, debris, and foreign matter shall be removed. Tack coat shall be applied uniformly. The Contractor shall allow the tack coat to cure (dehydrate) prior to the placement of APM. If the tack becomes contaminated during construction, it shall be cleaned, and if necessary, additional tack coat shall be reapplied and allowed to cure before paving resumes.

**TABLE 407-1  
Tack Coat Application  
Rates**

Pavement Condition	Application Rate (gal/yd <sup>2</sup> )		
	Residual	Undiluted	Diluted (1:1)
New asphalt	0.03 - 0.04	0.05 - 0.07	0.10 - 0.13
Oxidized asphalt	0.04 - 0.06	0.07 - 0.10	0.13 - 0.20
Milled Surface (asphalt)	0.06 - 0.08	0.10 - 0.13	0.20 - 0.30
Milled Surface (PCC)	0.06 - 0.08	0.10 - 0.13	0.20 - 0.30
Portland Cement Concrete	0.04 - 0.06	0.07 - 0.10	0.13 - 0.20

**407.09 Method of Measurement and Basis of Payment.**

Delete and replace the following:

Tack Coat will not be measured and paid separately but shall be considered included in the work for Section 401 – Asphalt Pavement Materials.

**SP-6 SECTION 601 – STRUCTURAL CONCRETE**

**REVISION OF SECTION 601  
STRUCTURAL CONCRETE**

Section 601 of the Standard Specifications is hereby revised for this project as follows:

**Subsection 601.02, Classification:**

CONCRETE SHALL MEET THE FOLLOWING REQUIREMENTS:

- 4,500 PSI Compressive at 28 Days
- 6% air ±1.5%
- Slump 4", Loads exceeding 4 ½" shall be rejected
- Maximum Water Cement Ratio no greater than 0.45.

**Subsection 601.06, Batching:**

The Contractor shall furnish a batch ticket (delivery ticket) with each load for all concrete.



Concrete delivered without a batch ticket containing complete information as specified shall be rejected. The Contractor shall collect and complete the batch ticket at the placement site and deliver all batch tickets to the Engineer or his representative at the end of each day. The Engineer or his representative shall have access to the batch tickets at any time during the placement. The following information shall be provided on each ticket:

1. Suppliers name and date
2. Truck number
3. Project name and location
4. Concrete class and designation number
5. Cubic yards batched
6. Type brand and amount of each admixture
7. Type, brand, and amount of cement and fly ash
8. Weights of fine and coarse aggregates
9. Moisture of fine and coarse aggregates
10. Gallons of batch water

The contractor shall add the following information to the batch ticket at time of placement:

1. Gallons of water added by the truck operator.
2. Number of revolutions of the drum for mixing
3. Discharge time

## **SP-7 UTILITIES**

Known utilities within the limits of this project are:

Century Link – Underground Telephone and Underground Fiber Optic

Charter – Aerial Cable

Grand Valley Drainage District – Culvert

Grand Valley Power – Underground Electric

Grand Valley Power – Overhead Power

United Private Network – Aerial Fiber Optic

Ute Water – 8" PVC Water Line

Xcel Energy – Gas

Xcel Energy – Underground Electric

City of Grand Junction – Sanitary Sewer

The work described in these plans and specifications requires coordination between the Contractor and the utility companies in accordance with subsection 105.11 in conducting their respective operations as necessary to complete the utility work with minimum delay to the project.

The work listed below shall be performed by the Contractor in accordance with the plans and specifications, and as directed by the Engineer. The Contractor shall keep each utility company advised of any work being done to its facility, so that the utility company can coordinate its inspections for final acceptance of the work with the Engineer:

FOR:

Century Link – Protect Underground Telephone and Underground Fiber Optic in place  
Charter – Protect Aerial Cable in place  
Grand Valley Drainage District – Remove and replace existing Culvert per plans  
Grand Valley Power – Protect Underground Electric in 6” conduit in place  
Grand Valley Power – Protect Overhead Power in place  
Unite Private Networks – Protect Aerial Fiber Optic in place  
Ute Water – Protect 8” C900 Water Line in place if possible

Over 40 feet of active 8” water line may be difficult to support while installing the new culvert. The pipe should be continuously supported with a beam or pole along the length of the exposed pipeline and monitored for movement. Mechanical restraints may need to be added to the pipe joints exposed in the limits of the excavation. There is also the possibility of the fitting on the south side of the ditch being exposed within the limits of excavation. This fitting will have a thrust block that will need to be removed and replaced.

The Contractor may prefer to remove/replace this segment of pipeline from their excavation. Under this scenario, please plan on new C900 pipe, fitting(s), and couplings, mechanically disinfected, and reconstructed when fill for culvert is mostly completed.

Both above options will require the Contractor to provide temporary water service to the property at 798 21 ½ Road during construction. One option is to connect to the existing water service at 780 21 ½ Road, extend a 2-inch poly line north across Pritchard Wash, and connect to the 798 21 ½ Road meter. Ute Water will provide the parts required in the meter pits (all other materials to be provided by the Contractor). Ute Water staff can assist the Contractor with the installation of the temporary water service.

Xcel Energy – Protect 3” Gas line in place  
Xcel Energy – Protect Underground Electric in 6” conduit in place  
City of Grand Junction – Protect Sanitary Sewer in place

See Title Sheet of Construction Drawings for utility contact information.

#### GENERAL:

The Contractor shall comply with Article 1.5 of Title 9, CRS ("Excavation Requirements") when excavation or grading is planned in the area of underground utility facilities. The Contractor shall notify all affected utilities at least two (2) business days, not including the day of notification, prior to commencing such operations. The Contractor shall contact the Utility Notification Center of Colorado (UNCC) at (8-1-1) or 1-800-922-1987 to have locations of UNCC registered lines marked by member companies. All other underground facilities shall be located by contacting the respective company. Utility service laterals shall also be located prior to beginning excavating or grading.

The location of utility facilities as shown on the plan and profile sheets, and herein described, were obtained from the best available information.

All costs incidental to the foregoing requirements will not be paid for separately but shall be included in the work.

**3.5. Attachments:**

- Appendix A: Project Submittal Form
- Appendix B: Project Geotechnical Report
- Appendix C: Construction Drawings

**3.6. Contractor Bid Documents:** For Contractor's convenience, the following is a list of forms/items to be submitted with the Contractor's bid response. However, should a form/item not be listed in this section, but required in the solicitation documents, it is the Contractor's responsibility to ensure all forms/items are submitted.

- **Contractor's Bid Form**
- **Price Bid Schedule**
- **References**

**3.7. IFB TENTATIVE TIME SCHEDULE:**

Invitation For Bids available	November 23, 2020
Mandatory Site Visit Meeting	December 4, 2020
Inquiry deadline, no questions after this date	December 10, 2020
Addendum Posted	December 14, 2020
Submittal deadline for proposals	December 17, 2020
City Council Approval	January 6, 2021
Notice of Award & Contract execution	January 7, 2021
Bonding & Insurance Cert due	January 14, 2021
Preconstruction meeting	January 14, 2021
Work begins no later than	Receipt of Notice to Proceed
Final Completion	90 Calendar Days from Notice to Proceed
Holidays:	January, 18, 2021
	February 15, 2021

## 4. Contractor's Bid Form

**Bid Date:** \_\_\_\_\_

**Project:** IFB-4853-21-DH "GRJM 21.5-G.95 Culvert Replacement"

**Bidding Company:** \_\_\_\_\_

**Name of Authorized Agent:** \_\_\_\_\_

**Email** \_\_\_\_\_

**Telephone** \_\_\_\_\_ **Address** \_\_\_\_\_

**City** \_\_\_\_\_ **State** \_\_\_\_\_ **Zip** \_\_\_\_\_

The undersigned Bidder, in compliance with the Invitation for Bids, having examined the Instruction to Bidders, General Contract Conditions, Statement of Work, Specifications, and any and all Addenda thereto, having investigated the location of, and conditions affecting the proposed work, hereby proposes to furnish all labor, materials and supplies, and to perform all work for the Project in accordance with Contract Documents, within the time set forth and at the prices stated below. These prices are to cover all expenses incurred in performing the work required under the Contract Documents, of which this Contractor's Bid Form is a part.

The undersigned Contractor does hereby declare and stipulate that this offer is made in good faith without collusion or connection to any person(s) providing an offer for the same work, and that it is made in pursuance of, and subject to, all terms and conditions of the Instructions to Bidders, the Specifications, and all other Solicitation Documents, all of which have been examined by the undersigned.

The Contractor also agrees that if awarded the Contract, to provide insurance certificates within ten (10) working days of the date of Notification of Award. Submittal of this offer will be taken by the Owner as a binding covenant that the Contractor will be prepared to complete the project in its entirety.

The Owner reserves the right to make the award on the basis of the offer deemed most favorable, to waive any formalities or technicalities and to reject any or all offers. It is further agreed that this offer may not be withdrawn for a period of sixty (60) calendar days after closing time. Submission of clarifications and revised offers automatically establish a new thirty day (30) period.

Prices in the bid proposal have not knowingly been disclosed with another provider and will not be prior to award.

- Prices in this bid proposal have been arrived at independently, without consultation, communication or agreement for the purpose of restricting competition.
- No attempt has been made nor will be to induce any other person or firm to submit a bid proposal for the purpose of restricting competition.
- The individual signing this bid proposal certifies they are a legal agent of the offeror, authorized to represent the offeror and is legally responsible for the offer with regard to supporting documentation and prices provided.
- Direct purchases by the City of Grand Junction are tax exempt from Colorado Sales or Use Tax. Tax exempt No. 98-903544. The undersigned certifies that no Federal, State, County or Municipal tax will be added to the above quoted prices.
- City of Grand Junction payment terms shall be Net 30 days.
- Prompt payment discount of \_\_\_\_\_ percent of the net dollar will be offered to the Owner if the invoice is paid within \_\_\_\_\_ days after the receipt of the invoice. The Owner reserves the right to take into account any such discounts when determining the bid award.

RECEIPT OF ADDENDA: the undersigned Contractor acknowledges receipt of Addenda to the Solicitation, Specifications, and other Contract Documents.

State number of Addenda received: \_\_\_\_\_.

It is the responsibility of the Bidder to ensure all Addenda have been received and acknowledged.

*By signing below, the Undersigned agree to comply with all terms and conditions contained herein.*

**Company:** \_\_\_\_\_

**Authorized Signature:** \_\_\_\_\_

**Title:** \_\_\_\_\_

# Bid Schedule: GRJM-21.5-G.95 Culvert Replacement

Item No.	CDOT, City Ref.	Description	Quantity	Units	Unit Price	Total Price
1	108.2	60" Culvert (HDPE)	100.	Lin. Ft.	\$ _____	\$ _____
2	201-00000	Clearing and Grubbing	450.	Sq. Yd.	\$ _____	\$ _____
3	202-00220	Removal of Asphalt Mat	122.	Sq. Yd.	\$ _____	\$ _____
4	202	Removal of Existing Pipe (Size & type as shown on plans)	90.	Lin. Ft.	\$ _____	\$ _____
5	203-00000	Unclassified Excavation (Complete in Place)	Lump Sum		---	\$ _____
6	206-00065	Structural Backfill Material (Flow-fill, Complete in Place)	200.	Cubic Yd.	\$ _____	\$ _____
7	206-00100	Structural Backfill Material (Class 1, Complete in Place)	1,034.	Cubic Yd.	\$ _____	\$ _____
8	208-00070	Vehicle Track Pad	2.	Each	\$ _____	\$ _____
9	208-00011	Erosion Bales (Weed Free)	4.	Each	\$ _____	\$ _____
10	208-00045	Concrete Washout Structure	1.	Each	\$ _____	\$ _____
11	211-03005	Dewatering (To be used for Pritchard Wash Bypass if needed)	Lump Sum		---	\$ _____
12	212-00007	Seeding (Native) (Hydraulic)	450.	Sq. Yd.	\$ _____	\$ _____
13	304	Aggregate Base Course (Class 6) complete in place	56.	Cubic Yd.	\$ _____	\$ _____
14	403-34752	Hot Mix Asphalt (Patching) (Grading SX) (75)(PG 64-22) (4" Thick)	31.	Ton	\$ _____	\$ _____
15	420-00300	Geotextile (Mirafi 500x)	220.	Sq. Yd.	\$ _____	\$ _____
16	601	Concrete Wall (Class D) per M and S Standard M-601-20 (Wall Design Height 3' to 7' per plan). (Includes associated headwall, toe walls and toe wall attached to walls beneath 21.5 Road.) Work shall include Reinforcing Steel (Epoxy Coated), Structural Concrete Coating (Exterior of wall), and any necessary appurtenances to complete work.	15.	Cubic Yd.	\$ _____	\$ _____

# Bid Schedule: GRJM-21.5-G.95 Culvert Replacement

Item No.	CDOT, City Ref.	Description	Quantity	Units	Unit Price	Total Price
17	606	Guardrail Type 3 (31 IN MGS). (Includes Installation)	37.5	Lin. Ft.	\$ _____	\$ _____
18	606	Transition Type 3J (31 IN MGS), R = 8'-6", 105° angle. (Includes Installation)	1.	Each	\$ _____	\$ _____
19	606	Transition Type 3J (31 IN MGS), R = 8'-6", 75° angle. (Includes Installation)	1.	Each	\$ _____	\$ _____
20	606	End Anchorage Type 3K (Includes Installation)	1.	Each	\$ _____	\$ _____
21	620- 00020	Sanitary Facility	1.	Each	\$ _____	\$ _____
22	625- 00000	Construction Surveying		Lump Sum	---	\$ _____
23	626- 00000	Mobilization		Lump Sum	---	\$ _____
24	630	Traffic Control (Complete in Place, Road Closure)		Lump Sum	---	\$ _____
25	700- 70170	F/A Pothole Utilities	---	---	---	\$ <u>6,000.00</u>
MCR		Minor Contract Revisions	---	---	---	\$ <u>25,000.00</u>
<b>Bid Amount:</b>						<b>\$ _____</b>

**Bid Amount:**

**dollars**

The undersigned Bidder proposes to subcontract the following portion of Work:

<u>Name &amp; address of Sub-Contractor</u>	<u>Description of work to be performed</u>	<u>% of Contract</u>
_____	_____	_____
_____	_____	_____
_____	_____	_____
_____	_____	_____

The undersigned Bidder acknowledges the right of the City to reject any and all Bids submitted and to waive informalities and irregularities therein in the City's sole discretion.

By submission of the Bid, each Bidder certifies, and in the case of a joint Bid each party thereto certifies as to his own organization, that this Bid has been arrived at independently, without collusion, consultation, communication, or agreement as to any matter relating to this Bid with any other Bidder or with any competitor.

# **APPENDIX A**

## **Project Submittal Form**



## PROJECT SUBMITTAL FORM

PROJECT: **GRJM 21.5-G.95 Culvert Replacement**

CONTRACTOR:

PROJECT ENGINEER: Kirsten Armbruster

Description	Date Received	Resubmittal Requested	Resubmittal Received	Date Accepted
-------------	---------------	-----------------------	----------------------	---------------

### CULVERT CONSTRUCTION

Base course gradation, Proctor curves (Str Bkfl CI 1)				
Geotextile cut sheet				
Concrete Mix Design				
Rebar Shop Drawings				
Base course gradation, Proctor curves (ABC CI 6)				
Asphalt Mix Design				
60-inch HDPE pipe cut sheet				

### EROSION CONTROL / STORMWATER MANAGEMENT

Vehicle Tracking Pad				
Concrete Washout				

### PERMITS, PLANS, OTHER

Construction Schedule				
Dewatering Plan				
Traffic Control Plan				

# **APPENDIX B**

## **Geotechnical Investigations**



**Huddlestone-Berry**  
Engineering & Testing, LLC

---

**GEOLOGIC HAZARDS AND  
GEOTECHNICAL INVESTIGATION  
21.5-G.95 BRIDGE OVER PRITCHARD WASH  
GRAND JUNCTION, COLORADO  
PROJECT#00208-0110**

**CITY OF GRAND JUNCTION  
333 WEST AVENUE, BLDG C  
GRAND JUNCTION, COLORADO 81501**

**FEBRUARY 5, 2020**

---

**Huddlestone-Berry Engineering and Testing, LLC  
2789 Riverside Parkway  
Grand Junction, Colorado 81501**

## **SUMMARY OF CONCLUSIONS AND RECOMMENDATIONS**

A geologic hazards and geotechnical investigation was conducted for the 21.5-G.95 Bridge over Pritchard wash in Grand Junction , Colorado. The project location is shown on Figure 1 – Site Location Map. The purpose of the investigation was to evaluate the surface and subsurface conditions at the site with respect to geologic hazards, subgrade preparation, foundation design, pavement design, and earthwork for the proposed construction. This summary has been prepared to include the information required by civil engineers, structural engineers, and contractors involved in the project.

### **Subsurface Conditions (p. 2)**

The subsurface investigation consisted of two borings, drilled on December 13<sup>th</sup>, 2019. The locations of the borings are shown on Figure 2 – Site Plan. The borings generally encountered pavements above native lean clay to fat clay soils. Groundwater was encountered in the borings at depths of between 17.0 and 18.0 feet at the time of the investigation.

### **Geologic Hazards (p. 3)**

The primary geologic hazard at the site is the presence of moisture sensitive soils. However, flooding of Pritchard wash could also impact the site.

### **Summary of Recommendations**

- *Recommended Subgrade Below Pipe* – Minimum 24-inches of structural fill. (p. 4)
- *Recommended Foundations for Headwalls/Wingwalls*– Shallow Foundations above structural fill. (p. 4)
- *Nominal Bearing Resistance at Strength Limit State* –  $q_{ult} = 450 \cdot \text{Effective footing width} + 3175$  psf. (p. 4)
- *Reduction Factor* – 0.45. (p. 4)
- *Nominal Bearing Resistance at Service Limit State* – See Appendix D.

#### *Other Foundation Criteria*

- *Seismic Site Class* – Site Class D (p. 5)

### **Summary of Pavement Recommendations (p. 6)**

It is recommended that new pavements match the existing pavement section of 4.0-inches of asphalt pavement above 14.0-inches of CDOT Class 6 base course.

## TABLE OF CONTENTS

<b>1.0</b>	<b>INTRODUCTION .....</b>	<b>1</b>
1.1	Scope.....	1
1.2	Site Location and Description .....	1
1.3	Proposed Construction .....	1
<b>2.0</b>	<b>GEOLOGIC SETTING.....</b>	<b>2</b>
2.1	Soils.....	2
2.2	Geology .....	2
2.3	Groundwater .....	2
<b>3.0</b>	<b>SUBSURFACE INVESTIGATION .....</b>	<b>2</b>
<b>4.0</b>	<b>LABORATORY TESTING .....</b>	<b>3</b>
<b>5.0</b>	<b>GEOLOGIC INTERPRETATION .....</b>	<b>3</b>
5.1	Geologic Hazards.....	3
5.2	Geologic Constraints.....	3
5.3	Water Resources .....	3
5.4	Mineral Resources .....	3
<b>6.0</b>	<b>CONCLUSIONS .....</b>	<b>3</b>
<b>7.0</b>	<b>RECOMMENDATIONS.....</b>	<b>4</b>
7.1	Subgrade Preparation .....	4
7.1	Headwall/Wingwall Foundations .....	4
7.2	Lateral Earth Pressures.....	5
7.3	Corrosion of Steel and Concrete.....	5
7.4	Seismic Site Classification .....	5
7.5	Excavations.....	5
7.1	Embankment Fill .....	6
7.2	Pavements.....	6
<b>8.0</b>	<b>GENERAL .....</b>	<b>7</b>

### FIGURES

Figure 1 – Site Location Map

Figure 2 – Site Plan

### APPENDICES

Appendix A – UDSA NRCS Soil Survey Data

Appendix B – Typed Boring Logs

Appendix C – Laboratory Testing Results

Appendix D – Nominal Bearing Resistance at the Service Limit State

Appendix E – ESAL Calculations

## 1.0 INTRODUCTION

As part of extensive infrastructure improvements in Western Colorado, the City of Grand Junction proposes to replace the 21.5-G.95 Bridge over Pritchard Wash. As part of the design development process, Huddlestone-Berry Engineering and Testing, LLC (HBET) was retained by the City of Grand Junction to conduct a geologic hazards and geotechnical investigation at the site.

### 1.1 Scope

As discussed above, a geologic hazards and geotechnical investigation was conducted for the 21.5-G.95 Bridge over Pritchard Wash in Grand Junction, Colorado. The scope of the investigation included the following components:

- Conducting a subsurface investigation to evaluate the subsurface conditions at the site.
- Collecting soil samples and conducting laboratory testing to determine the engineering properties of the soils at the site.
- Providing recommendations for foundation type and subgrade preparation.
- Providing recommendations for bearing capacity.
- Providing recommendations for lateral earth pressure.
- Providing recommendations for drainage, grading, and general earthwork.
- Providing recommendations for pavements.
- Evaluating potential geologic hazards at the site.

The investigation and report were completed by a Colorado registered professional engineer in accordance with generally accepted geotechnical and geological engineering practices. This report has been prepared for the exclusive use of the City of Grand Junction.

### 1.2 Site Location and Description

The site is located on 21½ Road, south of H Road in Grand Junction. The project location is shown on Figure 1 – Site Location Map.

At the time of the investigation, 21½ Road consisted of one lane in each direction. The roadway grade was fairly flat. The predominant land use in the vicinity of the bridge was commercial/industrial.

### 1.3 Proposed Construction

The proposed construction is anticipated to include replacement of the existing 60-inch CMP culvert with a new 60-inch HDPE pipe or larger RCP culvert.

## **2.0 GEOLOGIC SETTING**

### **2.1 Soils**

Soils data was obtained from the USDA Natural Resource Conservation Service Web Soil Survey. The data indicates that the soils at the site consist of Sagers silty clay loam, saline, 0 to 2 percent slopes. Soil survey data is included in Appendix A.

Road construction in the site soils is described as being very limited due to low strength, frost action, and/or shrink/swell. Excavation in the site soils is described as being somewhat limited due to dust and/or unstable excavation walls. The site soils are indicated to have a moderate potential for frost action, high risk of corrosion of uncoated steel, and high risk of corrosion of concrete.

### **2.2 Geology**

According to the *Geologic Map of the Colorado National Monument and Adjacent Areas, Mesa County, Colorado* (2001), the site is underlain by sheetwash deposits.

### **2.3 Groundwater**

Groundwater was encountered in the subsurface at depths of between 17.0 and 18.0 feet at the time of the investigation.

## **3.0 SUBSURFACE INVESTIGATION**

The subsurface investigation was conducted on December 13<sup>th</sup>, 2019 and consisted of two borings. Borings B-1 and B-2 were drilled to depths of 20.5 and 21.0 feet below the existing ground surface, respectively. The locations of the borings are shown on Figure 2 – Site Plan. The borings were located in the field relative to existing site features. Typed boring logs are included in Appendix B. Samples of the native soils were collected during Standard Penetration Testing (SPT) and using bulk sampling methods at the locations shown on the logs.

As indicated on the logs, the subsurface conditions at the site were slightly variable. However, the borings generally encountered 4.0-inches of asphalt pavement above granular base course to depths of between 1.5 and 2.0 feet. Below the base course, tan to brown, moist to wet, soft to very stiff lean clay soils with fat clay layers was encountered. The clays extended to the bottom of B-1. In B-2, the clays extended to a depth of 20.0 feet and were underlain by brown, wet, dense sandy gravel to the bottom of the boring. As discussed previously, groundwater was encountered in the borings at depths of between 17.0 and 18.0 feet at the time of the investigation.

## **4.0 LABORATORY TESTING**

Selected native soil samples collected from the borings were tested in the Huddlestone-Berry Engineering and Testing LLC geotechnical laboratory for natural moisture content, grain size analysis, maximum dry density and optimum moisture (Proctor), Atterberg limits, California Bearing Ratio (CBR), and water soluble sulfates. The laboratory testing results are included in Appendix C.

The laboratory testing results indicate that the native clay soils are slightly to highly plastic. In addition, the CBR results indicate that the native clay soils may expand as much as 2.4% when compacted and introduced to excess moisture. Water soluble sulfates were detected in the site soils in a concentration of 0.02%.

## **5.0 GEOLOGIC INTERPRETATION**

### **5.1 Geologic Hazards**

The primary geologic hazard at the site is the presence of moisture sensitive soils. However, flooding of Pritchard wash could also impact the site.

### **5.2 Geologic Constraints**

The primary geologic constraint to construction is the presence of surface water and groundwater associated with Pritchard wash. In addition, soft soil conditions associated with the surface and/or ground water may impact the construction. However, the presence of moisture sensitive soils may also impact the construction.

### **5.3 Water Resources**

The primary water feature in the area is Pritchard wash.

### **5.4 Mineral Resources**

No significant mineral resources were identified in the project area. Potential mineral resources in Western Colorado generally include gravel, uranium ore, and commercial rock products such as flagstone. As discussed previously, gravels were encountered in B-2. However, the gravels were deep. In general, HBET does not believe that any commercial quality mineral deposits exist at this site.

## **6.0 CONCLUSIONS**

Based upon the available data sources, field investigation, and nature of the proposed construction, HBET does not believe that there are any geologic conditions which should preclude construction at the site. However, the presence of surface water, groundwater, soft soils, and/or moisture sensitive soils may impact the design and construction.



## 7.0 RECOMMENDATIONS

### 7.1 Subgrade Preparation

As discussed previously, a new pipe culvert is proposed to carry Pritchard wash under 21½ Road. Based upon information provided to HBET, the base of the existing pipe is approximately 14 feet below the roadway elevation. As indicated in the boring logs, medium stiff clay soils are present in the subsurface at this elevation. In order to provide uniform support to the new pipe and overlying roadway, it is recommended that the culvert be constructed above a minimum of 24-inches of structural fill.

In general, due to their plasticity, the native clay soils are not suitable for reuse as structural fill. Imported structural fill should consist of a granular, non-expansive, non-free draining material such as crusher fines, pit-run, or CDOT Class 6 base course. However, if pit-run is used for structural fill, a minimum of six inches of crusher fines or Class 6 base course should be placed on top of the pit run to prevent large point stresses on the bottoms of the footings due to large particles in the pit-run. **In addition, HBET should be provided the opportunity to review all proposed structural fill materials prior to their use.**

Prior to placement of structural fill, it is recommended that the bottom of the foundation excavation be scarified to a depth of 6 to 8 inches, moisture conditioned, and compacted to a minimum of 95% of the standard Proctor maximum dry density, within  $\pm 2\%$  of the optimum moisture content as determined in accordance with ASTM D698. However, due to the presence of surface water and/or groundwater, soft soil conditions may be encountered and compaction of the subgrade may be difficult. It may be necessary to utilize geotextile and/or geogrid in conjunction with up to 24-inches of additional granular fill to stabilize the subgrade. HBET should be contacted to provide specific recommendations for subgrade stabilization based upon the actual conditions in the bottom of the excavation.

HBET recommends that structural fill and any required stabilization extend to the edges of the excavation. Structural fill should be moisture conditioned, placed in maximum 8-inch loose lifts, and compacted to a minimum of 95% of the standard Proctor maximum dry density for fine grained soils and modified Proctor maximum dry density for coarse grained soils, within  $\pm 2\%$  of the optimum moisture content as determined in accordance with ASTM D698 and D1557C, respectively. Pit-run materials should be proofrolled to the Engineer's satisfaction.

### 7.1 Headwall/Wingwall Foundations

For subgrade preparation as recommended above and structural fill consisting of imported granular materials, a nominal bearing resistance for the strength limit state of  $q_{ult} = 450 \times \text{Effective footing width} + 3175$  psf may be used. A resistance factor of 0.45 is recommended. Nominal bearing resistance for the service limit state should be in accordance with the attached plot of Bearing Stress versus Effective Footing Width for a maximum total settlement of 1.0-inch included in Appendix D. Foundations subject to frost should be at least 24-inches below the finished grade.

## 7.2 Lateral Earth Pressures

Any earth retaining structures should be designed to resist lateral earth pressures. HBET recommends that the structures be designed using the following earth pressure coefficients:

### Native Lean Clay Soils

- $K_a = 0.39$
- $K_p = 2.56$

### Class 1 Structural Backfill

- $K_a = 0.33$
- $K_p = 3.00$

The earth pressure coefficients above assume horizontal backslope and should be increased where the backslope is not level. Computed lateral earth pressures on the structures should consider surcharge loading from 21½ Road.

## 7.3 Corrosion of Steel and Concrete

Based upon information provided in the USDA NRCS Web Soil Survey, the soils at the site have a high risk of corrosion of uncoated steel. Therefore, it is recommended that corrosion be considered in the design of any steel structural elements or utilities.

With regard to soil corrosivity to concrete, as discussed previously, water soluble sulfates were detected in the site soils in a concentration of 0.02%. This concentration represents a negligible degree of potential sulfate attack on concrete exposed to the native soils. However, the Soil Survey data suggests that the native soils have a high risk of corrosion of concrete. Therefore, at a minimum, Type I-II sulfate resistant cement is recommended for construction at this site.

## 7.4 Seismic Site Classification

Based upon the results of the subsurface investigation, the site generally classifies as Seismic Site Class D for a stiff soil profile.

## 7.5 Excavations

Excavations in the soils at the site may stand for short periods of time but should not be considered to be stable. Trenching and excavations should be sloped back, shored, or shielded for worker protection in accordance with applicable OSHA standards. The native soils generally classify as Type C soil with regard to OSHA's *Construction Standards for Excavations*. In general, for Type C soils, the maximum allowable slope in temporary cuts is 1.5H:1V. However, at or near the water table, the soils will tend to slough and sheeting or shoring may be required.

In addition, it is important to note that the soil classification is based solely on the boring data. Some of the native clay soils may actually classify as Type B soils. It is recommended that HBET be contacted during construction to further evaluate the native soils where significant excavations are proposed.

## **7.1 Embankment Fill**

Based upon information provided to HBET, the existing pipe is ~9 feet below the roadway elevation. As a result, significant fill will be placed above the new pipe to bring up the grade back to the roadway elevation. In general, the native soils can be used as embankment fill above the new pipe to an elevation of 24-inches below the roadway pavement section. Suitable imported structural fill materials, as described previously, should be used for the upper 24-inches below the roadway pavement section.

In order to limit the potential for excessive settlements of the embankment fill, native soils or suitable imported materials above the pipe should be placed in 6 to 9-inch lifts and compacted to a minimum of 98% of the modified Proctor maximum dry density, within  $\pm 2\%$  of optimum moisture content in accordance with ASTM D1557. Pit-run or other non-testable materials should be moisture conditioned and proofrolled to the Engineer's satisfaction.

## **7.2 Pavements**

The proposed construction will include new pavements above the new pipe. As discussed previously, the native pavement subgrade materials consist primarily of lean to fat clay soils. The design CBR of the native clay soils was determined in the laboratory to be less than 2.0. Therefore, the minimum recommended Resilient Modulus of 3,000 psi was used for the design.

As discussed previously, the existing pavements along 21.5 Road consist of 4.0-inches of asphalt above granular base course to depths of between 1.5 and 2.0 feet. The thinner pavement section is suitable for a design ESAL value of approximately 363,000. However, the ESAL calculations included in Appendix E for 21.5 Road based upon available traffic data yield an ESAL value of approximately 338,000. Therefore, HBET recommends that the new pavements consist of a minimum of 4.0-inches of asphalt pavement above 14.0-inches of CDOT Class 6 base course to match the thinner existing pavement section.

Prior to pavement placement, areas to be paved beyond the limits of structural fill recommended for the embankment above the pipe should be stripped of all topsoil, uncontrolled fill, or other unsuitable materials. It is recommended that the subgrade soils be scarified to a depth of 12-inches; moisture conditioned, and recompacted to a minimum of 95% of the standard Proctor maximum dry density, within  $\pm 2\%$  of optimum moisture content as determined by AASHTO T-99.

Aggregate base course and subbase course should be placed in maximum 9-inch loose lifts, moisture conditioned, and compacted to a minimum of 95% and 93% of the maximum dry density, respectively, at -2% to +3% of optimum moisture content as determined by AASHTO T-180. In addition to density testing, base course should be proofrolled to verify subgrade stability.

It is recommended that Hot-Mix Asphaltic (HMA) pavement conform to CDOT grading SX or S specifications and consist of an approved 75 gyration Superpave method mix design. HMA pavement should be compacted to between 92% and 96% of the maximum theoretical density. An end point stress of 50 psi should be used.

The long-term performance of the pavements is dependent on positive drainage away from the pavements. Ditches, culverts, and inlet structures in the vicinity of paved areas must be maintained to prevent ponding of water on the pavement.

## 8.0 GENERAL

The recommendations included above are based upon the results of the subsurface investigation and on our local experience. These conclusions and recommendations are valid only for the proposed construction.

As discussed previously, the subsurface conditions at the site were slightly variable. However, the precise nature and extent of subsurface variability may not become evident until construction. Therefore, it is recommended that a representative of HBET be retained to provide engineering oversight and construction materials testing services during the construction. This is to verify compliance with the recommendations included in this report or permit identification of significant variations in the subsurface conditions which may require modification of the recommendations.

Huddleston-Berry Engineering and Testing, LLC is pleased to be of service to your project. Please contact us if you have any questions or comments regarding the contents of this report.

Respectfully Submitted:

**Huddleston-Berry Engineering and Testing, LLC**



Michael A. Berry, P.E.  
Vice President of Engineering


**FIGURES**



**FIGURE 1**  
**Site Location Map**

**Mesa County Map**

The Geographic Information System (GIS) and its components are designed as a source of reference for answering inquiries, for planning and for modeling. GIS is not intended or does not replace legal description information in the chain of title and other information contained in official government records such as the County Clerk and Records office or the courts. In addition, the representations of location in this GIS cannot be substituted for actual legal surveys. The information contained herein is believed accurate and suitable for the limited uses, and subject to the limitations, set forth above. Mesa County makes no warranty as to the accuracy or suitability of any information contained herein. Users assume all risk and responsibility for any and all damages, including consequential damages, which may flow from the user's use of this information.



Print Date: February 5, 2020



**Mesa County, Colorado**


**GIS/IT Department**  
gis.mesacounty.us



**FIGURE 2**  
**Site Plan**

## Mesa County Map

The Geographic Information System (GIS) and its components are designed as a source of reference for answering inquiries, for planning and for modeling. GIS is not intended or does not replace legal description information in the chain of title and other information contained in official government records such as the County Clerk and Records office or the courts. In addition, the representations of location in this GIS cannot be substituted for actual legal surveys. The information contained herein is believed accurate and suitable for the limited uses, and subject to the limitations, set forth above. Mesa County makes no warranty as to the accuracy or suitability of any information contained herein. Users assume all risk and responsibility for any and all damages, including consequential damages, which may flow from the user's use of this information.



Print Date: February 5, 2020



**Mesa County, Colorado**

**GIS/IT Department**  
gis.mesacounty.us


**APPENDIX A**  
**Soil Survey Data**



Soil Map—Mesa County Area, Colorado



Soil Map may not be valid at this scale.

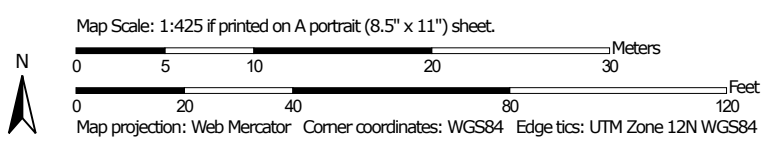

## MAP LEGEND

### Area of Interest (AOI)

 Area of Interest (AOI)

### Soils

 Soil Map Unit Polygons

 Soil Map Unit Lines

 Soil Map Unit Points

### Special Point Features



Blowout



Borrow Pit



Clay Spot



Closed Depression



Gravel Pit



Gravelly Spot



Landfill



Lava Flow



Marsh or swamp



Mine or Quarry



Miscellaneous Water



Perennial Water



Rock Outcrop



Saline Spot



Sandy Spot



Severely Eroded Spot



Sinkhole



Slide or Slip



Sodic Spot



Spoil Area



Stony Spot



Very Stony Spot



Wet Spot



Other



Special Line Features

### Water Features



Streams and Canals

### Transportation



Rails



Interstate Highways



US Routes



Major Roads



Local Roads

### Background



Aerial Photography

## MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

**Warning:** Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service

Web Soil Survey URL:

Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Mesa County Area, Colorado

Survey Area Data: Version 10, Sep 13, 2019

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Sep 13, 2010—Aug 8, 2017

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

## Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
BcS	Sagers silty clay loam, saline, 0 to 2 percent slopes	0.8	100.0%
<b>Totals for Area of Interest</b>		<b>0.8</b>	<b>100.0%</b>

## Map Unit Description

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions in this report, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named, soils that are similar to the named components, and some minor components that differ in use and management from the major soils.

Most of the soils similar to the major components have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Some minor components, however, have properties and behavior characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. All the soils of a series have major horizons that are similar in composition, thickness, and arrangement. Soils of a given series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

Additional information about the map units described in this report is available in other soil reports, which give properties of the soils and the limitations, capabilities, and potentials for many uses. Also, the narratives that accompany the soil reports define some of the properties included in the map unit descriptions.

## Report—Map Unit Description

### Mesa County Area, Colorado

#### BcS—Sagers silty clay loam, saline, 0 to 2 percent slopes

##### Map Unit Setting

*National map unit symbol:* k0bs

*Elevation:* 4,490 to 4,920 feet

*Mean annual precipitation:* 6 to 9 inches  
*Mean annual air temperature:* 50 to 55 degrees F  
*Frost-free period:* 140 to 180 days  
*Farmland classification:* Not prime farmland

### **Map Unit Composition**

*Sagers, saline, and similar soils:* 90 percent  
*Estimates are based on observations, descriptions, and transects of the mapunit.*

### **Description of Sagers, Saline**

#### **Setting**

*Landform:* Terraces  
*Landform position (three-dimensional):* Tread  
*Down-slope shape:* Linear, concave  
*Across-slope shape:* Linear  
*Parent material:* Cretaceous source alluvium derived from sandstone and shale

#### **Typical profile**

*Ap - 0 to 12 inches:* silty clay loam  
*C - 12 to 25 inches:* silty clay loam  
*Cy - 25 to 60 inches:* silty clay loam

#### **Properties and qualities**

*Slope:* 0 to 2 percent  
*Depth to restrictive feature:* More than 80 inches  
*Natural drainage class:* Well drained  
*Runoff class:* Low  
*Capacity of the most limiting layer to transmit water (Ksat):*  
Moderately high (0.21 to 0.71 in/hr)  
*Depth to water table:* More than 80 inches  
*Frequency of flooding:* None  
*Frequency of ponding:* None  
*Calcium carbonate, maximum in profile:* 15 percent  
*Gypsum, maximum in profile:* 5 percent  
*Salinity, maximum in profile:* Strongly saline (16.0 to 32.0 mmhos/cm)  
*Available water storage in profile:* Low (about 4.9 inches)

#### **Interpretive groups**

*Land capability classification (irrigated):* 7s  
*Land capability classification (nonirrigated):* 7c  
*Hydrologic Soil Group:* C  
*Ecological site:* Desert Loam (Shadscale) (R034BY106UT)  
*Hydric soil rating:* No

## **Data Source Information**

Soil Survey Area: Mesa County Area, Colorado  
Survey Area Data: Version 10, Sep 13, 2019

## Roads and Streets, Shallow Excavations, and Lawns and Landscaping

Soil properties influence the development of building sites, including the selection of the site, the design of the structure, construction, performance after construction, and maintenance. This table shows the degree and kind of soil limitations that affect local roads and streets, shallow excavations, and lawns and landscaping.

The ratings in the table are both verbal and numerical. Rating class terms indicate the extent to which the soils are limited by all of the soil features that affect building site development. *Not limited* indicates that the soil has features that are very favorable for the specified use. Good performance and very low maintenance can be expected. *Somewhat limited* indicates that the soil has features that are moderately favorable for the specified use. The limitations can be overcome or minimized by special planning, design, or installation. Fair performance and moderate maintenance can be expected. *Very limited* indicates that the soil has one or more features that are unfavorable for the specified use. The limitations generally cannot be overcome without major soil reclamation, special design, or expensive installation procedures. Poor performance and high maintenance can be expected.

Numerical ratings in the table indicate the severity of individual limitations. The ratings are shown as decimal fractions ranging from 0.01 to 1.00. They indicate gradations between the point at which a soil feature has the greatest negative impact on the use (1.00) and the point at which the soil feature is not a limitation (0.00).

*Local roads and streets* have an all-weather surface and carry automobile and light truck traffic all year. They have a subgrade of cut or fill soil material; a base of gravel, crushed rock, or soil material stabilized by lime or cement; and a surface of flexible material (asphalt), rigid material (concrete), or gravel with a binder. The ratings are based on the soil properties that affect the ease of excavation and grading and the traffic-supporting capacity. The properties that affect the ease of excavation and grading are depth to bedrock or a cemented pan, hardness of bedrock or a cemented pan, depth to a water table, ponding, flooding, the amount of large stones, and slope. The properties that affect the traffic-supporting capacity are soil strength (as inferred from the AASHTO group index number), subsidence, linear extensibility (shrink-swell potential), the potential for frost action, depth to a water table, and ponding.

*Shallow excavations* are trenches or holes dug to a maximum depth of 5 or 6 feet for graves, utility lines, open ditches, or other purposes. The ratings are based on the soil properties that influence the ease of digging and the resistance to sloughing. Depth to bedrock or a cemented pan, hardness of bedrock or a cemented pan, the amount of large stones, and dense layers influence the ease of digging, filling, and compacting. Depth to the seasonal high water table, flooding, and ponding may restrict the period when excavations can be made. Slope influences the ease of using machinery. Soil texture, depth to the water table, and linear extensibility (shrink-swell potential) influence the resistance to sloughing.

*Lawns and landscaping* require soils on which turf and ornamental trees and shrubs can be established and maintained. Irrigation is not considered in the ratings. The ratings are based on the soil properties that affect plant growth and trafficability after vegetation is established. The properties that affect plant growth are reaction; depth to a water table; ponding; depth to bedrock or a cemented pan; the available water capacity in the upper 40 inches; the content of salts, sodium, or calcium carbonate; and sulfidic materials. The properties that affect trafficability are flooding, depth to a water table, ponding, slope, stoniness, and the amount of sand, clay, or organic matter in the surface layer.

Information in this table is intended for land use planning, for evaluating land use alternatives, and for planning site investigations prior to design and construction. The information, however, has limitations. For example, estimates and other data generally apply only to that part of the soil between the surface and a depth of 5 to 7 feet. Because of the map scale, small areas of different soils may be included within the mapped areas of a specific soil.

The information is not site specific and does not eliminate the need for onsite investigation of the soils or for testing and analysis by personnel experienced in the design and construction of engineering works.

Government ordinances and regulations that restrict certain land uses or impose specific design criteria were not considered in preparing the information in this table. Local ordinances and regulations should be considered in planning, in site selection, and in design.

## Report—Roads and Streets, Shallow Excavations, and Lawns and Landscaping

[Onsite investigation may be needed to validate the interpretations in this table and to confirm the identity of the soil on a given site. The numbers in the value columns range from 0.01 to 1.00. The larger the value, the greater the potential limitation. The table shows only the top five limitations for any given soil. The soil may have additional limitations]

Roads and Streets, Shallow Excavations, and Lawns and Landscaping—Mesa County Area, Colorado							
Map symbol and soil name	Pct. of map unit	Lawns and landscaping		Local roads and streets		Shallow excavations	
		Rating class and limiting features	Value	Rating class and limiting features	Value	Rating class and limiting features	Value
BcS—Sagers silty clay loam, saline, 0 to 2 percent slopes							
Sagers, saline	90	Very limited		Very limited		Somewhat limited	
		Salinity	1.00	Low strength	1.00	Dusty	0.50
		Dusty	0.50	Frost action	0.50	Unstable excavation walls	0.01
		Droughty	0.13	Shrink-swell	0.03		



## Data Source Information

Soil Survey Area: Mesa County Area, Colorado  
Survey Area Data: Version 10, Sep 13, 2019

## Soil Features

This table gives estimates of various soil features. The estimates are used in land use planning that involves engineering considerations.

A *restrictive layer* is a nearly continuous layer that has one or more physical, chemical, or thermal properties that significantly impede the movement of water and air through the soil or that restrict roots or otherwise provide an unfavorable root environment. Examples are bedrock, cemented layers, dense layers, and frozen layers. The table indicates the hardness and thickness of the restrictive layer, both of which significantly affect the ease of excavation. *Depth to top* is the vertical distance from the soil surface to the upper boundary of the restrictive layer.

*Subsidence* is the settlement of organic soils or of saturated mineral soils of very low density. Subsidence generally results from either desiccation and shrinkage, or oxidation of organic material, or both, following drainage. Subsidence takes place gradually, usually over a period of several years. The table shows the expected initial subsidence, which usually is a result of drainage, and total subsidence, which results from a combination of factors.

*Potential for frost action* is the likelihood of upward or lateral expansion of the soil caused by the formation of segregated ice lenses (frost heave) and the subsequent collapse of the soil and loss of strength on thawing. Frost action occurs when moisture moves into the freezing zone of the soil. Temperature, texture, density, saturated hydraulic conductivity (Ksat), content of organic matter, and depth to the water table are the most important factors considered in evaluating the potential for frost action. It is assumed that the soil is not insulated by vegetation or snow and is not artificially drained. Silty and highly structured, clayey soils that have a high water table in winter are the most susceptible to frost action. Well drained, very gravelly, or very sandy soils are the least susceptible. Frost heave and low soil strength during thawing cause damage to pavements and other rigid structures.

*Risk of corrosion* pertains to potential soil-induced electrochemical or chemical action that corrodes or weakens uncoated steel or concrete. The rate of corrosion of uncoated steel is related to such factors as soil moisture, particle-size distribution, acidity, and electrical conductivity of the soil. The rate of corrosion of concrete is based mainly on the sulfate and sodium content, texture, moisture content, and acidity of the soil. Special site examination and design may be needed if the combination of factors results in a severe hazard of corrosion. The steel or concrete in installations that intersect soil boundaries or soil layers is more susceptible to corrosion than the steel or concrete in installations that are entirely within one kind of soil or within one soil layer.

For uncoated steel, the risk of corrosion, expressed as *low*, *moderate*, or *high*, is based on soil drainage class, total acidity, electrical resistivity near field capacity, and electrical conductivity of the saturation extract.

For concrete, the risk of corrosion also is expressed as *low*, *moderate*, or *high*. It is based on soil texture, acidity, and amount of sulfates in the saturation extract.

## Report—Soil Features

Soil Features—Mesa County Area, Colorado									
Map symbol and soil name	Restrictive Layer				Subsidence		Potential for frost action	Risk of corrosion	
	Kind	Depth to top	Thickness	Hardness	Initial	Total		Uncoated steel	Concrete
		<i>Low-RV-High</i>	<i>Range</i>		<i>Low-High</i>	<i>Low-High</i>			
		<i>In</i>	<i>In</i>		<i>In</i>	<i>In</i>			
BcS—Sagers silty clay loam, saline, 0 to 2 percent slopes									
Sagers, saline		—	—		0	0	Moderate	High	High

## Data Source Information

Soil Survey Area: Mesa County Area, Colorado  
 Survey Area Data: Version 10, Sep 13, 2019

**APPENDIX B**  
**Typed Boring Logs**



Huddlestone-Berry Engineering & Testing, LLC  
 2789 Riverside Parkway  
 Grand Junction, CO 81501  
 970-255-8005

# BORING NUMBER B-1

PAGE 1 OF 1

**CLIENT** City of Grand Junction **PROJECT NAME** 21.5-G.95 Bridge

**PROJECT NUMBER** 00208-0110 **PROJECT LOCATION** Grand Junction, CO

**DATE STARTED** 12/13/19 **COMPLETED** 12/13/19 **GROUND ELEVATION** \_\_\_\_\_ **HOLE SIZE** 4-inch

**DRILLING CONTRACTOR** S. McCracken **GROUND WATER LEVELS:**

**DRILLING METHOD** Simco 2000 Track Rig **▽ AT TIME OF DRILLING** 18.0 ft

**LOGGED BY** SD **CHECKED BY** MAB **▼ AT END OF DRILLING** 18.0 ft

**NOTES** \_\_\_\_\_ **AFTER DRILLING** ---

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
									LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
0		ASPHALT Pavement Granular BASE COURSE										
0 - 3												
3 - 18		Lean CLAY to Lean CLAY with Sand (CL), Fat CLAY layers, tan to brown, moist to wet, medium stiff to very stiff ***Lab Classified SS1	SS 1	78	6-5-5 (10)			11	24	16	8	82
18 - 20			SS 2	78	4-4-14 (18)							
20 - 20.5			SS 3	72	2-4-4 (8)							
20.5		***Lab Classified SS4	SS 4	100	5-7-11 (18)			24	58	26	32	99
20.5		Bottom of hole at 20.5 feet.										

GEOTECH BH COLUMNS 00208-0110 21.5-G.95 BRIDGE GPJ GINT US LAB.GDT 2/4/20



Huddlestone-Berry Engineering & Testing, LLC  
 2789 Riverside Parkway  
 Grand Junction, CO 81501  
 970-255-8005

# BORING NUMBER B-2

PAGE 1 OF 1

<b>CLIENT</b> <u>City of Grand Junction</u>	<b>PROJECT NAME</b> <u>21.5-G.95 Bridge</u>
<b>PROJECT NUMBER</b> <u>00208-0110</u>	<b>PROJECT LOCATION</b> <u>Grand Junction, CO</u>
<b>DATE STARTED</b> <u>12/13/19</u> <b>COMPLETED</b> <u>12/13/19</u>	<b>GROUND ELEVATION</b> _____ <b>HOLE SIZE</b> <u>4-inch</u>
<b>DRILLING CONTRACTOR</b> <u>S. McKracken</u>	<b>GROUND WATER LEVELS:</b> ▽ <b>AT TIME OF DRILLING</b> <u>17.0 ft</u> ▼ <b>AT END OF DRILLING</b> <u>17.0 ft</u>
<b>DRILLING METHOD</b> <u>Simco 2000 Track Rig</u>	
<b>LOGGED BY</b> <u>SD</u> <b>CHECKED BY</b> <u>MAB</u>	<b>AFTER DRILLING</b> <u>---</u>
<b>NOTES</b> _____	

DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE NUMBER	RECOVERY % (RQD)	BLOW COUNTS (N VALUE)	POCKET PEN. (tsf)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
									LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
0	[Cross-hatched pattern]	ASPHALT Pavement										
	[Dotted pattern]	Granular BASE COURSE										
	[Diagonal hatching]	Lean CLAY to Lean CLAY with Sand (cl), Fat CLAY layers, brown, moist to wet, soft to medium stiff	SS 1	78	4-4-3 (7)							
5												
	[Diagonal hatching]		SS 2	61	1-1-2 (3)							
10												
	[Diagonal hatching]		SS 3	78	1-2-3 (5)							
15												
	[Diagonal hatching]		SS 4	100	17-20							
20	[Stippled pattern]	Sandy GRAVEL (gw), brown, wet, dense										
		Bottom of hole at 21.0 feet.										

GEOTECH BH COLUMNS 00208-0110 21.5-G.95 BRIDGE GPJ GINT US LAB.GDT 2/4/20

**APPENDIX C**  
**Laboratory Testing Results**



Huddlestone-Berry Engineering & Testing, LLC  
 2789 Riverside Parkway  
 Grand Junction, CO 81501  
 970-255-8005


# GRAIN SIZE DISTRIBUTION

CLIENT City of Grand Junction

PROJECT NAME 21.5-G.95 Bridge

PROJECT NUMBER 00208-0110

PROJECT LOCATION Grand Junction, CO

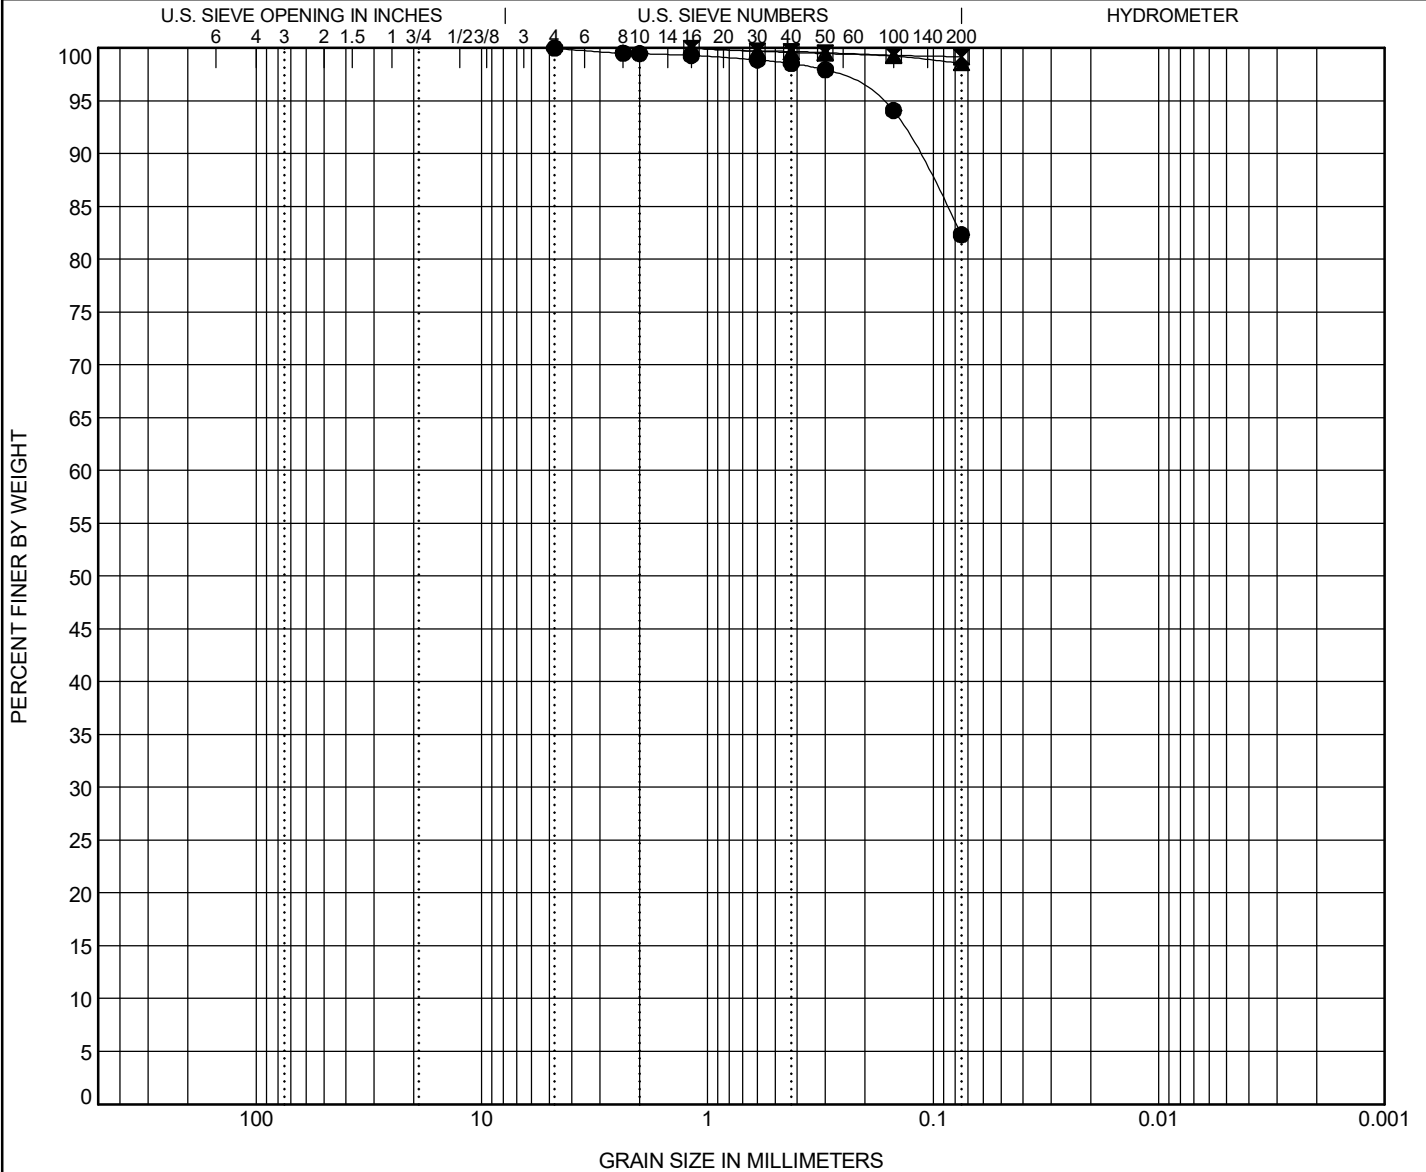

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Specimen Identification	Classification	LL	PL	PI	Cc	Cu
● B-1, SS1 12/19	LEAN CLAY with SAND(CL)	24	16	8		
☒ B-1, SS4 12/19	FAT CLAY(CH)	58	26	32		
▲ Composite 12/19	LEAN CLAY(CL)	49	22	27		

Specimen Identification	D100	D60	D30	D10	%Gravel	%Sand	%Silt	%Clay
● B-1, SS1 12/19	4.75				0.0	17.7	82.3	
☒ B-1, SS4 12/19	1.18				0.0	0.8	99.2	
▲ Composite 12/19	1.18				0.0	1.5	98.5	

GRAIN SIZE 00208-0110 21.5-G.95 BRIDGE.GPJ GINT US LAB.GDT 2/4/20





Huddlestone-Berry Engineering & Testing, LLC  
 2789 Riverside Parkway  
 Grand Junction, CO 81501  
 970-255-8005


# ATTERBERG LIMITS' RESULTS

CLIENT City of Grand Junction

PROJECT NAME 21.5-G.95 Bridge

PROJECT NUMBER 00208-0110

PROJECT LOCATION Grand Junction, CO

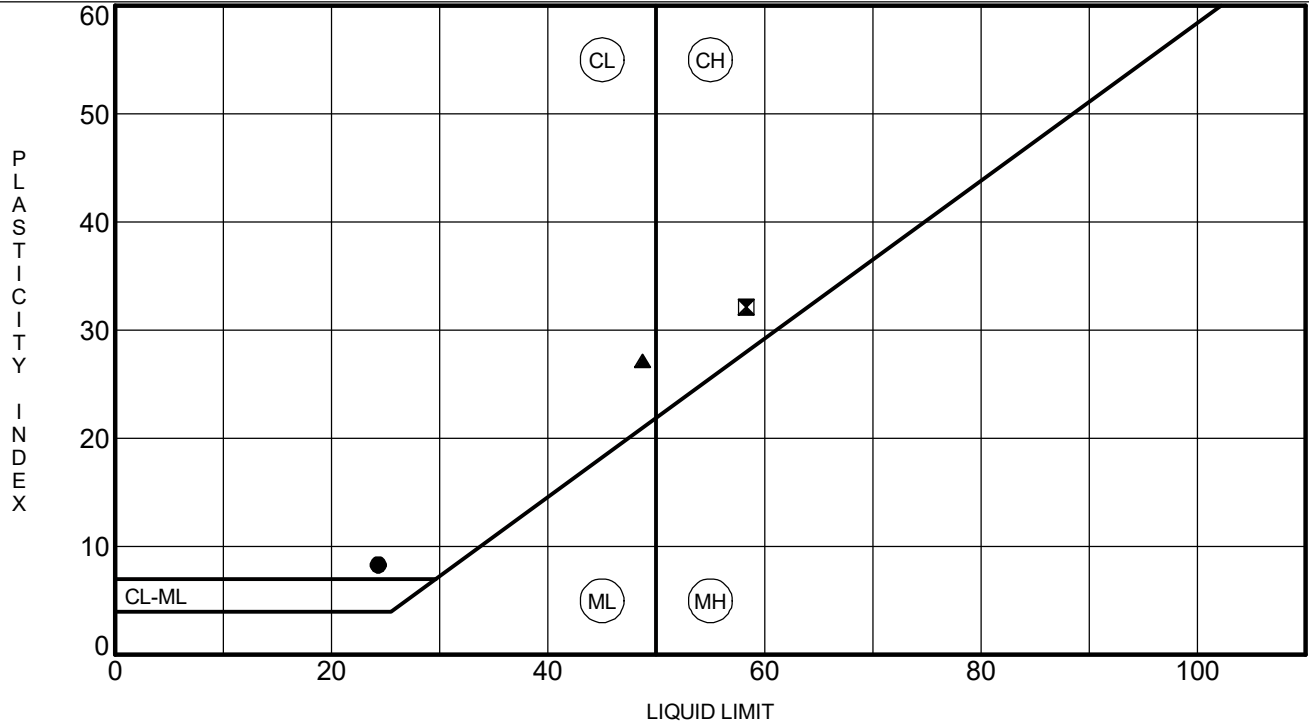

Specimen Identification	LL	PL	PI	#200	Classification
● B-1, SS1 12/13/2019	24	16	8	82	LEAN CLAY with SAND(CL)
⊠ B-1, SS4 12/13/2019	58	26	32	99	FAT CLAY(CH)
▲ Composite 12/13/2019	49	22	27	99	LEAN CLAY(CL)

ATTERBERG LIMITS 00208-0110 21.5-G.95 BRIDGE.GPJ GINT US LAB.GDT 2/4/20



Huddlestone-Berry Engineering & Testing, LLC  
2789 Riverside Parkway  
Grand Junction, CO 81501  
970-255-8005

# MOISTURE-DENSITY RELATIONSHIP

CLIENT City of Grand Junction

PROJECT NAME 21.5-G.95 Bridge

PROJECT NUMBER 00208-0110

PROJECT LOCATION Grand Junction, CO

Sample Date: 12/13/2019  
Sample No.: 1  
Source of Material: Composite  
Description of Material: LEAN CLAY(CL)  
Test Method: ASTM D698A

## TEST RESULTS

Maximum Dry Density 103.5 PCF  
Optimum Water Content 22.5 %

### GRADATION RESULTS (% PASSING)


#200	#4	3/4"
<u>99</u>	<u>100</u>	<u>100</u>

### ATTERBERG LIMITS

LL	PL	PI
<u>49</u>	<u>22</u>	<u>27</u>

Curves of 100% Saturation  
for Specific Gravity Equal to:

2.80  
2.70  
2.60

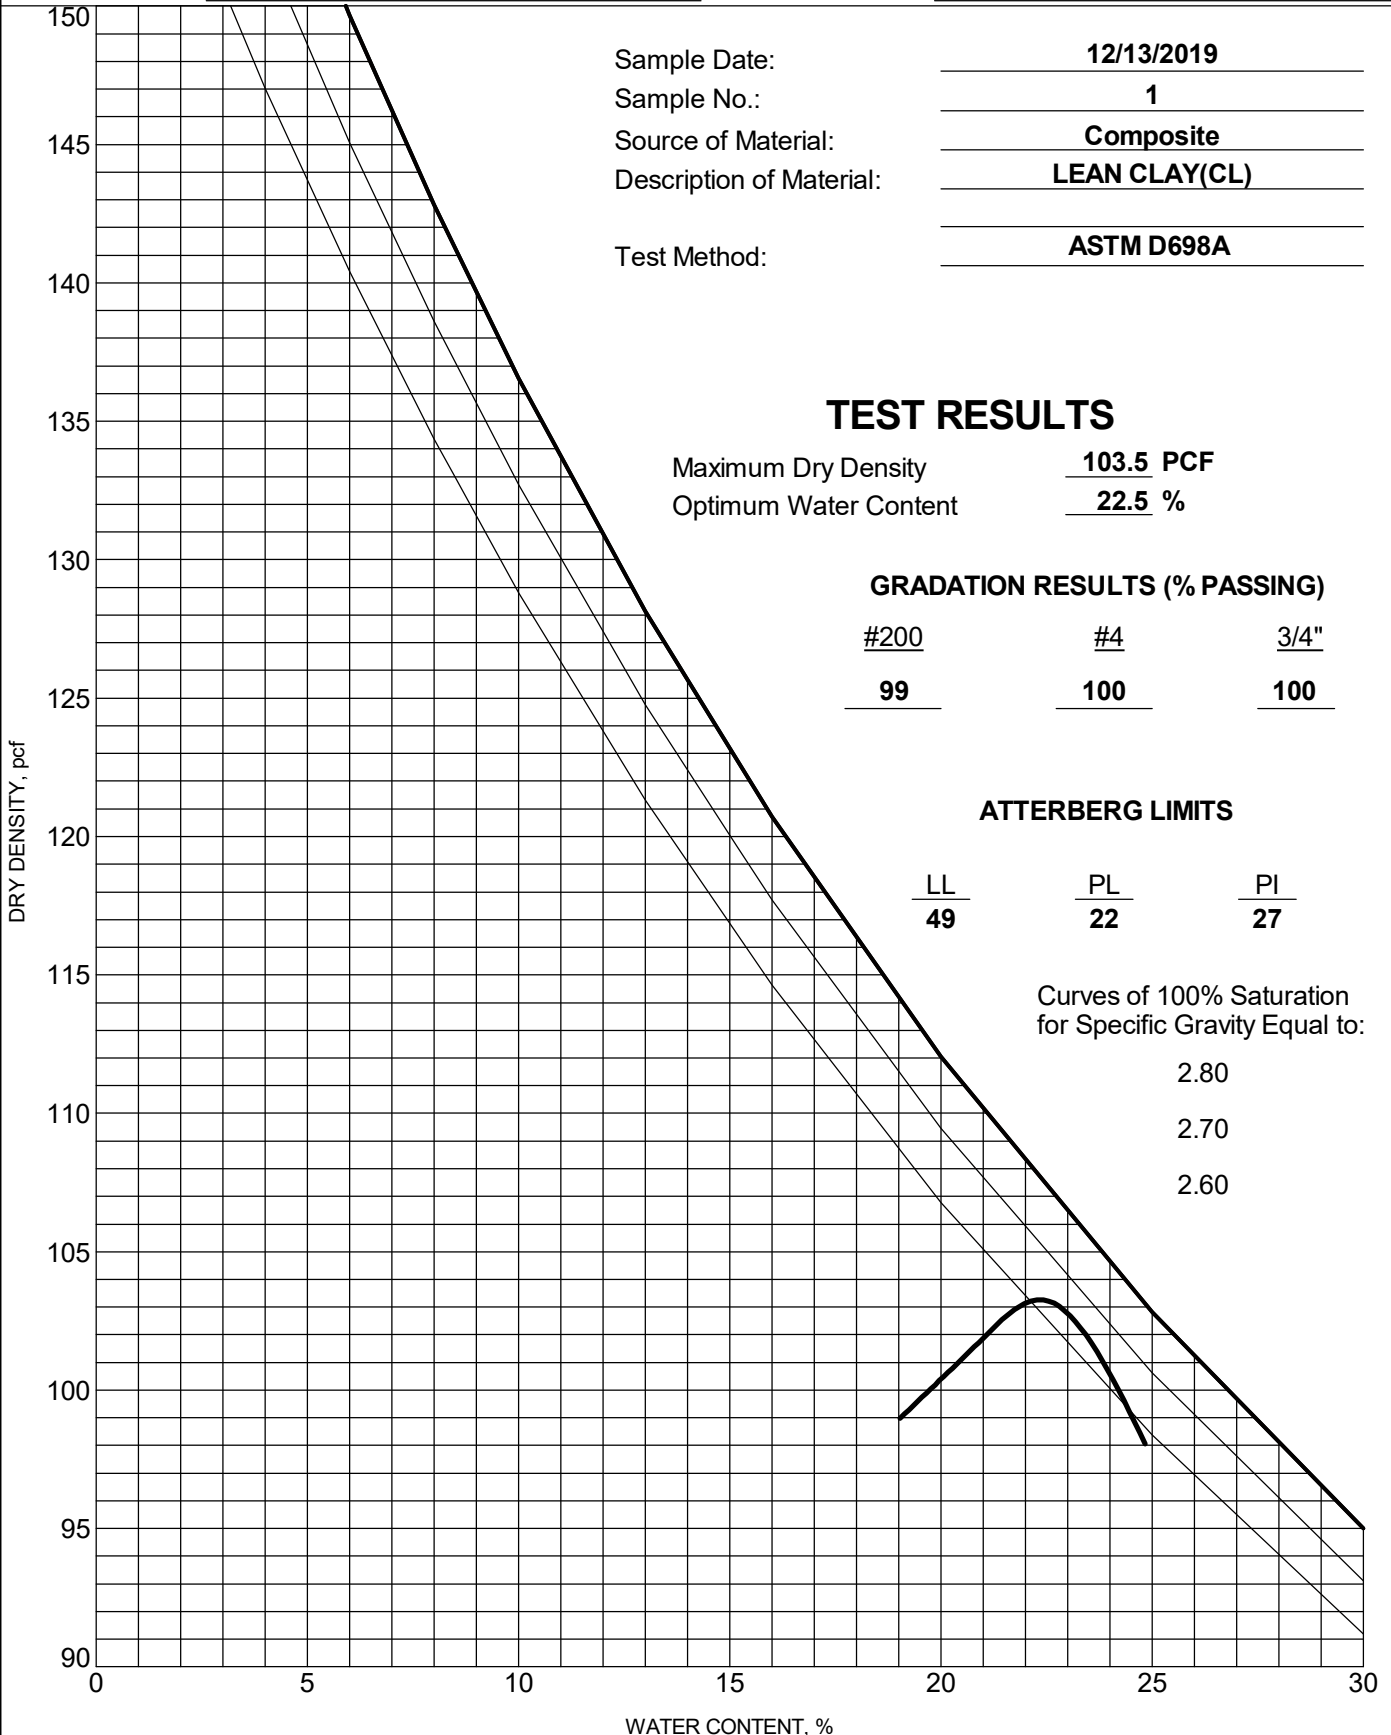




**Project No.:** 00208-0110  
**Project Name:** 21.5-G.95 Bridge  
**Client Name:** City of Grand Junction  
**Sample Number:** 19-0693    **Location:** Composite

**Authorized By:** Client    **Date:** 12/13/19  
**Sampled By:** SD    **Date:** 12/13/19  
**Submitted By:** SD    **Date:** 12/13/19  
**Reviewed By:** MAB    **Date:** 02/05/20


**Compaction Method:** ASTM D698, Method A

**Maximum Dry Density (pcf):** 103.5  
**Opt. Moisture Content (%):** 22.5  
**Sample Condition:** Soaked  
**Remarks:**

Sample Data			
	Point 1	Point 2	Point 3
Blows per Compacted Lift:	15	25	56
Surcharge Weight (lbs):	10.0	10.0	10.0
Dry Density Before Soak (pcf):	93.7	98.4	102.3
Dry Density After Soak (pcf):	91.5	96.8	101.6
Moisture Content (%)	Bottom Pre-Test	21.9	22.1
	Top Pre-Test	21.6	21.8
	Top 1" After Test	30.7	28.6
	Average After Soak:	28.0	25.5
Percent Swell After Soak:	2.4	1.7	0.7

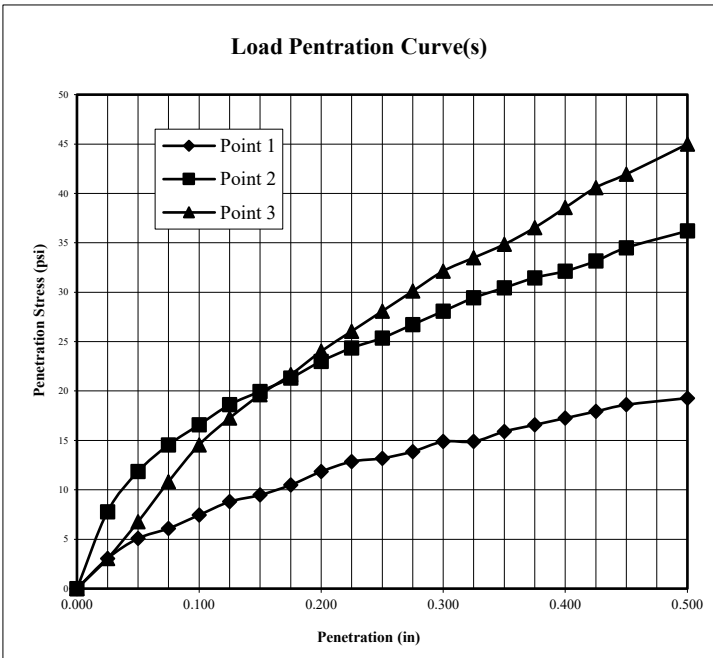

Penetration Data								
Point 1			Point 2			Point 3		
Dist. (in)	Load (lbs)	Stress (psi)	Dist. (in)	Load (lbs)	Stress (psi)	Dist. (in)	Load (lbs)	Stress (psi)
0.000	0	0	0.000	0	0	0.000	0	0
0.025	9	3	0.025	23	8	0.025	9	3
0.050	15	5	0.050	35	12	0.050	20	7
0.075	18	6	0.075	43	15	0.075	32	11
0.100	22	7	0.100	49	17	0.100	43	15
0.125	26	9	0.125	55	19	0.125	51	17
0.150	28	9	0.150	59	20	0.150	58	20
0.175	31	10	0.175	63	21	0.175	64	22
0.200	35	12	0.200	68	23	0.200	71	24
0.225	38	13	0.225	72	24	0.225	77	26
0.250	39	13	0.250	75	25	0.250	83	28
0.275	41	14	0.275	79	27	0.275	89	30
0.300	44	15	0.300	83	28	0.300	95	32
0.325	44	15	0.325	87	29	0.325	99	33
0.350	47	16	0.350	90	30	0.350	103	35
0.375	49	17	0.375	93	31	0.375	108	37
0.400	51	17	0.400	95	32	0.400	114	39
0.425	53	18	0.425	98	33	0.425	120	41
0.450	55	19	0.450	102	35	0.450	124	42
0.500	57	19	0.500	107	36	0.500	133	45

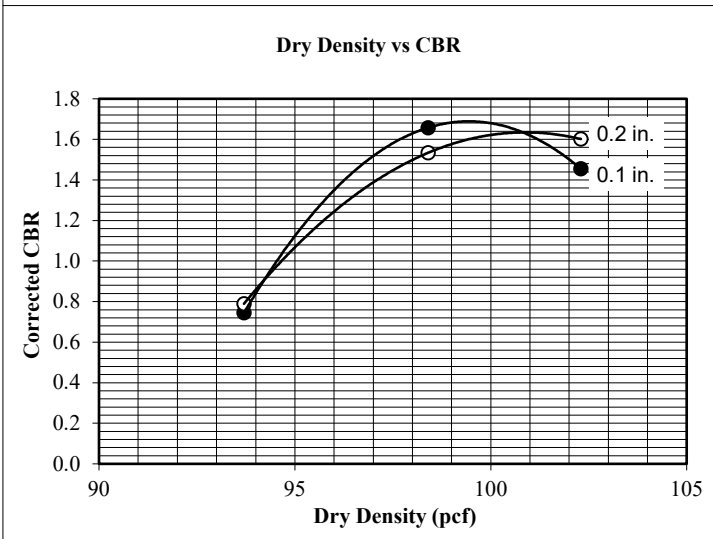


Corrected CBR @ 0.1"		
0.7	1.7	1.5
Corrected CBR @ 0.2"		
0.8	1.5	1.6

Penetration Distance Correction (in)		
0.000	0.000	0.000

**Figure:** \_\_\_\_\_

**APPENDIX D**  
**Nominal Bearing Resistance at the Service Limit State**

## LRFD Service Limit State

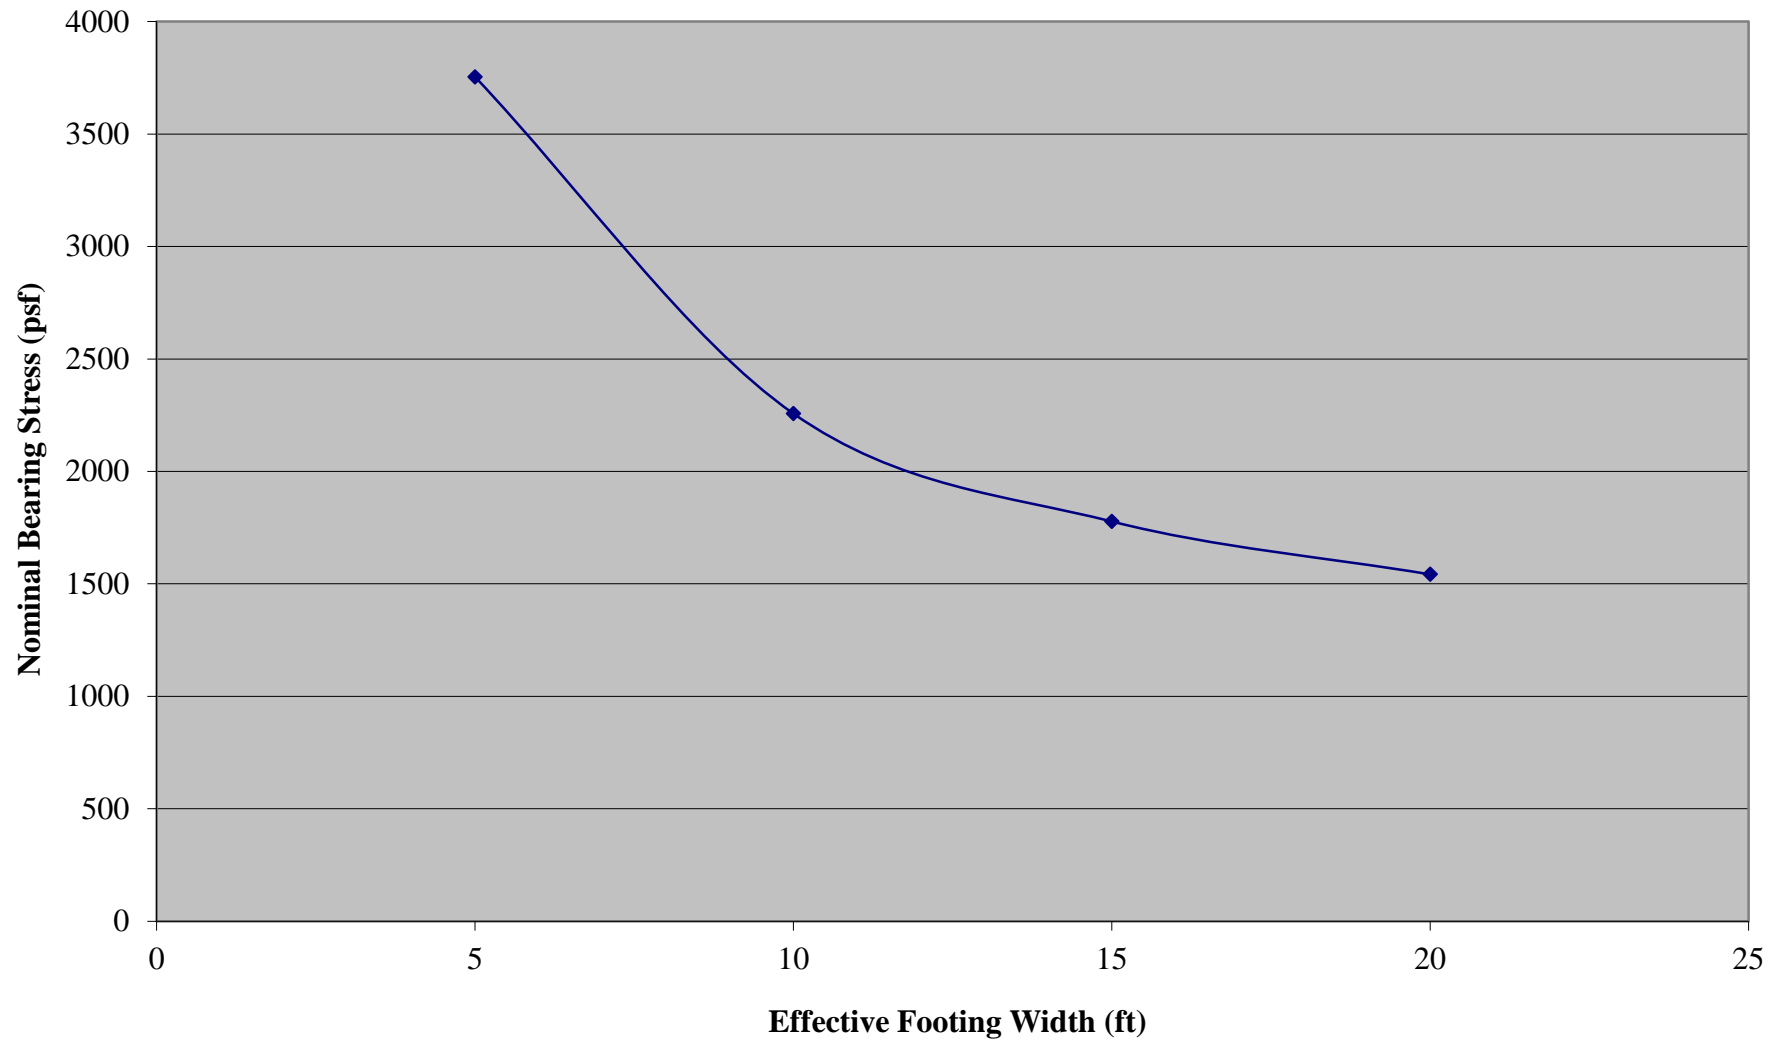

**APPENDIX E**  
**ESAL Calculations**



Project No.: 00208-0110  
 Project Name: 21.5-G.95 Bridge  
 Client Name: City of Grand Junction  
 Completed By: MAB  
 Date: 2/5/2020  
 Current Year: 2019

**GIVEN INFORMATION:**

Source: Mesa County GIS

Year: 2016 ADT: 1349  
 Year: \_\_\_\_\_ ADT: \_\_\_\_\_

**ASSUMPTIONS:**

Growth Rate (%): 2  
 Design Life (yr): 20  
 Truck Traffic (%): 8  
 Single Axle (%): 70  
 Combination (%): 30

**DEFINED EQUIVALENCY FACTORS:**

Automobiles Flexible: 0.003  
 Automobiles Rigid: 0.003  
 Single Unit Flexible: 0.249  
 Single Unit Rigid: 0.285  
 Combination Flexible: 1.087  
 Combination Rigid: 1.692

**CALCULATIONS:**

**ADT at Beginning of Design Life**  
 ADT: 1432

**ADT at End of Design Life**  
 ADT: 2128

**ADT at Midpoint of Design Life**  
 ADT: 1780

**Breakdown of Vehicles Multiplied by Equivalency Factors for Flexible Pavement**

Automobiles: 5  
 Single Unit: 25  
 Combination: 47

**Breakdown of Vehicles Multiplied by Equivalency Factors for Rigid Pavement**

Automobiles: 5  
 Single Unit: 29  
 Combination: 73

**Flexible Pavement ESAL's**

ESAL's: 337260

**Rigid Pavement ESAL's**

ESAL's: 468660

# **APPENDIX C**



## **Construction Drawings**



# GRJM 21.5-G.95 CULVERT REPLACEMENT NOVEMBER, 2020

- 1 ——— Cover Sheet
- 2 ——— Standard Abbreviations, Legend and Symbols
- 3 ——— Summary of Approximate Quantities
- 4 ——— Project Control Map
- 5 ——— Demolition                   Sta 0+00 — 1+15
- 6 ——— Roadway Construction   Sta 10+00 — 10+80
- 7 ——— S.U.E. General Notes
- 8 ——— Plan & Profile             Sta 0+00 — 1+15
- 9 ——— Engineering Geology     Sta 10+00 — 10+80
- 10 ——— Corrugated HDPE Pipe Details
- 11 ——— Headwalls and Wingwalls
- 12 ——— M-601-10 Headwalls
- 13 ——— M-601-20 Wingwalls (1 of 2)
- 14 ——— M-601-20 Wingwalls (2 of 2)

VICINITY MAP

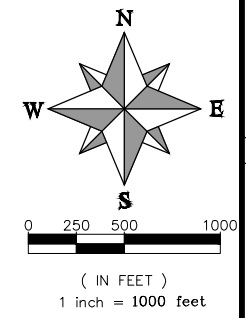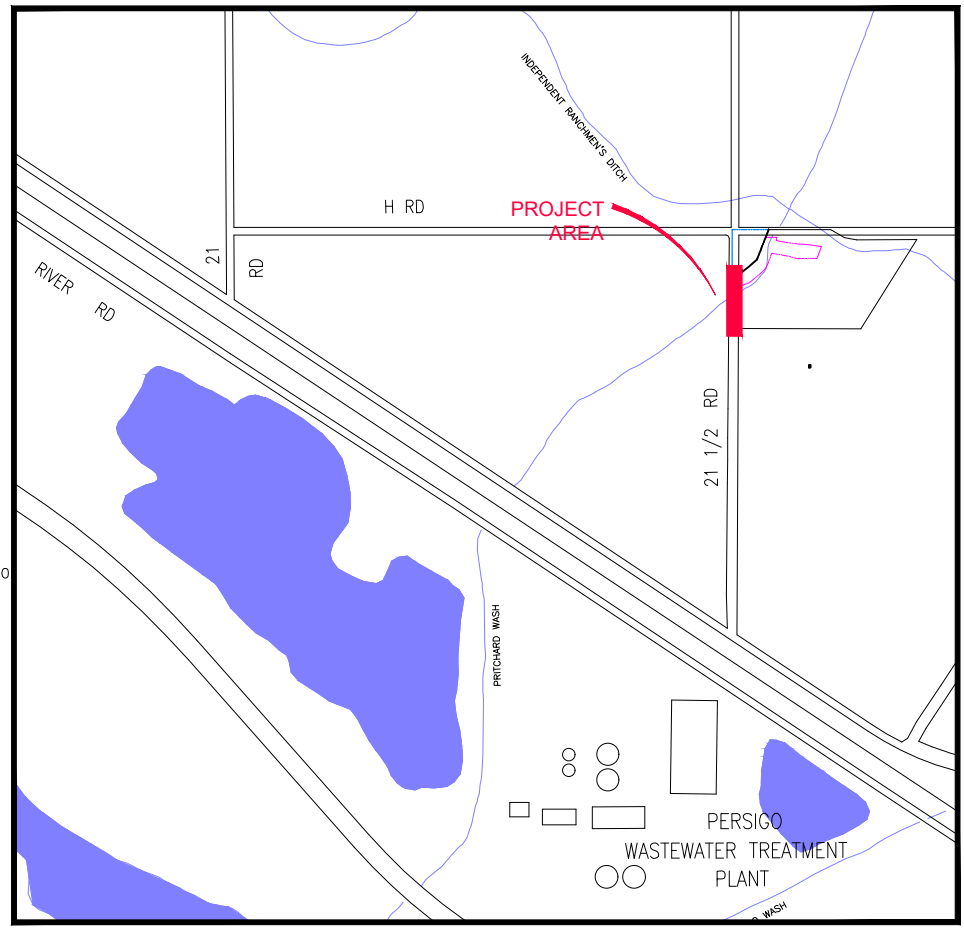

UTILITIES AND AGENCIES								
AGENCY	NAME	POSITION	ROLE	MAILING ADDRESS	STREET ADDRESS	CITY, STATE	VOICE-WK	FAX
CITY OF GRAND JCT.	KIRSTEN ARMBRUSTER	PROJECT ENGINEER	PROJECT ENGINEER	333 WEST AVE BLDG C	333 WEST AVE BLDG C	GRAND JCT., CO 81501	(970) 244-1421	(970) 256-4022
CITY OF GRAND JCT.	LEE COOPER	PROJECT ENGINEER	SANITARY SEWER	333 WEST AVE BLDG C	333 WEST AVE BLDG C	GRAND JCT., CO 81501	(970) 256-4155	(970) 256-4022
GRAND VALLEY IRRIGATION CO.	PHIL BERTRAND	MANAGER	IRRIGATION	688 26 RD	688 26 RD	GRAND JCT., CO 81506	(970) 242-2762	
CHARTER	ED PACHECO	CONSTRUCTION COORDINATOR	CABLE	315 MOUNTAIN VIEW ST	315 MOUNTAIN VIEW ST	GRAND JCT., CO 81503	(970) 986-1195	
CENTURYLINK	CHRIS JOHNSON	ENGINEER	TELEPHONE	2524 BLICHMANN AVE	2524 BLICHMANN AVE	GRAND JCT., CO 81504	(970) 244-4311	(970) 244-4311
UTE WATER	DAVE PRISKE	SUPERVISOR	WATER	PO BOX 460	2190 H ¼ RD	GRAND JCT., CO 81502	(970) 242-7491	
GRAND VALLEY POWER	PERRY RUPP	SERVICE PLANNER	ELECTRIC	PO BOX 190	845 22 RD	GRAND JCT., CO 81505	(970) 242-0040	
XCEL	BRENDA BOES	PLANNER	ELECTRIC	2538 BLICHMANN AVE	2538 BLICHMANN AVE	GRAND JCT., CO 81506	(970) 244-2698	
XCEL	BRENDA BOES	PLANNER	GAS	2538 BLICHMANN AVE	2538 BLICHMANN AVE	GRAND JCT., CO 81506	(970) 244-2698	
UNITED PRIVATE NETWORK	TERRI KING		FIBER OPTIC	123 N 7TH ST, STE. 100	123 N 7TH ST, STE. 100	GRAND JCT., CO 81501	(720) 324-9703	



*Public Works  
Engineering Division*



Know what's below.  
Call before you dig.

DRAWING STATUS:	
○ PROGRESS	● FINAL CONSTRUCTION DRAWINGS
○ ASBUILT	
DESIGNED BY:	
KIRSTEN ARMBRUSTER	2020
REVIEWED BY:	
TRENT C. PRALL, PUBLIC WORKS DIRECTOR	201X
AUTHORIZED FOR CONSTRUCTION	
TRENT C. PRALL, PUBLIC WORKS DIRECTOR	201X
ACCEPTED AS CONSTRUCTED	
LEE COOPER-ERIC MOCKO-JEROD TIMOTHY, PROJECT ENGINEER	

N:\Landro2019 GRJM 21.5-G.95 Culvert Repl\dwg\vert\_4-27-20.dwg, 1 Title, 1/16/2020 3:54:07 PM

NOTE: NOTIFY AFFECTED UTILITY VENDOR 48 HOURS PRIOR TO EXCAVATIONS THAT WILL EXPOSE UTILITY LINES. THE COVER SHEET WILL HAVE A LISTING OF UTILITY VENDORS AND TELEPHONE NUMBERS.	
DESCRIPTION	DATE
REVISION Δ XXX	201X
REVISION Δ XXX	201X
REVISION Δ XXX	201X
REVISION Δ XXX	201X

GRJM 21.5-G.95 CULVERT REPLACEMENT NOVEMBER, 2020

**ABBREVIATIONS**

AASHTO	AMERICAN ASSOCIATION OF STATE HIGHWAY & TRANSPORTATION OFFICIALS
ABC	AGGREGATE BASE COURSE
AC	ASBESTOS CEMENT
AP	ANGLE POINT
ASB	ANCHORED STRAW BALES
ASP	ALUMINIZED STEEL PIPE
ASTM	AMERICAN SOCIETY FOR TESTING MATERIALS
AWWA	AMERICAN WATER WORKS ASSOCIATION
BC	BACK OF CURB
BF	BUTTERFLY VALVE
BOW	BACK OF WALK
BCR	BEGIN CURB RETURN
BOT	BOTTOM
BSWMP	BETTER STORM WATER MANAGEMENT PRACTICES
CH	CHORD
CAP	CORRUGATED ALUMINUM PIPE
CDOT	COLORADO DEPARTMENT OF TRANSPORTATION
CI	CAST IRON
C,G,& SW	CURB, GUTTER & SIDEWALK
C	CENTER LINE
CL	CLEAR
CMP	CORRUGATED METAL PIPE
CO	CLEAN OUT
COMB	COMBINATION (AS IN STORM SEWER AND SANITARY SEWER)
CONC	CONCRETE
CSM	CITY SURVEY MONUMENT
CSP	CORRUGATED STEEL PIPE
CU	COPPER
DI	DUCTILE IRON
DWY	DRIVEWAY
E	ELECTRIC
ECR	END CURB RETURN
EG	EDGE OF GUTTER
EL	ELEVATION
EP	EDGE OF PAVEMENT
EX	EXISTING
FB	FULL BODY
FC	FACE OF CURB
FG	FINISHED GRADE
F	FLOW LINE
FL	FLANGE
FM	FORCE MAIN
FO	FIBER OPTICS
FS	FAR SIDE
FTG	FOOTING
G	GAS
GB	GRADE BREAK
GM	GAS METER
GV	GATE VALVE
HBP	HOT BITUMINOUS PAVEMENT
HDPE	HIGH DENSITY POLYETHYLENE
INV	INVERT
IRR	IRRIGATION
L	LENGTH OF ARC
LC	LONG CHORD
LF	LINEAR FEET
LL	LONG ARC
LS	SHORT ARC
LT	LEFT
MB	MAILBOX
MCSM	MESA COUNTY SURVEY MONUMENT
MH	MANHOLE
MJ	MECHANICAL JOINT
MW	MILL WRAP
N/A	NOT APPLICABLE
NIC	NOT IN CONTRACT
NOP	NO ONE PERSON
NRCP	NON-REINFORCED CONCRETE PIPE
NS	NEAR SIDE
NTS	NOT TO SCALE
OHP	OVERHEAD POWER
OHT	OVERHEAD TELEPHONE
PC	POINT OF CURVATURE
PCC	POINT OF COMPOUND CURVATURE
PE	POLYETHYLENE
PERF	PERFORATED
PI	POINT OF INTERSECTION
PIP	PLASTIC IRRIGATION PIPE
POC	POINT ON CURVE
POT	POINT ON TANGENT
PR	PROPOSED
PRC	POINT OF REVERSE CURVATURE
PT	POINT OF TANGENCY
PVC	POLYVINYL CHLORIDE
R	RADIUS
RCP	REINFORCED CONCRETE PIPE
REQ'D	REQUIRED
RG	RESTRAINED GLANDS
RL	LONG RADIUS
ROW	RIGHT OF WAY
RP	RADIUS POINT
RR	RAIL ROAD
RS	SHORT RADIUS
RT	RIGHT
S	SLOPE
SAN	SANITARY
SC	SHORT CHORD
SCD	STANDARD CONTRACT DOCUMENTS
SCH	SCHEDULE
SF	SILT FENCE
SL	SECTION LINE
SSRB	STANDARD SPECIFICATIONS FOR ROAD & BRIDGE CONSTRUCTION
SSUU	STANDARD SPECIFICATIONS FOR CONSTRUCTION OF UNDERGROUND UTILITIES
STA	STATION
STL	STEEL
STM	STORM
T	TELEPHONE
TAN	LENGTH OF TANGENT
TC	TOP OF CURB
TH	TEST HOLE
TV	TELEVISION
(TYP)	TYPICAL
UU	UNDERGROUND UTILITIES
VC	VERTICAL CURVE
VCP	VITRIFIED CLAY PIPE
VPC	VERTICAL POINT OF CURVATURE
VPCC	VERTICAL POINT OF COMPOUND CURVATURE
VPRC	VERTICAL POINT OF REVERSE CURVATURE
VPI	VERTICAL POINT OF INTERSECTION
VPT	VERTICAL POINT OF TANGENCY
W	WATER
Δ	DELTA ANGLE



**LEGEND**

BSWMP	BSWMP
DRAINAGE BASIN BOUNDARY	
BSWMP	BSWMP
ANCHORED STRAW BALES	
BSWMP	BSWMP
SILT FENCE	
BUILDING	
CONCRETE CURB AND GUTTER	
CONCRETE CURB, GUTTER, & SIDEWALK	
CONCRETE DITCH	
CONCRETE SIDEWALK	
CULVERT	
EARTH DITCH	
EDGE OF GRAVEL	
EDGE OF PAVEMENT	
FENCE (BARBED WIRE)	
FENCE (CHAIN LINK)	
FENCE (IRON)	
FENCE (PLASTIC)	
FENCE (TEMPORARY CONSTRUCTION)	
FENCE (WOOD)	
FENCE (WOVEN WIRE)	
GUARD RAIL	
HATCHING: INDICATES ASPHALT REMOVAL	
HATCHING: INDICATES CONCRETE REMOVAL	
HATCHING: INDICATES STAGING AREA	
LINE (CENTER OF IMPROVEMENTS)	
LINE (CITY LIMITS)	
LINE (CONTROL)	
LINE (EASEMENT)	
LINE (MONUMENT/SECTION)	
LINE (PROPERTY)	
LINE (RIGHT OF WAY)	
MATCH LINE	
PIPE (IRRIGATION)	
PIPE (SIPHON)	

PROPOSED CONCRETE CURB AND GUTTER	
PROPOSED CONCRETE CURB, GUTTER, & SIDEWALK	
PROPOSED CONCRETE SIDEWALK	
PROPOSED "WET" UTILITIES (CONSTRUCTION NOTE WILL INDICATE TYPE, SIZE, AND MATERIAL OF NEW MAIN)	
ALL PROPOSED FEATURES NOT SHOWN IN LEGEND WILL BE SHOWN THE SAME AS THEIR EXISTING COUNTERPART, BUT INDICATED BY BOLDER LINETYPE	
RAIL ROAD	
RETAINING WALL	
STRIPING (CONTINUOUS WHITE)	
STRIPING (DASHED WHITE)	
STRIPING (CONTINUOUS YELLOW)	
STRIPING (DASHED YELLOW)	
TOP OF SLOPE	
CONTOUR LINES (SHOWN BETWEEN TOP & TOE)	
TOE OF SLOPE	
TRAFFIC DETECTOR LOOP	
UTILITY LINE (ABANDON) (THIS CASE A WATER LINE)	
UTILITY LINE (CABLE TV)	
UTILITY LINE (ELECTRIC)	
UTILITY LINE (GAS)	
UTILITY LINE (HIGH VOLTAGE OVERHEAD POWER)	
UTILITY LINE (OVERHEAD POWER)	
UTILITY LINE (OVERHEAD TELEPHONE)	
UTILITY LINE (SANITARY SEWER)	
UTILITY LINE (SANITARY SEWER FORCE MAIN)	
UTILITY LINE (SANITARY SEWER SERVICE)	
UTILITY LINE (STORM SEWER)	
UTILITY LINE (STORM SEWER, PERFORATED)	
UTILITY LINE (STORM/SANITARY SEWER SEWER COMBINATION)	
UTILITY LINE (TELEPHONE)	
UTILITY LINE (WATER)	

**SYMBOLS**

BENCH MARK	
CATCH BASIN	
CLEAN OUT	
CURB STOP	
FIRE HYDRANT	
GUY WIRE ANCHOR	
HEADGATE	
IRRIGATION PUMP	
MAILBOX	
MANHOLE (ELECTRIC)	
MANHOLE (GAS)	
MANHOLE (SANITARY/STORM)	
MANHOLE (TELEPHONE)	
MANHOLE (TV)	
MANHOLE (WATER)	
METER (GAS)	
METER (WATER)	
PEDESTAL (TELEPHONE)	
PEDESTAL (TV)	
PROPERTY PIN	
PULL BOX	
REDUCER FITTING	
SIGN OR POST (SIGN TYPE NOTED)	
SPRINKLER HEAD	
STREET LIGHT	
SURVEY MONUMENT (CITY)	
SURVEY MONUMENT (TYPE NOTED)	
TEST HOLE	
TRAFFIC PAINT MARKING	
TRAFFIC SIGNAL POLE AND MAST ARM	
UTILITY POLE	
VALVE (GAS)	
VALVE (IRRIGATION)	
VALVE (WATER)	
VEGETATION (HEDGE OR BUSH)	
VEGETATION (TREE STUMP)	
VEGETATION (TREE) (CALIPER SIZE NOTED)	
WATER HYDRANT	
WEIR	
YARD LIGHT	



N:\landro2019 GRJM 21 5-G-95-Culvert\Repl\dwg\cvt\_4-27-20.dwg, 2 Legend, 1/14/2020 3:54:10 PM

REVISION Δ	DESCRIPTION	DATE	DRAWN BY	JCS	DATE	4-02
REVISION Δ			DESIGNED BY		DATE	
REVISION Δ			CHECKED BY		DATE	
REVISION Δ			APPROVED BY		DATE	

SCALES: PLAN & PROFILE

HORIZONTAL: 1" = \_\_\_\_\_

VERTICAL: 1" = \_\_\_\_\_



**PUBLIC WORKS ENGINEERING DIVISION**

**CITY OF GRAND JUNCTION STANDARD ABBREVIATIONS, LEGEND, AND SYMBOLS**

### Bid Schedule: GRJM-21.5-G.95 Bridge Replacement

Item No.	CDOT, City Ref.	Description	Quantity	Units
1	108.2	60" Culvert (HDPE)	100.	Lin. Ft.
2	201-00000	Clearing and Grubbing	450.	Sq. Yd.
3	202-00220	Removal of Asphalt Mat	122.	Sq. Yd.
4	202	Removal of Existing Pipe (Size & type as shown on plans)	90.	Lin. Ft.
5	203-00000	Unclassified Excavation (Complete in Place)		Lump Sum
6	206-00065	Structural Backfill Material (Flow-fill, Complete in Place)	200.	Cubic Yd.
7	206-00100	Structural Backfill Material (Class 1, Complete in Place)	1,034.	Cubic Yd.
8	208-00070	Vehicle Track Pad	2.	Each
9	208-00011	Erosion Bales (Weed Free)	4.	Each
10	208-00045	Concrete Washout Structure	1.	Each
11	211-03005	Dewatering (To be used for Pritchard Wash Bypass if needed)		Lump Sum
12	212-00007	Seeding (Native) (Hydraulic)	450.	Sq. Yd.
13	304	Aggregate Base Course (Class 6) complete in place	56.	Cubic Yd.
14	403-34752	Hot Mix Asphalt (Patching) (Grading SX) (75)(PG 64-22) (4" Thick)	31.	Ton
15	420-00300	Geotextile (Mirafi 500x)	220.	Sq. Yd.
16	601	Concrete Wall (Class D) per M and S Standard M-601-20 (Wall Design Height 3' to 7' per plan). (Includes associated headwall, toe walls and toe wall attached to walls beneath 21.5 Road.) Work shall include Reinforcing Steel (Epoxy Coated), Structural Concrete Coating (Exterior of wall), and any necessary appurtenances to complete work.	15.	Cubic Yd.

17	606	Guardrail Type 3 (31 IN MGS). (Includes Installation)	37.5	Lin. Ft.
18	606	Transition Type 3J (31 IN MGS), R = 8'-6", 105° angle. (Includes Installation)	1.	Each
19	606	Transition Type 3J (31 IN MGS), R = 8'-6", 75° angle. (Includes Installation)	1.	Each
20	606	End Anchorage Type 3K (Includes Installation)	1.	Each
21	620-00020	Sanitary Facility	1.	Each
22	625-00000	Construction Surveying		Lump Sum
23	626-00000	Mobilization		Lump Sum
24	630	Traffic Control (Complete in Place, Road Closure)		Lump Sum

EARTHWORKS	
CUT	861 Cubic Yd.
FILL	1034 Cubic Yd.



N:\landro2019 GRJM 21.5-G.95 Culvert Repl\dwg\cvt\_4-27-20.dwg, 3 Quant, 11/4/2020 3:54:14 PM

REVISION	DESCRIPTION	DATE	DRAWN BY	KSO	DATE	2020	SCALES: PLAN & PROFILE
REVISION	△		DESIGNED BY	KA	DATE	2020	
REVISION	△		CHECKED BY	XXX	DATE	201X	
REVISION	△		APPROVED BY	XXX	DATE	201X	




**PUBLIC WORKS  
ENGINEERING DIVISION**

**GRJM-21.5-G.95 CULVERT REPLACEMENT  
SUMMARY OF APPROXIMATE QUANTITIES**

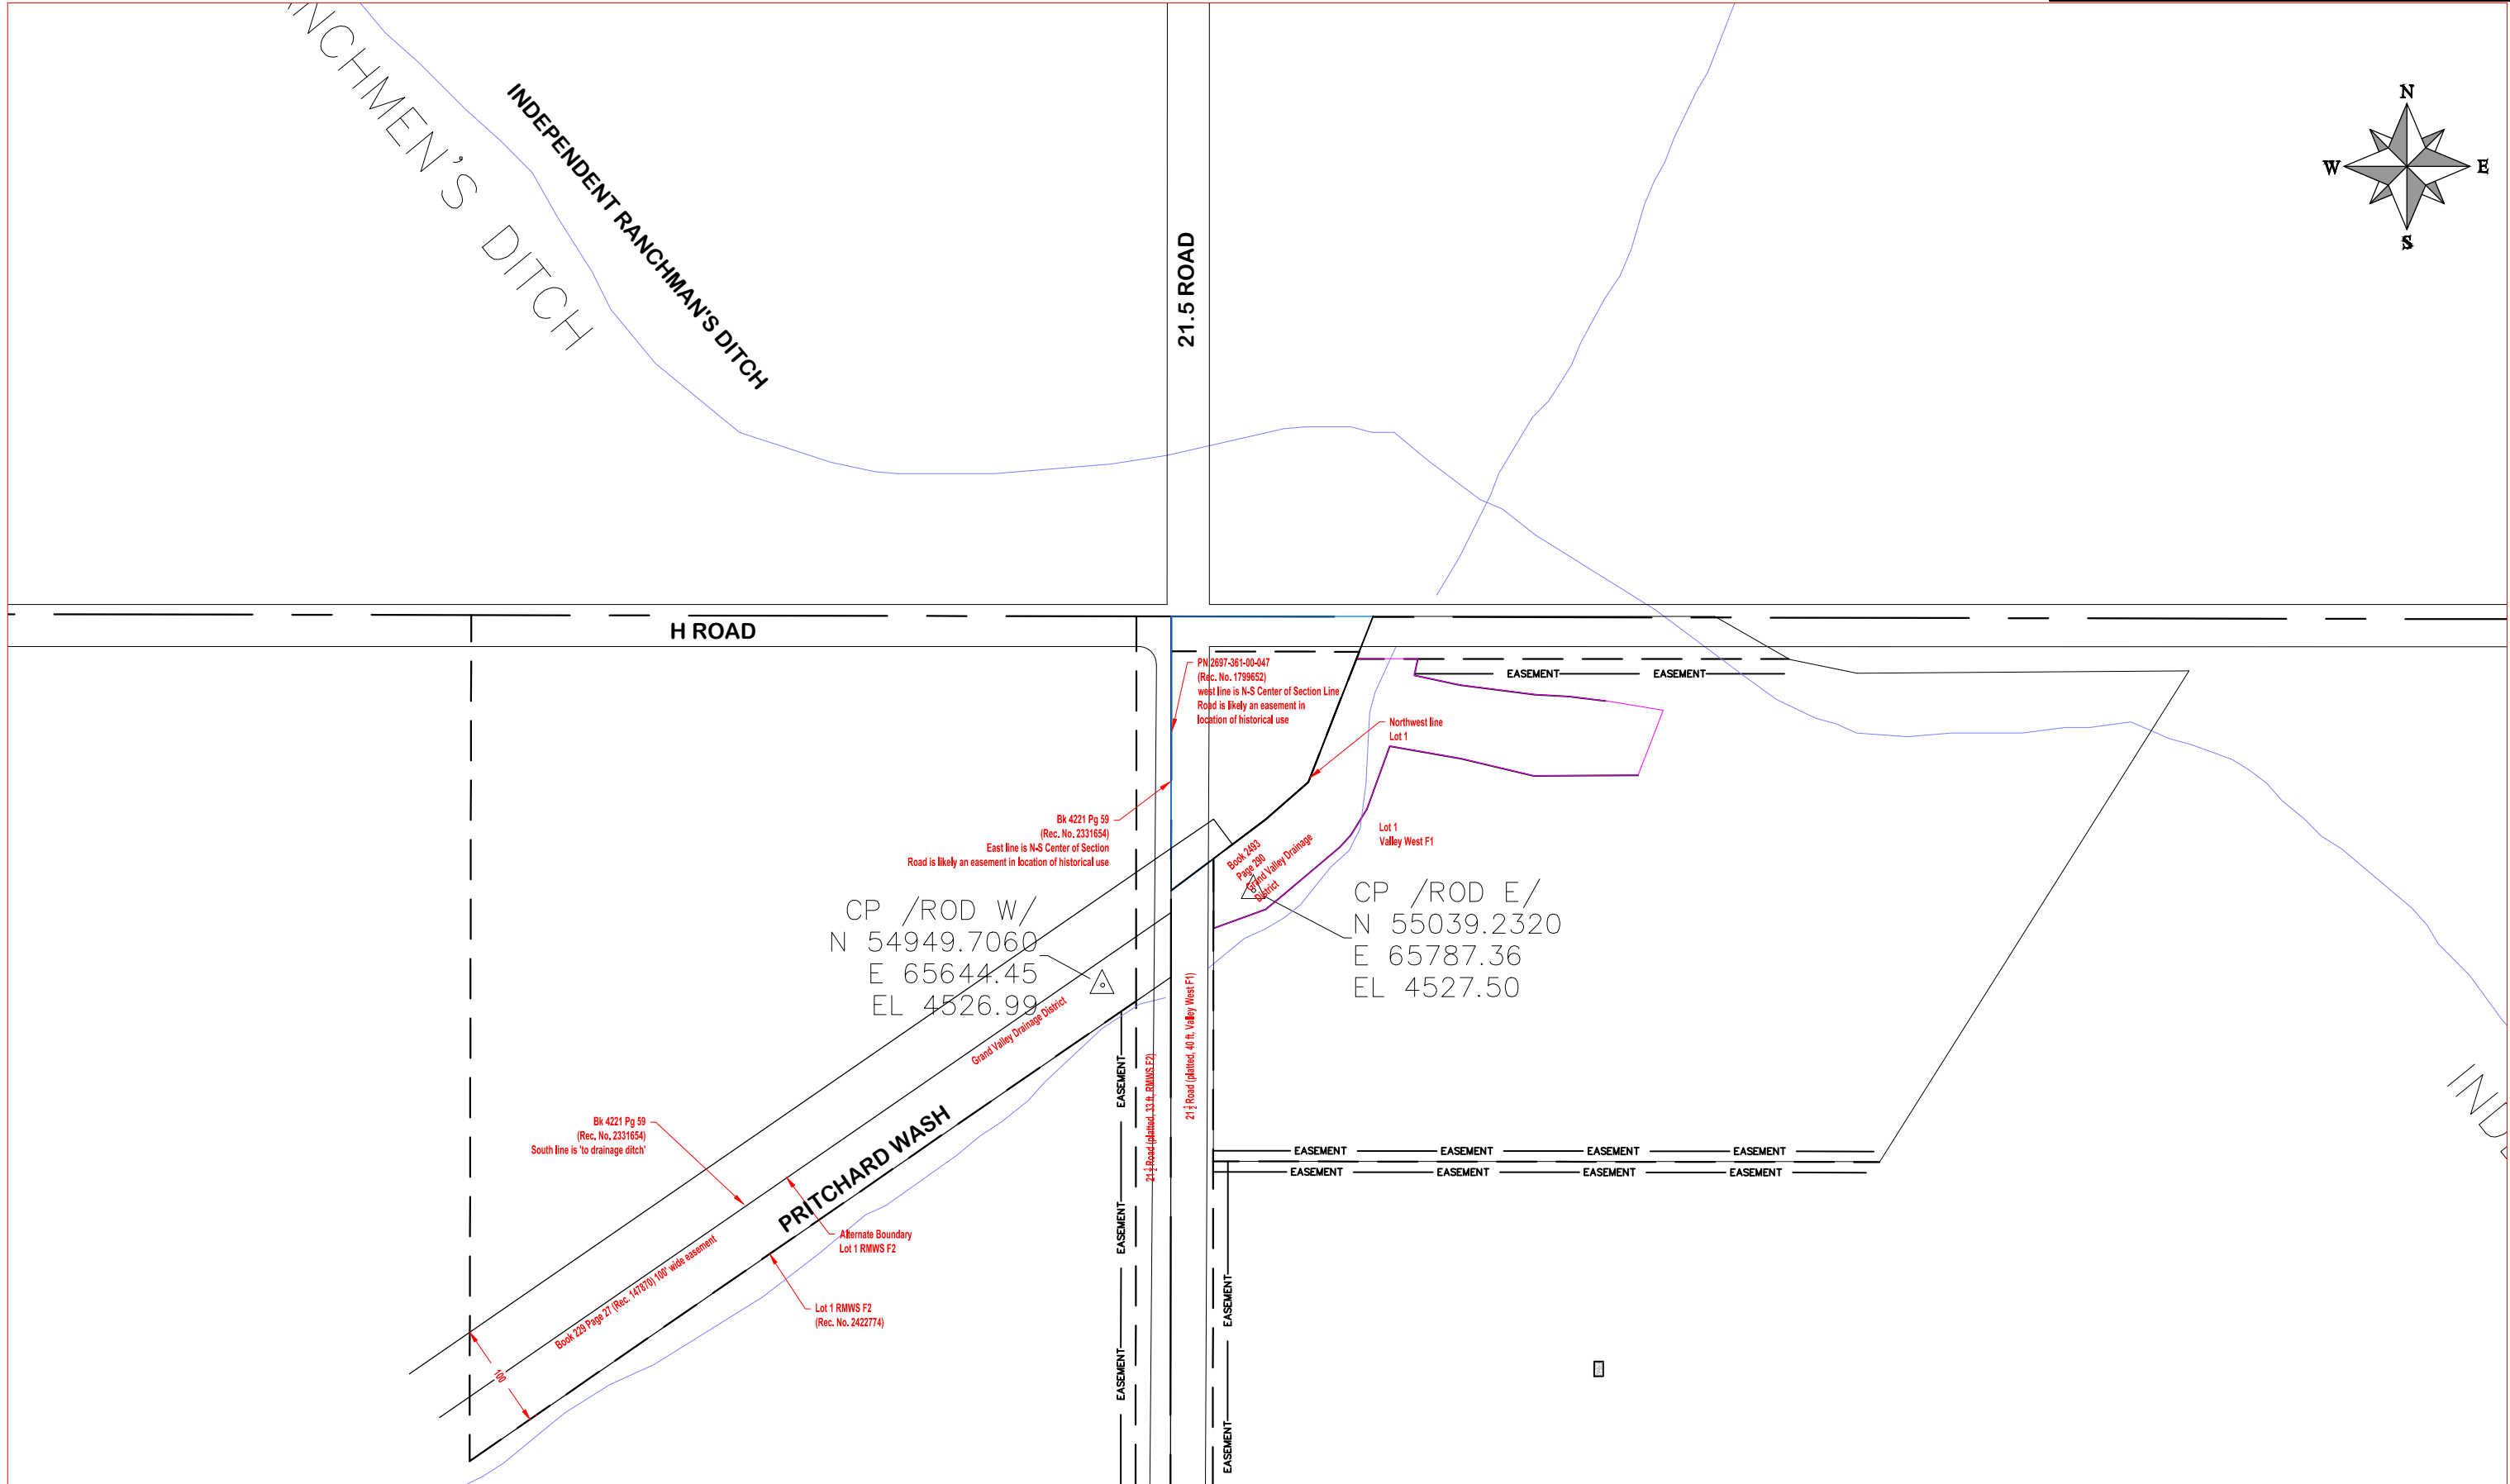

N:\landro2019 GRJM 21.5-G.95 Culvert Repl\dwg\cvt\_4-27-20.dwg, 4 Project Control Map, 11/4/2020 3:54:21 PM

REVISION	DESCRIPTION	DATE	DRAWN BY	KSO	DATE	2020
△			DESIGNED BY	KA	DATE	2020
△			CHECKED BY	XXX	DATE	201X
△			APPROVED BY	XXX	DATE	201X



**PUBLIC WORKS  
ENGINEERING DIVISION**


**GRJM-21.5-G.95 CULVERT REPLACEMENT  
PROJECT CONTROL MAP**

CONSTRUCTION NOTES


- 1 202 - REMOVAL OF ASPHALT MAT. CUT AND REMOVE ASPHALT AS SHOWN. (INDICATED BY DOT HATCH PATTERN)
- 3 202 - REMOVAL OF CONCRETE. SAW CUT AND REMOVE CONCRETE AS SHOWN. (INDICATED BY CROSS HATCH PATTERN) INCLUDES BUT NOT LIMITED TO CURB, GUTTER, SIDEWALK, DRIVEWAY, SLABS, V-PAN, CURB RAMPS, INTERSECTION CORNERS, APRONS, AND LANDSCAPE BORDERS.
- 26 202 - REMOVAL OF EXISTING CULVERT. (SIZE AND TYPE AS SHOWN ON PLAN)
- 103 210 - REMOVE AND RESET SIGN - BY CITY
- 828 828 - PROTECT EXISTING UTILITIES IN PLACE. SEE TABLE BELOW FOR MORE INFORMATION ABOUT EACH UTILITY. ALSO SEE PROJECT SPECIFICATIONS - UTILITY SECTION FOR COORDINATION WITH UTILITY OWNERS.

PROTECT UTILITIES

	UTILITY	OWNER
(A)	PROTECT 2" GAS LINE	XCEL ENERGY
(B)	PROTECT 6" ELECTRIC LINE	XCEL ENERGY
(C)	PROTECT 6" ELECTRIC LINE	GRAND VALLEY POWER
(D)	PROTECT OVERHEAD POWER	GRAND VALLEY POWER
(E)	PROTECT OVERHEAD CABLE	CHARTER?
(F)	PROTECT 2 TELEPHONE LINES	CENTURY LINK
(G)	PROTECT OVERHEAD FIBER OPTIC	UNITED PRIVATE NETWORK
(H)	PROTECT 8" WATER LINE	UTE WATER
(I)	PROTECT 8" SANITARY SEWER	CITY OF GRAND JUNCTION
(J)	PROTECT 2" FIBER OPTIC	CENTURY LINK

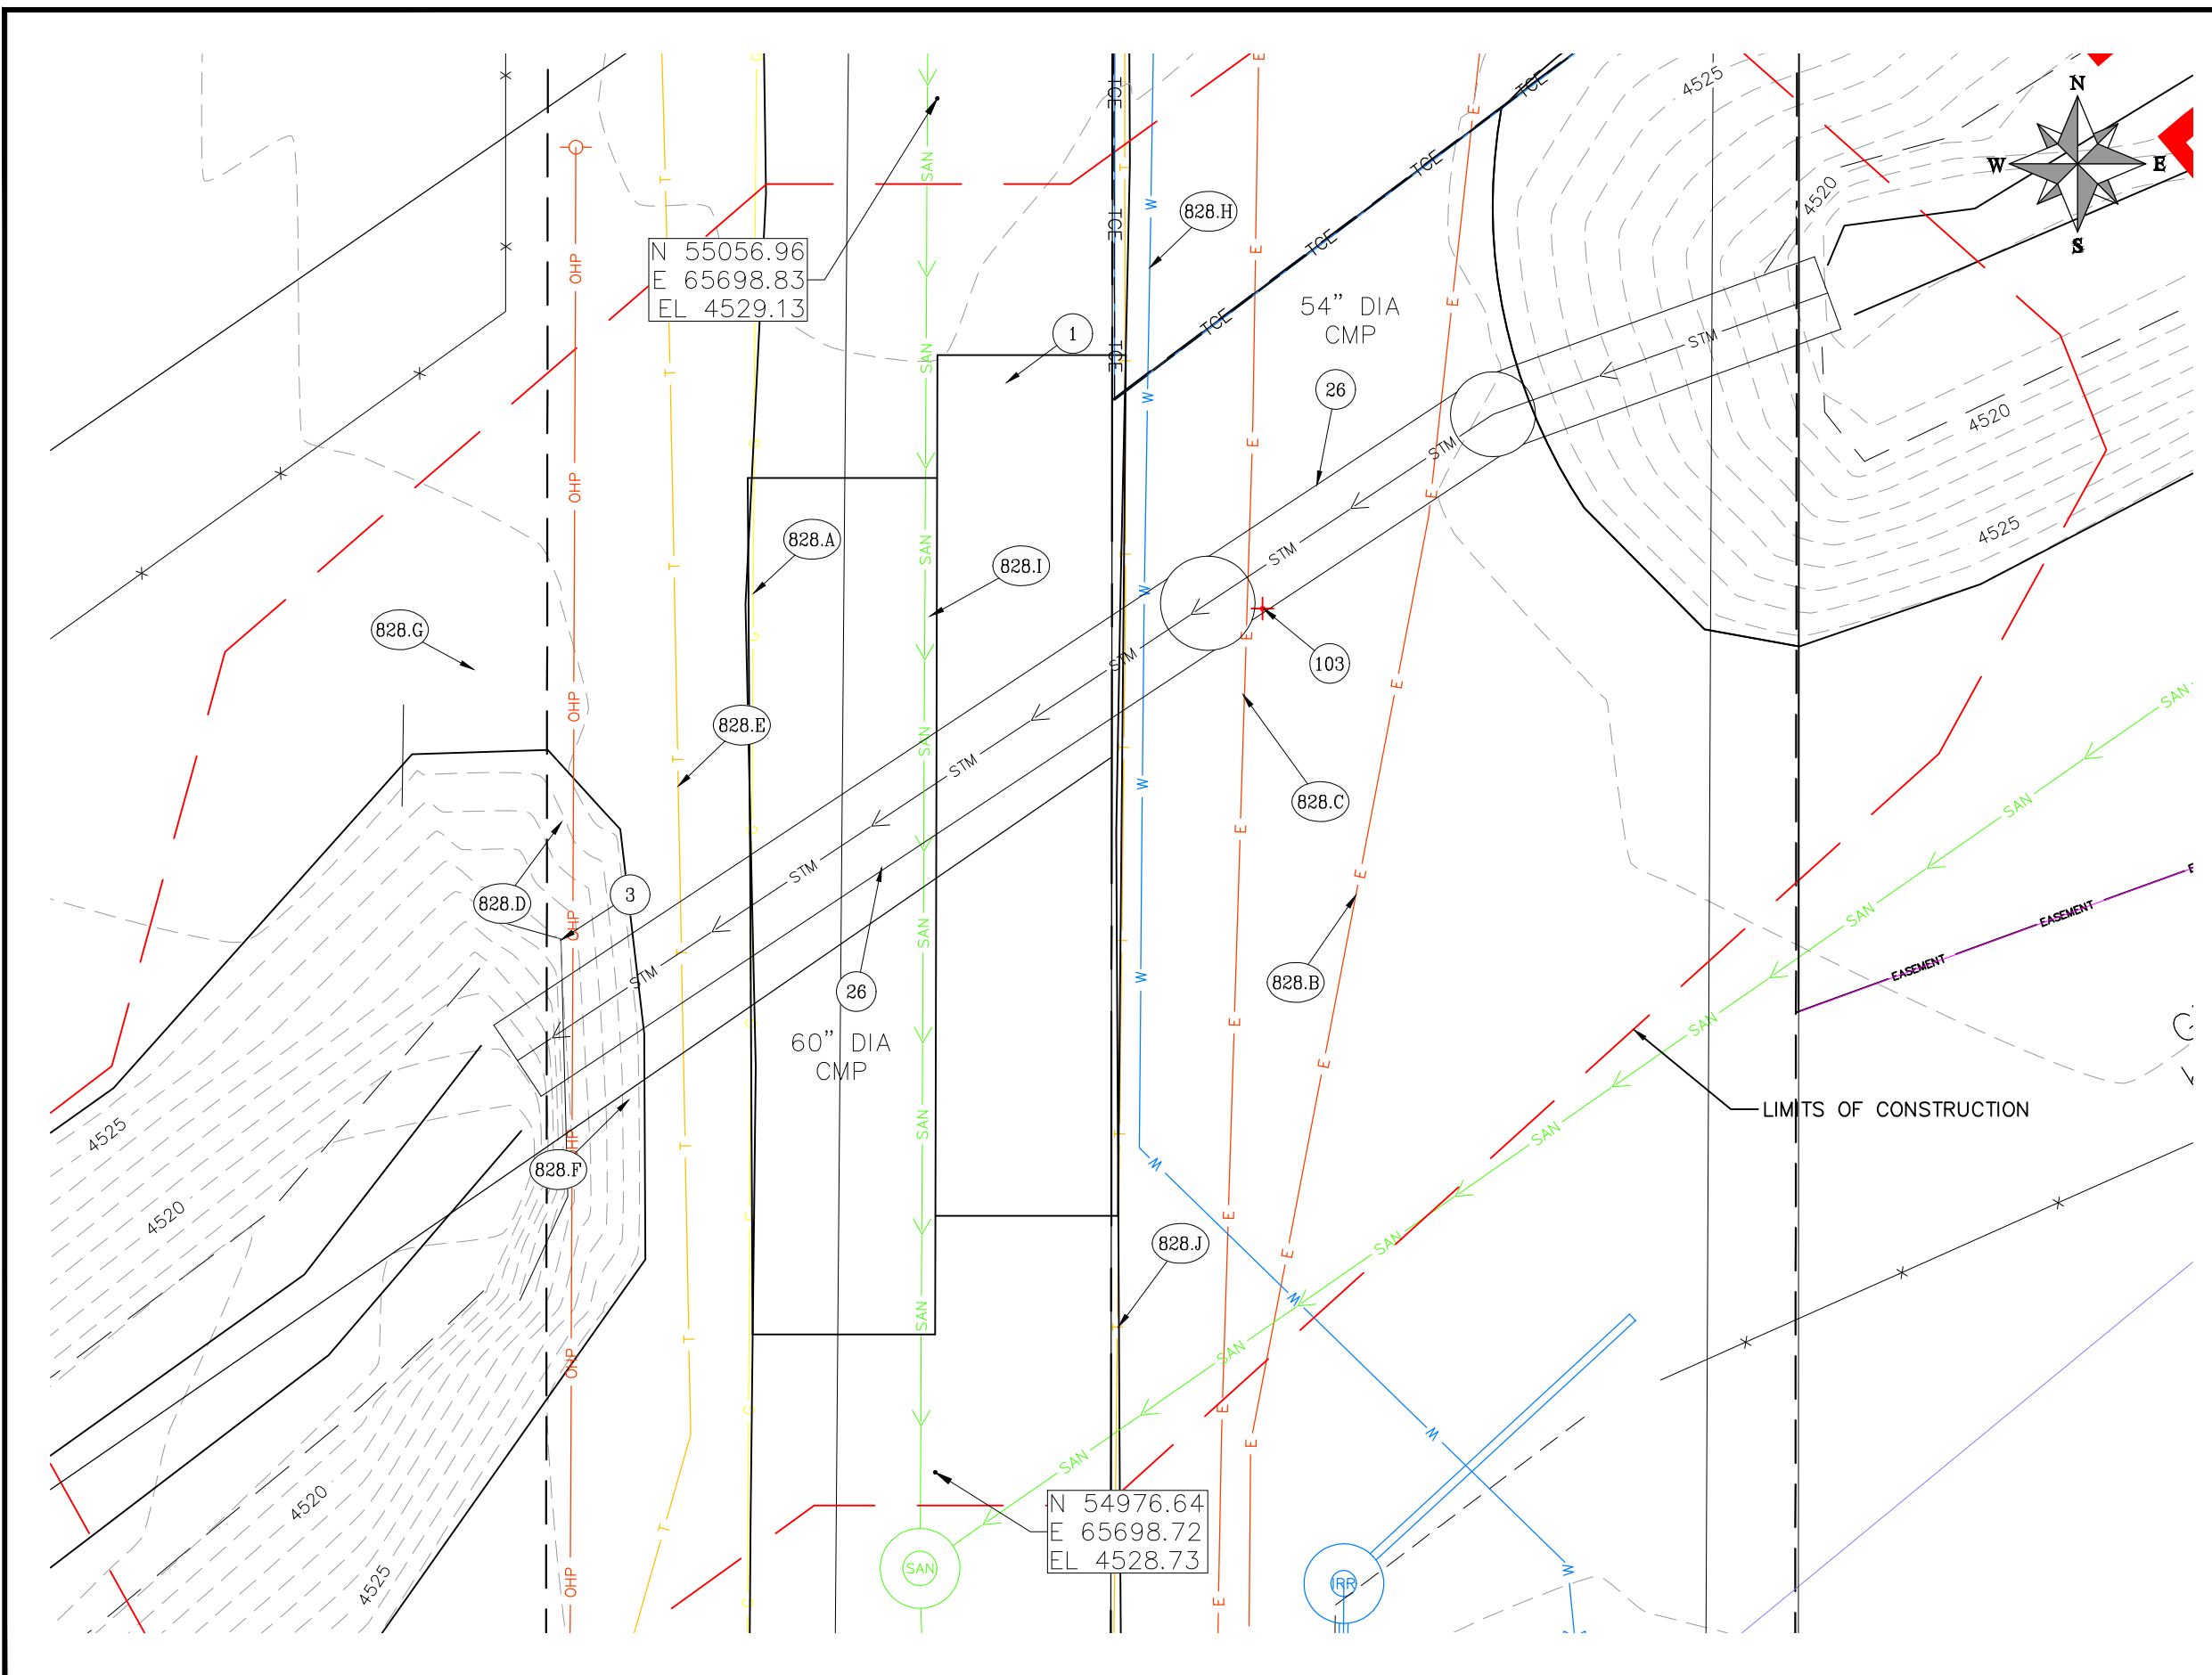

REVISION	DESCRIPTION	DATE	DRAWN BY	DATE
△			KSO	2020
△			KA	2020
△			XXX	201X
△			XXX	201X






PUBLIC WORKS  
ENGINEERING DIVISION

GRJM-21.5-G.95 CULVERT REPLACEMENT  
DEMOLITION PLAN  
STA 0+00 TO STA 1+15

N:\Landro\2019 GRJM 21.5-G.95 Culvert Replacement\4-27-20.dwg, 5 Demo, 11/4/2020 3:54:25 PM

- (667) 304 - AGGREGATE BASE COURSE (CLASS 6) (COMPLETE IN PLACE)
- (682) 401.08 - HOT BITUMINOUS PAVEMENT (PATCHING) (4" THICK) (GRADING SX, PG 64-22, GYR.=75) (TWO 2" LIFT)

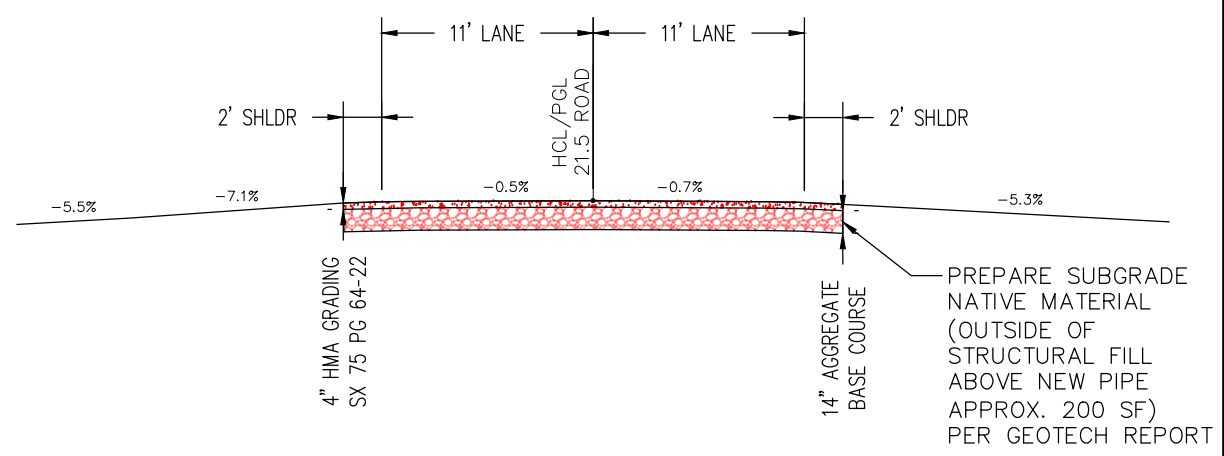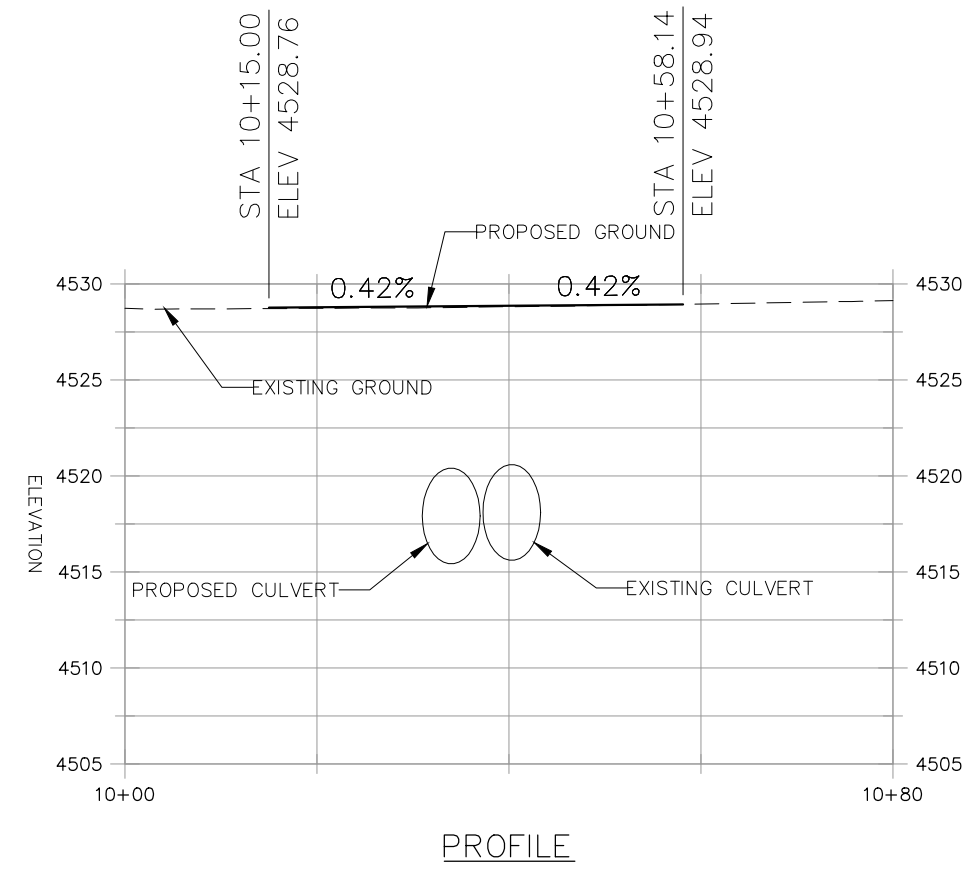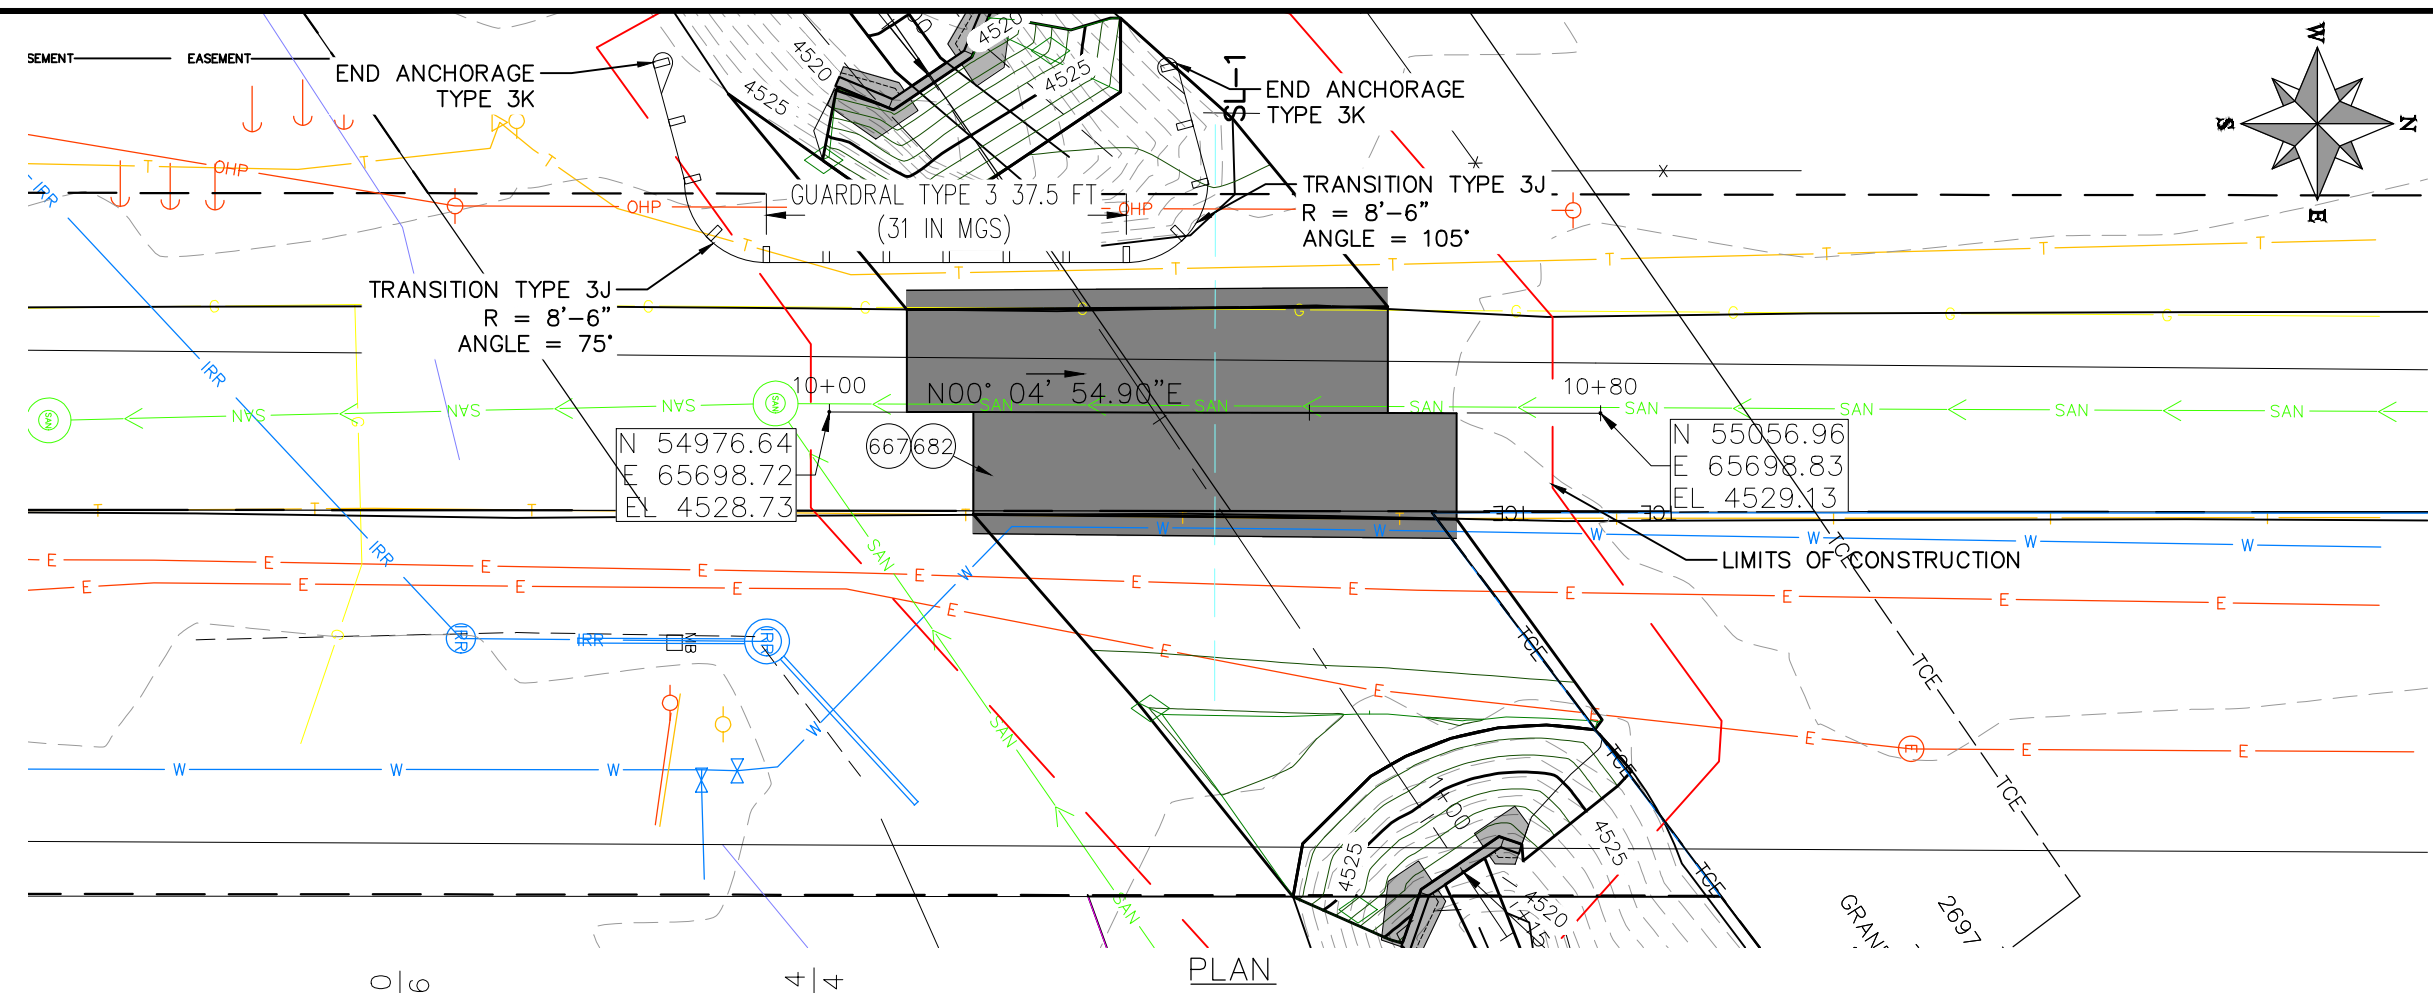

N:\landro2019 GRJM 21.5-G.95 Culvert\Repl\dwg\cvt\_4-27-20.dwg, 6 Roadway Construction, 11/14/2020 3:54:30 PM

REVISION	DESCRIPTION	DATE	DRAWN BY	DATE
△			KSO	2020
△			KA	2020
△			XXX	201X
△			XXX	201X

SCALES: PLAN & PROFILE	
HORIZONTAL: 1" = 20'	0 5 10 20
VERTICAL: 1" = 10'	0 2.5 5 10




**PUBLIC WORKS  
ENGINEERING DIVISION**

**GRJM-21.5-G.95 CULVERT REPLACEMENT  
ROADWAY CONSTRUCTION  
STA 10+00 TO STA 10+80**

GENERAL NOTES:

- 1 PURPOSE: TO SEARCH, INTERPRET, AND DEPICT SPECIFIC EXISTING UNDERGROUND UTILITIES AS PER THE SCOPE OF WORK FOR THE GRJM-21.5-G.95 CULVERT REPLACEMENT PROJECT.
- 2 THE SUBSURFACE UTILITIES SHOWN ON THE SUBSURFACE UTILITY INVESTIGATION WERE IDENTIFIED USING APPROPRIATE INDUSTRY STANDARD DETECTION METHODOLOGIES IN ACCORDANCE WITH THE AMERICAN SOCIETY OF CIVIL ENGINEERS (ASCE) STANDARD GUIDELINE FOR THE COLLECTION AND DEPICTION OF EXISTING SUBSURFACE UTILITY DATA. QUALITY LEVELS AND DEFINITIONS PER CI/ASCE STANDARD NO. 38.
- 3 QUALITY LEVEL "D" – QL-D – DEPICTED ACCORDING TO UTILITY RECORD INFORMATION AND IN-FIELD VISUAL INSPECTION. NO ELECTRONIC DESIGNATING INFORMATION WAS OBTAINED. UTILITIES WITH A QL-D LABEL ARE DEPICTED ON THE PLANS USING PROFESSIONAL JUDGMENT IN INTERPRETING THIRD-PARTY RECORDS OR OTHER INFORMATION.
- 4 QUALITY LEVEL "C" – QL-C – EXISTING UTILITY STRUCTURES HAVE BEEN FIELD LOCATED AND SURVEYED TO ASSIST IN THE DEPICTING OF THE UTILITIES SHOWN ON THE RECORDS. NO ELECTRONIC DESIGNATING INFORMATION WAS OBTAINED. UTILITIES WITH A QL-C LABEL ARE DEPICTED ON THE PLANS USING PROFESSIONAL JUDGMENT IN INTERPRETING AND CORRELATING THE SURVEYED UTILITY APPURTENANCES, WITH THIRD-PARTY RECORDS INFORMATION.
- 5 QUALITY LEVEL "B" – QL-B – INFORMATION WAS OBTAINED THROUGH THE APPLICATION OF APPROPRIATE SURFACE GEOPHYSICAL METHODS TO DETERMINE THE EXISTENCE AND APPROXIMATE HORIZONTAL POSITION OF THE SUBSURFACE UTILITIES. QL-B DATA SHOULD BE REPRODUCIBLE BY SURFACE GEOPHYSICS AT ANY POINT OF THEIR DEPICTION. ALL UTILITIES ARE QL-B UNLESS OTHERWISE NOTED. THEY ARE DEPICTED ON THE PLANS USING PROFESSIONAL JUDGMENT IN SELECTING AND INTERPRETING APPROPRIATE GEOPHYSICAL DATA, SURVEYING TO APPROPRIATE PROJECT ACCURACIES, AND USING JUDGMENT TO CORRELATE THIRD-PARTY RECORDS OR OTHER INFORMATION, IF AVAILABLE, TO THESE QL-B DEPICTIONS.
- 6 QUALITY LEVEL "A" – QL-A – OBTAIN PRECISE HORIZONTAL AND VERTICAL POSITION OF THE UTILITY LINE BY EXCAVATING A TEST HOLE. THE TEST HOLE SHALL BE DONE USING VACUUM EXCAVATION OR COMPARABLE NON-DESTRUCTIVE EQUIPMENT IN A MANNER AS TO CAUSE NO DAMAGE TO UTILITY LINE.
- 7 RELIANCE UPON SUBSURFACE UTILITY DATA FOR RISK MANAGEMENT PURPOSES DURING BIDDING DOES NOT RELIEVE THE EXCAVATOR OR UTILITY OWNER FROM FOLLOWING ALL APPLICABLE UTILITY DAMAGE PREVENTION STATUTES, POLICIES, AND/OR PROCEDURES DURING EXCAVATION.
- 8 IT IS IMPORTANT THAT THE CONTRACTOR INVESTIGATES AND UNDERSTANDS THE SCOPE OF WORK AND LIMITS OF THE UTILITY INVESTIGATIONS LEADING TO THESE UTILITY DEPICTIONS.
- 9 UTILITY SIZE AND TYPE ARE DETERMINED THROUGH AVAILABLE UTILITY OWNER INFORMATION OR FIELD OBSERVATIONS; UTILITIES LABELED AS UNKNOWN HAVE NO CORRELATED RECORDS OR VISIBLE APPURTENANCES TO DETERMINE FUNCTION OR TYPE.
- 10 UTILITY MAPPING WAS COMPLETED IN THE FIELD ON 11/14/2019. UTILITIES MAY HAVE BEEN CHANGED OR ADDED AFTER THIS DATE.
- 11 "END OF INFORMATION" (EOI) SIGNIFIES GEOPHYSICAL EQUIPMENT LOST THE SIGNAL OF THE TARGET UTILITY AND THE LINE WAS UNABLE TO BE DESIGNATED ANY FURTHER. LINES MAY CONTINUE ON OR MAY STOP. POSITIVE VERIFICATION BY EXCAVATION IS REQUIRED TO CONFIRM PRESENCE BEYOND END OF SIGNAL.
- 12 THE FOLLOWING EQUIPMENT WAS USED IN THE UTILITY INVESTIGATION: VM-810 METROTECH UTILITY LINE LOCATOR, TRIMBLE GPS SURVEY CONTROL AND/OR TOTAL STATION.
- 13 HORIZONTAL COORDINATE SYSTEM: PROJECT COORDINATES ARE BASED ON MESA COUNTY LOCAL COORDINATE SYSTEM, MCLS ZONE GVA.
- 14 VERTICAL DATUM: WGS 1984
- 15 SEE THE STANDARD ABBREVIATIONS, LEGENDS, AND SYMBOLS FOR UTILITY LINE LINE TYPE DEPICTIONS, UTILITY APPURTENANCES SYMBOLS, AND ABBREVIATIONS USED FOR THE SUBSURFACE UTILITY ENGINEERING PLAN.
- 16 THE FOLLOWING COMPANIES HAVE NOT SUPPLIED RECORDS AS OF 11/05/2020: NONE.
- 17 THE OWNERS WITHIN THE PROJECT LIMITS ARE LISTED IN THE TABLE ON THE COVER SHEET BUT MAY NOT BE LIMITED TO THOSE LISTED IN THE TABLE.


REVISION	DESCRIPTION	DATE	DRAWN BY	KSO	DATE	2020
REVISION	△		DESIGNED BY	KA	DATE	2020
REVISION	△		CHECKED BY	XXX	DATE	201X
REVISION	△		APPROVED BY	XXX	DATE	201X



**PUBLIC WORKS  
ENGINEERING DIVISION**

**GRJM-21.5-G.95 CULVERT REPLACEMENT  
S.U.E. GENERAL NOTES**

N:\Landproj\2019 GRJM 21.5-G.95 Culvert Repl\dwg\culvert\_4-27-20.dwg, 11/5/2020 8:32:08 AM

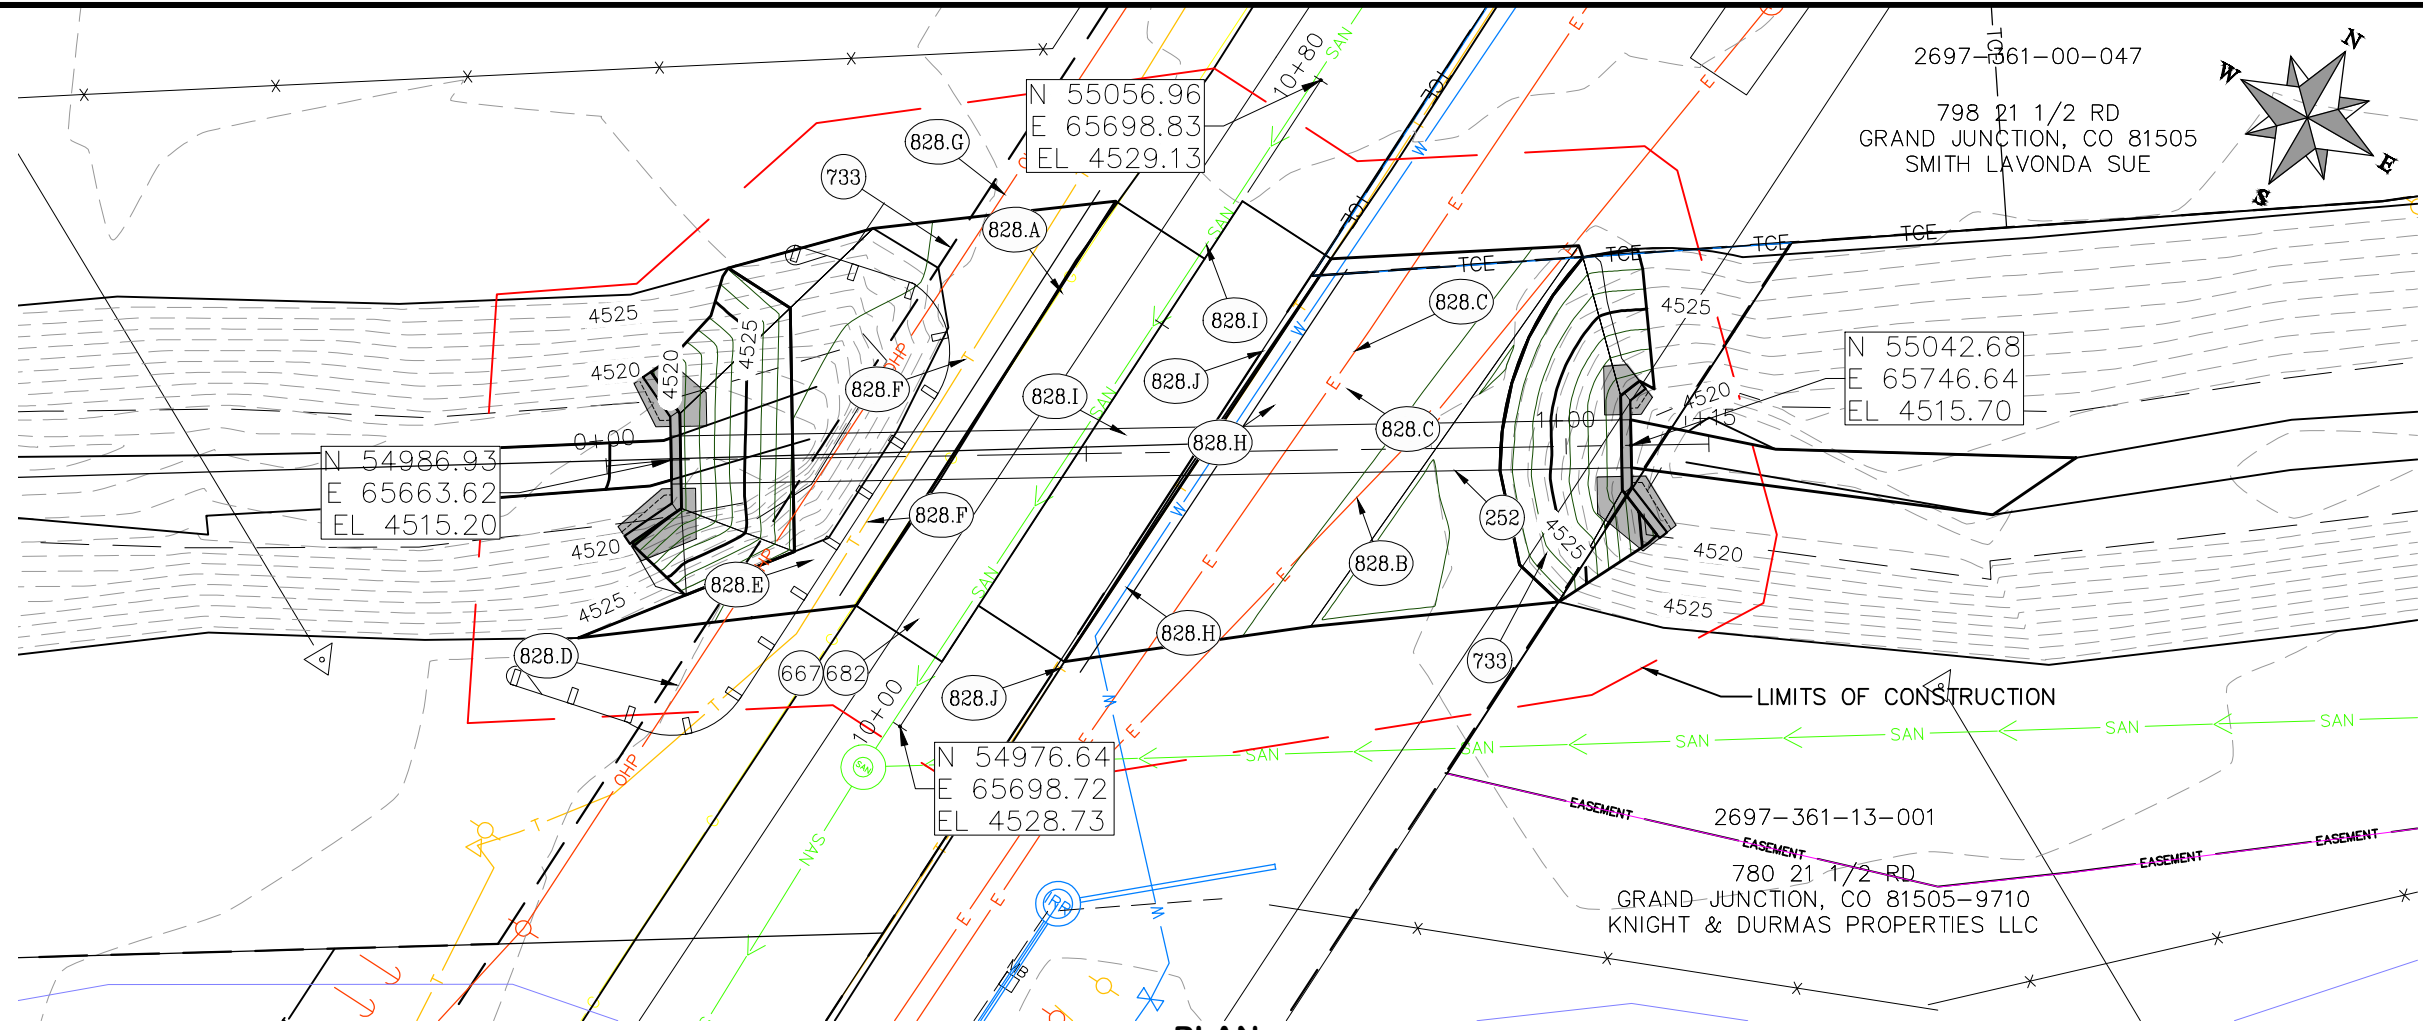

PROJECT NO. \_\_\_\_\_


CONSTRUCTION NOTES

- (252) 60" CULVERT (HDPE)
- (667) 304 - AGGREGATE BASE COURSE (CLASS 6) (6" THICK)
- (682) 401.08 - HOT BITUMINOUS PAVEMENT (PATCHING) (4" THICK) (GRADING SX, PG 64-22, GYR.=75) (TWO 2" LIFT)
- (733) 212 - HYDROSEED WITH NATIVE SEED MIX.
- (828) PROTECT UTILITIES

NOTE:  
ALL UTILITIES DEPICTED AT QUALITY LEVEL B (QL-B) UNLESS OTHERWISE NOTED.

### PROTECT UTILITIES

	UTILITY	OWNER
(A)	PROTECT 2" GAS LINE	XCEL ENERGY
(B)	PROTECT 6" ELECTRIC LINE	XCEL ENERGY
(C)	PROTECT 6" ELECTRIC LINE	GRAND VALLEY POWER
(D)	PROTECT OVERHEAD POWER	GRAND VALLEY POWER
(E)	PROTECT OVERHEAD CABLE	CHARTER
(F)	PROTECT 2 TELEPHONE LINES	CENTURY LINK
(G)	PROTECT OVERHEAD FIBER OPTIC	UNITE PRIVATE NETWORKS
(H)	PROTECT 8" WATER LINE	UTE WATER
(I)	PROTECT 8" SANITARY SEWER	CITY OF GRAND JUNCTION
(J)	PROTECT 2" FIBER OPTIC	CENTURY LINK

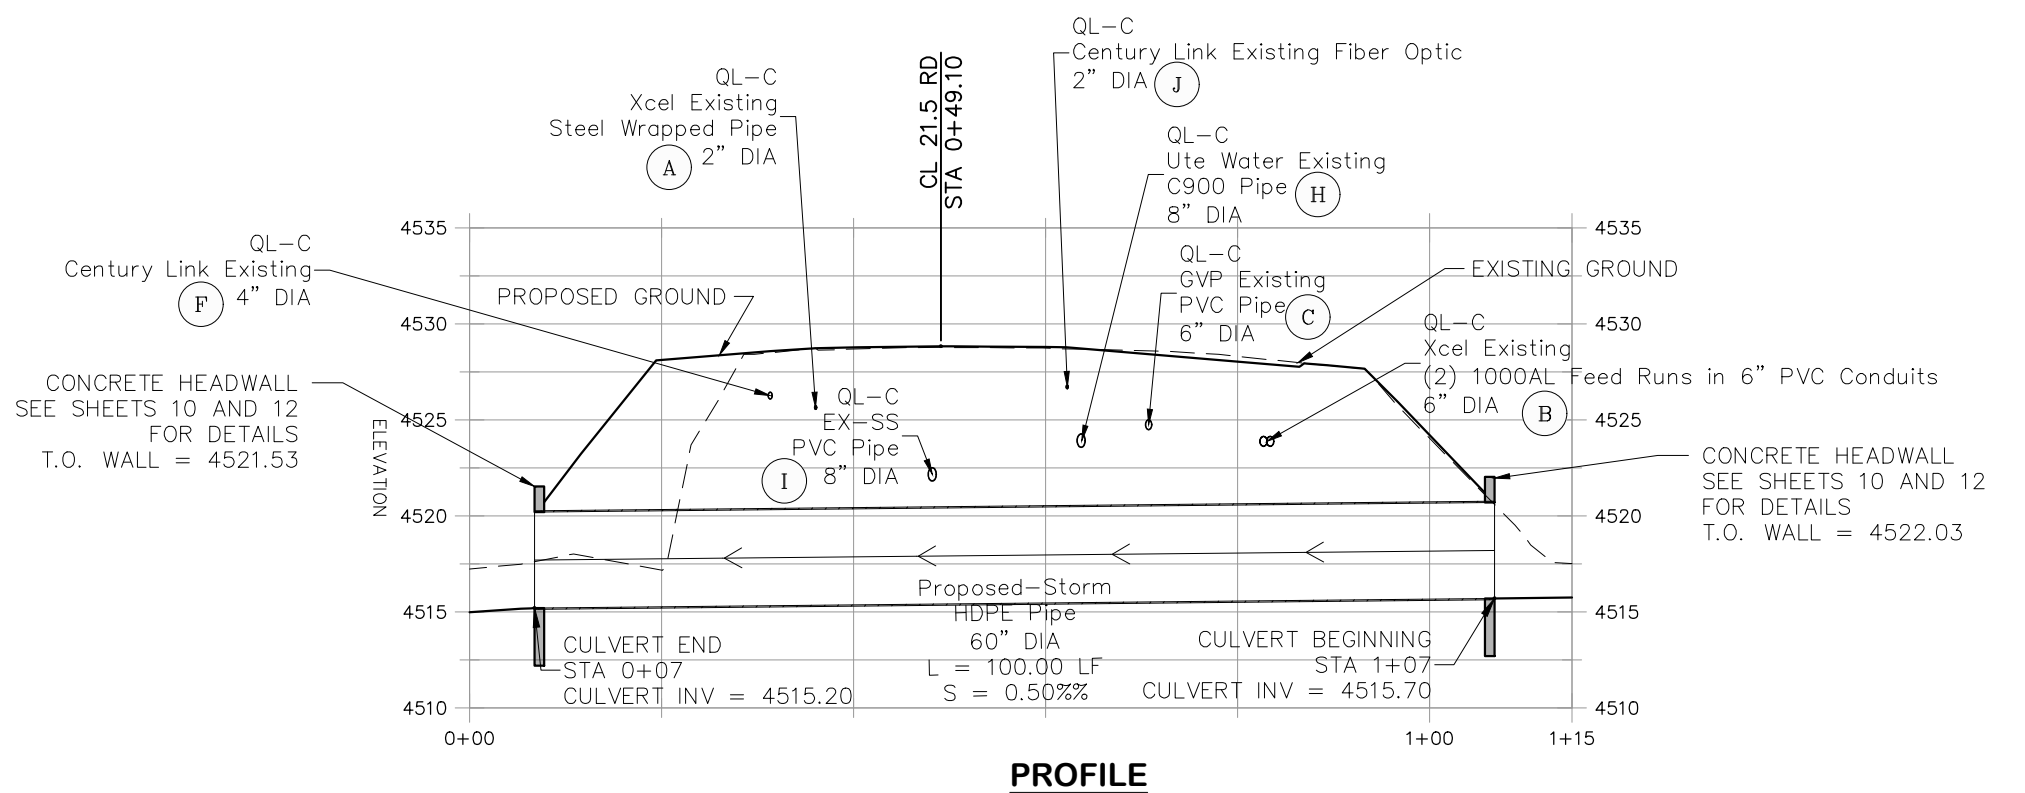

N:\landro2019 GRJM 21.5-G.95 Culvert Replacement.dwg, 8 Plan and Profile, 11/4/2020 3:54:37 PM

REVISION	DESCRIPTION	DATE	DRAWN BY	DATE
REVISION			KSO	2020
REVISION			KA	2020
REVISION			XXX	201X
REVISION			XXX	201X

SCALES: PLAN & PROFILE

HORIZONTAL: 1" = 20'

VERTICAL: 1" = 10'



PUBLIC WORKS  
ENGINEERING DIVISION



GRJM-21.5-G.95 CULVERT REPLACEMENT  
PLAN AND PROFILE  
STA 0+00 TO STA 1+15





NOTES:

1. THESE EXPLORATORY BORINGS WERE DRILLED ON DECEMBER 13, 2019 WITH A 4 INCH DIAMETER CONTINUOUS FLIGHT POWER AUGER BY HUDDLESTON-BERRY ENGINEERING AND TESTING LLC.
2. THE LINES BETWEEN MATERIALS SHOWN IN THE EXPLORATORY BORING LOGS REPRESENT THE APPROXIMATE BOUNDARIES BETWEEN MATERIAL TYPES AND THE ACTUAL TRANSITIONS MAY BE GRADUAL.
3. GROUND WATER LEVELS SHOWN ON THE LOGS WERE MEASURED AT THE TIME OF DRILLING AND END OF DRILLING. FLUCTUATIONS IN THE WATER LEVEL MAY OCCUR WITH TIME.
4. FOR FURTHER INFORMATION OR CLARIFICATION OF DATA ON THIS SHEET PLEASE REFER TO THE GEOTECHNICAL AND GEOLOGIC HAZARDS INVESTIGATION 21.5-G.95 BRIDGE OVER PRITCHARD WASH GRAND JUNCTION, COLORADO DATED FEBRUARY 5, 2020.

LEGEND

-  LOCATION OF EXPLORATORY BORING
-  INDICATES APPROXIMATE GROUND WATER LEVEL (IN THIS CASE BOTH AT THE TIME OF DRILLING AND END OF DRILLING)

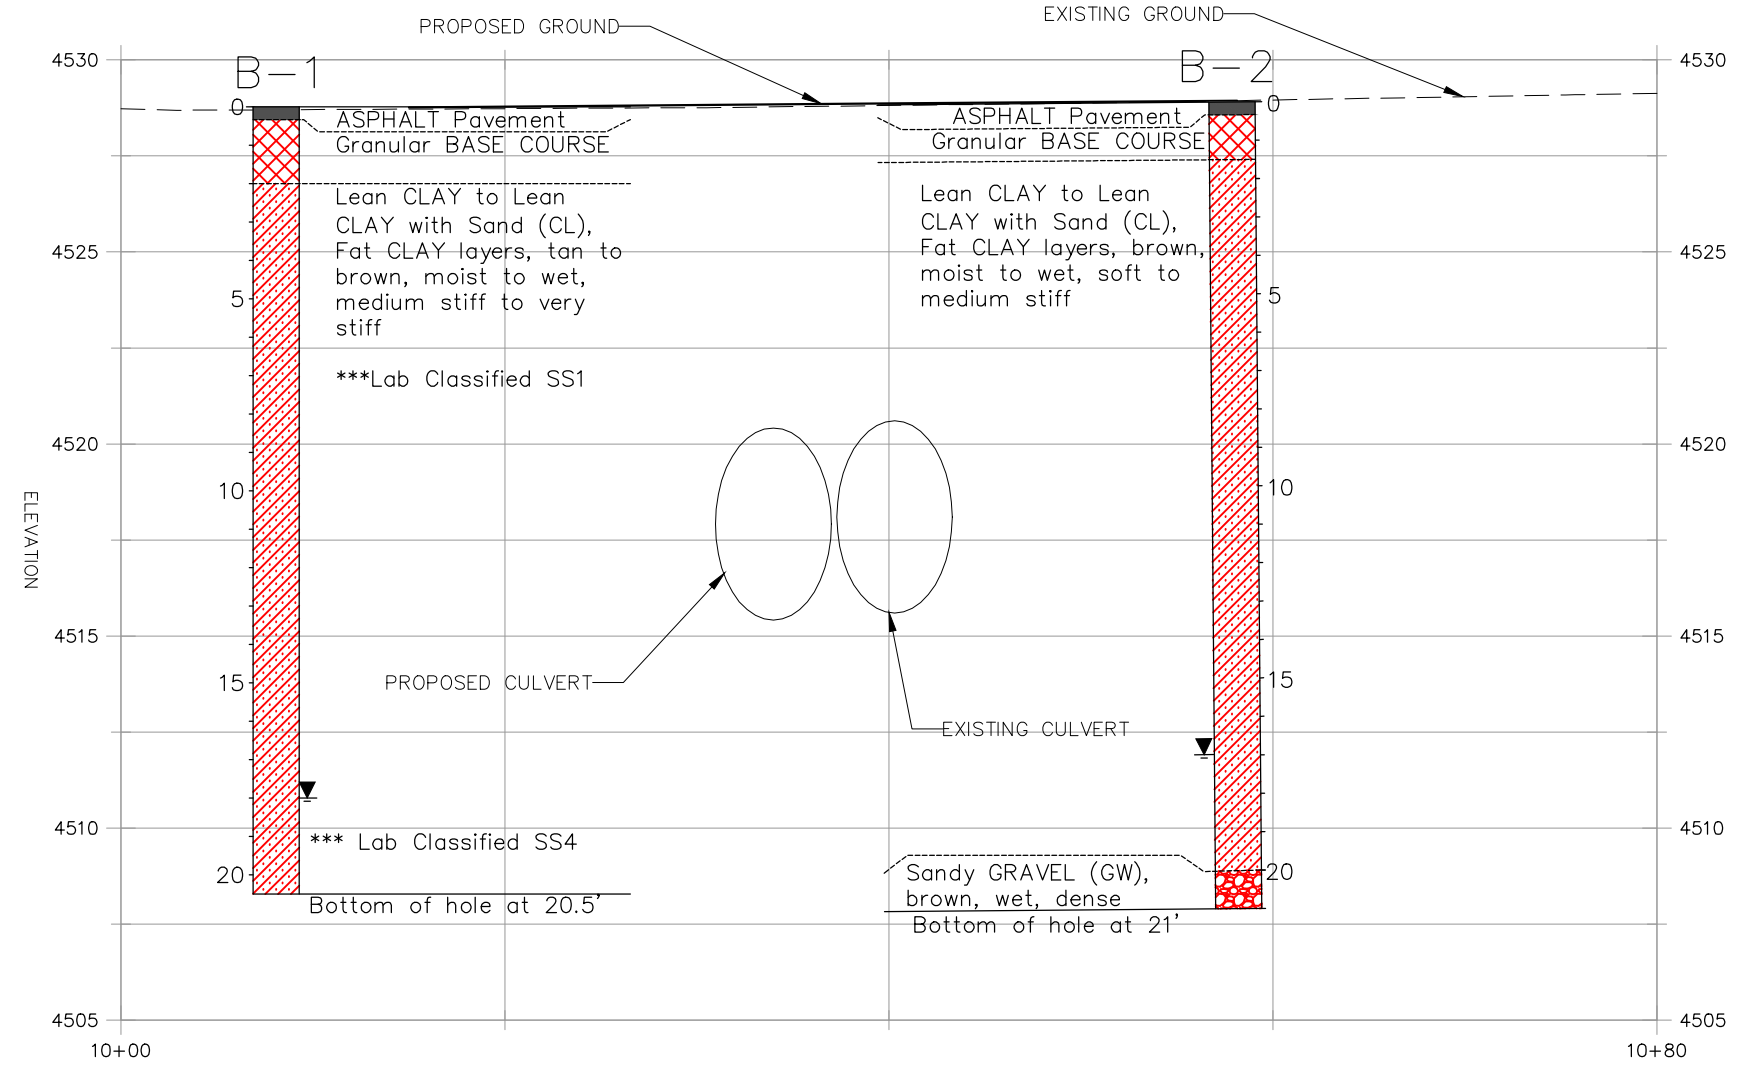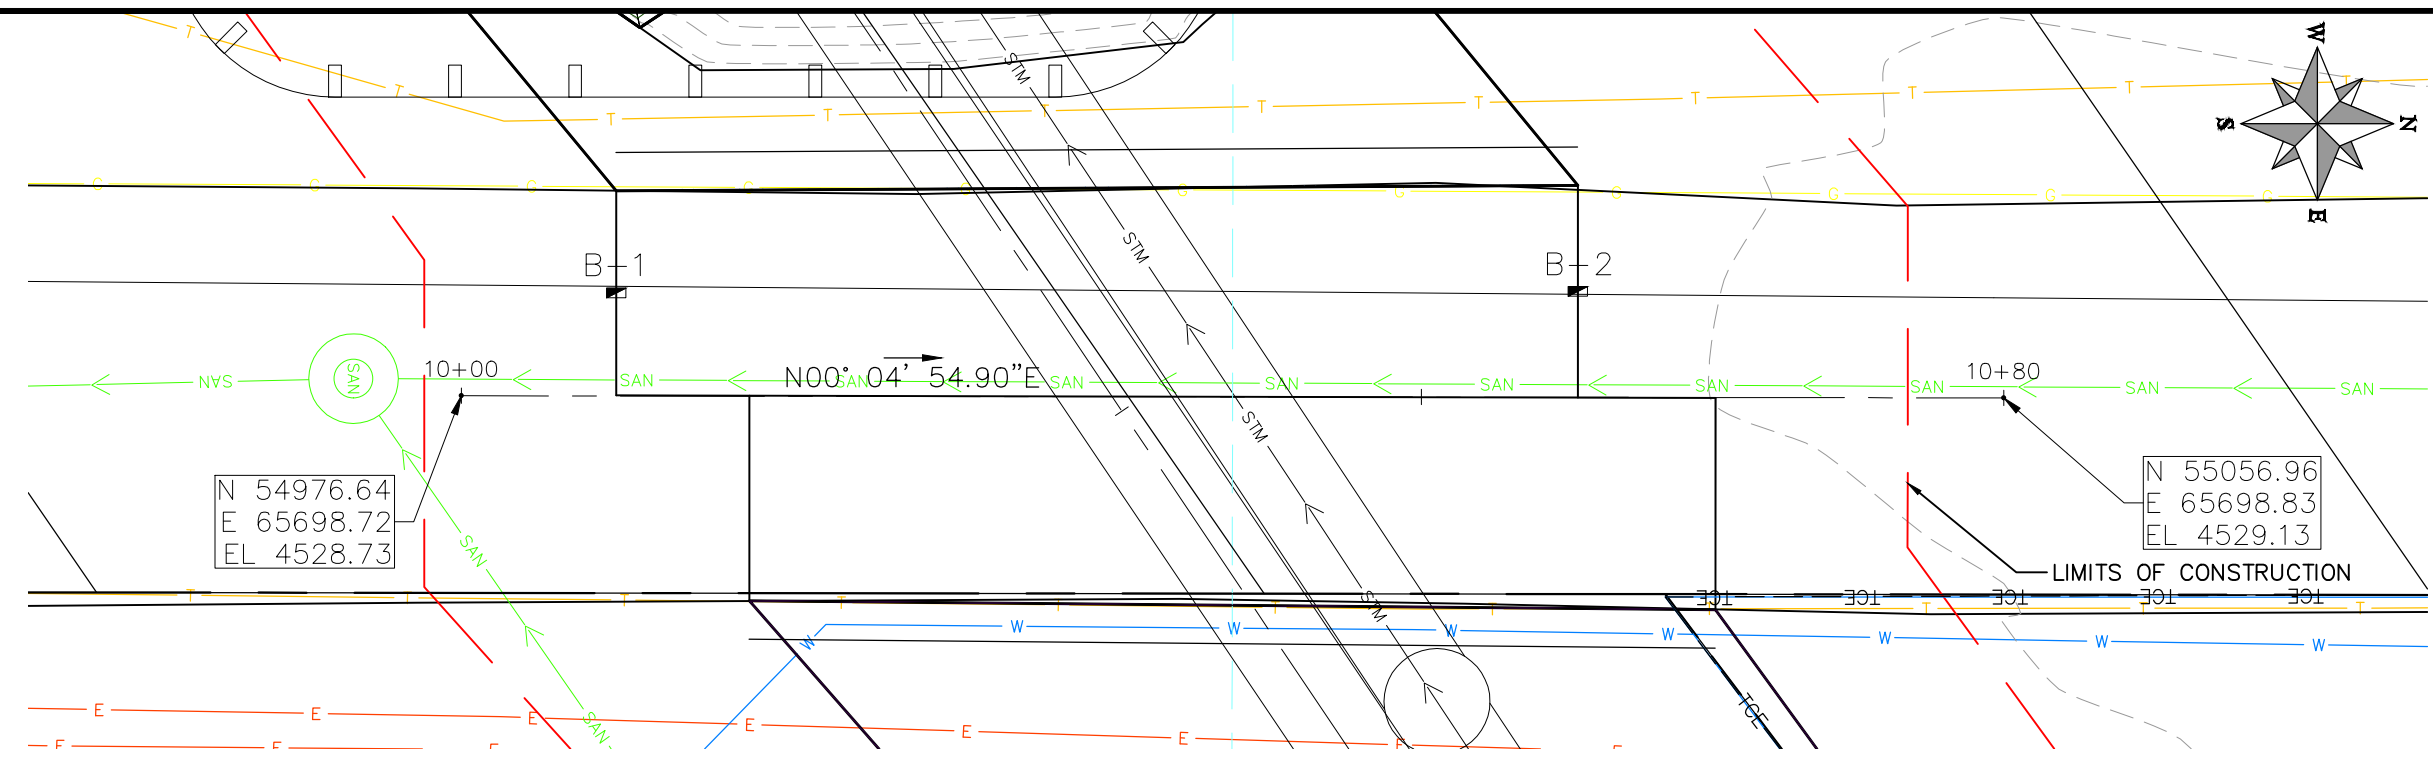

N:\landora\2019 GRJM 21.5-G.95 Culvert Replacement\4-27-20.dwg, 9 Engineering Geology, 1/14/2020 3:54:43 PM

REVISION	DESCRIPTION	DATE	DRAWN BY	KSO	DATE	2020
REVISION	△		DESIGNED BY	KA	DATE	2020
REVISION	△		CHECKED BY	XXX	DATE	201X
REVISION	△		APPROVED BY	XXX	DATE	201X

SCALES: PLAN & PROFILE

HORIZONTAL: 1" = 10'

VERTICAL: 1" = 5'



PUBLIC WORKS  
ENGINEERING DIVISION

GRJM-21.5-G.95 CULVERT REPLACEMENT  
ENGINEERING GEOLOGY  
STA 10+00 TO STA 10+80

**LEGEND**

**H** = MAXIMUM ALLOWABLE HEIGHT OF COVER OVER THE TOP OF THE PIPE, EXCLUDING PAVEMENT THICKNESS.

FILL HEIGHTS AND DESIGN ASSUMPTIONS ARE BASED ON AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS, 4TH EDITION, SECTION 12, FOR 900 PSI LONG TERM STRENGTH OF HDPE, AND AASHTO T180 MINIMUM RELATIVE COMPACTION OF 95% OR 90%.

FILL HEIGHTS ARE BASED ON AASHTO M294 FOR POLYETHYLENE AND ~~AASHTO M330 FOR POLYPROPYLENE, TYPE S~~ PIPES WITH OUTER, CORRUGATED WALLS AND SMOOTH INNER LINEARS.

FILL HEIGHTS, FOR INSTALLATION WITH HIGH WATER TABLE, REQUIRE A SPECIAL DESIGN. THE MAXIMUM HEIGHT IN HIGHWATER LOCATIONS SHOULD BE 15 FEET OR BASED ON AASHTO LRFD DESIGN SPECIFICATIONS.


THE MINIMUM COVER SHALL BE AS SHOWN ON THESE TABLES OR CONFORM TO AASHTO REQUIREMENTS, WHICHEVER IS GREATER. THE MINIMUM COVER FOR PIPE IS MEASURED FROM THE TOP OF THE PIPE TO THE BOTTOM OF THE PAVEMENT: HMA OR PCCP.

THE MINIMUM COVER IS MEASURED FROM THE TOP OF THE PIPE TO THE TOP OF THE SUBGRADE DURING CONSTRUCTION. THE MINIMUM COVER IS BASED ON DUAL AXLE LOADS UP TO 50,000 POUNDS.

**L<sub>1</sub>** = LENGTH OF PIPE TO BE MEASURED WHEN PLACED IN ACCORDANCE WITH SECTION 624.


**L<sub>2</sub>** = LENGTH OF PIPE TO BE MEASURED WHEN PLACED IN ACCORDANCE WITH SECTION 603.

**+** = THE MINIMUM SPACING BETWEEN THE OUTSIDE WALLS OF MULTIPLE PIPES OR END SECTIONS IS 18" OR 1/2(d), WHICHEVER IS GREATER.

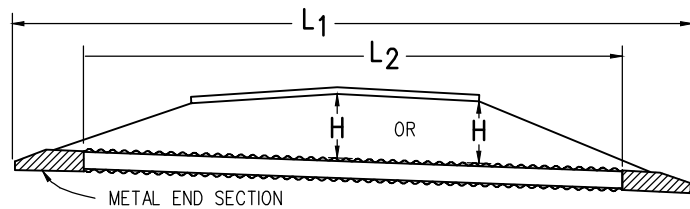


NOTE: USE THE H THAT IS GREATER FOR MAXIMUM ALLOWABLE FILL HEIGHT.

**PIPE WITH END SECTIONS**

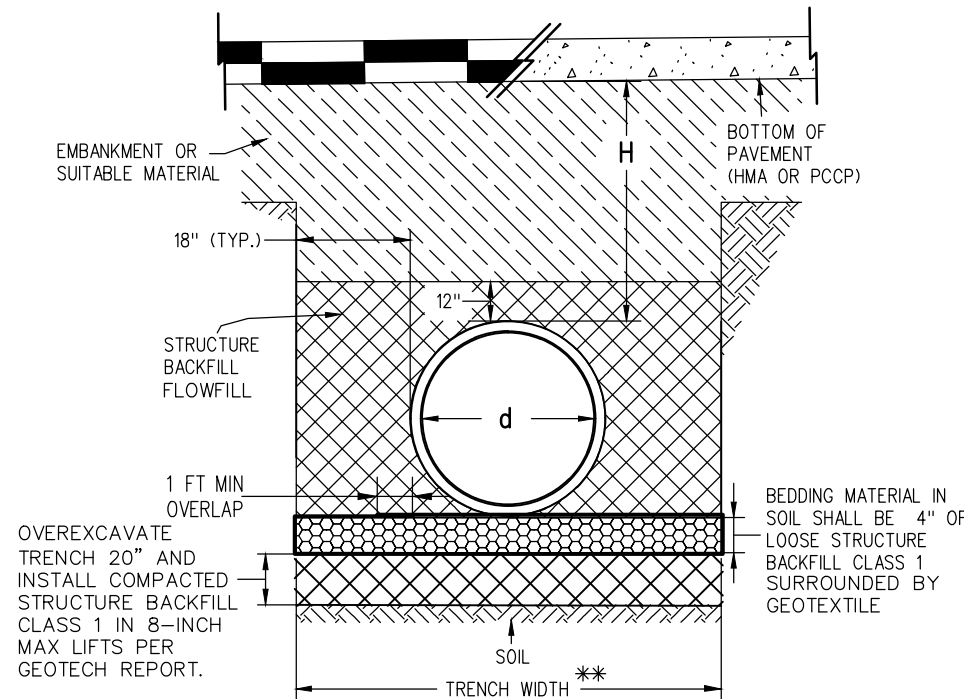

**INSTALLATION OF PIPE**

\*\* TRENCH WIDTH ASSUMES STABLE IN-SITU SIDE WALL

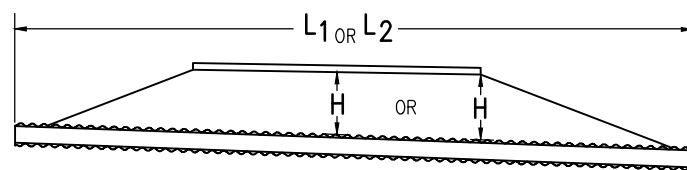


NOTE: USE THE H THAT IS GREATER FOR MAXIMUM ALLOWABLE FILL HEIGHT.

**PIPE WITHOUT END SECTIONS**

PIPE DIAMETER, d (IN.)	H MINIMUM HEIGHT OF COVER (FT.)	H MAXIMUM HEIGHT OF COVER (FT.)				
		95% COMPACTION		90% COMPACTION		
12	2	<i>2</i>	27	<i>25</i>	19	<i>17</i>
15	2	<i>2</i>	29	<i>27</i>	20	<i>20</i>
18	2	<i>2</i>	24	<i>23</i>	17	<i>17</i>
24	2	<i>2</i>	21	<i>20</i>	15	<i>14</i>
30	2	<i>2</i>	18	<i>23</i>	12	<i>17</i>
36	2	<i>2</i>	20	<i>20</i>	13	<i>14</i>
42	2	<i>2</i>	19	<i>18</i>	13	<i>13</i>
48	3	<i>2</i>	17	<i>20</i>	12	<i>13</i>
60	3	<i>2.5</i>	20	<i>21</i>	13	<i>14</i>

NOTE: THE VALUES FOR POLYPROPYLENE PIPES (AASHTO M330) ARE SHOWN IN ITALICS.


**MINIMUM AND MAXIMUM COVER**

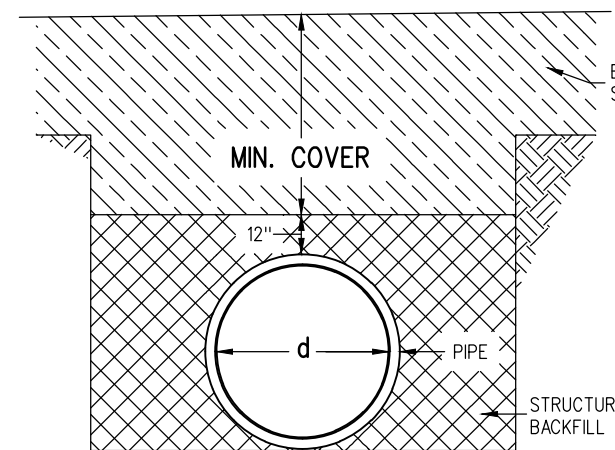

**CONSTRUCTION MINIMUM COVER FOR PIPE**

**GENERAL NOTES**

1. ALL PIPES SHALL MEET THE REQUIREMENTS OF AASHTO M294 FOR POLYETHYLENE AND ~~AASHTO M330 FOR POLYPROPYLENE, TYPE S~~ FOR HIGH DENSITY CORRUGATED POLYETHYLENE PIPE (HDPE) AND ~~POLYPROPYLENE PIPE (PP)~~ RESPECTIVELY, WITH SMOOTH INNER SURFACE.
2. WHEN A PIPE IS TO BE EXTENDED, THE SAME PIPE MATERIAL AND SIZE AS IN THE ORIGINAL INSTALLATION SHALL BE USED.
3. MINIMUM COVER SHALL BE PROVIDED DURING CONSTRUCTION TO PROTECT THE PIPE FROM DAMAGE.
4. WHEN INSTALLING A GUARDRAIL OR A SIGN POST DIRECTLY ABOVE A PIPE, THE POST'S BOTTOM MUST BE AT LEAST 1 FOOT ABOVE THE TOP OF THE PIPE. THE HOLE FOR THE POST SHALL BE DRILLED INTO THE SOIL.
5. STRUCTURE BACKFILL MATERIAL SHALL BE CLASS 1.
- ~~6. FOR PIPES 24 INCHES OR LESS IN DIAMETER, H MIN. MAY BE REDUCED TO ONE FOOT FOR LOW VOLUME APPROACH ROADS NOT ON STATE HIGHWAYS.~~

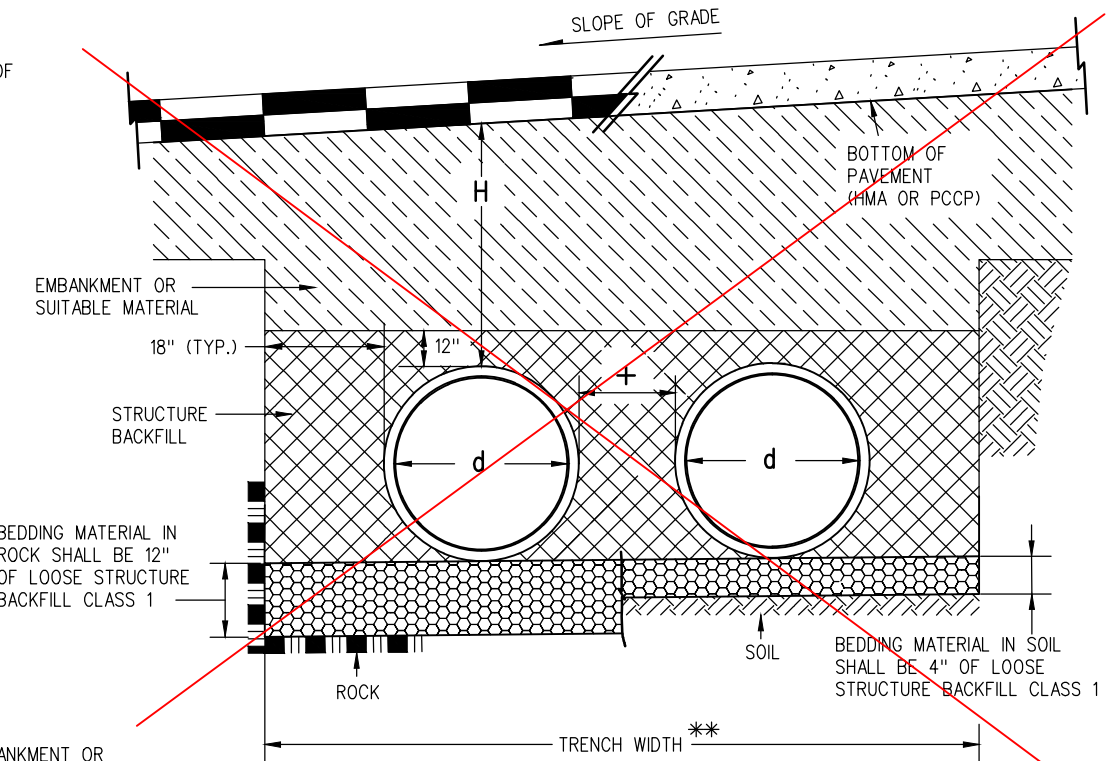

**INSTALLATION OF MULTIPLE PIPES**

NOMINAL PIPE DIAMETER (IN.)	MINIMUM COVER (IN.) FOR INDICATED AXLE LOADS (KIPS)			
	18.0-50.0	50.0-75.0	75.0-110.0	110.0-150.0
24 - 36	24.0	30.0	36.0	36.0
42 - 48	36.0	36.0	42.0	48.0
54 - 60	36.0	36.0	42.0	48.0



**AASHTO MINIMUM COVER FOR CONSTRUCTION LOADS**

REVISION	DESCRIPTION	DATE	DRAWN BY	KSO	DATE	2020	SCALES: PLAN & PROFILE
REVISION			DESIGNED BY	KA	DATE	2020	
REVISION			CHECKED BY	XXX	DATE	201X	
REVISION			APPROVED BY	XXX	DATE	201X	




PUBLIC WORKS ENGINEERING DIVISION

GRJM-21.5-G.95 CULVERT REPLACEMENT CORRUGATED POLYETHYLENE PIPE (AASHTO M294) DETAILS

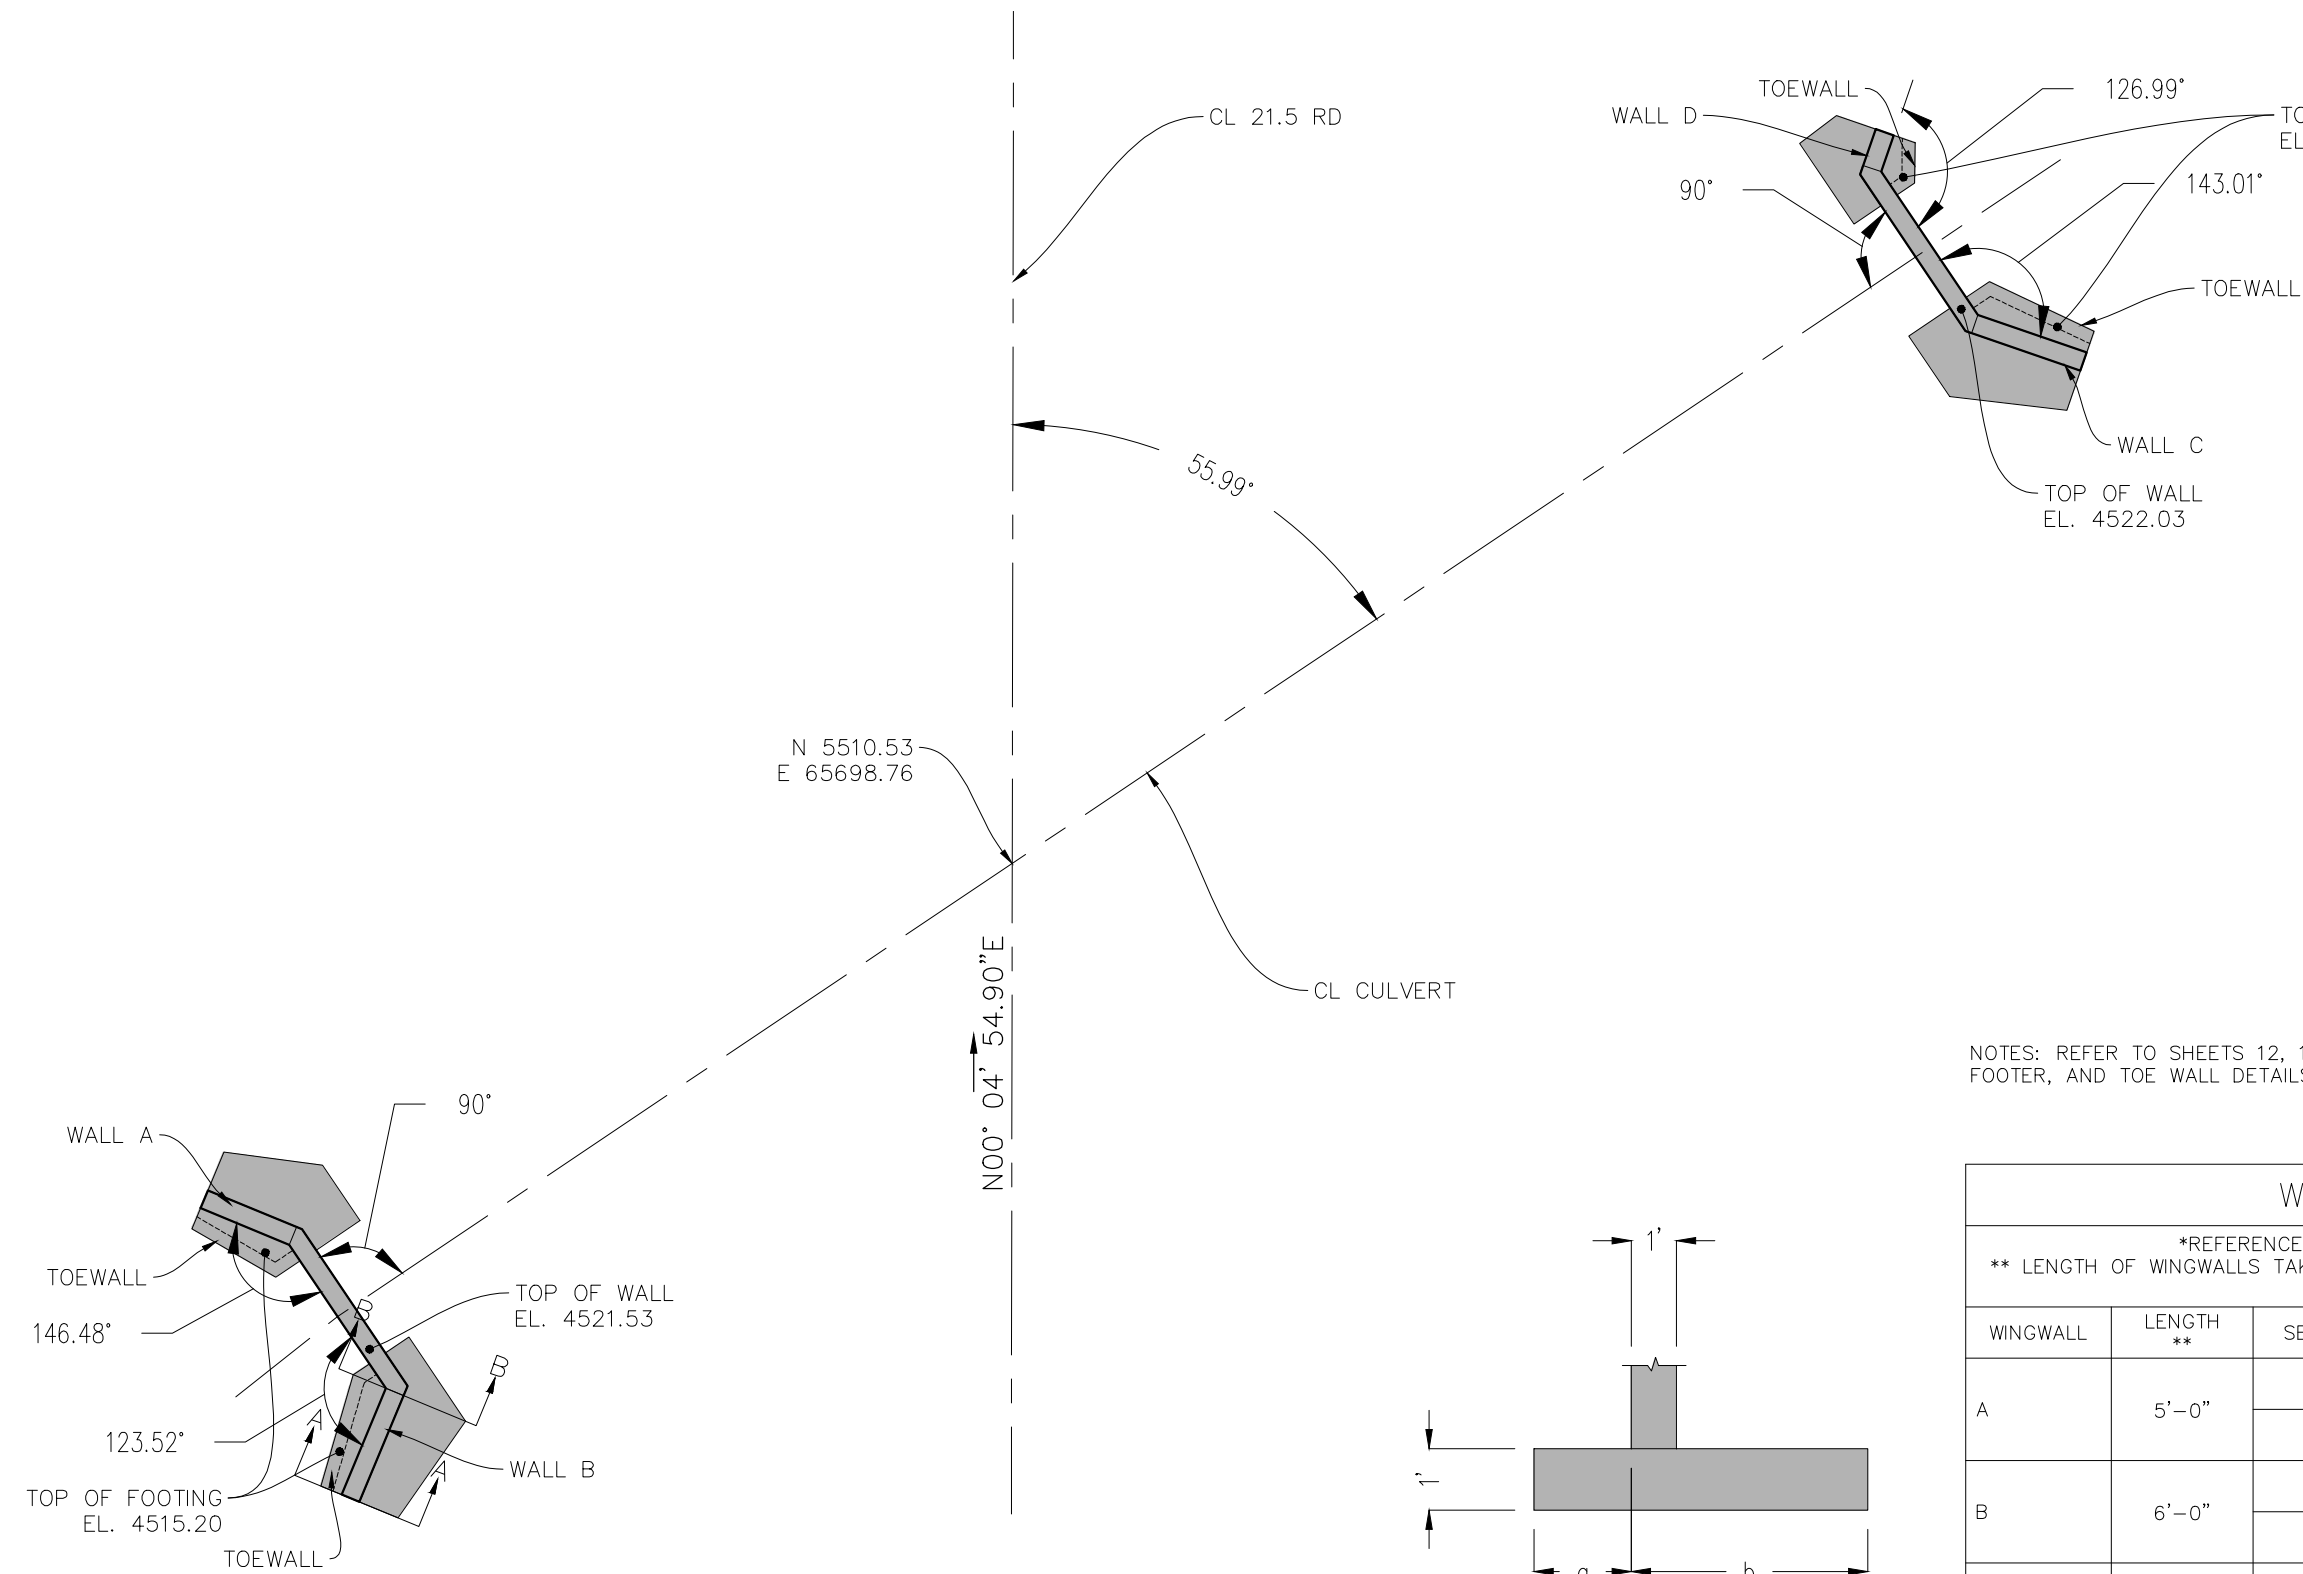


NOTES: REFER TO SHEETS 12, 13, AND 14 FOR REBAR, FOOTER, AND TOE WALL DETAILS.

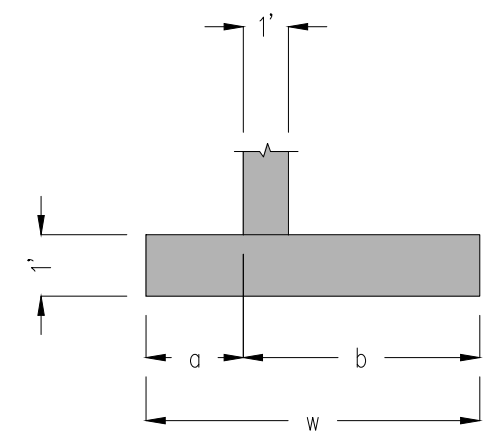

WINGWALL GEOMETRY						
*REFERENCE M STD M-601-20 FOR REBAR & FOOTER						
** LENGTH OF WINGWALLS TAKEN ALONG FRONT FACE OF WALL, FROM END OF HEADWALL TO END OF WINGWALL						
WINGWALL	LENGTH **	SECTION	HEIGHT	a	b	w
A	5'-0"	A-A	4'-6"	1'-6"	2'-8"	4'-2"
		B-B	6'-4"	1'-8"	3'-0"	4'-8"
B	6'-0"	A-A	4'-2"	1'-4"	2'-4"	3'-8"
		B-B	6'-4"	1'-8"	3'-0"	4'-8"
C	6'-0"	A-A	4'-2"	1'-4"	2'-4"	3'-8"
		B-B	6'-4"	1'-8"	3'-0"	4'-8"
D	2'-0"	A-A	6'-4"	1'-10"	3'-4"	5'-2"
		B-B	6'-4"	1'-8"	3'-0"	4'-8"


REVISION	DESCRIPTION	DATE	DRAWN BY	DATE	DESIGNED BY	DATE	CHECKED BY	DATE	APPROVED BY	DATE
REVISION Δ			KSO	2020	KA	2020	XXX	201X	XXX	201X
REVISION Δ										
REVISION Δ										
REVISION Δ										




PUBLIC WORKS  
ENGINEERING DIVISION

GRJM-21.5-G.95 CULVERT REPLACEMENT  
HEADWALLS AND WINGWALLS


N:\Landproj\2019 GRJM 21.5-G.95 Culvert Repl\dwg\culvert\_4-27-20.dwg, 11/5/2020 8:35:52 AM

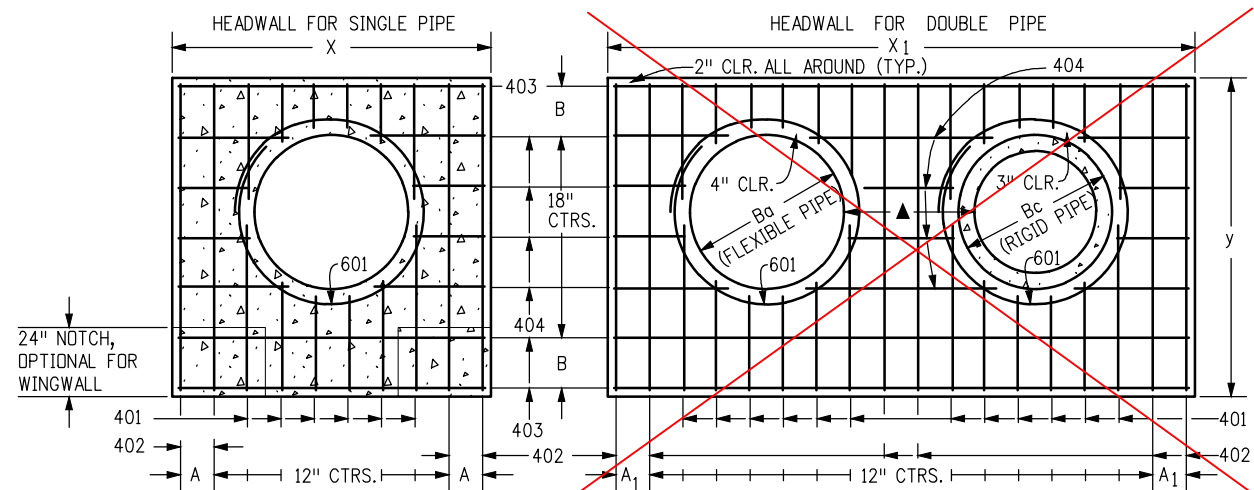

TYPICAL BAR LAYOUT FOR CONCRETE HEADWALLS

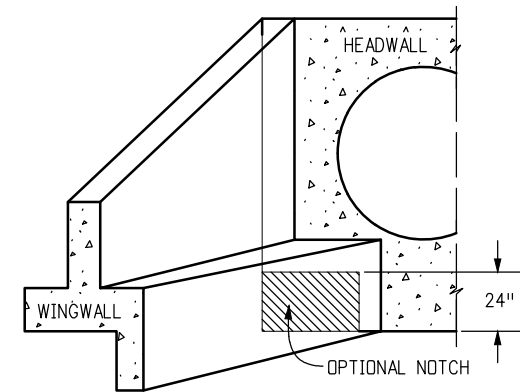


FRONT VIEW

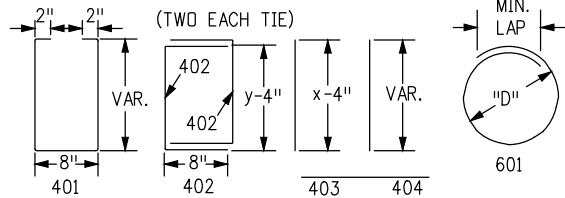

RIGID PIPE =  $B_c + 6"$   
 FLEXIBLE PIPE =  $B_a + 8"$   
 STRUCTURAL ARCH =  $SPAN + 8"$


BAR BENDING

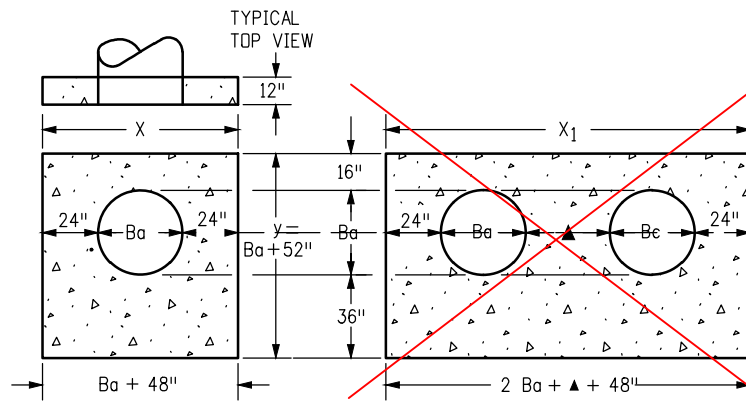

HEADWALL FOR RIGID ROUND PIPE

Ba IN.	Bc IN.	X FT.-IN.	A IN.	X1 FT.-IN.	A1 IN.	y FT.-IN.	B IN.	CONCRETE		STEEL	
								SGL CU. YD.	DBL CU. YD.	SGL LBS.	DBL LBS.
54	60	8-6	7	15-3	11/2	8-10	15	2.19	3.81	211	358
60	72	9-0	10	16-6	7	9-4	18	2.38	4.25	217	396
66	79	9-6	7	17-9	8 1/2	9-10	12	2.58	4.70	252	454
72	86	10-0	10	19-0	10	10-4	15	2.78	5.17	255	472
78	93	10-6	7	20-0	10	10-10	18	2.98	5.56	276	499
84	100	11-0	10	21-0	10	11-4	12	3.19	5.95	297	553
90	107	11-6	7	22-0	10	11-10	15	3.40	6.36	317	517
96	114	12-0	10	23-0	10	12-4	18	3.62	6.79	321	597
102	121	12-6	7	24-0	10	12-10	12	3.84	7.21	364	663
108	128	13-0	10	25-0	10	13-4	15	4.06	7.63	362	678

HEADWALL FOR FLEXIBLE ROUND PIPE

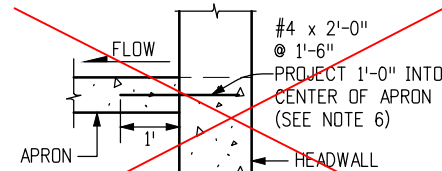


WHEN APRON IS REQUIRED

GENERAL NOTES

1. CONCRETE SHALL BE CLASS ~~X~~ **D**
2. HEADWALL SHALL BE PERPENDICULAR TO THE PIPE  $\phi$  UNLESS OTHERWISE SHOWN ON THE PLANS. TABULATED DIMENSIONS AND QUANTITIES MUST BE ADJUSTED FOR SKEWED INSTALLATIONS.
3. FOR WINGWALL DETAILS, SEE STANDARD PLAN M-601-20.
4. VOLUME OCCUPIED BY PIPE HAS BEEN DEDUCTED FROM STEEL AND CONCRETE QUANTITIES.
5. EXPOSED CONCRETE CORNERS SHALL BE CHAMFERED  $\frac{3}{4}$  IN.
6. ALL REINFORCING BARS SHALL HAVE A 2 IN. MINIMUM CLEARANCE.

▲ WHEN TWO OR MORE PIPES ARE LAID SIDE BY SIDE, THEY SHALL BE PLACED SO THAT THE ADJACENT PIPES WILL BE  $\frac{1}{2}$  INSIDE DIAMETER APART, OR  $\frac{1}{2}$  INSIDE SPAN APART, OR 3 FT. APART (INCLUDING WALL THICKNESS), WHICHEVER IS LESS.

■ ADD  $0.89 \times (X \text{ OR } X_1)$  (LB.) WHEN APRON IS REQUIRED.

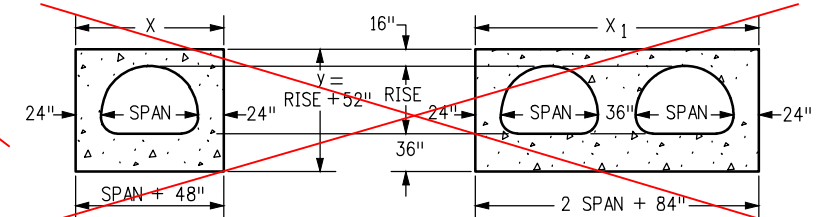

EQUIV. Ba IN.	SPAN IN.	RISE IN.	X FT.-IN.	A IN.	X1 FT.-IN.	A1 IN.	y FT.-IN.	B IN.	CONCRETE		STEEL	
									SGL CU. YD.	DBL CU. YD.	SGL LBS.	DBL LBS.
72	81	59	10-9	8 1/2	20-6	7	9-3	17 1/2	2.72	5.10	250	467
78	87	63	11-3	11 1/2	21-6	7	9-7	10 1/2	2.85	5.34	275	531
84	95	67	11-9	8 1/2	22-10	9	9-11	12 1/2	3.08	5.79	290	547
90	103	71	12-7	7 1/2	24-2	11	10-3	15	3.30	6.21	321	591
96	112	75	13-4	12	25-8	8	10-7	16 1/2	3.52	6.65	314	606
102	117	79	13-9	8 1/2	26-6	7	10-11	9 1/2	3.63	6.86	356	672
108	128	83	14-8	8	28-4	12	11-3	11 1/2	3.96	7.51	376	699

HEADWALL FOR FLEXIBLE PIPE ARCH

EQUIV. Ba IN.	SPAN FT.-IN.	RISE FT.-IN.	X FT.-IN.	A IN.	X1 FT.-IN.	A1 IN.	y FT.-IN.	B IN.	CONCRETE		STEEL	
									SGL CU. YD.	DBL CU. YD.	SGL LBS.	DBL LBS.
66	6-1	4-7	10-1	10 1/2	19-2	11	8-11	15 1/2	2.52	4.70	232	424
75	7-0	5-1	11-0	10	21-0	10	9-5	9 1/2	2.80	5.25	282	509
84	7-11	5-7	11-11	9 1/2	22-10	9	9-11	12 1/2	3.08	5.79	291	540
93	8-10	6-1	12-10	9	24-8	8	10-5	15 1/2	3.36	6.33	309	622
102	9-9	6-7	13-9	8 1/2	26-6	7	10-11	9 1/2	3.63	6.86	379	673
111	10-11	7-1	14-11	9 1/2	28-10	9	11-5	12 1/2	4.05	7.67	377	711
120	11-10	7-7	15-10	9	30-8	8	11-11	15 1/2	4.36	8.28	395	731
132	12-10	8-4	16-10	9	32-8	8	12-8	11	4.75	9.03	441	839
141	14-1	8-9	18-1	10 1/2	35-2	11	13-1	13 1/2	5.17	9.86	448	931
150	15-4	9-3	19-4	12	37-8	8	13-7	16 1/2	5.69	10.88	490	953
159	15-10	9-10	19-10	9	38-8	8	14-2	11	5.89	11.25	534	1019

HEADWALL FOR STRUCTURAL PLATE ARCH

SKEW ANGLE A°	90	85	80	75	70	65	60	55	50	45	40	35	30
FACTOR (cosecA°)	1.000	1.004	1.015	1.035	1.064	1.103	1.155	1.221	1.305	1.414	1.556	1.743	2.000


SKEW FACTOR TABLE

REVISION	DESCRIPTION	DATE	DRAWN BY	DATE	SCALE
REVISION $\Delta$			KSO	2020	PLAN & PROFILE
REVISION $\square$			KA	2020	
REVISION $\triangle$			XXX	201X	
REVISION $\square$			XXX	201X	









PUBLIC WORKS  
ENGINEERING DIVISION

GRJM-21.5-G.95 CULVERT REPLACEMENT  
M-601-10 HEADWALLS  
DETAILS

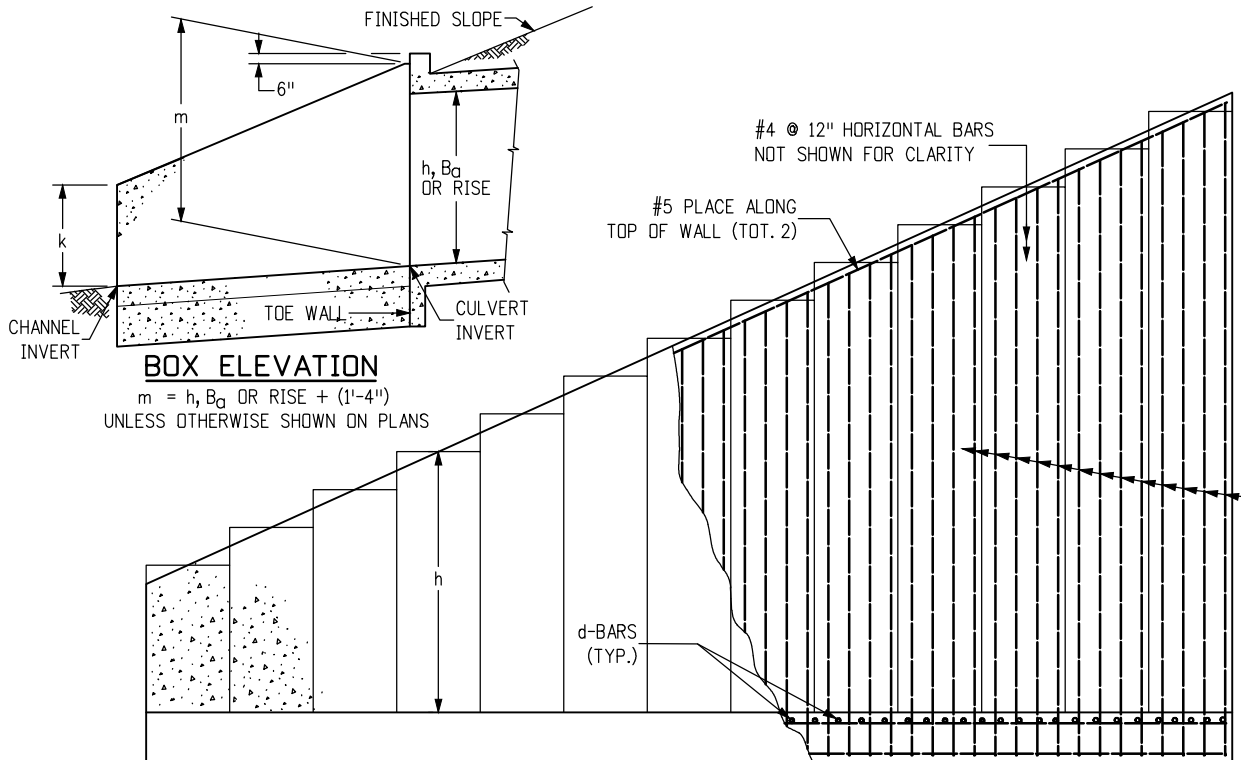

h =	2'	3'	4'	5'	6'	7'	8'	9'	10'	11'	12'	13'	14'
a =	1'-0"	1'-2"	1'-4"	1'-6"	1'-8"	1'-10"	2'-0"	2'-2"	2'-4"	2'-6"	2'-8"	2'-10"	3'-0"
b =	1'-8"	2'-0"	2'-4"	2'-8"	3'-0"	3'-4"	3'-8"	4'-0"	4'-4"	4'-8"	5'-0"	5'-4"	5'-8"
w =	2'-8"	3'-2"	3'-8"	4'-2"	4'-8"	5'-2"	5'-8"	6'-2"	6'-8"	7'-2"	7'-8"	8'-2"	8'-8"
d-BARS	#4 @ 9"	#4 @ 9"	#4 @ 9"	#4 @ 9"	#4 @ 9"	#4 @ 9"	#5 @ 11"	#5 @ 10"	#5 @ 10"	#5 @ 8"	#6 @ 8"	#7 @ 9"	#7 @ 7"
* CONC. CY/FT	0.161	0.210	0.259	0.309	0.358	0.407	0.457	0.506	0.556	0.605	0.654	0.704	0.753

\* DOES NOT INCLUDE TOE WALL QUANTITIES (0.05 CY/FT) SEE SHEET 2 OF 2 FOR REINFORCING STEEL QUANTITY  
 ■ REQUIRED DRAINAGE BEHIND WINGWALLS SEE NOTE 6

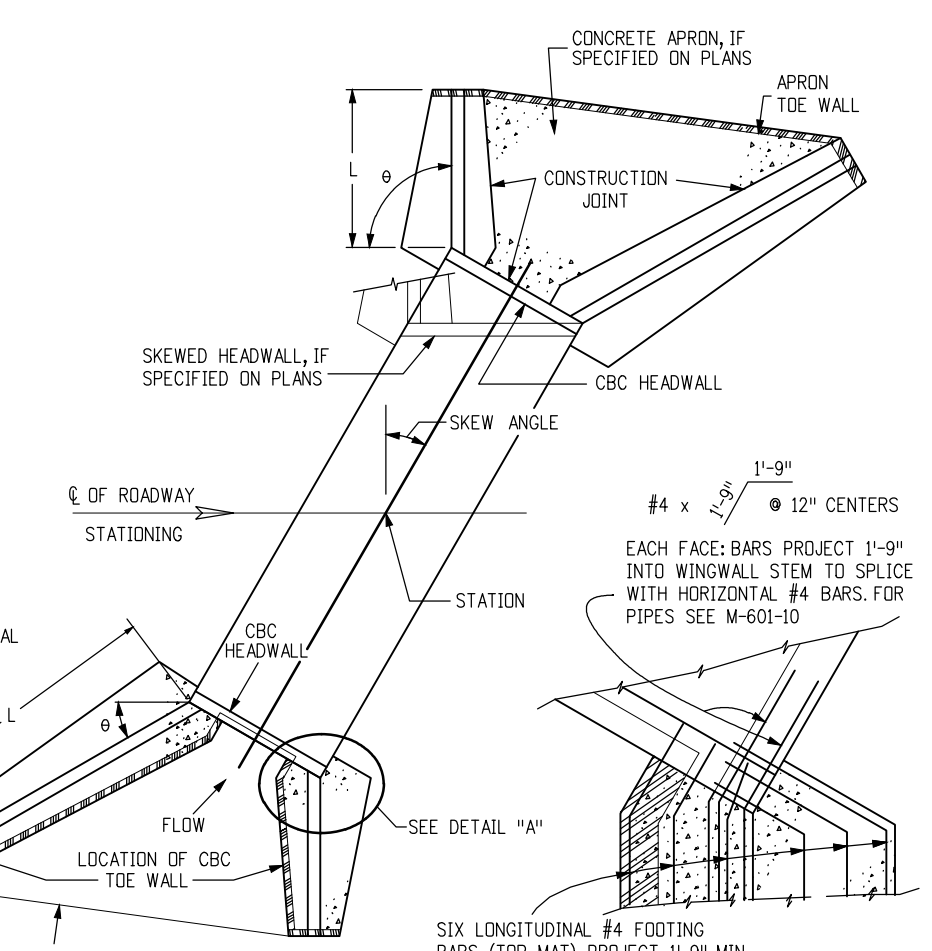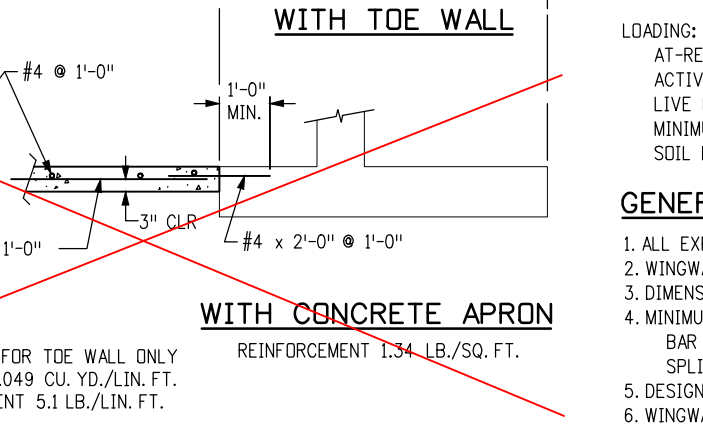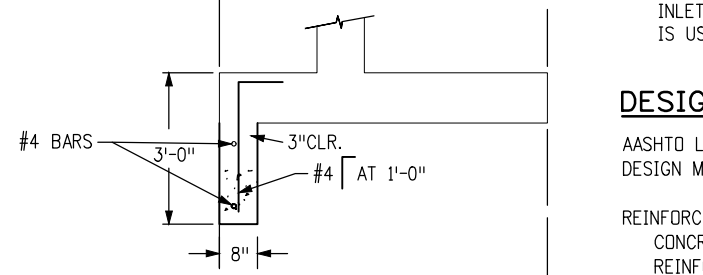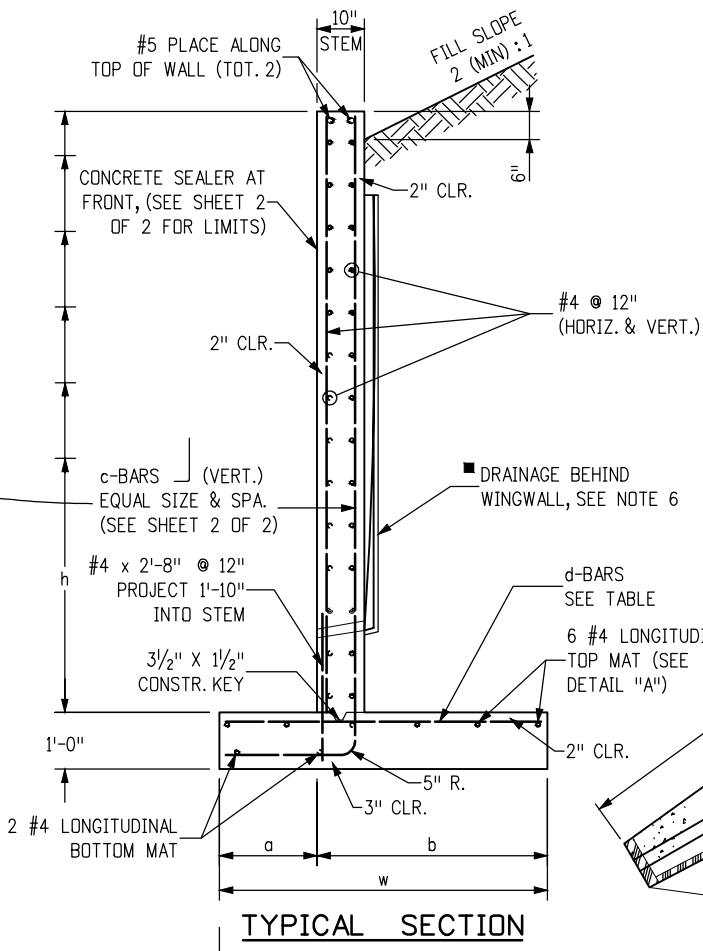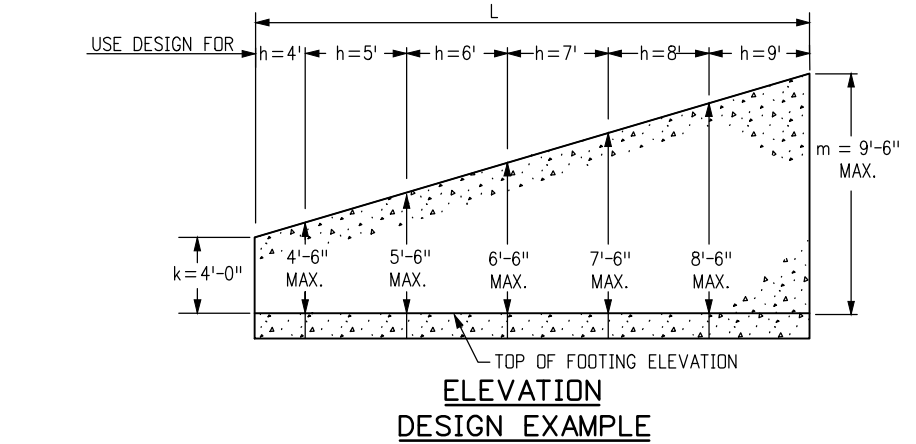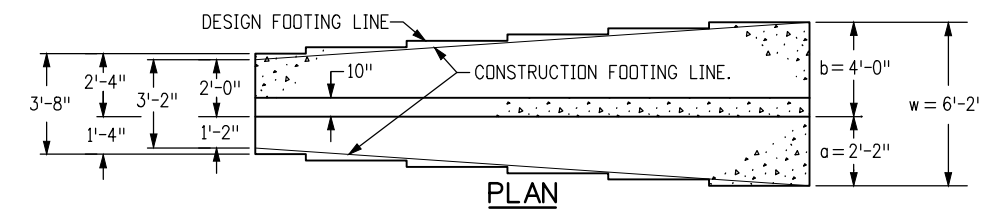

INLET APRON IS REQUIRED IF CBC IS USED AS AN ANIMAL PASS  
 SIX LONGITUDINAL #4 FOOTING BARS (TOP MAT), PROJECT 1'-9" MIN. INTO CULVERT FLOOR. FOR PIPES (SEE M-601-10)

**DESIGN DATA:**  
 AASHTO LRFD EIGHTH EDITION, 2017  
 DESIGN METHOD: LOAD AND RESISTANCE FACTOR DESIGN, YIELD LINE METHOD  
 REINFORCED CONCRETE:  
 CONCRETE CLASS D (BOX CULVERT):  $f'_c = 4,500$  PSI  
 REINFORCING STEEL:  $f_y = 60,000$  PSI

**LOADING:**  
 AT-REST EARTH (FLUID) PRESSURE FOR CONCRETE STEM DESIGN = 55 PCF FOR 2 (MIN.):1 SLOPED BACKFILL  
 ACTIVE EARTH (FLUID) PRESSURE FOR CONCRETE FOOTING DESIGN = 40 PCF FOR 2 (MIN.):1 SLOPED BACKFILL  
 LIVE LOAD SURCHARGE = 2'  
 MINIMUM RESISTANCE FOR SOIL BEARING = 5.5 KSF  
 SOIL BEARING RESISTANCE FACTOR = 0.45

**GENERAL NOTES:**  
 1. ALL EXPOSED CONCRETE CORNERS SHALL BE CHAMFERED 3/4 IN.  
 2. WINGWALL FOOTING AND FLOOR OF BOX CULVERT SHALL BE PLACED MONOLITHICALLY.  
 3. DIMENSIONS "h", "k", "L", "m" AND ANGLE "θ" FOR WINGWALL SHALL BE AS SHOWN ON THE PLANS.  
 4. MINIMUM CLASS B LAP SPLICE LENGTH FOR BLACK REINFORCING BARS:  
 BAR SIZE: #4 #5 #6 #7  
 SPLICE LENGTH: 1'-6" 1'-11" 2'-3" 2'-7"  
 5. DESIGN DOES NOT CONSIDER ANY SCOUR EFFECTS.  
 6. WINGWALL DRAIN SHALL BE REQUIRED IF "h" ≥ 12.0 FT., SEE SHEET 2 OF 2 FOR DETAILS.

N:\landro2019 GRJM 21.5-G.95 Culvert Replacement\4-27-20.dwg, 13 Wingwalls Details (1), 11/14/2020 3:55:01 PM

REVISION	DESCRIPTION	DATE	DRAWN BY	KSO	DATE	2020	SCALES:	PLAN & PROFILE
REVISION			DESIGNED BY	KA	DATE	2020		
REVISION			CHECKED BY	XXX	DATE	201X		
REVISION			APPROVED BY	XXX	DATE	201X		



**PUBLIC WORKS  
 ENGINEERING DIVISION**

**GRJM-21.5-G.95 CULVERT REPLACEMENT  
 M-601-20 (SHEET 1 OF 2) WINGWALLS  
 DETAILS**

