

**Geotechnical Investigation Report
24 Road and G Road Improvements
City of Grand Junction, Colorado
RockSol Project No. 599.07**

November 12, 2020



Prepared for:

City of Grand Junction
333 West Avenue, Building C
Grand Junction, Colorado 81501

Attention: Mr. Lee Cooper, PE

Prepared by:



RockSol Consulting Group, Inc.
566 W Crete Circle, Unit 2
Grand Junction, Colorado 81505
(970)-822-4350

**Geotechnical Investigation Report
24 Road and G Road Improvements
City of Grand Junction, Colorado
RockSol Project No. 599.07**

November 12, 2020

Prepared for:

City of Grand Junction
333 West Avenue, Building C
Grand Junction, Colorado 81501

Attention: Mr. Lee Cooper, PE

Prepared by:



RockSol Consulting Group, Inc.
566 W Crete Circle, Unit 2
Grand Junction, Colorado 81505
(970)-822-4350

A blue ink signature of Calen Shoen, consisting of several loops and a long horizontal stroke.

Calen Shoen, E.I.T.
Civil Engineering Associate

A blue ink signature of Ryan Lepro, written in a cursive style.

Ryan Lepro
Engineering Geologist



Donald G. Hunt, P.E.
Senior Geotechnical Engineer

Table of Contents

1.0	PROJECT OBJECTIVE AND DESCRIPTION	1
2.0	PROJECT SITE CONDITIONS	2
3.0	GEOLOGICAL CONDITIONS	3
4.0	SUBSURFACE EXPLORATION	3
5.0	SURFACE AND SUBSURFACE CONDITIONS	5
5.1	Existing Asphalt Pavement Sections	5
5.2	Fill Material	6
5.3	Native Subgrade Soils	6
5.4	Sedimentary Bedrock	6
5.5	Groundwater	6
6.0	LABORATORY TESTING	7
7.0	SUBGRADE CHARACTERIZATION	8
7.1	Roadway Subgrade Soil Classification	8
7.2	Swell/Consolidation Potential of Subgrade Soils	8
7.3	Water-Soluble Sulfate Content	9
8.0	G ROAD OVER NORTH LEACH CREEK CROSSING FOUNDATION RECOMMENDATIONS .	10
8.1	Drilled Shaft Foundation System	10
8.2	Driven Pile Foundation System	11
8.3	CBC Structure Recommendations with Ground Improvement	13
9.0	G ROAD PEDESTRIAN UNDERPASS FOUNDATION RECOMMENDATIONS	14
9.1	Underpass Foundation Recommendations with Ground Improvement	14
10.0	PEDESTRIAN BRIDGE OVER LEACH CREEK FOUNDATION RECOMMENDATIONS	15
10.1	Drilled Shaft Foundation System	15
10.2	Driven Pile Foundation System	16
10.3	Shallow Foundation Recommendations with Ground Improvement	17
11.0	PAVEMENT DESIGN RECOMMENDATIONS	18
11.1	Traffic Loading	18
11.2	Pavement Subgrade Characterization	19
11.3	Pavement Section Recommendations	19
11.4	Subgrade Preparation (Prior to Pavement Construction)	20
12.0	EARTHWORK	21
13.0	SEISMICITY DISCUSSION	22
13.1	General	22
13.2	Seismic Design Parameters	23
14.0	OTHER DESIGN AND CONSTRUCTION CONSIDERATIONS	24
15.0	LIMITATIONS	24

ATTACHMENTS

- Figure 1: Borehole Location Plan (Boreholes 24-1, 24-2)
 - Figure 2: Borehole Location Plan (Boreholes 24-3, 24-4)
 - Figure 3: Borehole Location Plan (Boreholes 24-6, G-4, T-1, T-2, T-3, UP-1, UP-2)
 - Figure 4: Borehole Location Plan (Boreholes 24-7)
 - Figure 5: Borehole Location Plan (Boreholes G-1, G-2)
 - Figure 6: Borehole Location Plan (Boreholes G-5, G-6)
 - Figure 7: Borehole Location Plan (Boreholes LC-1 and LC-2)
 - Figure 8: North Leach Creek Realignment Conceptual Plan
-
- Appendix A: Legend and Individual Borehole Logs
 - Appendix B: Summary of Laboratory Test Results
 - Appendix C: Pavement Design Output Sheets – 24 Road and G Road Roundabout
 - Appendix D: Pavement Design Output Sheets – 24 Road
 - Appendix E: Pavement Design Output Sheets – G Road

1.0 PROJECT OBJECTIVE AND DESCRIPTION

This report documents the geotechnical engineering investigation performed by RockSol Consulting Group, Inc. (RockSol) for the 24 Road and G Road Improvements Project in the City of Grand Junction, Colorado (see Image 1, *Site Vicinity Map*).

Image 1 – Site Vicinity Map (Google Maps)



The City of Grand Junction is planning to make improvements to the intersection of 24 Road and G Road, relocate and replace the bridge over relocated North Leach Creek and design and construct a pedestrian underpass beneath G Road (See Figure 8). A new pedestrian bridge over Leach Creek is also proposed as part of this project approximately 1,000 feet south of G Road, east of 24 Road (See Figure 7). The primary purpose of the improvements to the intersection is to add a traffic circle (roundabout) to improve traffic and pedestrian movements.

The geotechnical investigation was conducted by RockSol for the City of Grand Junction. The scope of work for this geotechnical investigation included:

- Preparing a drilling/sampling program to perform a subsurface investigation and implementing the program to collect soil samples for laboratory testing.
- Performing laboratory tests and analyzing the data.
- Preparing a report that presents the field and laboratory data obtained, geological setting and conditions, geotechnical design parameters for the proposed structures, project site improvements, and roadway pavement thickness recommendations.

Surface and groundwater hydrology, hydraulic engineering, and environmental evaluation of site soils and groundwater for possible contaminant characterization were not included in RockSol's geotechnical scope of work.


2.0 PROJECT SITE CONDITIONS

24 Road is classified as a principal arterial roadway and G Road is classified as a minor arterial roadway. A combination of farm, commercial, and undeveloped land immediately surround the project limits, with residential neighborhoods less than a half mile from the site. Canyon View Park is located east of 24 Road and north of G Road.

24 Road currently consists of three lanes, one in each direction and a center turn lane within the project vicinity. G Road consists of two lanes, one in each direction. At the intersection of 24 Road and G Road, each direction of travel has a designated left turn lane and pedestrian crossing. Both roads have shoulders on each side of varying widths. The existing lanes are approximately 12 feet wide and surfaced with asphalt pavement in all directions of travel.

Topography throughout the project limits of 24 Road and G Road consist of nearly flat slopes. North Leach Creek crosses under G Road in a north/south direction within the project limits (see Image 2) just east of 24 Road. The existing bridge structure that takes G Road traffic over North Leach Creek will be replaced as part of this project. In addition, a pedestrian crossing structure is proposed at a location approximately 250 feet east of 24 Road under G Road.


Image 2 – Site Structures Map

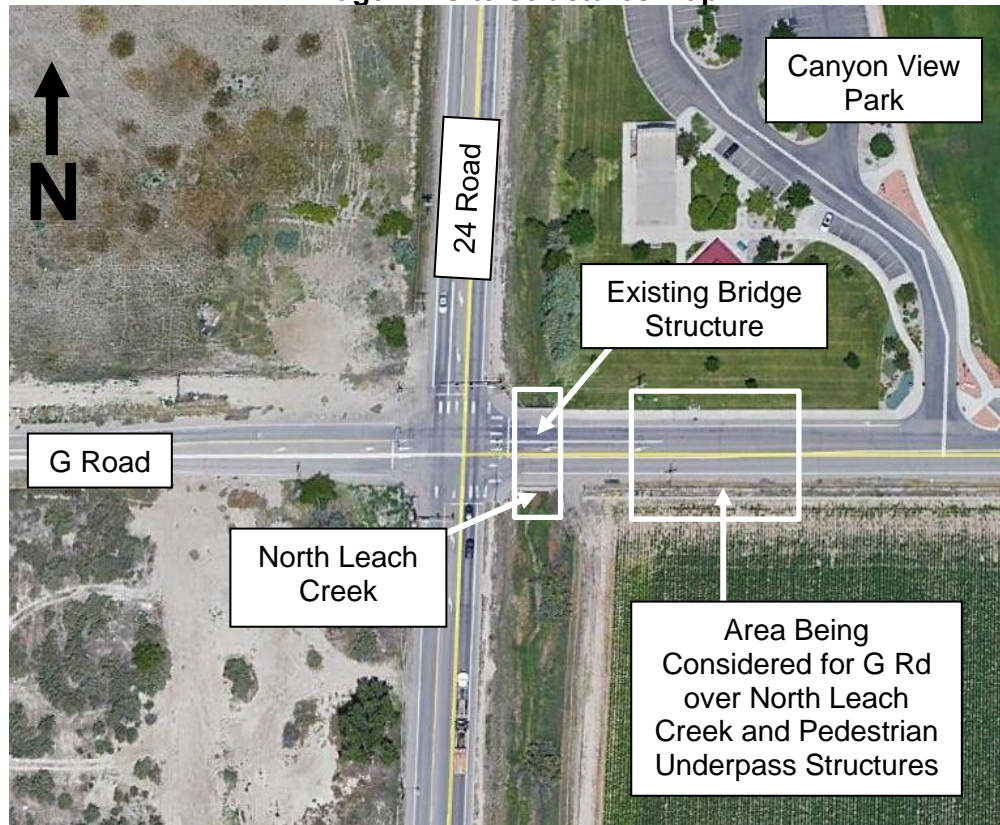

3.0 GEOLOGICAL CONDITIONS

Based on information presented in the United States Geological Survey (USGS) Geologic Map (See Image 3, *Site Geology Map*) of the Grand Junction Quadrangle, Mesa County, Colorado, by Roger B. Scott, Paul E. Carrara, William C. Hood, and Kyle E. Murray, dated 2002, alluvium and colluvium, undivided, (Holocene and late Pleistocene) (Qac) is mapped at the project site, as well as at the immediate surrounding areas. Alluvium generally consists of silt, sand and gravels and the colluvium generally consists of sandy silt, silty to clayey sand, and sandy clay. The materials identified by the USGS mapping was consistent with native soils encountered during our geotechnical investigation.

Image 3 – Site Geology Map (Grand Junction, Mesa County, Colorado 2002)

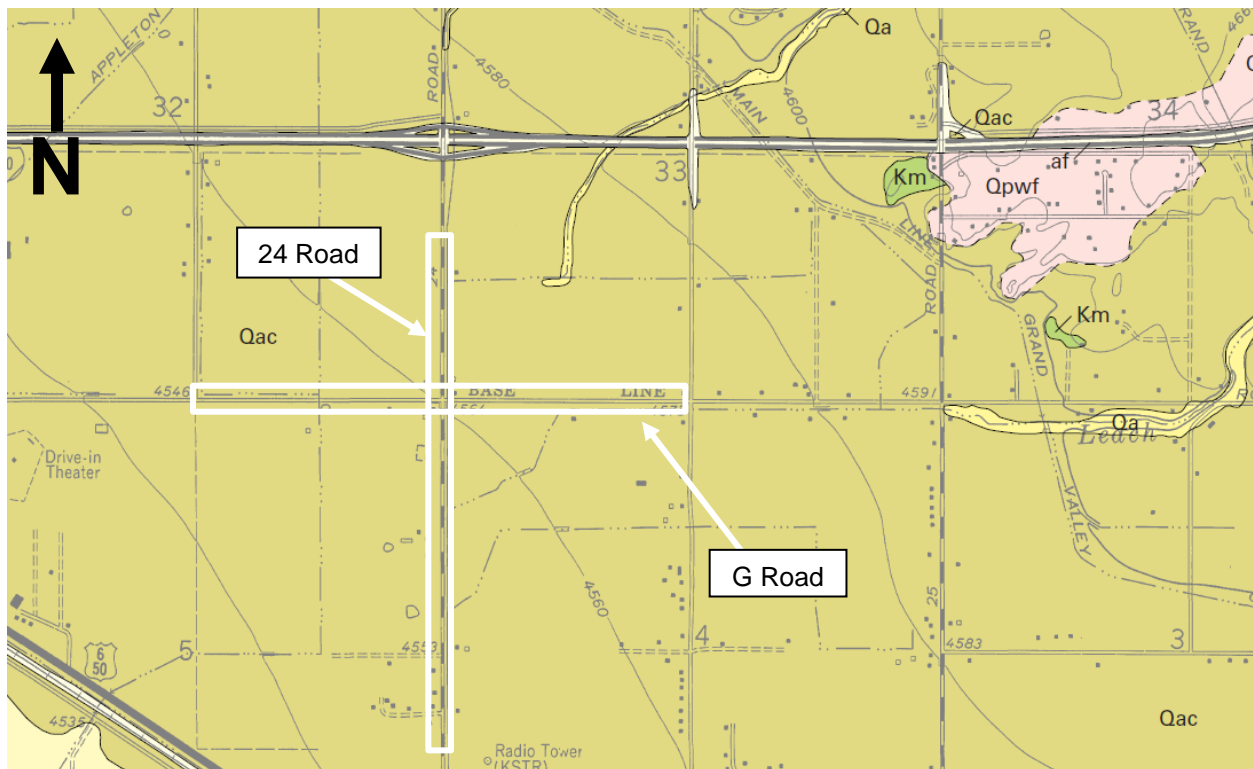

4.0 SUBSURFACE EXPLORATION

For this investigation, RockSol completed a total of 18 boreholes identified as 24-1 through 24-4, 24-6, 24-7, G-1, G-2, G-4 through G-6, LC-1, LC-2, T-1 through T-3, UP-1 and UP-2 (See Figures 1 through 7).

Boreholes 24-1 through 24-4, 24-6, and 24-7 were drilled along 24 Road and Boreholes G-1, G-2, G-4 through G-6 were drilled along G Road (See Figures 1 through 6). These boreholes extended to approximate depths of 5 feet to 10 feet for characterization of subsurface conditions, including groundwater depths/elevations, to assist with development of pavement thickness recommendations.

Boreholes LC-1 and LC-2 were drilled approximately 1,000 feet south of G Road and east of 24 Road on the north and south sides of Leach Creek to provide subsurface information for the proposed pedestrian bridge structure over Leach Creek (See Figure 7).

Boreholes T-1 through T-3 were drilled east of 24 Road on the north and south sides of G Road to provide subsurface information for the proposed crossing structure over relocated North Leach Creek (See Figure 3).

Boreholes UP-1 and UP-2 were drilled on the north and south sides of G Road approximately 250 feet east of 24 Road to provide subsurface information for the proposed pedestrian underpass structure and extended to approximate depths of 20 feet to 30 feet (See Figure 3).

The locations of the geotechnical investigation boreholes are summarized below in Table 4. The boreholes were drilled between June 9, 2020 and July 24, 2020. The boreholes were surveyed after drilling operations were completed by the City of Grand Junction and the survey information (surface elevations, northing, easting) was provided to RockSol.

Table 4- Borehole and Pavement Core Location Summary

Borehole ID	Borehole Location	Location
24-1	SB 24 Road	Outside Shoulder
24-2	SB 24 Road at NW corner of 24 Road and F ½ Road	Off SB Shoulder
24-3	NB 24 Road, ~1000' N of F ½ Road	Outside Shoulder
24-4	NB 24 Road	Outside Shoulder
24-6	NW corner of 24 Road and G Road	Off SB Shoulder
24-7	SB 24 Road	On inside white edge line
G-1	EB G Road	Off Shoulder
G-2	WB G Road	Outside Shoulder
G-4	EB G Road, SW corner of G Road and 24 Road	Off Shoulder
G-5	WB G Road	Off Shoulder
G-6	EB G Road	Off Shoulder
LC-1	≈1,056 ft S. of G Road & 90 ft E of 24 Rd	North side of Leach Creek
LC-2	≈1,140 ft S. of G Road & 70 ft E of 24 Rd	South side of Leach Creek
T-1	NE corner of 24 Road and G Road	Off Shoulder
T-2	SE corner of 24 Road and G Road	Within private property
T-3	NE corner of 24 Road and G Road	In park
UP-1	NE corner of 24 Road and G Road	In park
UP-2	EB G Road	Off shoulder

Boreholes were advanced with a truck mounted Simco 2800 drill rig or CME 55 track mounted drill rig using 4.25-inch outside diameter solid stem or 8-inch outside diameter hollow stem augers. The boreholes were logged in the field by a representative of RockSol with the depth to groundwater, if encountered, noted at the time of drilling. The boreholes were backfilled at the completion of drilling and groundwater level checks and patched with surface asphalt patch mix when drilled within existing pavement. A temporary piezometer well was installed at Borehole UP-2 for purposes of monitoring groundwater levels at the proposed underpass structure. The temporary piezometer well is within City of Grand Junction right-of-way (outside shoulder) of eastbound G Road.

Subsurface materials were sampled and resistance of the soil to penetration of the sampler was performed using modified California barrel and standard split spoon samplers. Penetration Tests were performed using an automatic lift system and a hammer weighing 140 pounds falling 30 inches. The modified California barrel sampler has an outside diameter of approximately 2.5

inches and an inside diameter of 2 inches. The standard split spoon sampler used had an outside diameter of 2 inches and an inside diameter of 1 3/8-inches. Brass tube liners were used with the modified California barrel sampler. Brass tube liners are not used with the standard split spoon sampler.

The standard split spoon sampling method is the Standard Penetration Test (SPT) described by ASTM Method D-1586.

The modified California Barrel sampling method is similar to the SPT test with the difference being the sampler dimensions and the number of 6-inch intervals driven with the hammer per ASTM D3550. It is RockSol’s experience that blow counts obtained with the modified California sampler tend to be slightly greater than a standard split spoon sampler.

Penetration resistance values (blow counts) were recorded for each sampling event. Blow counts, when properly evaluated, indicate the relative density or consistency of the soils. Depths at which the samples were taken, the type of sampler used, and the blow counts that were obtained are shown on the Borehole Logs (See Appendix A).

5.0 SURFACE AND SUBSURFACE CONDITIONS

The surface and subsurface materials encountered by RockSol at our borehole locations included asphaltic pavement, road base (aggregate base course/pit run material), topsoil, fill material, native soils, and sedimentary bedrock. A brief description of the materials encountered is presented below.

5.1 Existing Asphalt Pavement Sections

Asphalt pavement was encountered in Boreholes 24-1, 24-3, 24-4, 24-7, and G-2. Asphalt pavement ranged in thickness from 3 to 15 inches.

Road base or aggregate base course (ABC) was noted at the ground surface in Boreholes 24-2, 24-6, G-1, and G-4 and ranged in thickness from 4 to 18 inches. A summary of existing pavement section thickness encountered at each borehole location is presented in Table 5.1. Pavement section thicknesses are also shown on the individual borehole logs in Appendix A.

Table 5.1 – Existing Pavement Sections

Borehole ID	Pavement Type	Pavement Thickness (in)	ABC Thickness (in)
24-1	HMA	8	NE
24-2	Road Base	NE	12
24-3	HMA	8	21.5
24-4	HMA	8.5	3.5
24-6	Road Base	NE	6
24-7	HMA	15	NE
G-1	ABC	NE	18
G-2	HMA	3	9
G-4	Road Base	NE	4

HMA = Hot Mix Asphalt; ABC = Aggregate Base Course; NE = Not Encountered

5.2 Fill Material

Fill material was encountered in boreholes 24-1, 24-3, 24-4, 24-6, 24-7, G-4 through G-6, T-1, and UP-1, and extended to depths ranging from 1 foot to 5 feet below existing grades. Fill material generally consisted of loose to dense, brown to brownish gray and black, slightly moist to moist, slightly silty and gravelly sand and sandy gravel with cobbles and clay lenses in parts.

5.3 Native Subgrade Soils

With the exception of 24-1 and G-5, native soils were encountered in all boreholes and extended to depths ranging from 5 feet (maximum depth drilled) within the pavement boreholes and to 53 feet below existing grades in the structure boreholes. Native soils encountered generally consisted of varying layers of hard to very loose, light brown to brownish gray, moist to wet, occasionally calcareous, silty to clayey sand with gravel and sandy silt in parts, and medium stiff, brown to brownish gray, moist, sandy to silty clay with iron staining in parts. The native soils encountered by RockSol are generally consistent with the alluvium and colluvium materials identified on the USGS Geological Map (See Image 3 – *Site Geology Map*) found in Section 3.0 of this report.

5.4 Sedimentary Bedrock

Sedimentary bedrock was encountered at borehole locations LC-1, LC-2, T-1, T-2 and T-3 at approximate depths ranging from 44 feet to 53 feet below existing grades (elevations ranging from 4,512 feet and 4,521 feet). Bedrock encountered consisted of very hard, dark gray, moist claystone and shale. See Table 5.2, *Approximate Bedrock Depth and Elevation* for approximate depths and elevations to bedrock.

Table 5.2 – Approximate Bedrock Depth and Elevation

Borehole I.D.	Bedrock Depth (Feet)	Bedrock Elevation (Feet)
LC-1	46	4,515.7
LC-2	44	4,516.1
T-1	46	4,521.4
T-2	53	4,512.7
T-3	53	4,513.5

5.5 Groundwater

Groundwater was encountered during drilling/sampling activities at borehole locations 24-4, G-4, LC-1, LC-2, T-1 through T-3, UP-1, and UP-2 at approximate depths ranging from 4 feet to 14 feet below existing grade at the time of drilling operations. See Table 5.3, *Approximate Groundwater Depths and Elevations* for approximate depths and elevations to groundwater, where encountered. The boreholes were backfilled at the completion of drilling/sampling operations except at Borehole UP-2 where a temporary monitoring well was installed to an approximate depth of 15 feet below existing grade for groundwater level monitoring for the proposed underpass structure.

Table 5.3 – Approximate Groundwater Depths and Elevations

Borehole I.D.	Ground Surface Elevation (Feet)	Groundwater Depth (Feet)	Groundwater Elevation (Feet)
24-1	4,553.7	NE	NE
24-2	4,554.1	NE	NE
24-3	4,559.0	NE	NE
24-4	4,562.0	4	4,558.0
24-6	4,566.0	NE	NE
24-7	4,571.8	NE	NE
G-1	4,574.8	NE	NE
G-2	4,571.2	NE	NE
G-4	4,565.3	4	4,561.3

Table 5.3 – Approximate Groundwater Depths and Elevations (Continued)

Borehole I.D.	Ground Surface Elevation (Feet)	Groundwater Depth (Feet)	Groundwater Elevation (Feet)
G-5	4,555.5	NE	NE
G-6	4,548.7	NE	NE
LC-1	4,561.7	11.5	4,550.2
LC-2	4,560.2	14.0	4,546.2
T-1	4,567.4	9	4,558.4
T-2	4,565.7	8	4,557.7
T-3	4,566.5	8	4,558.5
UP-1	4,567.0	7	4,560.0
UP-2	4,566.2	9 (during drilling) and 6 (~ 06/15/2020)	4,557.2 and 4,560.2

NE = Not Encountered to the depth drilled

Groundwater elevations are subject to change depending on climatic conditions, water flows in North Leach Creek and Leach Creek, local irrigation practices, changes in local topography, and changes in surface storm water management. Long-term monitoring of groundwater elevations is required to establish groundwater fluctuations.

6.0 LABORATORY TESTING

Soil samples retrieved from the borehole locations were examined by the project geotechnical engineer in the RockSol laboratory. Selected samples were tested and classified per the Unified Soil Classification System (USCS). The following laboratory tests were performed in accordance with the American Society for Testing and Materials (ASTM), American Association of State Highway and Transportation Officials (AASHTO), and current local practices:

- Natural Moisture Content (ASTM D-2216)
- Percent Passing No. 200 Sieve (ASTM D-1140)
- Liquid and Plastic Limits (ASTM D-4318)
- Dry Density (ASTM D-2937)
- Gradation (ASTM D 6913)
- Water-Soluble Sulfates (CDOT CP-L 2103)
- Water-Soluble Chloride Content (AASHTO T291-91)

- Standard Test Method for pH of Soils (ASTM D4972-01)
- Soil Resistivity (ASTM G187 - Soil Box)
- Soil Classification (ASTM D-2487, ASTM D-2488, and AASHTO M145)
- Swell Test (ASTM D-4546)
- Resistance Value (AASHTO T-190)

R-Values (Resistance Values) were tested by Cesare, Inc. All other laboratory tests were performed by RockSol. Laboratory test results are presented in Appendix B and are also summarized on the Borehole Logs presented in Appendix A.

7.0 SUBGRADE CHARACTERIZATION

Laboratory test results were used to characterize the engineering properties of the subsurface material encountered. For soil classification, RockSol conducted sieve analyses and Atterberg Limits tests. RockSol assigned R-Value testing based on the results of the soil classifications. Swell tests were used to determine the swell or consolidation characteristics of the subsurface materials. Lab testing was also performed on selected samples to determine the water-soluble sulfate content of subsurface materials to assist with cement type recommendations. A summary of the physical and chemical test results is included in Appendix B.

7.1 Roadway Subgrade Soil Classification

Subgrade bulk samples of existing roadway grades were obtained at various depths from each pavement borehole location and were tested for AASHTO soil classification. The subgrade soils tested varied between A-1 and A-4 AASHTO soil types. A summary of the roadway subgrade soil classifications is presented in Table 7.1.

Table 7.1 – Roadway Subgrade Soil Classifications

Borehole Location	Depth (feet)	AASHTO Classification
24-1	0.67-4	A-1-b (0)
24-2	1-4	A-6 (9)
24-3	0.67-2.5	A-1-b (0)
24-4	0.71-2	A-1-b (0)
24-6	0-4	A-4 (4)
24-7	1.25-3.5	A-1-a (0)
G-1	1.5-7	A-4 (0)
G-2	2.1-7	A-4 (0)
G-5	0-4	A-1-a (0)
G-6	0-4	A-4 (0)

7.2 Swell/Consolidation Potential of Subgrade Soils

Based on swell test results and plasticity index (PI) testing, the subgrade soils encountered within the upper 4 feet of the pavement surface of 24 Road and G Road exhibit low swell potential and low to moderate consolidation potential (-1.1 percent consolidation to 0.7 percent swell under 200 pounds per square foot (psf) surcharge pressure). Tests performed on samples obtained from Boreholes LC-1, LC-2, T-1, T-2, and T-3 for the proposed structures exhibited -2.4 to 0.4 percent swell.

Based on the swell test results and subgrade soil classifications obtained, special mitigation methods for expansive soil are not deemed necessary for new pavement construction or for the proposed G

Road over North Leach Creek structure (bridge and abutment walls), pedestrian underpass structure, and pedestrian bridge structure.

However, based on consolidation and penetration data obtained from the boreholes drilled, special mitigation is recommended for design and construction of shallow foundation systems being considered (See Section 9) due to settlement potential and constructability. Mitigation may consist of over excavation and replacement with coarse, granular material with geosynthetic fabrics and geogrids to help stabilize shallow foundation soils.

7.3 Water-Soluble Sulfate Content

Cementitious material requirements for concrete in contact with site soils or groundwater is typically based on the percentage of water-soluble sulfate. Mix design requirements for concrete exposed to water-soluble sulfates in soils or water is considered by CDOT as shown in Table 7.3a and in the CDOT Standard Specifications for Road and Bridge Construction, dated 2019. Water-soluble Sulfate Testing Results are summarized in Table 7.3b.

**Table 7.3a – Requirements to Protect Against Damage to Concrete
by Sulfate Attack from External Sources of Sulfate**

Severity of Sulfate Exposure	Water-Soluble Sulfate (SO ₄), in dry soil, percent	Sulfate (SO ₄), in water, ppm	Water Cementitious Ratio, Maximum	Cementitious Material Requirements
Class 0	0.00 to 0.10	0 to 150	0.45	Class 0
Class 1	0.11 to 0.20	151 to 1,500	0.45	Class 1
Class 2	0.21 to 2.0	1,501 to 10,000	0.45	Class 2
Class 3	2.01 or greater	10,001 or greater	0.40	Class 3

Table 7.3b – Water-Soluble Sulfate Testing Summary

Borehole I.D.	Sample Depth (Feet)	Water-Soluble Sulfate (SO ₄) in dry soil, percent	Cementitious Material Requirements
24-1	0.67 – 4	0.43	Class 2
24-2	1 – 4	0.32	Class 2
24-3	0.67 – 2.5	0.29	Class 2
24-3	2.5 – 4	0.08	Class 0
24-4	0.71 – 2	0.26	Class 2
24-4	2.1 – 4	0.37	Class 2
24-6	0 – 4	0.72	Class 2
24-7	1.25 – 3.5	1.38	Class 2
G-1	1.5 – 7	0.76	Class 2
G-2	2.1 – 7	0.40	Class 2
G-5	0 – 4	0.49	Class 2
G-6	0 – 4	0.40	Class 2
LC-1	48	0.45	Class 2
LC-2	2	1.32	Class 2
LC-2	9	0.12	Class 1
T-1	0 – 4	0.40	Class 2
T-1	24	0.13	Class 1
T-2	9	0.08	Class 0
T-2	60	0.33	Class 2
T-3	53 – 72	0.24	Class 2
UP-1	9	0.45	Class 2
UP-2	0 – 4	0.40	Class 2
UP-2	4	0.36	Class 2

The concentration of water-soluble sulfates measured in soil samples obtained from RockSol's exploratory boreholes ranged from 0.08 percent to 1.38 percent by weight. Based on the results of the water-soluble sulfate testing, concrete in contact with subgrade materials may be constructed with cement meeting the requirements for CDOT Exposure Class 2. Concrete constructed with ASTM C150 Type II, III, or V cement is appropriate for Class 2 requirements.

8.0 G ROAD OVER NORTH LEACH CREEK CROSSING FOUNDATION RECOMMENDATIONS

As part of the proposed roundabout at the intersection of G Road and 24 Road, North Leach Creek is proposed to be relocated east of its present alignment and a new crossing structure over North Leach Creek will be constructed. The North Leach Creek crossing is feasible using a bridge structure or four-sided concrete box culvert (CBC). Recommendations for both structure types are presented below.

The sedimentary bedrock encountered in the RockSol boreholes is considered suitable bearing material for supporting heavily loaded structures such as the proposed G Road bridge structure over North Leach Creek. Drilled shafts (caisson) and driven steel H-piles are feasible foundation systems for the proposed bridge structure and retaining wall abutments. Geotechnical design parameters for the deep foundation geotechnical parameters are presented in Sections 8.1 and 8.2. Due to the presence of soft to very soft subsurface soil conditions, deep foundation systems are recommended for retaining wall/wing wall structures at the bridge abutments.

A CBC structure is also feasible for the proposed G Road crossing of North Leach Creek. However, due to the presence of soft to very soft subsurface soil and groundwater conditions, ground improvement is recommended. Construction of the CBC will require excavations extend below groundwater elevations, therefore dewatering and control of groundwater during construction should be anticipated. A discussion of ground improvement mitigation for a shallow foundation system is presented in Section 8.3.

8.1 Drilled Shaft Foundation System

Drilled shafts will provide support by embedment into sedimentary bedrock. Based on the subsurface conditions encountered, it is anticipated that very hard claystone/shale bedrock will be encountered at an approximate elevation 4,513 feet.

Based on our evaluation, recommended nominal (unfactored) base resistance and nominal (unfactored) side resistance values for the bedrock material are presented in Table 8.1 for use with Load and Resistance Factor Design (LRFD) methods.

Table 8.1: Base and Side Resistance Values for Drilled Shafts in Bedrock

Bridge at G Road Over North Leach Creek	Estimated Bedrock Elevation at Borehole (feet)	Ultimate (Nominal) Resistance (LRFD)		Service Resistance (LRFD)	
		Base (ksf)	Side (ksf)	Bearing (ksf)	Side (ksf)
South Abutment	4,513.5 (T-2)	138	11.3	47	3.8
North Abutment	4,512.7 (T-3)				

The side resistance is applicable to the portion of the shaft embedded in competent bedrock. When evaluating the side resistance of the drilled shaft, the lower 1.0-diameter length above the

shaft tip should be ignored. Side resistance in the soil zone above competent bedrock should be neglected when calculating axial resistance. For LRFD strength limit state evaluation, a resistance factor of 0.55 is recommended for base/ tip resistance and a resistance factor of 0.60 is recommended for side resistance evaluation for redundant single shafts. Per AASHTO LRFD (Section 10.5.5.2.4) the resistance factors for base/tip and side resistance should be reduced by 20 percent for non-redundant single shafts.

For axial bearing, a minimum shaft embedment into bedrock of 5 feet is recommended.

Drilled shaft diameters shall be sufficient to satisfy axial, bending, and lateral load resistance requirements. In addition, the shaft diameters shall be sufficient to allow for use of casing, if required, and placement of reinforcement with adequate concrete cover.

Additional design and construction considerations for drilled shafts are presented below.

- (a) The construction of the drilled shafts should follow the guidelines specified in the “CDOT Standard Specifications for Road and Bridge Construction (SSRBC), Section 503, 2019.”
- (b) During construction of drilled shafts, casing or slurry methods may be required to support the excavation where holes are unstable due to soil and groundwater conditions. Groundwater was encountered in Boreholes (T-1 through T-3) at an approximate depth of 8 feet (approximate elevation of 4,558 feet) below the existing ground surface during drilling operations.
- (c) Prior to the placement of the concrete, the drilled shaft excavation, including the bottom, should be cleaned of all loose material. For wet conditions (more than two inches of water), concrete placement by “tremie” methods should be used.
- (d) Lateral load capacity of the drilled shafts should be evaluated. Geotechnical parameters for evaluation of lateral load capacity are provided in Table 8.2.3.
- (e) Drilled shafts should be constructed with spacing at least four shaft diameters center to center. For closely spaced drilled shafts, the axial and lateral capacities should be appropriately reduced. Group action of drilled shafts should be analyzed on an individual basis to assess the appropriate reduction.

8.2 Driven Pile Foundation System

Alternatively, the G Road bridge structure over North Leach Creek and abutment retaining wall structures may be supported on driven steel H-piles (Grade 50 steel). RockSol recommends the piles be driven to practical refusal in the bedrock. If significant penetration into bedrock (greater than 5 feet) is necessary for lateral resistance requirements, pre-drilling may be required. For the LRFD method, a nominal (ultimate) geotechnical capacity of 36 ksi, based on the cross-section area of the pile, can be used for Grade 50 steel.

During construction, pile driving shall be monitored per CDOT requirements per Section 502 of the “CDOT Standard Specifications for Road and Bridge Construction (SSRBC), 2019”. Monitoring shall be conducted using a Pile Driving Analyzer (PDA) to determine the condition of the pile, the efficiency of the hammer and the static bearing capacity of the pile, and to establish the pile driving criteria. A resistance factor of 0.65 is recommended for LRFD strength limit state design for axial compression provided PDA testing is performed.

Additional design and construction considerations for driven piles are presented below.

- (a) Steel piling, pile driving equipment, and installation of the driven steel H-piles should follow the guidelines specified in “CDOT Standard Specifications for Road and Bridge Construction (SSRBC), Section 502, 2019”.

- (b) Lateral load parameters presented in Table 8.2.1 may be used for lateral load analysis. Battered piles may be used to resist the lateral loads. The battered piles inclination should be within one (1) horizontal to four (4) vertical.
- (c) RockSol anticipates that 3 to 5 feet of pile penetration into bedrock will be required to achieve capacity. The actual length of the piles should be determined during installation.
- (d) Center to center pile spacing should not be less than 30 inches or 2.5 pile diameters. For evaluation of horizontal pile foundation movement, the effects of group interaction shall be evaluated in accordance with AASHTO LRFD Bridge Design Specifications, Section 10.7.2.4.
- (e) Pile tips should be protected against damage using driving shoes during penetration into the sedimentary bedrock.
- (f) Potential damage to adjacent properties or structures during pile installation due to noise and vibrations should be considered and evaluated, if necessary.

Lateral Resistance Parameters (Drilled Shaft and Driven Pile Foundations)

Recommended preliminary lateral resistance parameters for drilled shafts and driven piles constructed are presented in Table 8.2.1. The parameters listed are for use with LPILE® or equivalent software.

Table 8.2.1: Drilled Shaft and Driven Pile Lateral Resistance Parameters

Borehole Material	L-Pile Soil Type	Undrained Shear Strength (psf)	Angle of Internal Friction (degrees)	Subgrade Reaction Coefficient (pci)	Strain Factor ϵ_{50} (%)	Unit Weight (pcf)
CLAY, silty to sandy, above water table	Stiff clay w/o free water	500	0	500	0.015	125 (Total)
CLAY, silty to sandy, below water table	Stiff clay w/ free water	250	0	100	0.025	63 (Submerged)
GRAVEL, silty to sandy, Below water table	Sand	0	34	60	--	63 (Submerged)
Claystone/Shale Bedrock	Stiff clay w/o free water	8,000	0	2,000	0.004	125 (Total)

Total unit weight indicated in the table above includes soil plus moisture content. Depths at which groundwater were encountered are indicated on the attached borehole logs.

Lateral Earth Pressure Parameters (Bridge Abutments and Wing Walls)

To assist with design of bridge abutments, lateral earth pressure parameters are presented in Table 8.2.2 for the existing soils encountered. Also included are parameters for CDOT Class 1 Structure backfill material.

Table 8.2.2: Lateral Earth Pressure Parameters

Soil Type	Total Unit Weight (γ) pcf	Effective Friction Angle, ϕ' (degrees)	Cohesion (psf)	Lateral Earth Pressure Coefficients (Notes 1 and 2)		
				Active (k_a)	At-Rest (k_o)	Passive (k_p) (Note 3)
CDOT Class 1 Structure Backfill (CDOT Section 703.08)	125	34	0	0.28	0.44	3.54
CLAY, silty to sandy	125	0	500	0.46	0.63	2.20

Note 1: Based on Coloumb Theory of earth pressure

Note 2: For horizontal backslope and foreslope.

Note 3: Full value, no reduction applied.

8.3 CBC Structure Recommendations with Ground Improvement

Boreholes T-1 through T-3 were advanced at the approximate location of the proposed North Leach Creek CBC structure. RockSol considers a design groundwater elevation of 4,557 feet appropriate for this location. Construction of the CBC will require excavations extend below groundwater elevations, therefore dewatering and control of groundwater during construction should be anticipated.

Based on conditions encountered in RockSol Boreholes T-1 through T-3, ground improvement is recommended to achieve a service bearing resistance greater than 750 psf for a 4-sided CBC system.

At a minimum, RockSol recommends ground improvement consisting of overexcavation of subgrade soils to a minimum depth of 2 feet below the bottom of the CBC bottom slab and replacement with at least 2-feet of a crushed aggregate material meeting CDOT No. 57 Concrete Aggregate which is fully wrapped with a CDOT approved Class 1 stabilization/separator geotextile placed at 6-inch intervals. The crushed aggregate and geotextile shall extend horizontally beyond the limits of the CBC a minimum of 5 feet in each direction (north/south and east/west). Placement of the aggregate material should be in horizontal lifts with a maximum lift thickness of 6 inches. Compaction of each lift with vibratory methods using lightweight equipment is recommended. RockSol recommends placement of at least 6-inches of CDOT Class 1 Structural Fill between the top of the geotextile wrapped granular material and the bottom of the foundation.

With two feet (vertically) of aggregate materials, RockSol considers a service bearing resistance of 1.0 ksf appropriate. If greater service bearing resistance is required, additional thickness of replaced subgrade soil is required. Bearing resistances, based on replacement thicknesses of aggregate is presented in Table 8.3.

Table 8.3 - Bearing Resistances for Shallow Foundations After Ground Improvement

Overexcavation And Replacement Thickness (No. 57 Material)	Strength Limit State (LRFD)		Service Limit State (LRFD)
	Ultimate (Nominal) Resistance (ksf)	Factored Resistance (ksf)	Service Bearing Resistance (LRFD) (ksf)
2 feet	4.6	2.1	1.0
3 feet	5.9	2.6	1.5
4 feet	7.7	3.4	2.0

A resistance factor of 0.45 is used to determine the factored bearing resistance for LRFD strength limit state evaluation. Service limit state, service bearing resistance is estimated to correspond to a total settlement of less than 1-inch. RockSol assumes a minimum foundation width of 6 feet for the CBC.

A representative of the geotechnical engineer should observe all foundation excavations prior to placement of the geotextile and aggregate material.

9.0 G ROAD PEDESTRIAN UNDERPASS FOUNDATION RECOMMENDATIONS

A pedestrian underpass is being considered adjacent to the new G Road over North Leach Creek bridge or CBC structure. The underpass would allow for approximately 8 feet to 10 feet of clearance for pedestrians. The bottom of the underpass would likely be approximately 12 feet below the top of pavement on G Road. The bottom of the underpass would be at an approximate elevation of 4,554 feet, which will be approximately 6 feet below the groundwater elevation.

A four-sided concrete box culvert (CBC) structure is feasible for the proposed pedestrian underpass structure. However, due to the presence of soft to very soft subsurface soil and groundwater conditions, ground improvement is recommended. Construction of the CBC will require excavations extend below groundwater elevations, therefore dewatering and control of groundwater during construction should be anticipated. A permanent subsurface drainage system will also be required to control groundwater after construction. A discussion of ground improvement mitigation for a shallow foundation system is presented in Section 9.1.

9.1 Underpass Foundation Recommendations with Ground Improvement

Boreholes UP-1 and UP-2 were advanced at the general location of the proposed underpass CBC structure. RockSol considers a design groundwater elevation of 4,560 feet appropriate for this location. Borehole information from T-1 through T-3 was also used for providing geotechnical recommendations for the pedestrian underpass structure, if elected to attach the pedestrian underpass CBC structure to the G Road over North Leach Creek structure.

Based on conditions encountered in RockSol Boreholes UP-1, UP-2, and T-1 through T-3 ground improvement is recommended to achieve a service bearing resistance greater than 750 psf for a 4-sided CBC system.

At a minimum, RockSol recommends ground improvement consisting of overexcavation of subgrade soils to a minimum depth of 2 feet below the bottom of the CBC bottom slab and replacement with at least 2-feet of a crushed aggregate material meeting CDOT No. 57 Concrete Aggregate which is fully wrapped with a CDOT approved Class 1 stabilization/separator geotextile placed at 6-inch intervals. The crushed aggregate and geotextile shall extend horizontally beyond the limits of the CBC a minimum of 5 feet in each direction (north/south and east/west). Placement of the aggregate material should be in horizontal lifts with a maximum lift thickness of 6 inches. Compaction of each lift with vibratory methods using lightweight equipment is recommended. RockSol recommends placement of at least 6-inches of CDOT Class 1 Structural Fill between the top of the geotextile wrapped granular material and the bottom of the foundation.

With two feet (vertically) of aggregate materials, RockSol considers a service bearing resistance of 1.0 ksf appropriate. If greater service bearing resistance is required, additional thickness of replaced subgrade soil is required. Bearing resistances, based on replacement thicknesses of aggregate is presented in Table 9.1.

Table 9.1 - Bearing Resistances for Shallow Foundations After Ground Improvement

Overexcavation And Replacement Thickness (No. 57 Material)	Strength Limit State (LRFD)		Service Limit State (LRFD)
	Ultimate (Nominal) Resistance (ksf)	Factored Resistance (ksf)	Service Bearing Resistance (LRFD) (ksf)
2 feet	4.6	2.1	1.0
3 feet	5.9	2.6	1.5
4 feet	7.7	3.4	2.0

A resistance factor of 0.45 is used to determine the factored bearing resistance for LRFD strength limit state evaluation. Service limit state, service bearing resistance is estimated to correspond to a total settlement of less than 1-inch. RockSol assumes a minimum foundation width of 6 feet for the CBC.

A representative of the geotechnical engineer should observe all foundation excavations prior to placement of the geotextile and aggregate material.

10.0 PEDESTRIAN BRIDGE OVER LEACH CREEK FOUNDATION RECOMMENDATIONS

The sedimentary bedrock encountered in the RockSol boreholes is considered suitable bearing material for supporting structures such as the proposed pedestrian bridge at the confluence of Leach Creek and North Leach Creek, approximately 1,000 feet south of the corner of 24 Road and G Road. Drilled shafts (caisson) and driven steel H-piles are feasible foundation systems for the proposed pedestrian bridge structure. Geotechnical design parameters for the deep foundation are presented in Sections 10.1 and 10.2. Shallow foundations with ground improvement may also be feasible due to the lighter loads encountered in a pedestrian bridge.

10.1 Drilled Shaft Foundation System

Drilled shafts will provide support by embedment into sedimentary bedrock. Based on the subsurface conditions encountered, it is anticipated that very hard claystone/shale bedrock will be encountered at an approximate elevation 4,516 feet.

Based on our evaluation, recommended nominal (unfactored) base resistance and nominal (unfactored) side resistance values for the bedrock material are presented in Table 10.1 for use with Load and Resistance Factor Design (LRFD) methods.

Table 10.1: Base and Side Resistance Values for Drilled Shafts in Bedrock

Pedestrian Bridge Over Leach Creek	Estimated Bedrock Elevation at Borehole (feet)	Ultimate (Nominal) Resistance (LRFD)		Service Resistance (LRFD)	
		Base (ksf)	Side (ksf)	Bearing (ksf)	Side (ksf)
North Caisson	4,516 (LC-1)	138	11.3	47	3.8
South Caisson	4,516 (LC-2)				

The side resistance is applicable to the portion of the shaft embedded in competent bedrock. When evaluating the side resistance of the drilled shaft, the lower 1.0-diameter length above the shaft tip should be ignored. Side resistance in the soil zone above competent bedrock should be neglected when calculating axial resistance. For LRFD strength limit state evaluation, a resistance factor of 0.55 is recommended for base/ tip resistance and a resistance factor of 0.60 is recommended for side resistance evaluation for redundant single shafts. Per AASHTO LRFD

(Section 10.5.5.2.4) the resistance factors for base/tip and side resistance should be reduced by 20 percent for non-redundant single shafts.

For axial bearing, a minimum shaft embedment into bedrock of 5 feet is recommended.

Drilled shaft diameters shall be sufficient to satisfy axial, bending, and lateral load resistance requirements. In addition, the shaft diameters shall be sufficient to allow for use of casing, if required, and placement of reinforcement with adequate concrete cover.

Additional design and construction considerations for drilled shafts are presented below.

- (f) The construction of the drilled shafts should follow the guidelines specified in the “CDOT Standard Specifications for Road and Bridge Construction (SSRBC), Section 503, 2019.”
- (g) During construction of drilled shafts, casing or slurry methods may be required to support the excavation where holes are unstable due to soil and groundwater conditions. Groundwater was encountered in Boreholes LC-1 and LC-2 at an approximate depth 11.5 and 14 feet (approximate elevation of 4,549 and 4,546 feet), respectively, below the existing ground surface during drilling operations.
- (h) Prior to the placement of the concrete, the drilled shaft excavation, including the bottom, should be cleaned of all loose material. For wet conditions (more than two inches of water), concrete placement by “tremie” methods should be used.
- (i) Lateral load capacity of the drilled shafts should be evaluated. Geotechnical parameters for evaluation of lateral load capacity are provided in Table 10.2.
- (j) Drilled shafts should be constructed with spacing at least four shaft diameters center to center. For closely spaced drilled shafts, the axial and lateral capacities should be appropriately reduced. Group action of drilled shafts should be analyzed on an individual basis to assess the appropriate reduction.

10.2 Driven Pile Foundation System

Alternatively, the proposed pedestrian bridge over Leach Creek may be supported on driven steel H-piles (Grade 50 steel). RockSol recommends the piles be driven to practical refusal in the bedrock. If significant penetration into bedrock (greater than 5 feet) is necessary for lateral resistance requirements, pre-drilling may be required.

For the LRFD method, a nominal (ultimate) geotechnical capacity of 36 ksi, based on the cross-section area of the pile, can be used for Grade 50 steel.

During construction, pile driving shall be monitored per CDOT requirements per Section 502 of the “CDOT Standard Specifications for Road and Bridge Construction (SSRBC), 2019”. Monitoring shall be conducted using a Pile Driving Analyzer (PDA) to determine the condition of the pile, the efficiency of the hammer and the static bearing capacity of the pile, and to establish the pile driving criteria. A resistance factor of 0.65 is recommended for LRFD strength limit state design for axial compression provided PDA testing is performed.

Additional design and construction considerations for driven piles are presented below.

- (g) Steel piling, pile driving equipment, and installation of the driven steel H-piles should follow the guidelines specified in “CDOT Standard Specifications for Road and Bridge Construction (SSRBC), Section 502, 2019”.
- (h) Lateral load parameters presented in Table 10.2 may be used for lateral load analysis. Battered piles may be used to resist the lateral loads. The battered piles inclination should be within one (1) horizontal to four (4) vertical.

- (i) RockSol anticipates that 3 to 5 feet of pile penetration into bedrock will be required to achieve capacity. The actual length of the piles should be determined during installation.
- (j) Center to center pile spacing should not be less than 30 inches or 2.5 pile diameters. For evaluation of horizontal pile foundation movement, the effects of group interaction shall be evaluated in accordance with AASHTO LRFD Bridge Design Specifications, Section 10.7.2.4.
- (k) Pile tips should be protected against damage using driving shoes during penetration into the sedimentary bedrock.
- (l) Potential damage to adjacent properties or structures during pile installation due to noise and vibrations should be considered and evaluated, if necessary.

Lateral Resistance Parameters (Drilled Shaft and Driven Pile Foundations)

Recommended preliminary lateral resistance parameters for drilled shafts and driven piles constructed are presented in Table 10.2. The parameters listed are for use with LPILE® or equivalent software.

Table 10.2: Drilled Shaft and Driven Pile Lateral Resistance Parameters

Borehole Material	L-Pile Soil Type	Undrained Shear Strength (psf)	Angle of Internal Friction (degrees)	Subgrade Reaction Coefficient (pci)	Strain Factor ϵ_{50} (%)	Unit Weight (pcf)
CLAY, silty to sandy, above water table	Stiff clay w/o free water	500	0	500	0.015	125 (Total)
CLAY, silty to sandy, below water table	Stiff clay w/ free water	250	0	100	0.025	63 (Submerged)
SAND, with gravel, Below water table	Sand	0	34	60	--	63 (Submerged)
Claystone/Shale Bedrock	Stiff clay w/o free water	8,000	0	2,000	0.004	125 (Total)

Total unit weight indicated in the table above includes soil plus moisture content. Depths at which groundwater were encountered are indicated on the attached borehole logs.

10.3 Shallow Foundation Recommendations with Ground Improvement

Boreholes LC-1 and LC-2 were advanced at the approximate location of the abutments for the proposed pedestrian bridge structure. RockSol considers a design groundwater elevation of 4,549 feet appropriate for this location.

Based on conditions encountered in RockSol Boreholes LC-1 and LC-2, ground improvement is recommended to achieve a service bearing resistance greater than 750 psf for a shallow foundation system.

At a minimum, RockSol recommends ground improvement consisting of overexcavation of subgrade soils to a minimum depth of 2 feet below the bottom of the foundation bottom slab and replacement with at least 2-feet of a crushed aggregate material meeting CDOT No. 57 Concrete

Aggregate which is fully wrapped with a CDOT approved Class 1 stabilization/separator geotextile placed at 6-inch intervals. The crushed aggregate and geotextile shall extend horizontally beyond the limits of the CBC a minimum of 5 feet in each direction (north/south and east/west). Placement of the aggregate material should be in horizontal lifts with a maximum lift thickness of 6 inches. Compaction of each lift with vibratory methods using lightweight equipment is recommended. RockSol recommends placement of at least 6-inches of CDOT Class 1 Structural Fill between the top of the geotextile wrapped granular material and the bottom of the foundation.

With two feet (vertically) of aggregate materials, RockSol considers a service bearing resistance of 1.0 ksf appropriate. If greater service bearing resistance is required, additional thickness of replaced subgrade soil is required. Bearing resistances, based on replacement thicknesses of aggregate is presented in Table 10.3.

Table 10.3 - Bearing Resistances for Shallow Foundations After Ground Improvement

Overexcavation And Replacement Thickness (No. 57 Material)	Strength Limit State (LRFD)		Service Limit State (LRFD)
	Ultimate (Nominal) Resistance (ksf)	Factored Resistance (ksf)	Service Bearing Resistance (LRFD) (ksf)
2 feet	4.6	2.1	1.0
3 feet	5.9	2.6	1.5
4 feet	7.7	3.4	2.0

A resistance factor of 0.45 is used to determine the factored bearing resistance for LRFD strength limit state evaluation. Service limit state, service bearing resistance is estimated to correspond to a total settlement of less than 1-inch. RockSol assumes a minimum foundation width of 6 feet for the foundation system.

A representative of the geotechnical engineer should observe all foundation excavations prior to placement of the geotextile and aggregate material.

11.0 PAVEMENT DESIGN RECOMMENDATIONS

New pavement is planned for the proposed 24 Road and G Road traffic circle (roundabout) and sections of 24 Road and G Road. Pavement thickness evaluation for development of flexible and rigid pavement design recommendations within the City of Grand Junction right of way was performed in accordance with *Chapter 29.32 – Pavements and Truck Routes* (April 21, 2004) in the City of Grand Junction Municipal Code, *AASHTO Guide for the Design of Pavements* (1993 with the 1998 update for rigid pavement) and the *Guideline for the Design and Use of Asphalt Pavements for Colorado Roadways* (January, 2006), published by the Colorado Asphalt Pavement Association. Correlation of subgrade soil R-Value to Resilient Modulus for this report was performed using the latest correlation used by the Colorado Asphalt Pavement Association. 24 Road is classified as principal arterial and G Road is classified as minor arterial by the City.

11.1 Traffic Loading

Traffic loading was estimated for a 30-year design life in accordance with the City of Grand Junction Municipal Code (Chapter 29.32). The largest of the two vehicle counts for both G road and 24 Road approaching the intersection were taken from the 2035 projections of average daily traffic provided by Fehr and Peers as the midpoint traffic load given the design life. They were then used separately to calculate the equivalent single axle loading (ESALs) on the roadway sections and added together to estimate loading on the roundabout pavement. The 2 percent heavy vehicle ratio was considered for combination trucks, and Rocksol assumed a conservative estimate of 13 percent single axle trucks in the total traffic count.

Traffic data and projections are available in Appendices C through E.

11.2 Pavement Subgrade Characterization

Subgrade bulk samples within the upper four feet of existing roadway grades were obtained at each borehole location and were tested for AASHTO soil classification. The subgrade soils tested classified as A-1-a, A-1-b, A-2-4, A-4, and A-6 AASHTO soil types (See Sections 5.2 and 5.3).

Based on R-Value testing, an R-Value of 20 with a corresponding subgrade resilient modulus value of 4,940 psi was used by RockSol as the design R-value for evaluation of new pavement constructed on the existing site soils.

To provide an appropriate structural transitional material for flexible pavement (HMA), RockSol recommends a subbase soil layer of CDOT Class 1 aggregate base course (ABC) be included as part of the pavement design section in addition to the CDOT Class 6 ABC directly underlying the pavement. A structural coefficient of 0.12 was used for Class 6 ABC, 0.11 for Class 1 ABC and 0.44 for HMA. The Class 1 ABC must have an R-Value of at least 70 and the Class 6 ABC must have an R-Value of at least 78.

For pavement design, RockSol is providing individual pavement thickness recommendations for the roundabout and the adjacent connecting roadways.

11.3 Pavement Section Recommendations

A summary of the recommended pavement section thicknesses for flexible pavement constructed over CDOT Class 6 ABC placed on existing soils and on CDOT Class 1 ABC subbase soils, and rigid pavement placed on CDOT Class 6 ABC over existing soils in the roundabout section is presented in Table 11.3a and the pavement design output sheets are included in Appendix C.

**Table 11.3a – Pavement Section Thickness Recommendations
(24 Road and G Road Roundabout) (30 Year Design Life)**

Subgrade/Subbase	Structural Layering	Material Type	Thickness
Existing Soils (R-Value = 20)	HMA Over CDOT Class 6 ABC	HMA	10.25 inches
		ABC	8 inches
Existing Soils (R-Value = 20)	PCCP Over CDOT Class 6 ABC	PCCP	9 inches
		CDOT Class 6 ABC	8 inches
CDOT Class 1 ABC Over Existing Soils	HMA Over CDOT Class 6 ABC Over CDOT Class 1 ABC	HMA	6 inches
		CDOT Class 6 ABC	8 inches
		CDOT Class 1 ABC	16 inches

HMA = Hot Mix Asphalt; ABC = Aggregate Base Course; PCCP = Portland Cement Concrete Pavement

A summary of the recommended pavement section thicknesses for flexible pavement constructed over CDOT Class 6 ABC placed on existing soils and on CDOT Class 1 ABC subbase soils, and rigid pavement placed on CDOT Class 6 ABC over existing soils at 24 Road is presented in Table 11.3b and the pavement design output sheets are included in Appendix D.

**Table 11.3b – Pavement Section Thickness Recommendations (24 Road)
(30 Year Design Life)**

Subgrade/Subbase	Structural Layering	Material Type	Thickness
Existing Soils (R-Value = 20)	HMA Over CDOT Class 6 ABC	HMA	9.5 inches
		ABC	8 inches
Existing Soils (R-Value = 20)	PCCP Over CDOT Class 6 ABC	PCCP	8.5 inches
		CDOT Class 6 ABC	8 inches
CDOT Class 1 ABC Over Existing Soils	HMA Over CDOT Class 6 ABC Over CDOT Class 1 ABC	HMA	6 inches
		CDOT Class 6 ABC	8 inches
		CDOT Class 1 ABC	14 inches

HMA = Hot Mix Asphalt; ABC = Aggregate Base Course; PCCP = Portland Cement Concrete Pavement

A summary of the recommended pavement section thicknesses for flexible pavement constructed over CDOT Class 6 ABC placed on existing soils and on CDOT Class 1 ABC subbase soils, and rigid pavement placed on CDOT Class 6 ABC over existing soils at G Road is presented in Table 10.3c and the pavement design output sheets are included in Appendix E.

**Table 11.3c – Pavement Section Thickness Recommendations (G Road)
(30 Year Design Life)**

Subgrade/Subbase	Structural Layering	Material Type	Thickness
Existing Soils (R-Value = 20)	HMA Over CDOT Class 6 ABC	HMA	8.5 inches
		ABC	8 inches
Existing Soils (R-Value = 20)	PCCP Over CDOT Class 6 ABC	PCCP	7.5 inches
		CDOT Class 6 ABC	8 inches
CDOT Class 1 ABC Over Existing Soils	HMA Over CDOT Class 6 ABC Over CDOT Class 1 ABC	HMA	6 inches
		CDOT Class 6 ABC	8 inches
		CDOT Class 1 ABC	10 inches

HMA = Hot Mix Asphalt; ABC = Aggregate Base Course; PCCP = Portland Cement Concrete Pavement

HMA pavement shall consist of CDOT-approved mix designs. The full depth of new HMA should consist of S(100) PG 64-22 or SX(100) PG 64-22 materials to resist rutting damage. ABC should consist of material meeting CDOT Class 5 or 6 Aggregate Base Course and subbase should consist of material meeting CDOT Class 1 Aggregate Base Course per CDOT 703.03. Concrete pavement shall have transverse joint spacing of 12 feet with a panel width of 12 feet and use 1.25-inch diameter (#9) dowels to resist faulting. Concrete mix designs shall consist of CDOT-approved mixes for pavements.

11.4 Subgrade Preparation (Prior to Pavement Construction)

Prior to construction of new pavements on subgrade soils, the underlying subgrade should be properly prepared by removal of all organic matter (topsoil), debris, loose material, and any deleterious material identified by the Project Engineer followed by scarification, moisture conditioning and recompaction. The minimum depth of scarification, moisture conditioning and re-compaction in all cases shall be 6 inches. Cobbles greater than 6 inches in diameter, if encountered, should be removed from the scarification zone.

Prior to pavement section construction, subgrade proof rolling with pneumatic tire equipment shall be performed using a minimum axle load of 18 kips per axle after specified subgrade compaction has been obtained. Areas found to be weak and those areas which exhibit soft spots, non-uniform deflection or excessive deflection as determined by the project engineer shall be ripped, scarified, wetted or dried if necessary, and re-compacted to the requirements for density and moisture. Complete coverage of the proof roller will be required. The use of flyash to assist with subgrade stabilization is acceptable if the contractor proposes to use it.

All pavement subgrade preparation, including final proof-rolling, pavement materials, and pavement construction shall conform to the *Guideline for the Design and Use of Asphalt Pavements for Colorado Roadways* (January 2006). The subgrade should be compacted to a uniform density of 95 percent of the maximum density determined by the Standard or Modified Proctor density (ASTM D698 or ASTM D1557). See Table 11.3 for the required compaction standard by soil type.

Table 11.3 –Roadway Subgrade Compaction Specifications

AASHTO Classification	Minimum Relative Compaction (Percentage of MDD), %	Moisture Content (Deviation from OMC)
A-1-a, A-1-b, A-2-4, A-4	95% of ASTM D1557	-3 to +3
A-6, A-7-6	95% of ASTM D698	-2 to +2

MDD = Maximum Dry Density; OMC = Optimum Moisture Content

Based on the results of our field and laboratory tests, A-1-a, A-1-b, A-2-4, A-4 and A-6 soils are anticipated to be encountered at existing pavement subgrade elevations within the project limits.

12.0 EARTHWORK

North Leach Creek Backfill Recommendations

As part of the proposed roundabout at the intersection of G Road and 24 Road, North Leach Creek is proposed to be relocated east of its present alignment. The approximate layout has been provided by the City of Grand Junction (See Figure 8). The new G Road and 24 Road intersection will be constructed over backfill material placed within the old alignment of North Leach Creek once it is relocated. This backfill zone of North Leach Creek is estimated to be approximately 350 linear feet along the eastern side of 24 Road. RockSol understands the existing utilities will be removed and/or abandoned following removal of the existing 24 Road bridge over North Leach Creek.

Due to the presence of soft to very soft subsurface soil and groundwater conditions, ground improvement is recommended for the proposed backfilling operations to reduce settlement potential within the new roadway improvements. Control of groundwater during backfill placement should be anticipated. Based on data collected from Boreholes T-1 through T-3, RockSol considers a design groundwater elevation of 4,557 feet appropriate for this location.

Prior to placing backfill, RockSol recommends ground improvement consisting of overexcavating North Leach Creek soil/sediment deposits and vegetation (creek muck) to a minimum depth of 12-inches and subsequent placement with at least 3-feet of a crushed aggregate material meeting CDOT No. 57 Concrete Aggregate, which is fully wrapped with a CDOT approved Class 1 stabilization geotextile placed at 12-inch intervals. A total of 3 stabilization/separator geotextile layers are recommended. Before placing the first layer of stabilization geotextile and No. 57 rock,

a layer of pit run material consisting of sands, gravel, and rock/cobble may be used following the muck removal to provide a working platform layer. Consultation with the geotextile manufacture/contractor to ensure proper soil/rock/geotextile interaction is recommended.

The crushed aggregate (No. 57 rock) and geotextile shall extend a minimum of 12-inches horizontally into the creek bank slope. The ends of each layer of geotextile must also extend upward at least 12-inches along the interface of the aggregate fill and the creek bank soil to prevent site soils from migrating into the fill aggregate. Placement of the aggregate material should be in horizontal lifts with a maximum lift thickness of 6 inches. Compaction of each lift using lightweight vibratory equipment is recommended. Each lift of aggregate backfill material should be compacted with a minimum of 3 complete passes of the vibratory compaction equipment.

Above the 3-foot stabilized zone, CDOT Class 2 Aggregate Base Course material is recommended as backfill up to the final pavement section subgrade elevation.

New Embankment

To accommodate widening of 24 Road and G Road, new embankment may be required along the roadway alignments. At some locations minor cuts may be required. Materials used to construct embankments, roadway side slopes, structure backfill, and aggregate base course materials should meet the material and moisture density control requirements specified in Article IV of the Mesa County Standard Specifications for Road and Bridge Construction and City of Grand Junction Transportation Engineering Design Standards (current editions).

At a minimum, the ground surface underlying all embankment fills should be carefully prepared by removing all organic matter (topsoil), scarification to a minimum depth of 6 inches and recompacting to the requirements for maximum dry density and moisture content listed in Table 11.1 of this report prior to fill placement.

Where fill material is to be placed on existing slopes steeper than 4 (H):1 (V), benching must be performed to tie the new fill into the existing slope. Benching into the existing slopes shall allow sufficient bench width to accommodate placing and compaction equipment to operate in a horizontal orientation.

Broken concrete, broken asphalt, or other solid materials more than 6 inches in greatest dimension shall not be placed within embankment areas supporting the roadway shoulders and pavement structure. Claystone materials shall not be used for construction of new embankment. Imported fill material used for embankment constructed shall be compatible with designed side slopes. Material excavated from utility trenches may be used for backfilling provided it does not contain unsuitable material or particles larger than 3 inches. Unsuitable material includes, but is limited to, topsoil, vegetation, brush, sod, trash, and other deleterious substances.

13.0 SEISMICITY DISCUSSION

13.1 General

Boreholes LC-1, LC-2, T-1, T-2 and T-3 terminated at depths ranging from approximately 48 feet to 72 feet below existing grades at the G Road and North Leach Creek crossing and the proposed pedestrian bridge over Leach Creek location. Based on the subsurface conditions encountered, including blow counts and laboratory testing, it is our opinion that the subject structure sites meet criteria for Seismic Site Class E, as defined by AASHTO LRFD Table 3.10.3.1-1. Shear wave velocity testing was not performed by RockSol. Soil conditions necessary for Site Class F were not encountered in RockSol's boreholes.

For final design, RockSol recommends performing shear wave velocity testing or performing penetration tests to a depth of 100 feet if determination of Seismic Site Class D conditions is necessary. Seismic design parameters for Seismic Site Class E are discussed below.

13.2 Seismic Design Parameters

Seismic design parameters were obtained from the *2017 AASHTO Guide Specifications for LRFD Seismic Bridge Design*. Interpolated values for Peak Ground Acceleration Coefficient (PGA), Spectral Response Acceleration Parameter for Short Period (S_s), and Spectral Response Acceleration Parameter at 1-s Period (S_1) were obtained using Figures 3.10.2.1-1, 3.10.2.1-2 and 3.10.2.1-3 of the *2017 AASHTO Guide Specifications for LRFD Seismic Bridge Design* for the project site. The seismic acceleration coefficients obtained from the Design Maps are presented in Table 13.2.1.

Table 13.2.1 – Seismic Acceleration Coefficients

G Road and 24 Road Project (Latitude°/Longitude°)	Peak Ground Acceleration (PGA)	Spectral Acceleration Coefficient - S_s (Period 0.2 sec)	Spectral Acceleration Coefficient - S_1 (Period 1.0 sec)
(39° 06' 22.73"/ -108° 36' 29.45")	0.08	0.16	0.045

The acceleration coefficients are then used to obtain Site Factors F_{pga} , F_a , and F_v based on the defined Site Class as shown in Tables 3.10.3.2-1, 3.10.3.2-2 and 3.10.3.2-3 of the *2017 AASHTO Guide Specifications for LRFD Seismic Bridge Design*. A summary of the Site Factor values obtained are shown in Table 13.2.2.

Table 13.2.2 – Seismic Site Factor Values

G Road and 24 Road Project (Latitude°/Longitude°)	F_{pga} (at zero-period on acceleration spectrum)	F_a (for short period range of acceleration spectrum)	F_v (for long period range of acceleration spectrum)
(39° 06' 22.73"/ -108° 36' 29.45")	2.5	2.5	3.5

Values for S_1 and F_v are presented in Tables 13.2.1 and 13.2.2, shown above. The seismic design category was determined with the *2017 AASHTO Guide Specifications for LRFD Seismic Bridge Design* Table 3.10.6-1. Table 13.2.3 summarizes the Seismic Design Category determination and horizontal response spectral Acceleration Coefficients (S_{DS} and S_{D1}) obtained for the proposed structure. Seismic Performance Zone determination is based on the value of the horizontal response spectral Acceleration Coefficient, S_{D1} , as determined by Eq. 3.10.4.2-6 and S_{DS} , as determined by Eq. 3.10.4.2-3 of the *2017 AASHTO Guide Specifications for LRFD Seismic Bridge Design*.

Table 13.2.3 – Seismic Performance Zone

G Road and 24 Road Project (Latitude°/Longitude°)	Acceleration Coefficient (S_{D1})	Seismic Zone ⁽¹⁾	Acceleration Coefficient, S_{DS}
(39° 06' 22.73"/ -108° 36' 29.45")	0.157	2	0.4

Note 1: Seismic Zone 2 is assigned when $0.15 < S_{D1} \leq 0.30$.

14.0 OTHER DESIGN AND CONSTRUCTION CONSIDERATIONS

Proper construction practices, in accordance with City of Grand Junction Transportation Engineering Design Standards and Mesa County Standard Specifications for Road and Bridge Construction (current editions), should be followed during site preparation, earthwork, excavations, roadway and bridge construction, and embankment and retaining wall construction for the suitable long-term performance of the proposed improvements. Excavation support should be provided to maintain onsite safety and the stability of excavations and slopes. Excavations shall be constructed in accordance with local, state and federal regulations including OSHA guidelines. The contractor must provide a competent person to determine compliance with OSHA excavation requirements. For preliminary planning, existing fill material and native soils may be considered as OSHA Type C soils.

Surface drainage patterns may be altered during construction and local landscape irrigation (if any) must be controlled to prevent excessive moisture infiltration into the subgrade soils during and after construction.

Environmentally contaminated material, if encountered, should be characterized and removed under the direction of the project environmental consultant. Design and construction plans should be reviewed, and onsite construction should be observed by the professional engineers.

15.0 LIMITATIONS

This geotechnical investigation was conducted in general accordance with the scope of work. RockSol's geotechnical practices are similar to those used in Colorado with similar soil conditions and based on our understanding of the proposed work. This report has been prepared for use by the City of Grand Junction for the project described in this report. The report is based on our exploratory boreholes and does not consider variations in the subsurface conditions that may exist between boreholes. Additional investigation is required to address such variation. If during construction activities, materials or water conditions appear to be different from those described herein, RockSol should be advised at once so that a re-evaluation of the recommendations presented in this report can be made. RockSol is not responsible for liability associated with interpretation of subsurface data by others.

Borehole Location Plan Sheets



Figure 1 – Boreholes 24-1 and 24-2



Figure 2 – Boreholes 24-3 and 24-4

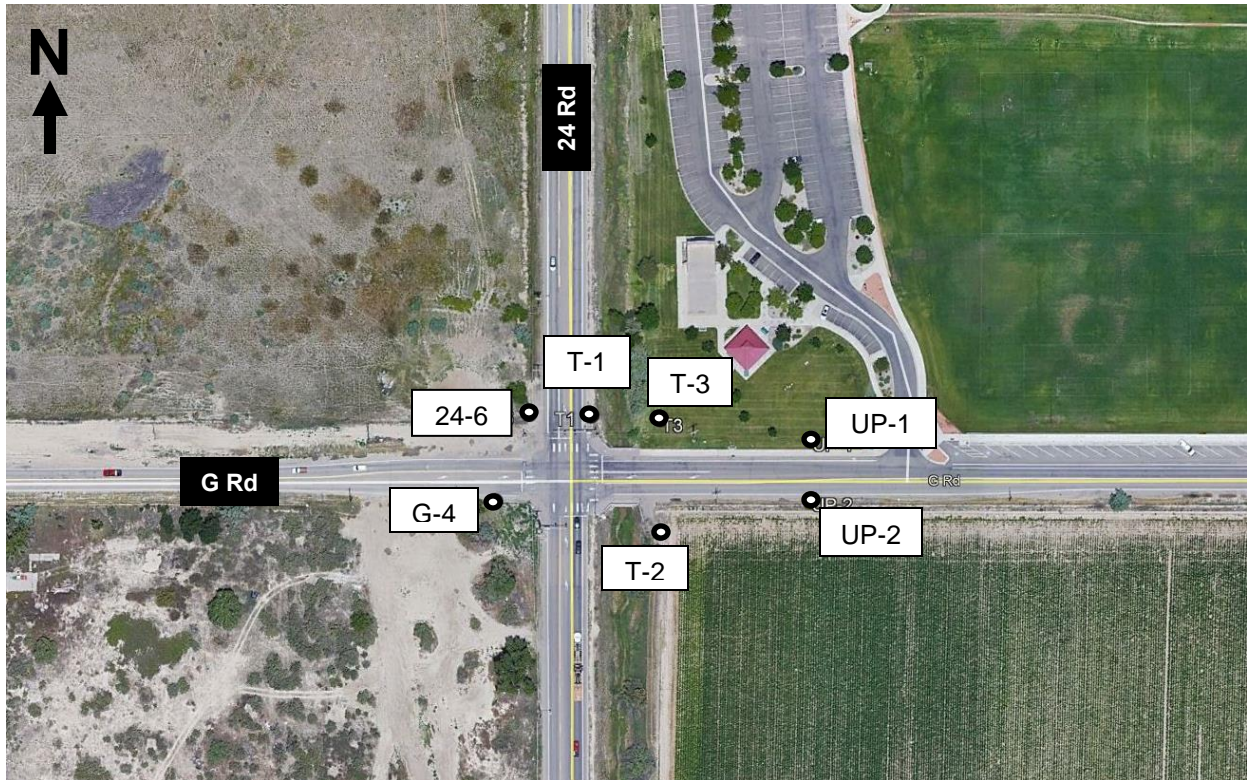


Figure 3 – Boreholes 24-6, G-4, T-1, T-2, T-3, UP-1, and UP-2



Figure 4 – Borehole 24-7



Figure 5 – Boreholes G-1 and G-2

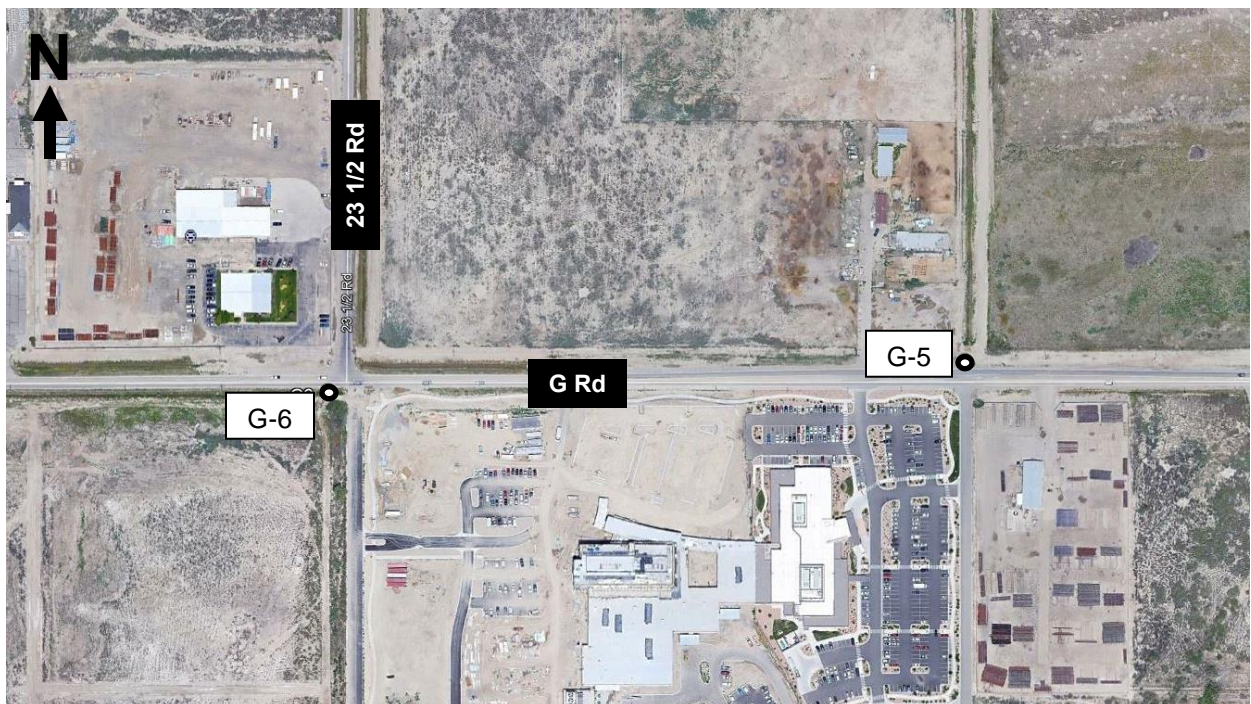


Figure 6 – Boreholes G-5 and G-6

Proposed Pedestrian Bridge Location over Leach Creek


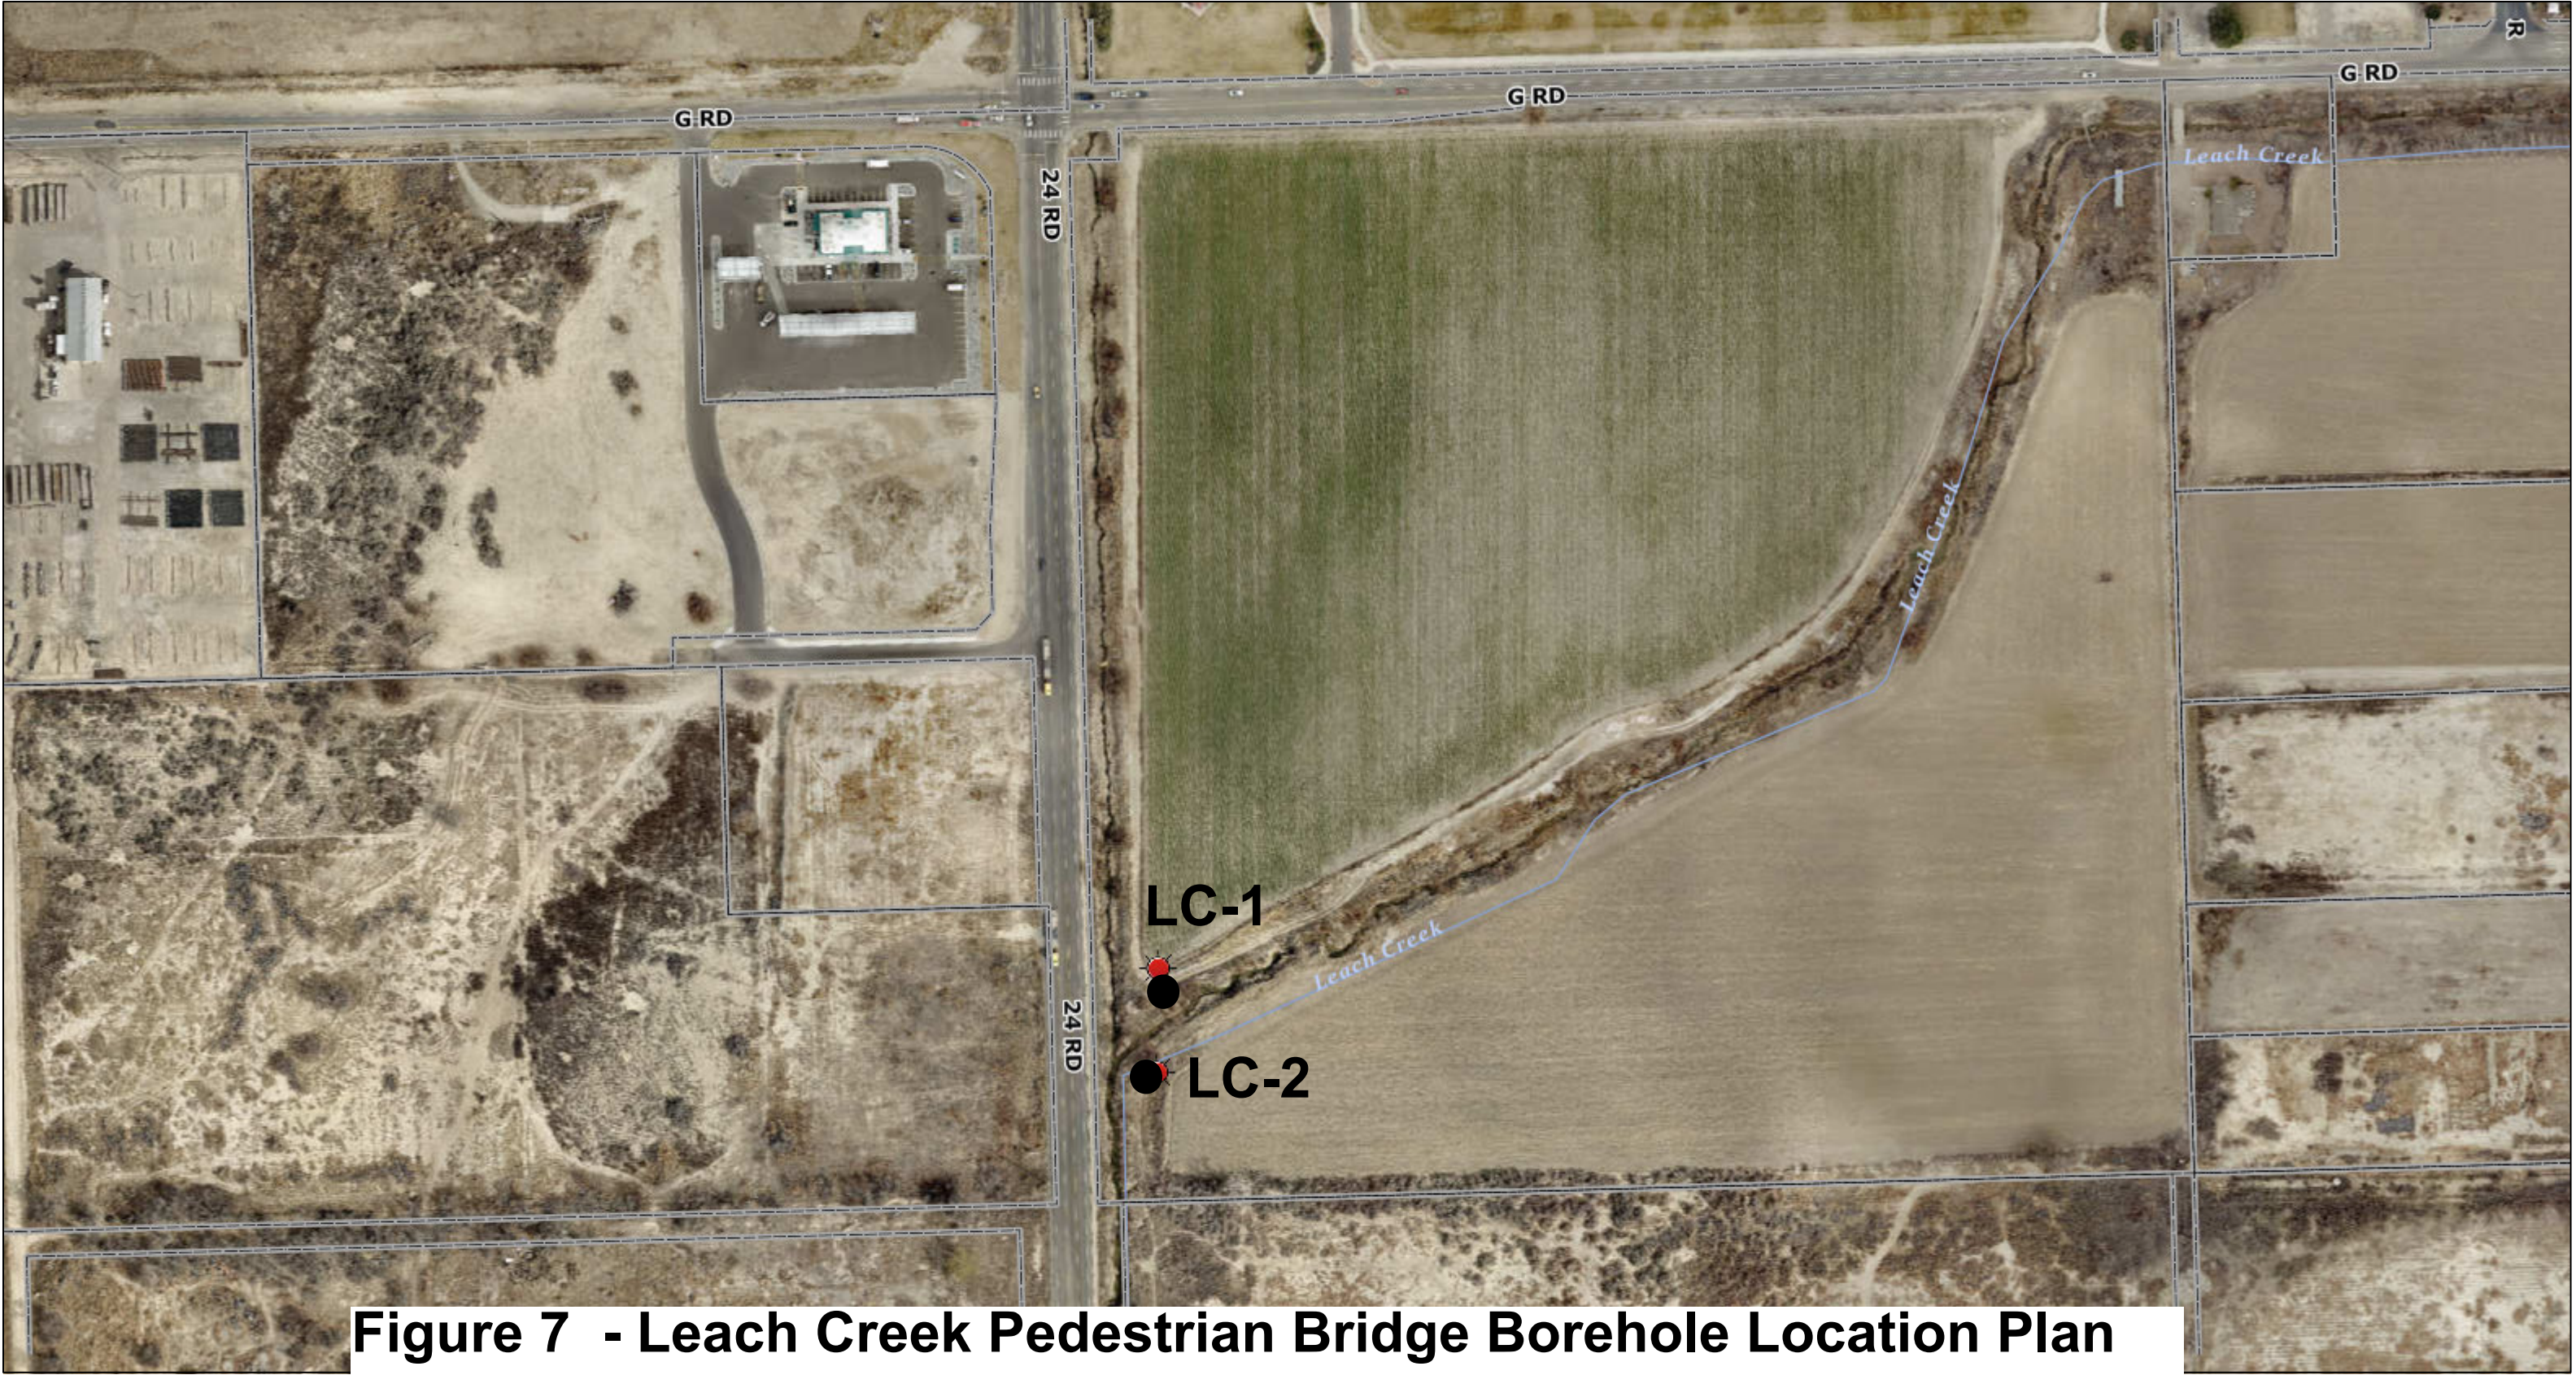



Figure 7 - Leach Creek Pedestrian Bridge Borehole Location Plan

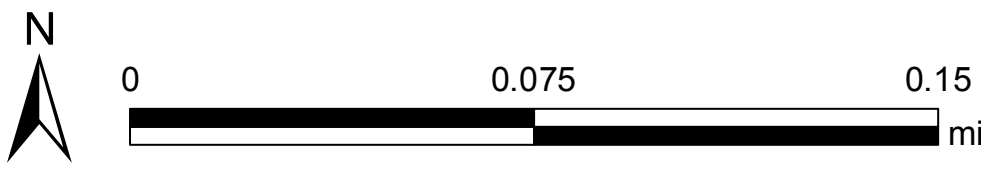

Date: 7/8/2020

1 inch = 188 feet

Figure 8: North Leach Creek Realignment Conceptual Plan

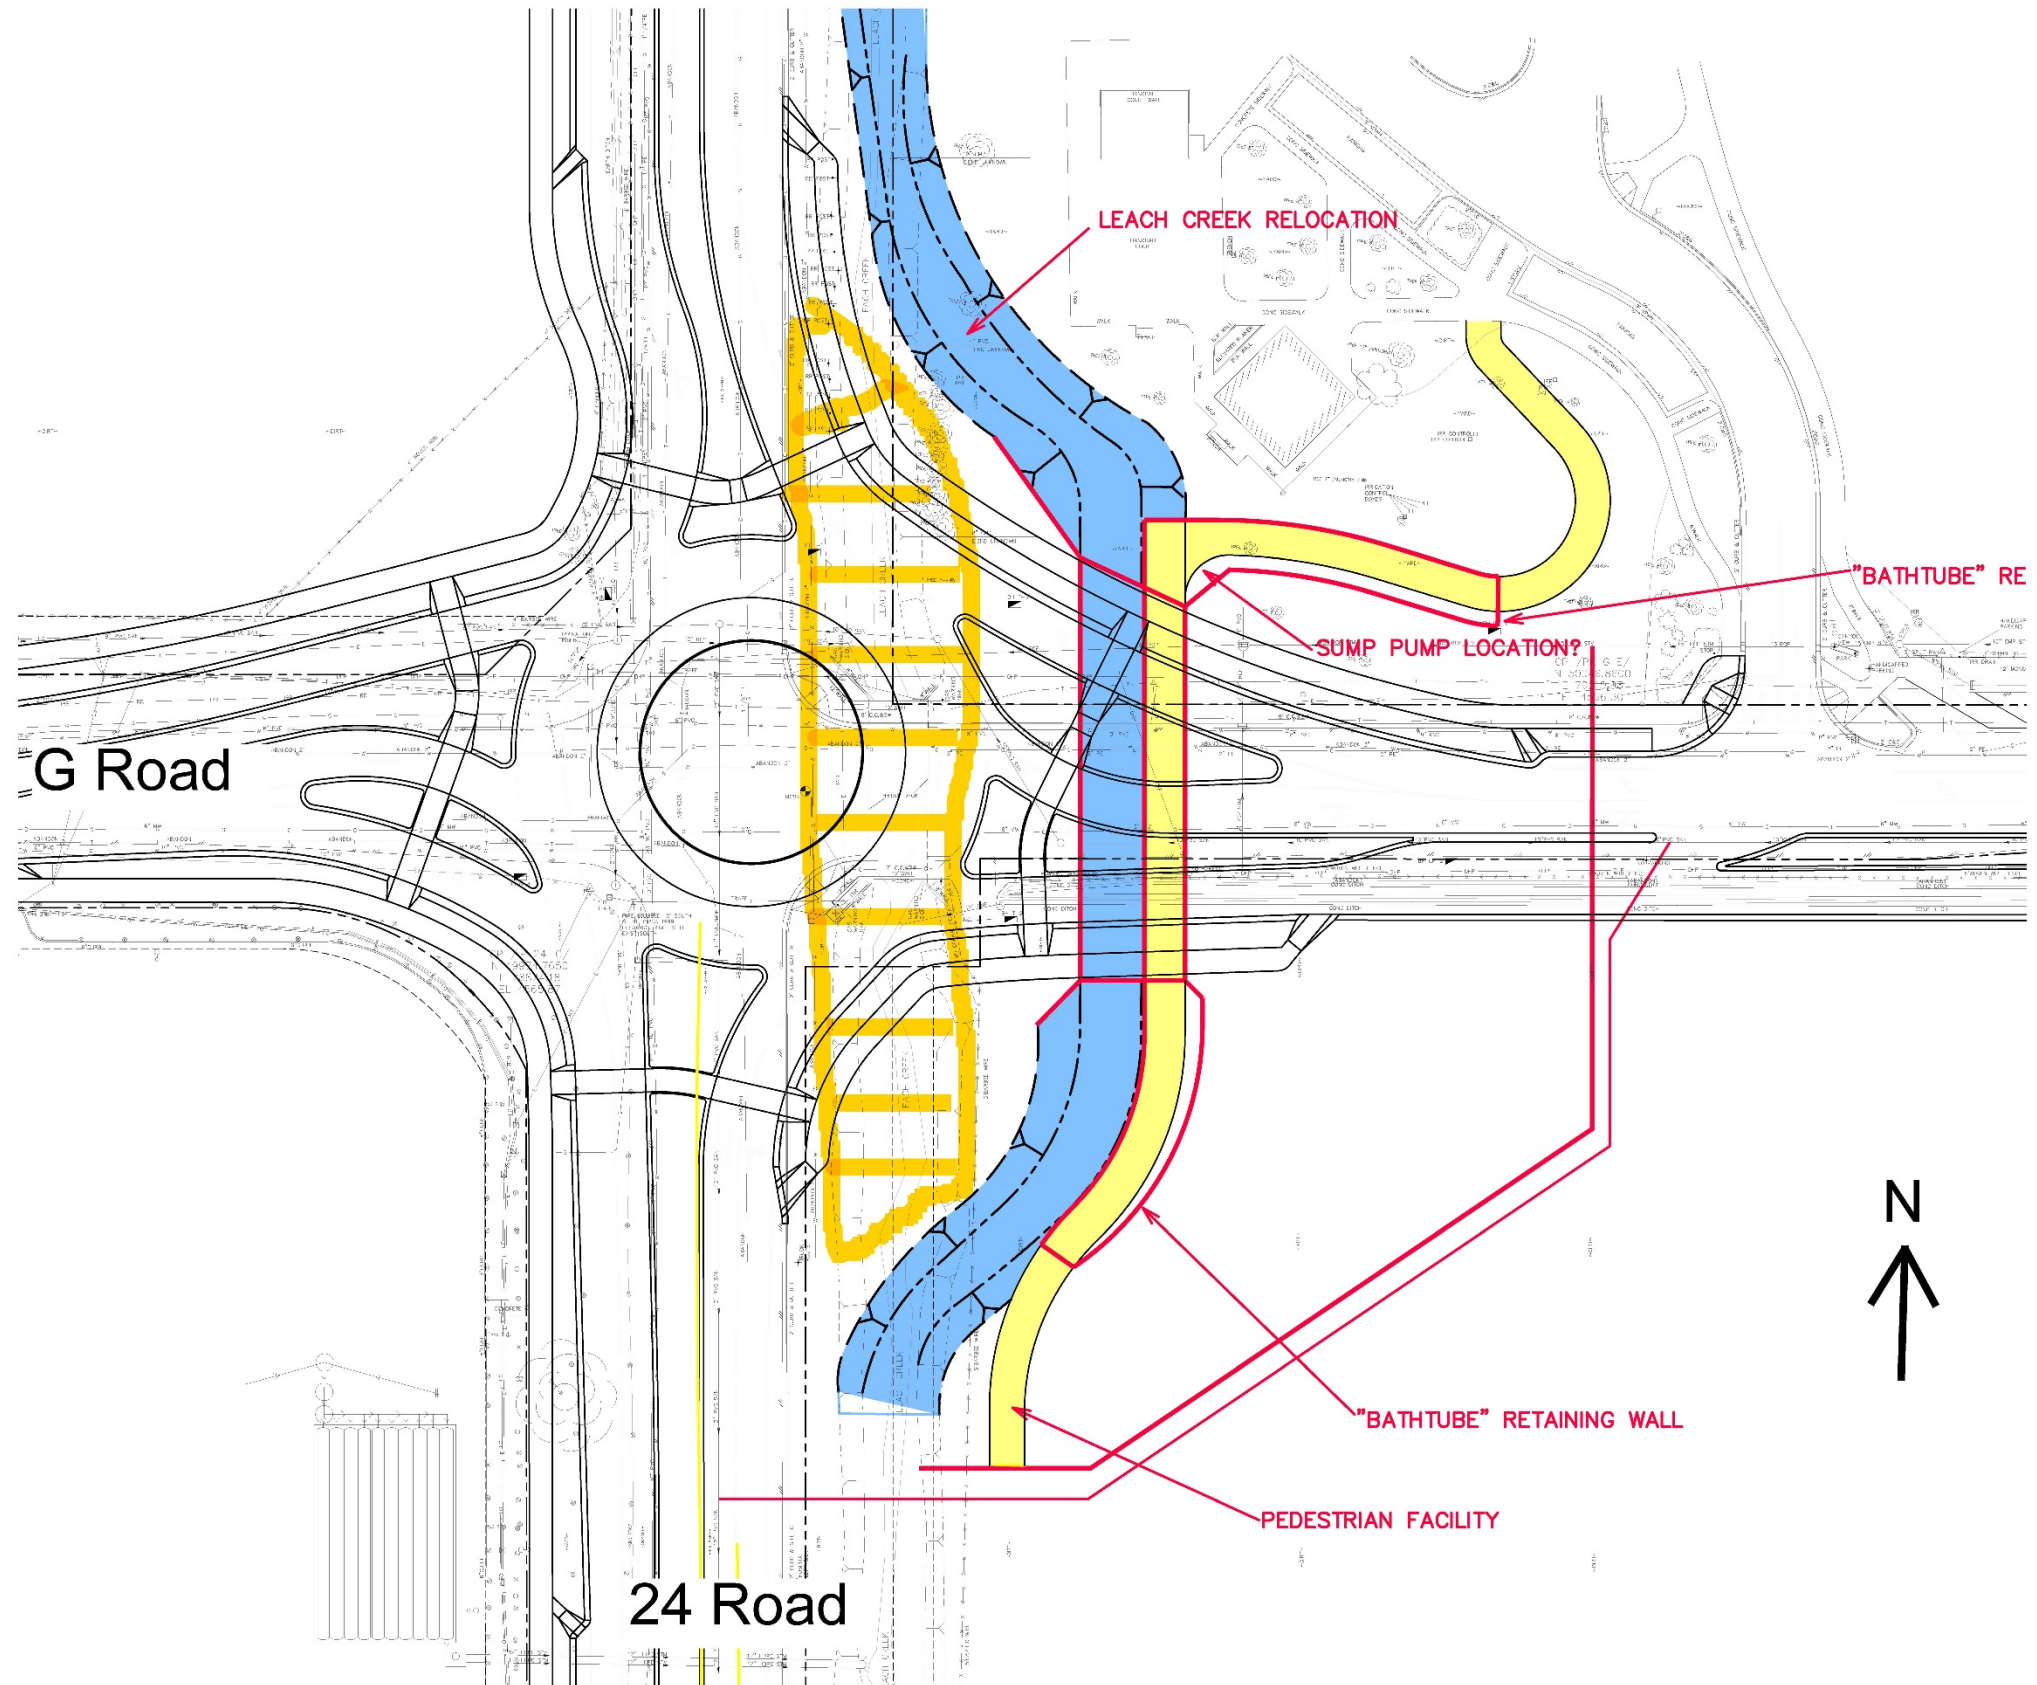

APPENDIX A

LEGEND AND INDIVIDUAL BOREHOLE LOGS












CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements





PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

LITHOLOGY

- | | | | |
|---|-------------------------------|---|-------------------------------------|
|  | Asphalt Pavement |  | Fill - Aggregate Base Course |
|  | Fill - SAND |  | Fill - SAND |
|  | TOPSOIL |  | Native - SAND |
|  | Native - SAND, silty |  | Native - SAND, gravelly |
|  | Native - SAND, clayey |  | Native - CLAY |
|  | Native - CLAY, silty |  | Native - CLAY, sandy |
|  | Native - SILT |  | Native - SILT, sandy |
|  | Native - GRAVEL, silty |  | Bedrock - CLAYSTONE |

SAMPLE TYPE

- | | | | |
|---|---|---|--|
|  | Bulk Sample (Auger Cuttings) |  | GRAB SAMPLE FROM CUTTINGS |
|  | MODIFIED CALIFORNIA SAMPLER
2.5" O.D. AND 2" I.D.
WITH BRASS LINERS INCLUDED |  | SPLIT SPOON SAMPLER
2" O.D. AND 1 3/8" I.D.
NO LINERS |






15/12 Indicates 15 blows of a 140 pound hammer falling 30 inches was required to drive the sampler 12 inches.

50/11 Indicates 50 blows of a 140 pound hammer falling 30 inches was required to drive the sampler 11 inches.

5,5,5 Indicates 5 blows, 5 blows, 5 blows of a 140 pound hammer falling 30 inches was required to drive the sampler 18 inches.




▼ GROUND WATER LEVEL NOTED AT THE TIME OF DRILLING

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 6/9/20 **COMPLETED** 6/9/20 **GROUND ELEVATION** 4553.7 ft **STATION NO.** _____
DRILLING CONTRACTOR McCracken Drilling **NORTH** 78849.2 **EAST** 46796.2
DRILLING METHOD Solid Stem Auger **HOLE SIZE** 4.0" **BORING LOCATION:** SB 24 Rd, outside shoulder
LOGGED BY R. Lepro **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES ~2' W of white edge line **WATER DEPTH** None Encountered on 6/9/20

ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
4553.7	0		Asphalt pavement, approximately 8" thick										
4552.7	1		(Fill) SAND, slightly silty and gravelly to with silt and gravel, slightly moist to moist, brown, medium dense to loose Approximate Bulk Depth 0.67-4 Liquid Limit= NP Plastic Limit= NP Plasticity Index= NP Fines Content= 17.8 Sulfate= 0.43	BULK			0.43			NP	NP	NP	17.8
4551.7	2			MC	28/12			121.7	3.2	NP	NP	NP	11.8
4550.7	3												
4549.7	4			MC	7/12			106.2	20.1				
4548.7	5		Bottom of hole at 5.0 feet.										







LOG - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ 7/23/20

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 6/9/20 **COMPLETED** 6/9/20 **GROUND ELEVATION** 4554.1 ft **STATION NO.** _____
DRILLING CONTRACTOR McCracken Drilling **NORTH** 78832.6 **EAST** 47363.1
DRILLING METHOD Solid Stem Auger **HOLE SIZE** 4.0" **BORING LOCATION:** SB 24 Rd, off shoulder
LOGGED BY R. Lepro **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES NW corner of F 1/2 Rd & 24 Rd **WATER DEPTH** None Encountered on 6/9/20

ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
4554.1	0		(Aggregate Base Course) SAND, gravelly, approximately 12" thick Approximate Bulk Depth 0-1 Liquid Limit= NP Plastic Limit= NP Plasticity Index= NP Fines Content= 18.5	BULK						NP	NP	NP	18.5
4553.1	1		(Native) CLAY, with sand, silty, moist, brown, medium stiff Approximate Bulk Depth 1-4 Liquid Limit= 30 Plastic Limit= 16 Plasticity Index= 14 Fines Content= 78.5 Sulfate= 0.32	BULK			0.32			30	16	14	78.5
4552.1	2		(Native) CLAY, with sand, moist, brownish gray, medium stiff, iron staining	MC	6/12			105.9	14.5				85.9
4551.1	3												
4550.1	4			MC	5/12		0.1	104.1	17.7				
4549.1	5		Bottom of hole at 5.0 feet.										





LOG - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ 7/24/20

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 6/9/20 **COMPLETED** 6/9/20 **GROUND ELEVATION** 4559.0 ft **STATION NO.** _____
DRILLING CONTRACTOR McCracken Drilling **NORTH** 78895.7 **EAST** 48502.0
DRILLING METHOD Solid Stem Auger **HOLE SIZE** 4.0" **BORING LOCATION:** NB 24 Rd, outside shoulder
LOGGED BY R. Lepro **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES ~2" E of white edge line & ~1000' N of F 1/2 Rd **WATER DEPTH** None Encountered on 6/9/20

ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
4559.0	0		Asphalt pavement, approximately 8" thick										
4558.0	1		(Aggregate Base Course) SAND, slightly silty to gravelly with CLAY, slightly moist to moist, brownish gray, medium dense to dense Approximate Bulk Depth 0.67-2.5 Liquid Limit= NP Plastic Limit= NP Plasticity Index= NP Fines Content= 16.0 Sulfate= 0.29	BULK			0.29			NP	NP	NP	16.0
4557.0	2		(Native) SAND, silty to clayey with sandy SILT in parts, moist, brownish gray, medium dense to dense Approximate Bulk Depth 2.5-4 Liquid Limit= NP Plastic Limit= NP Plasticity Index= NP Fines Content= 40.9 Sulfate= 0.08	MC BULK	32/12		0.08	129.1	7.5	NP	NP	NP	34.2
4556.0	3		(Native) SAND, trace silt and gravel, moist, brown, medium dense	MC	10/12			111.7	8.8				
4555.0	4		(Native) SAND, trace silt and gravel, moist, brown, medium dense	MC	10/12								
4554.0	5		Bottom of hole at 5.0 feet.										







LOG - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ 7/23/20

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 6/9/20 **COMPLETED** 6/9/20 **GROUND ELEVATION** 4562.0 ft **STATION NO.** _____
DRILLING CONTRACTOR McCracken Drilling **NORTH** 78886.0 **EAST** 49277.7
DRILLING METHOD Solid Stem Auger **HOLE SIZE** 4.0" **BORING LOCATION:** NB 24 Rd, outside shoulder
LOGGED BY R. Lepro **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES ~2" E of white edge line **WATER DEPTH** 4' on 6/9/20

ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
4562.0	0		Asphalt pavement, approximatley 8.5" thick										
4561.0	1		(Aggregate Base Course) SAND, gravelly (Fill) SAND, slightly silty to gravelly, slightly moist to moist, brown, medium dense to dense Approximate Bulk Depth 0.71-2 Liquid Limit= NP Plastic Limit= NP Plasticity Index= NP Fines Content= 15.1 Sulfate= 0.26	BULK			0.26			NP	NP	NP	15.1
4560.0	2		(Native) SILT, sandy with clayey SAND in parts, slightly moist to moist, brownish gray, hard Approximate Bulk Depth 2-4 Liquid Limit= NP Plastic Limit= NP Plasticity Index= NP Fines Content= 60.7 Sulfate= 0.37	BULK MC	34/12	0.0	0.37	127.5	10.0	NP	NP	NP	60.7
4559.0	3												
4558.0	4		(Native) SAND, with gravel to gravelly, wet, brown, very loose	MC	3/12			102.9	21.6				
4557.0	5		Bottom of hole at 5.0 feet.										







LOG - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ 7/23/20

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 6/9/20 **COMPLETED** 6/9/20 **GROUND ELEVATION** 4566.0 ft **STATION NO.** _____
DRILLING CONTRACTOR McCracken Drilling **NORTH** 78830.4 **EAST** 50076.0
DRILLING METHOD Solid Stem Auger **HOLE SIZE** 4.0" **BORING LOCATION:** NW corner of 24 Rd & G Rd
LOGGED BY R. Lepro **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES off shoulder, ~15' W & 50' N **WATER DEPTH** None Encountered on 6/9/20

ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
4566.0	0		(Aggregate Base Course) SAND, gravelly, approximately 6" thick	BULK			0.72			26	17	9	68.8
4565.0	1		(Fill) SAND, silty to gravelly in parts, CLAY lenses in parts, slightly moist, brown, loose Approximate Bulk Depth 0-4 Liquid Limit= 26 Plastic Limit= 17 Plasticity Index= 9 Fines Content= 68.6 Sulfate= 0.72										
4564.0	2			MC	7/12			111.2	8.3				22.6
4563.0	3												
4562.0	4		(Native) SAND, clayey to silty, moist, brown, loose	MC	9/12		-0.8	111.9	16.2				
4561.0	5		Bottom of hole at 5.0 feet.										








LOG - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ 7/23/20

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 6/9/20 **COMPLETED** 6/9/20 **GROUND ELEVATION** 4571.8 ft **STATION NO.** _____
DRILLING CONTRACTOR McCracken Drilling **NORTH** 78851.2 **EAST** 51211.2
DRILLING METHOD Solid Stem Auger **HOLE SIZE** 4.0" **BORING LOCATION:** SB 24 Rd, in lane
LOGGED BY R. Lepro **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES On inside white edge line **WATER DEPTH** None Encountered on 6/9/20

ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
4571.8	0		Asphalt pavement, approximately 15" thick										
4570.8	1		(Fill) SAND, gravelly with SILT lenses in parts, slightly moist to moist, brown, medium dense	BULK			1.38			NP	NP	NP	14.1
4569.8	2		Approximate Bulk Depth 1.25-3.5 Liquid Limit= NP Plastic Limit= NP Plasticity Index= NP Fines Content= 14.1 Sulfate= 1.38	MC	18/12			120.3	13.1				66.4
4568.8	3												
4567.8	4		(Native) CLAY, sandy, moist, brown, medium stiff	MC	7/12	-0.7		111.8	18.0				
4566.8	5		Bottom of hole at 5.0 feet.										





LOG - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ 7/23/20

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 6/9/20 **COMPLETED** 6/9/20 **GROUND ELEVATION** 4574.8 ft **STATION NO.** _____
DRILLING CONTRACTOR McCracken Drilling **NORTH** 81368.3 **EAST** 49988.8
DRILLING METHOD Solid Stem Auger **HOLE SIZE** 4.0" **BORING LOCATION:** EB G Rd
LOGGED BY R. Lepro **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES Off shoulder **WATER DEPTH** None Encountered on 6/9/20








ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
4574.8	0.0		(Aggregate Base Course) SAND, gravelly, approximately 18" thick Approximate Grab Sample Depth 0-1.5 Liquid Limit= NP Plastic Limit= NP Plasticity Index= NP Fines Content= 10.0	 GB						NP	NP	NP	10.0
			(Native) SAND, silty, fine to coarse grained, slightly moist to moist, light brown to brown, medium dense to loose, calcareous Approximate Bulk Depth 1.5-7 Liquid Limit= NP Plastic Limit= NP Plasticity Index= NP Fines Content= 40.0 Sulfate= 0.76	 BULK			0.76			NP	NP	NP	40.0
4572.3	2.5			 MC	22/12			112.0	6.3				
				 MC	6/12			106.3	16.1				
4569.8	5.0												
			Bottom of hole at 7.0 feet.										

LOG - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ 7/24/20

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 6/9/20 **COMPLETED** 6/9/20 **GROUND ELEVATION** 4571.2 ft **STATION NO.** _____
DRILLING CONTRACTOR McCracken Drilling **NORTH** 80314.4 **EAST** 50018.9
DRILLING METHOD Solid Stem Auger **HOLE SIZE** 4.0" **BORING LOCATION:** WB G Rd, outside shoulder
LOGGED BY R. Lepro **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES ~3" N of white edge line **WATER DEPTH** None Encountered on 6/9/20







ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
4571.2	0.0		Asphalt pavement, approxiamtely 3" thick										
			(Aggregate Base Course) SAND, gravelly, approximately 9" thick Approximate Bulk Depth 0.25-1.5 Liquid Limit= 19 Plastic Limit= 16 Plasticity Index= 3 Fines Content= 23.3	BULK						19	16	3	23.3
			(Native) SAND, silty to slightly clayey in parts, moist, brown, medium dense to loose Approximate Bulk Depth 2-7 Liquid Limit= NP Plastic Limit= NP Plasticity Index= NP Fines Content= 68.2 Sulfate= 0.40	BULK MC	11/12		0.40	104.9	12.0	NP	NP	NP	60.6 68.2
4568.7	2.5			MC									
				MC	6/12		-0.1	114.5	15.8				
4566.2	5.0												
			Bottom of hole at 7.0 feet.										

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 6/9/20 **COMPLETED** 6/9/20 **GROUND ELEVATION** 4565.3 ft **STATION NO.** _____
DRILLING CONTRACTOR McCracken Drilling **NORTH** 78800.2 **EAST** 49978.8
DRILLING METHOD Solid Stem Auger **HOLE SIZE** 4.0" **BORING LOCATION:** EB G Rd, off shoulder
LOGGED BY R. Lepro **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES SW corner of G Rd & 24 Rd **WATER DEPTH** 4.0 ft on 6/9/20

ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
4565.3	0		(Aggregate Base Course) SAND, gravelly, approximately 4" thick										
			(Fill) SAND, silty to gravelly, moist, medium dense										
4564.3	1		(Native) SAND, silty to slightly clayey in parts, moist, brown, loose, gilsinite dust control odor noted	BULK									
4563.3	2		Approximate Bulk Depth 1.5-4	MC	6/12	0.0		108.4	18.7				
4562.3	3												
4561.3	4		(Native) SAND, silty with sandy CLAY lenses in parts, wet, brownish gray, loose, minor iron staining	MC	3/12	-1.1		99.2	23.8				
4560.3	5		Bottom of hole at 5.0 feet.										






LOG - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ 7/23/20

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 6/9/20 **COMPLETED** 6/9/20 **GROUND ELEVATION** 4555.5 ft **STATION NO.** _____
DRILLING CONTRACTOR McCracken Drilling **NORTH** 77564.8 **EAST** 50040.8
DRILLING METHOD Solid Stem Auger **HOLE SIZE** 4.0" **BORING LOCATION:** WB G Rd, off shoulder
LOGGED BY R. Lepro **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES _____ **WATER DEPTH** None Encountered on 6/9/20

ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)	
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX		
4555.5	0		(Fill) SAND, gravelly with silt and trace clay, with cobbles in parts, slightly moist to moist, brown and dark gray, medium dense to dense <u>Approximate Bulk Depth 0-4</u> Liquid Limit= 24 Plastic Limit= 18 Plasticity Index= 6 Fines Content= 11.9 Sulfate= 0.49	BULK			0.49			24	18	6	11.9	
4554.5	1													
4553.5	2			MC	18/12			114.7	7.0	NP	NP	NP	35.7	
4552.5	3													
4551.5	4			MC	31/12			124.6	5.6					
4550.5	5		Bottom of hole at 5.0 feet.											


LOG - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ 7/23/20

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 6/9/20 **COMPLETED** 6/9/20 **GROUND ELEVATION** 4548.7 ft **STATION NO.** _____
DRILLING CONTRACTOR McCracken Drilling **NORTH** 76215.5 **EAST** 49980.8
DRILLING METHOD Solid Stem Auger **HOLE SIZE** 4.0" **BORING LOCATION:** EB G Rd, off shoulder
LOGGED BY R. Lepro **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES _____ **WATER DEPTH** None Encountered on 6/9/20

ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
4548.7	0		(Fill) SAND, silty with gravel and cobbles Approximate Bulk Depth 0-4 Liquid Limit= NP Plastic Limit= NP Plasticity Index= NP Fines Content= 50.0 Sulfate= 0.4	BULK			0.40			NP	NP	NP	50.0
4547.7	1												
4546.7	2		(Native) CLAY, sandy with silt, moist, brown, very stiff, slightly calcareous	MC	17/12			113.9	12.6				
4545.7	3		(Native) SAND, silty, slightly clayey in parts, moist, brown, loose										
4544.7	4			MC	6/12			114.2	8.7				
4543.7	5		Bottom of hole at 5.0 feet.										




LOG - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ 7/23/20

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 7/24/20 **COMPLETED** 7/24/20 **GROUND ELEVATION** 4561.7 ft **STATION NO.** _____
DRILLING CONTRACTOR DA Smith **NORTH** 78973.5 **EAST** 48927.3
DRILLING METHOD Hollow Stem Auger **HOLE SIZE** 8.0" **BORING LOCATION:** North side of Leach Creek
LOGGED BY D. Hamer **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES ~1,000 ft S of G Rd & ~100' E of 24 Rd **WATER DEPTH** 11.5 ft on 7/24/20

ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)	
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX		
4561.7	0		(Native) CLAY, silty to sandy, moist to wet, brown to light brown, very soft	MC BULK			0.16			25	18	7	75.5	
			Approximate Bulk Depth 0-5 Liquid Limit= 25 Plastic Limit= 18 Plasticity Index= 7 Fines Content= 75.5 Sulfate= 0.16	MC	3/12			107.1	19.9					82.0
4551.7	10		MC	1/12		-0.6		93.1	25.1	25	20	5		
			MC	1/12				97.8	27.9				91.8	
4541.7	20		MC	1/12		-1.4		99.2	24.4	25	16	9		
			MC	2/12				100.9	26.4				99.7	
4531.7	30		MC	6/12				102.9	23.1					
			(Native) SAND, with gravel, wet, light brown, loose	MC	1/12			101.0	23.8	NP	NP	NP	12.3	
4521.7	40		SS	13/32/26					15.7	NP	NP	NP	4.7	
			(Native) SAND, with gravel, wet, light brown, dense to very dense											
		(Bedrock) SHALE/CLAYSTONE, moist, dark gray, very hard	SS	50/2.5		0.45		10.4				80.6		
		Bottom of hole at 49.3 feet.	SS	50/2.5				10.1						

LOG - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ 11/13/20

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 7/24/20 **COMPLETED** 7/24/20 **GROUND ELEVATION** 4560.2 ft **STATION NO.** _____
DRILLING CONTRACTOR DA Smith **NORTH** 78963.8 **EAST** 48846.9
DRILLING METHOD Hollow Stem Auger **HOLE SIZE** 8.0" **BORING LOCATION:** South side of Leach Creek
LOGGED BY D. Hamer **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES ~1,100' S of G Rd & ~100' E of 24 Rd **WATER DEPTH** 14.0 ft on 7/24/20

ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
4560.2	0		(Native) CLAY, sandy to silty, moist to wet, brown, very soft	MC	3/12	-0.5	1.32	105.5	20.1	24	18	6	93.1
	MC			2/12									
4550.2	10			MC	1/12	0.12	98.9	23.7					
				MC	1/12	-0.3	106.0	22.4	20	19	1		
4540.2	20			MC	1/12		72.7	18.3					
4530.2	30		(Native) SAND, with cobbles, dense	SS	36/14/10				16.2				28.9
4520.2	40			SS	52/1.5			23.5					
			(Bedrock) SHALE/CLAYSTONE, moist, dark gray, very hard	SS	50/2			7.5					76.2
			Bottom of hole at 49.2 feet.										






LOG - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ 11/5/20

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 6/10/20 **COMPLETED** 6/10/20 **GROUND ELEVATION** 4567.4 ft **STATION NO.** _____
DRILLING CONTRACTOR McCracken Drilling **NORTH** 78901.3 **EAST** 50090.1
DRILLING METHOD Solid Stem Auger **HOLE SIZE** 4.25" **BORING LOCATION:** NE corner of 24 Rd & G Rd
LOGGED BY R. Lepro **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES Proposed bridge location **WATER DEPTH** 9.0 ft on 6/10/20

ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
4567.4	0		(Fill) SAND, clayey to silty, gravel in parts, slightly moist, brown	BULK			0.40			NP	NP	NP	43.6
			(Native) CLAY, sandy, moist, brown, medium stiff, slightly calcareous	MC	6/12	0.4		110.7	14.2				
			(Native) CLAY, sandy to silty with SAND lenses in parts, wet, brown with gray to brown, soft	MC	2/12	-0.3		98.2	26.8				
4557.4	10		Approximate Bulk Depth 0-4 Liquid Limit= NP Plastic Limit= NP Plasticity Index= NP Fines Content= 43.6 Sulfate= 0.4	MC	2/12			150.8	24.9				77.1
			(Native) CLAY, sandy to silty with SAND lenses in parts, wet, gray brown, medium stiff to stiff	MC	6/12		0.13	95.4	25.9				
4547.4	20			MC	11/12			105.6	23.4				85.1
4537.4	30		(Native) GRAVEL, sandy with cobbles, wet, brown, dense										
4527.4	40		(Native) CLAY, sandy, (weathered CLAYSTONE), iron staining	SS	6/7/7				22.7				75.9
			(Bedrock) CLAYSTONE, sandy, moist, very hard	SS	50/6								
			Bottom of hole at 48.0 feet.										









LOG - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ 7/23/20

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 6/12/20 **COMPLETED** 6/12/20 **GROUND ELEVATION** 4565.7 ft **STATION NO.** _____
DRILLING CONTRACTOR McCracken Drilling **NORTH** 78968.8 **EAST** 49964.2
DRILLING METHOD Solid Stem Auger **HOLE SIZE** 4.25" **BORING LOCATION:** SE corner of 24 Rd & G Rd
LOGGED BY R. Lepro **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES Within private property access/roadway entrance **WATER DEPTH** 8.0 ft on 6/12/20

ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
4565.7	0		(Native) CLAY, with silt and sand, SAND lenses in parts, very moist to wet, brown, very soft	SS	1/1/2				23.2	21	18	3	87.4
4555.7	10		SS	0/1/1			0.08		27.1				
			MC	2/12			-1.0		94.7	26.7			
4545.7	20		(Native) CLAY, with silt, wet, brown, medium stiff	MC	5/12			95.3	27.9				95.9
4535.7	30		MC	8/12				98.4	23.5				
4525.7	40		(Native) GRAVEL, sandy to silty with cobbles, wet, brown, dense to very dense	SS	50/11				6.8	NP	NP	NP	10.3
4515.7	50		(Native) CLAY, weathered SHALE/CLAYSTONE, moist to very moist, brownish gray, hard										
4505.7	60		(Bedrock) SHALE/CLAYSTONE, moist, dark gray, very hard	SS	50/1			0.33		13.5			
4495.7	70		Bottom of hole at 70.1 feet.	SS	50/1								

LOG - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ 7/23/20

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 6/11/20 **COMPLETED** 6/11/20 **GROUND ELEVATION** 4566.5 ft **STATION NO.** _____
DRILLING CONTRACTOR McCracken Drilling **NORTH** 78970.1 **EAST** 50072.3
DRILLING METHOD Solid Stem Auger **HOLE SIZE** 4.0" **BORING LOCATION:** NE corner, of 24 Rd & G Rd
LOGGED BY R. Lepro **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES ~20' E of canal & ~25' W of G Rd, in park **WATER DEPTH** 8.0 ft on 6/11/02

ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
4566.5	0		(Native) CLAY, silty, moist, brown with gray, soft, plant/grass roots encountered	MC	4/12	-0.7		97.1	25.2				
4556.5	10		(Native) CLAY, silty, wet, brown to brown with some black, soft	MC	2/12	-2.3		95.3	29.1				
				MC	3/12	-2.4		100.1	25.2				
4546.5	20			MC	4/12			91.6	28.1				98.3
			(Native) CLAY, with silt and sand, silty SAND lenses in parts, wet, brown, medium stiff	MC	5/12			93.5	26.1				
4526.5	40		(Native) GRAVEL, sandy with cobbles, wet, brown, very dense	SS	50/11			5.3		NP	NP	NP	7.3
4516.5	50		(Bedrock) SHALE/CLAYSTONE, moist, dark gray, very hard	BULK			0.24			27	15	12	55.4
4506.5	60			MC	50/1				2.3				
4496.5	70			MC	50/1				12.1				
			Bottom of hole at 72.1 feet.	MC	50/1								

LOG - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ 7/23/20

CLIENT City of Grand Junction **PROJECT NAME** 24 Rd & G Rd Improvements
PROJECT NUMBER 599.07 **PROJECT LOCATION** Grand Junction, CO
DATE STARTED 6/10/20 **COMPLETED** 6/10/20 **GROUND ELEVATION** 4567.0 ft **STATION NO.** _____
DRILLING CONTRACTOR McCracken Drilling **NORTH** 79135.0 **EAST** 50063.1
DRILLING METHOD Solid Stem Auger **HOLE SIZE** 4.25" **BORING LOCATION:** Canyon View Park, NE corner of 24 Rd & G Rd
LOGGED BY R. Lepro **HAMMER TYPE** Automatic **GROUND WATER LEVELS:**
NOTES Proposed underpass, ~200' E of 24 Rd & ~50' N of G Rd **WATER DEPTH** 7.0 ft on 6/10/20

ELEVATION (ft)	DEPTH (ft)	GRAPHIC LOG	MATERIAL DESCRIPTION	SAMPLE TYPE	BLOW COUNTS	SWELL POTENTIAL (%)	SULFATE (%)	DRY UNIT WT. (pcf)	MOISTURE CONTENT (%)	ATTERBERG LIMITS			FINES CONTENT (%)
										LIQUID LIMIT	PLASTIC LIMIT	PLASTICITY INDEX	
4567.0	0		(Topsoil) Grass landscape, approximately 6" thick										
			(Fill) SAND, silty to clayey with gravel, slightly moist to moist, brown										
			(Native) CLAY, silty, very moist, brown, soft										
4562.0	5			MC	4/12			98.0	25.3				98.9
			(Native) SILT, clayey, wet, brown, soft										
4557.0	10			MC	2/12		0.45	102.5	24.1				
4552.0	15			MC	2/12	-0.2		109.4	23.2				
			(Native) CLAY, silty, wet, brown, soft to stiff										
4547.0	20			MC	4/12	-3.9		97.5	27.8				
4542.0	25		(Native) CLAY, silty with SAND lenses, wet, brown, stiff										
4537.0	30			MC	8/12			108.2	21.1				
			Bottom of hole at 30.0 feet.										

LOG - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ 7/24/20

APPENDIX B

SUMMARY OF LABORATORY TEST RESULTS

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

Borehole	Depth (ft)	Liquid Limit	Plastic Limit	Plasticity Index	Swell Potential (%)	%<#200 Sieve	Classification		Water Content (%)	Dry Density (pcf)	Unconfined Compressive Strength (psi)	Sulfate (%)	Resistivity (ohm-cm)	pH	Chlorides (%)	Proctor		
							USCS	AASHTO								MDD	OMC	S/M
24-1	0.67-4	NP	NP	NP		18	GM	A-1-b (0)				0.43		7.9				
24-1	2	NP	NP	NP		12		A-2-4 (0)	3.2	121.7								
24-1	4								20.1	106.2								
24-2	0-1	NP	NP	NP		18	GM	A-1-b (0)										
24-2	1-4	30	16	14		79	CL	A-6 (9)				0.32	480 @ 19.40%	7.9	0.0327			
24-2	2					86			14.5	105.9								
24-2	4				0.1				17.7	104.1								
24-3	0.67-2.5	NP	NP	NP		16	SM	A-1-b (0)				0.29	1400 @ 13.80%	7.9	0.0200			
24-3	2					34			7.5	129.1								
24-3	2.5-4	NP	NP	NP		41	SM	A-4 (0)				0.08	790 @ 16.3%	8.1	0.0300			
24-3	4								8.8	111.7								
24-4	0.71-2	NP	NP	NP		15	GM	A-1-b (0)				0.26		7.9				
24-4	2				0.0				10.0	127.5								
24-4	2.1-4	NP	NP	NP		61	ML	A-4 (0)				0.37	670 @ 16.30%	8.0	0.0300			
24-4	4								21.6	102.9								
24-6	0-4	26	17	9		69	CL	A-4 (4)				0.72	790 @ 16.30%	7.9	0.0500			
24-6	2					23			8.3	111.2								
24-6	4				-0.8				16.2	111.9								
24-7	1.25-3.5	NP	NP	NP		14	GM	A-1-a (0)				1.38		8.2	0.0200			
24-7	2					66			13.1	120.3								
24-7	4				-0.7				18.0	111.8								
G-1	0-1.5	NP	NP	NP		10	GP-GM	A-1-a (0)										
G-1	1.5-7	NP	NP	NP		40	SM	A-4 (0)				0.76	640 @ 16.30%	7.8	0.0500			
G-1	2				0.4				6.3	112.0								
G-1	4								16.1	106.3								
G-2	0.25-1.5	19	16	3		23	GM	A-1-b (0)										
G-2	2					61			12.0	104.9								
G-2	2.1-7	NP	NP	NP		68	ML	A-4 (0)				0.40	770 @ 17%	7.9	0.0400			
G-2	4				-0.1				15.8	114.5								
G-4	1.5-4																	

SUMMARY - STANDARD LANDSCAPE 599.07 24 RD & G RD IMPROVEMENTS.GPJ 11/13/20



SUMMARY OF PHYSICAL & CHEMICAL TEST RESULTS

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

Borehole	Depth (ft)	Liquid Limit	Plastic Limit	Plasticity Index	Swell Potential (%)	%<#200 Sieve	Classification		Water Content (%)	Dry Density (pcf)	Unconfined Compressive Strength (psi)	Sulfate (%)	Resistivity (ohm-cm)	pH	Chlorides (%)	Proctor		
							USCS	AASHTO								S=Standard	M=Modified	MDD
G-4	2				0.0				18.7	108.4								
G-4	4				-1.1				23.8	99.2								
G-5	0-4	24	18	6		12	GP-GC	A-1-a (0)				0.49	650 @ 17.30%	7.9	0.0345			
G-5	2	NP	NP	NP		36	SM	A-4 (0)	7.0	114.7								
G-5	4								5.6	124.6								
G-6	0-4	NP	NP	NP		50	GM	A-4 (0)				0.40		7.9	0.0400			
G-6	2				0.7				12.6	113.9								
G-6	4								8.7	114.2								
LC-1	0-5	25	18	7		75	CL-ML	A-4 (3)				0.16	190 @ 24.9%	8.6	0.1557			
LC-1	4					82			19.9	107.1								
LC-1	9	25	20	5	-0.6				25.1	93.1								
LC-1	14					92			27.9	97.8								
LC-1	19	25	16	9	-1.4				24.4	99.2								
LC-1	24					100			26.4	100.9								
LC-1	29								23.1	102.9								
LC-1	34	NP	NP	NP		12		A-2-4 (0)	23.8	101.0								
LC-1	39	NP	NP	NP		5	SP	A-3 (0)	15.7									
LC-1	48					81			10.4			0.45						
LC-1	49								10.1									
LC-2	2					93			20.1	105.5		1.32						
LC-2	4	24	18	6	-0.5				21.5	107.0								
LC-2	9								23.7	98.9		0.12						
LC-2	10					92												
LC-2	14	20	19	1	-0.3				22.4	106.0								
LC-2	24								18.3	72.7								
LC-2	34					29			16.2									
LC-2	44					12			23.5									
LC-2	49					76			7.5									
T-1	0-4	NP	NP	NP		44	SM	A-4 (0)				0.40		7.9	0.0400			
T-1	4				0.4				14.2	110.7								

SUMMARY - STANDARD LANDSCAPE 599.07_24 RD & G RD IMPROVEMENTS.GPJ 11/13/20

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

Borehole	Depth (ft)	Liquid Limit	Plastic Limit	Plasticity Index	Swell Potential (%)	%<#200 Sieve	Classification		Water Content (%)	Dry Density (pcf)	Unconfined Compressive Strength (psi)	Sulfate (%)	Resistivity (ohm-cm)	pH	Chlorides (%)	Proctor		
							USCS	AASHTO								S=Standard	M=Modified	MDD
T-1	9				-0.3				26.8	98.2								
T-1	14					77			24.9	150.8								
T-1	24								25.9	95.4		0.13						
T-1	34					85			23.4	105.6								
T-1	45					76			22.7									
T-1	46					19			7.8									
T-2	4	21	18	3		87	ML	A-4 (0)	23.2									
T-2	9								27.1			0.08						
T-2	14				-1.0				26.7	94.7								
T-2	19					96			27.9	95.3								
T-2	29								23.5	98.4								
T-2	39	NP	NP	NP		10		A-3 (0)	6.8									
T-2	60					52			13.5			0.33						
T-3	4				-0.7				25.2	97.1								
T-3	9				-2.3				29.1	95.3								
T-3	14				-2.4				25.2	100.1								
T-3	19					98			28.1	91.6								
T-3	29								26.1	93.5								
T-3	39	NP	NP	NP		7	GP-GM	A-1-a (0)	5.3									
T-3	53-72	27	15	12		55	CL	A-6 (4)				0.24						
T-3	63								2.3									
T-3	72								12.1									
UP-1	4					99			25.3	98.0								
UP-1	9								24.1	102.5		0.45						
UP-1	14				-0.2				23.2	109.4								
UP-1	19				-3.9				27.8	97.5								
UP-1	29								21.1	108.2								
UP-2	0-4	26	16	10		75	CL	A-4 (5)				0.40		7.9	0.0400			
UP-2	2					20			9.6	98.9								
UP-2	4					80			23.2	96.2		0.36						

SUMMARY - STANDARD LANDSCAPE 599.07_24 RD & G RD IMPROVEMENTS.GPJ 11/13/20

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO


Borehole	Depth (ft)	Liquid Limit	Plastic Limit	Plasticity Index	Swell Potential (%)	% <#200 Sieve	Classification		Water Content (%)	Dry Density (pcf)	Unconfined Compressive Strength (psi)	Sulfate (%)	Resistivity (ohm-cm)	pH	Chlorides (%)	Proctor			
							USCS	AASHTO								S=Standard	M=Modified	MDD	OMC
UP-2	9				-3.3				23.0	100.1									
UP-2	14				-0.1				26.5	100.5									
UP-2	19				-0.5				26.6	99.8									
UP-2	24								27.6	98.6									

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

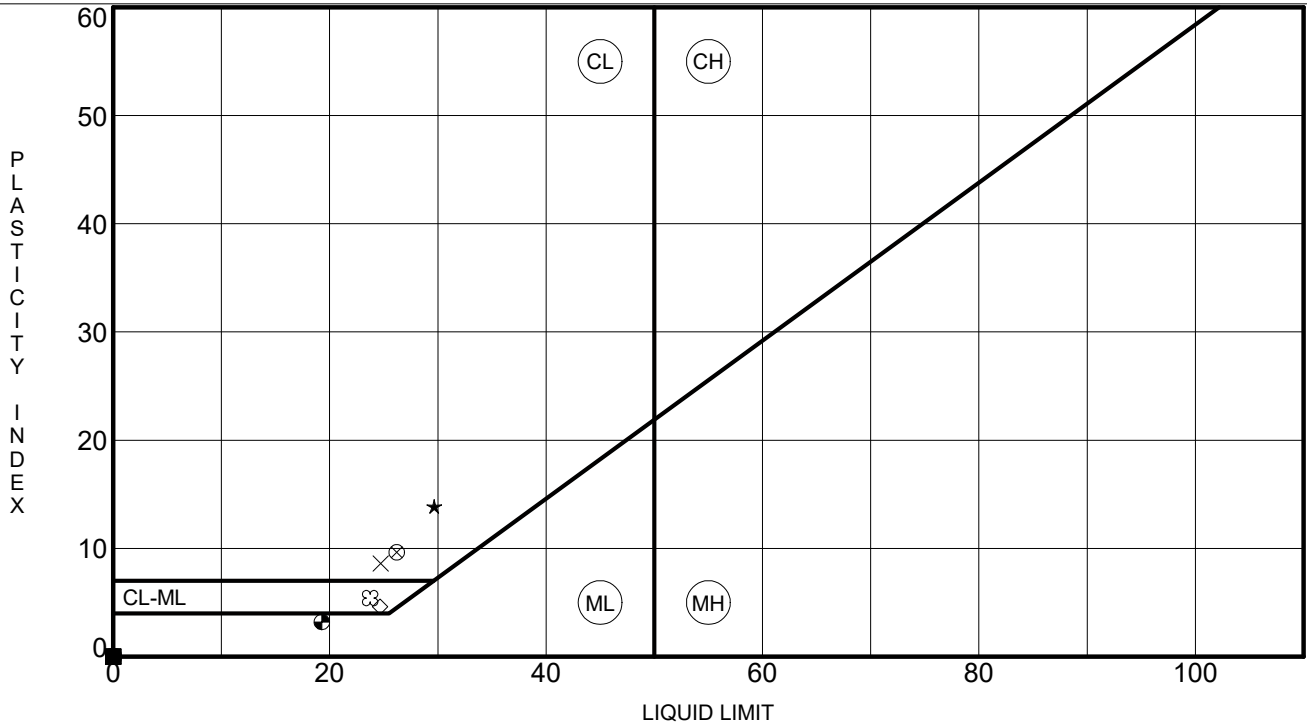

ATTERBERG LIMITS - STANDARD 599.07 - 24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	LL	PL	PI	Fines	Classification	
● 24-1	0.7-4.0	NP	NP	NP	17.8	SILTY GRAVEL with SAND (GM) (A-1-b)
☒ 24-1	2.0	NP	NP	NP	11.8	(Fill) SAND, slightly silty to gravelly (A-2-4)
▲ 24-2	0.0-1.0	NP	NP	NP	18.5	SILTY GRAVEL with SAND (GM) (A-1-b)
★ 24-2	1.0-4.0	30	16	14	78.5	LEAN CLAY with SAND (CL) (A-6)
⊕ 24-3	0.7-2.5	NP	NP	NP	16.0	SILTY SAND with GRAVEL (SM) (A-1-b)
⊕ 24-3	2.5-4.0	NP	NP	NP	40.9	SILTY SAND (SM) (A-4)
○ 24-4	0.7-2.0	NP	NP	NP	15.1	SILTY GRAVEL with SAND (GM) (A-1-b)
△ 24-4	2.1-4.0	NP	NP	NP	60.7	SANDY SILT (ML) (A-4)
⊗ 24-6	0.0-4.0	26	17	9	68.8	SANDY LEAN CLAY (CL) (A-4)
⊕ 24-7	1.3-3.5	NP	NP	NP	14.1	SILTY GRAVEL with SAND (GM) (A-1-a)
□ G-1	0.0-1.5	NP	NP	NP	10.0	POORLY GRADED GRAVEL with SILT and SAND (GP-GM) (A-1-a)
⊕ G-1	1.5-7.0	NP	NP	NP	40.0	SILTY SAND (SM) (A-4)
⊕ G-2	0.3-1.5	19	16	3	23.3	SILTY GRAVEL with SAND (GM) (A-1-b)
☆ G-2	2.1-7.0	NP	NP	NP	68.2	SANDY SILT (ML) (A-4)
⊗ G-5	0.0-4.0	24	18	6	11.9	POORLY GRADED GRAVEL with SILTY CLAY (GP-GC) (A-1-a)
■ G-5	2.0	NP	NP	NP	35.7	(Fill) SAND, gravelly w silt and trace clay, w cobbles (A-4)
◆ G-6	0.0-4.0	NP	NP	NP	50.0	SILTY GRAVEL with SAND (GM) (A-4)
◇ LC-1	9.0	25	20	5		CLAY, silty to sandy
× LC-1	19.0	25	16	9		CLAY, silty to sandy
⊗ LC-1	34.0	NP	NP	NP	12.3	SAND, with gravel (A-2-4)

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

ROCKSOL PROJECT NUMBER 599.07

CLIENT PROJECT NUMBER Grand Junction, CO

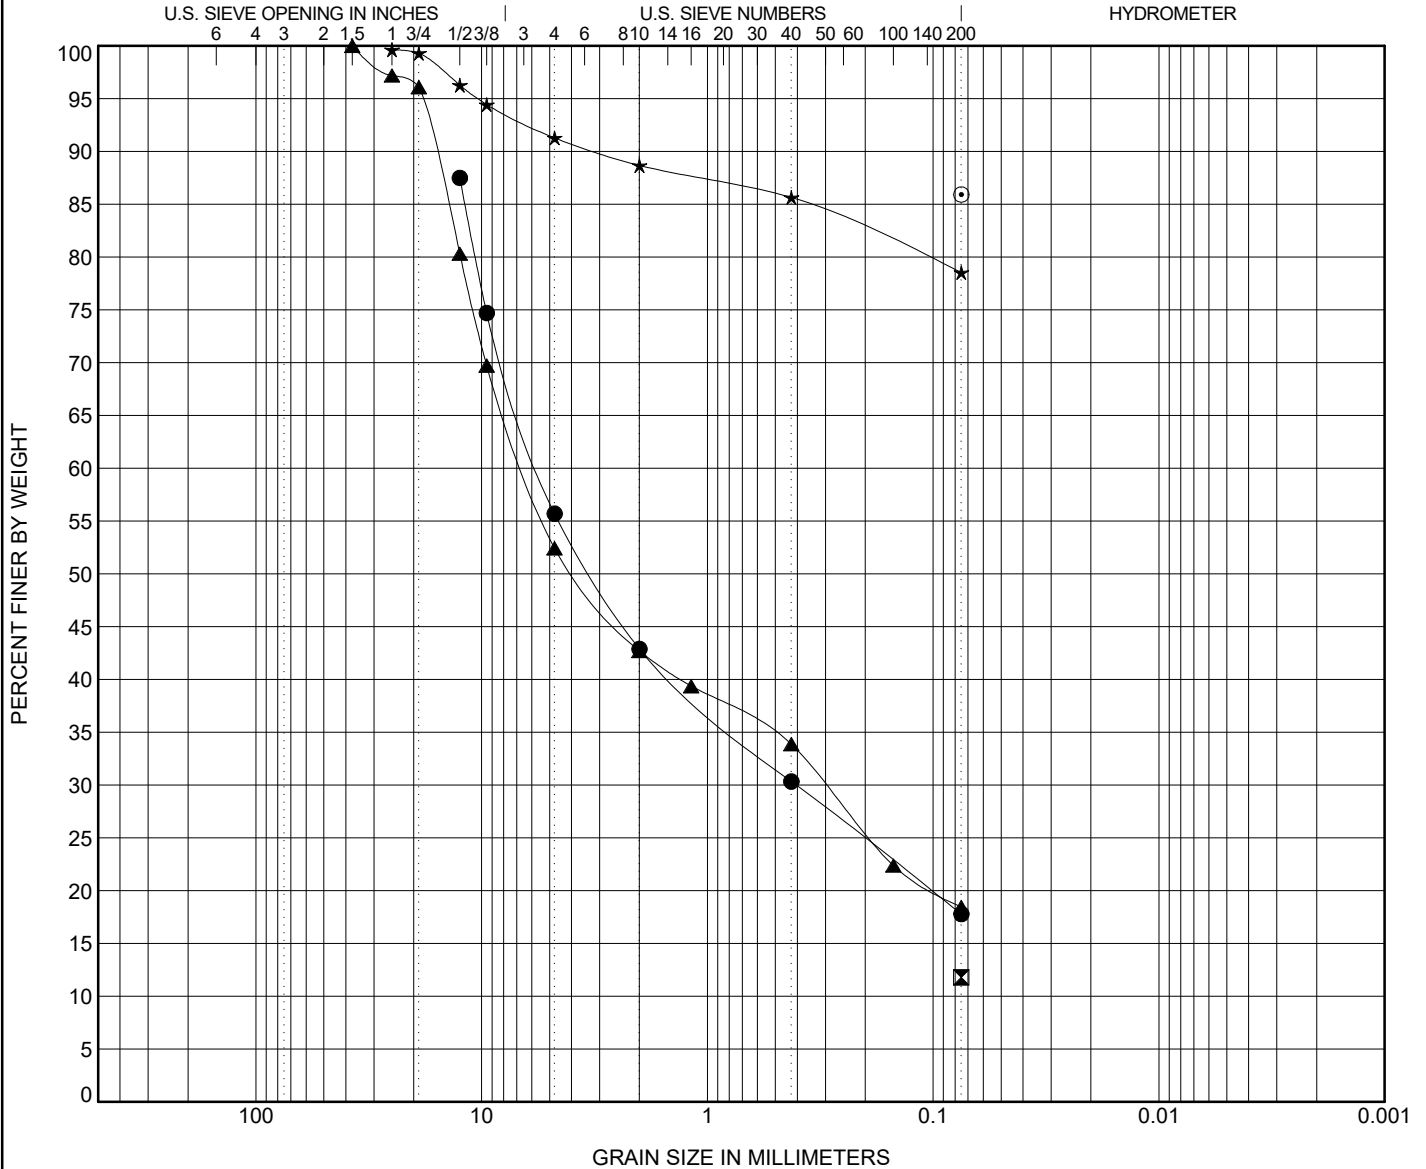

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Specimen Identification	Classification	LL	PL	PI	Cc	Cu
● 24-1 0.7-4	SILTY GRAVEL with SAND (GM) (A-1-b)	NP	NP	NP		
☒ 24-1 2.0	(Fill) SAND, slightly silty to gravelly (A-2-4)	NP	NP	NP		
▲ 24-2 0.0-1	SILTY GRAVEL with SAND (GM) (A-1-b)	NP	NP	NP		
★ 24-2 1.0-4	LEAN CLAY with SAND (CL) (A-6)	30	16	14		
⊙ 24-2 2.0	CLAY, with sand, silty					


Specimen Identification	D100	D60	D30	D10	%Gravel	%Sand	%Silt	%Clay
● 24-1 0.7-4	12.5	5.557	0.406		31.8	37.9		17.8
☒ 24-1 2.0	0.075							11.8
▲ 24-2 0.0-1	37.5	6.434	0.299		47.6	34.0		18.5
★ 24-2 1.0-4	25				8.4	12.8		78.5
⊙ 24-2 2.0	0.075							85.9

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

ROCKSOL PROJECT NUMBER 599.07

CLIENT PROJECT NUMBER Grand Junction, CO

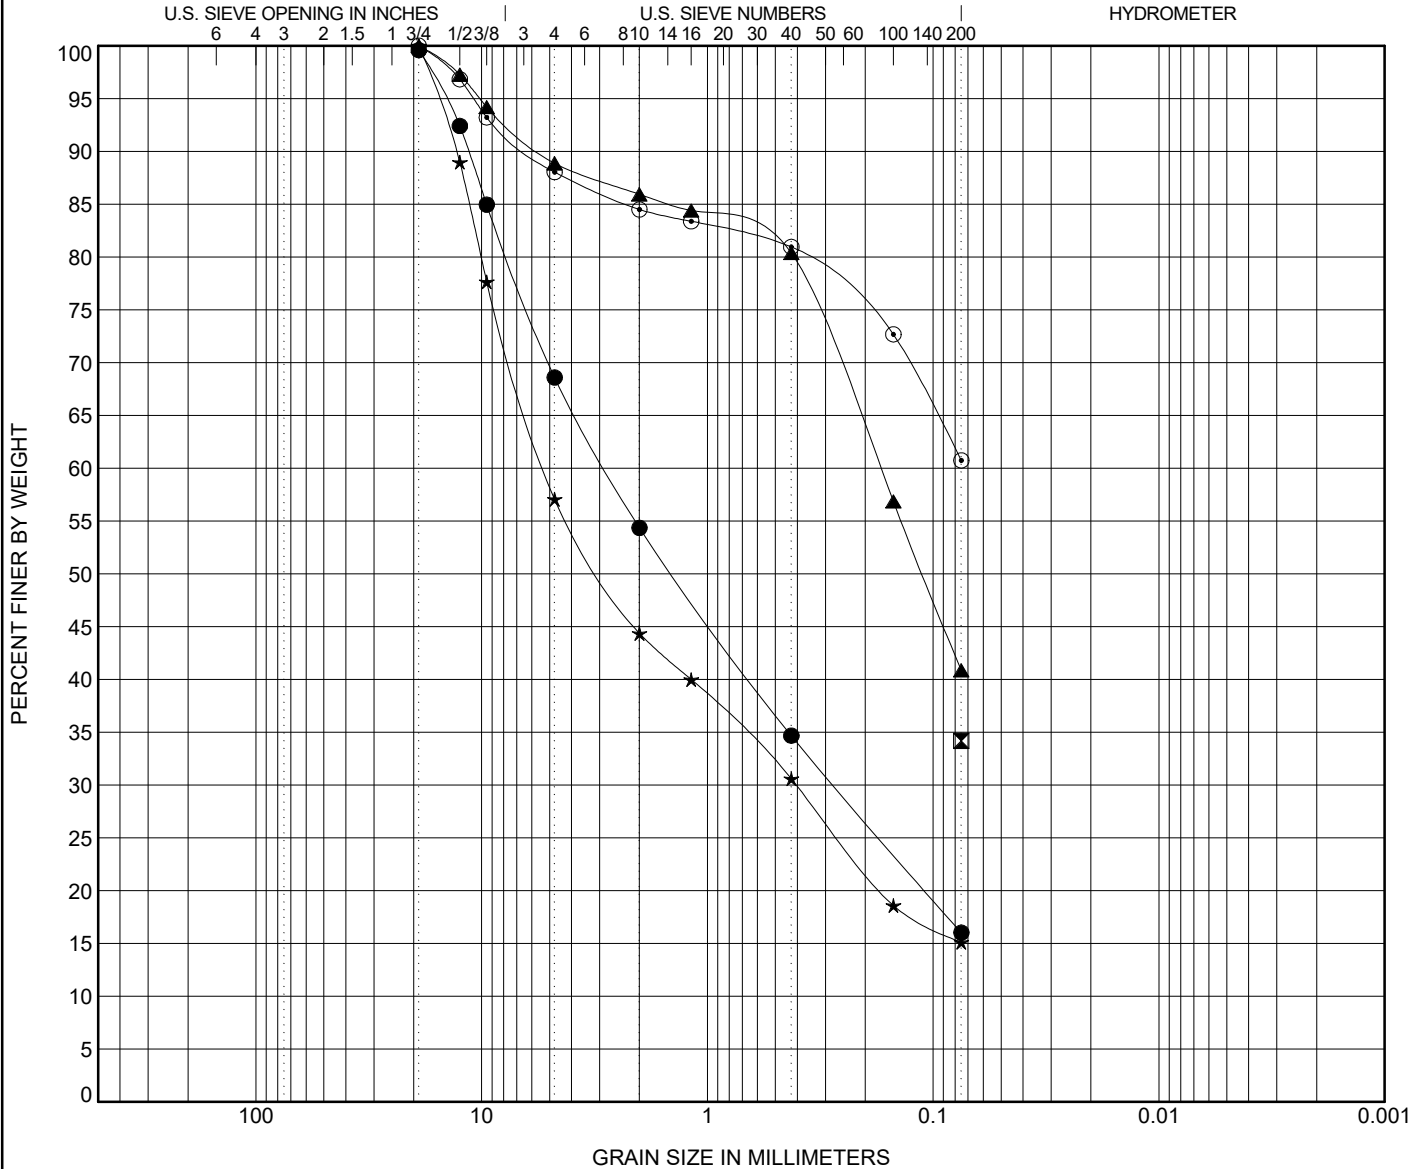

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Specimen Identification	Classification	LL	PL	PI	Cc	Cu
● 24-3 0.7-3	SILTY SAND with GRAVEL (SM) (A-1-b)	NP	NP	NP		
☒ 24-3 2.0	(ABC) SAND, slightly silty to gravelly w CLAY					
▲ 24-3 2.5-4	SILTY SAND (SM) (A-4)	NP	NP	NP		
★ 24-4 0.7-2	SILTY GRAVEL with SAND (GM) (A-1-b)	NP	NP	NP		
⊙ 24-4 2.1-4	SANDY SILT (ML) (A-4)	NP	NP	NP		


Specimen Identification	D100	D60	D30	D10	%Gravel	%Sand	%Silt	%Clay
● 24-3 0.7-3	19	2.818	0.275		31.0	52.6		16.0
☒ 24-3 2.0	0.075							34.2
▲ 24-3 2.5-4	19	0.172			11.1	48.0		40.9
★ 24-4 0.7-2	19	5.244	0.404		42.9	41.9		15.1
⊙ 24-4 2.1-4	19				12.0	27.3		60.7

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

ROCKSOL PROJECT NUMBER 599.07

CLIENT PROJECT NUMBER Grand Junction, CO

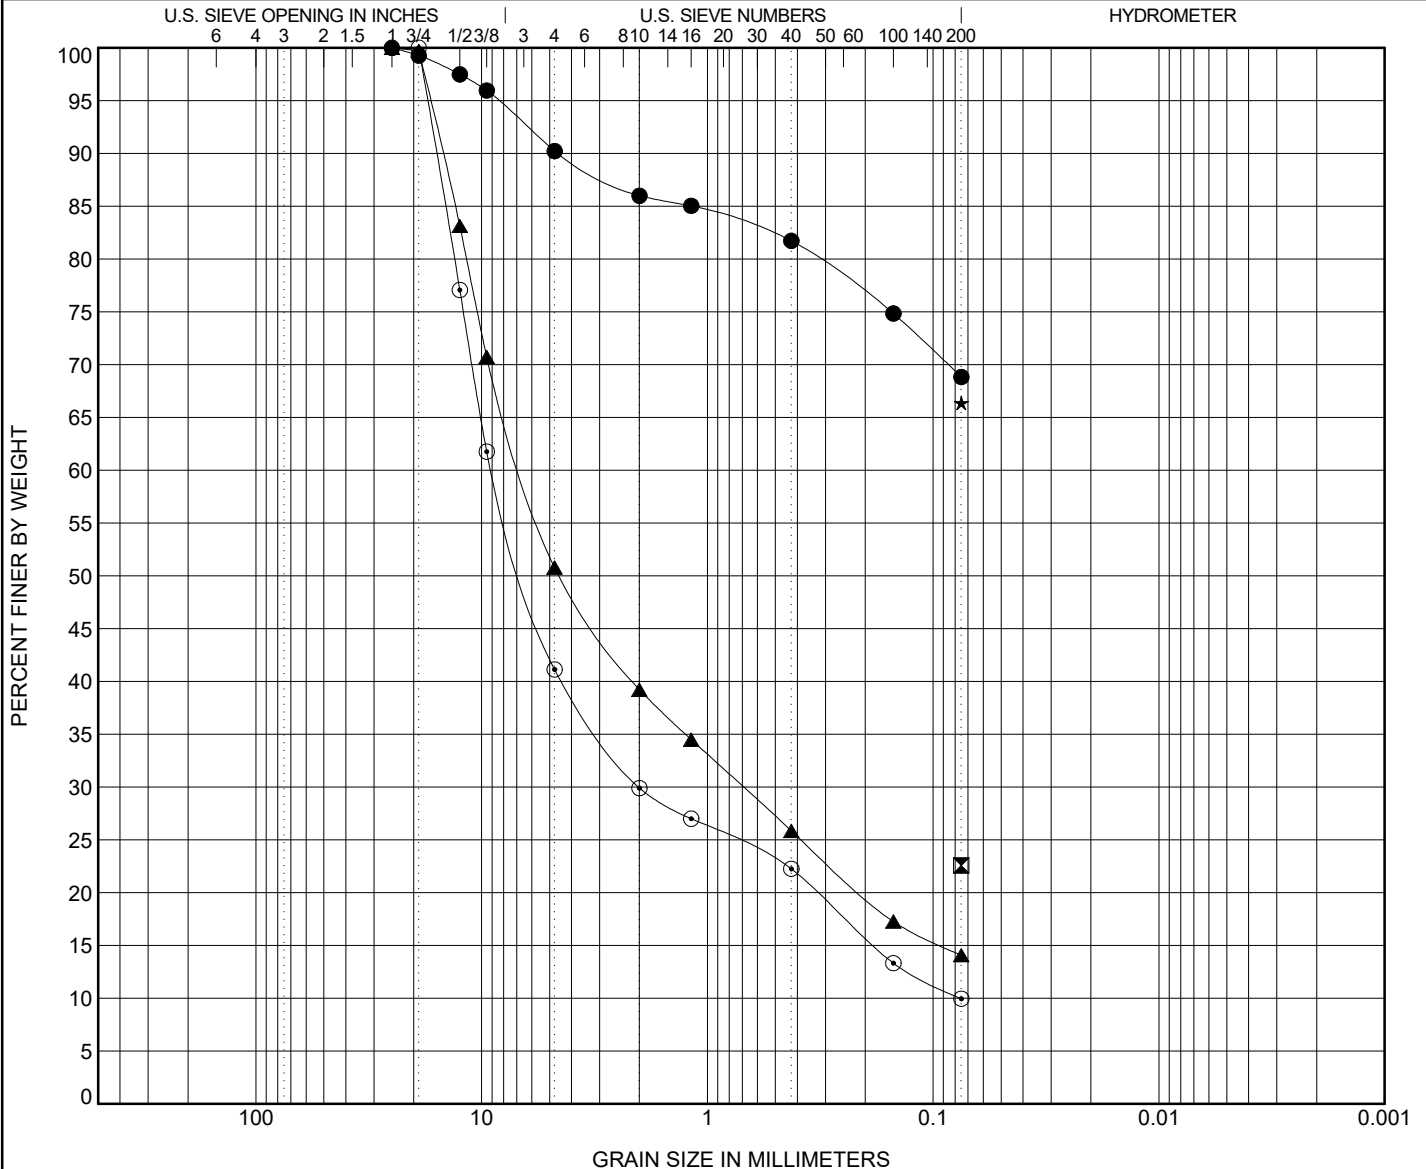

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Specimen Identification	Classification	LL	PL	PI	Cc	Cu
● 24-6 0.0-4	SANDY LEAN CLAY (CL) (A-4)	26	17	9		
☒ 24-6 2.0	(Fill) SAND, silty to gravelly in parts, CLAY lenses in parts					
▲ 24-7 1.3-4	SILTY GRAVEL with SAND (GM) (A-1-a)	NP	NP	NP		
★ 24-7 2.0	(Fill) SAND, gravelly w SILT lenses in parts					
⊙ G-1 0.0-2	POORLY GRADED GRAVEL with SILT and SAND (GP-GM) (A-1-a)	NP	NP	NP	5.99	118.24

Specimen Identification	D100	D60	D30	D10	%Gravel	%Sand	%Silt	%Clay
● 24-6 0.0-4	25				9.8	21.4		68.8
☒ 24-6 2.0	0.075							22.6
▲ 24-7 1.3-4	25	6.542	0.694		49.2	36.7		14.1
★ 24-7 2.0	0.075							66.4
⊙ G-1 0.0-2	19	8.954	2.016	0.076	58.9	31.2		10.0


GRADATION - CLIENT STANDARD 599.07 24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 11/5/20

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

ROCKSOL PROJECT NUMBER 599.07

CLIENT PROJECT NUMBER Grand Junction, CO

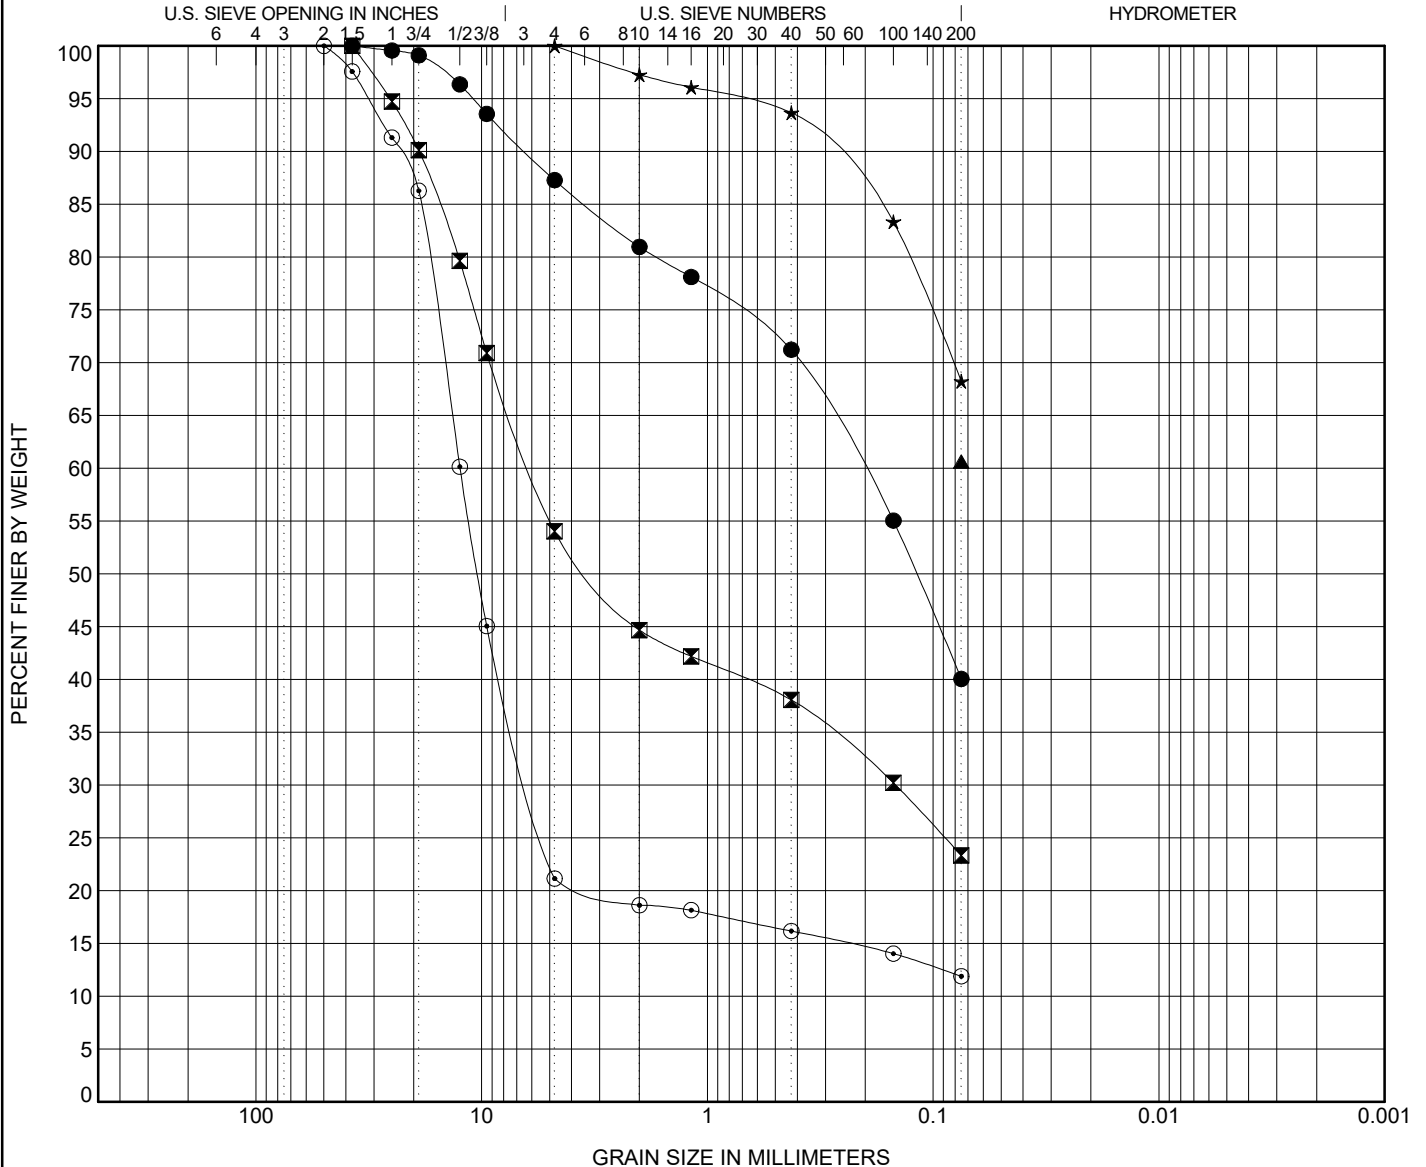

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Specimen Identification	Classification	LL	PL	PI	Cc	Cu
● G-1 1.5-7	SILTY SAND (SM) (A-4)	NP	NP	NP		
☒ G-2 0.3-2	SILTY GRAVEL with SAND (GM) (A-1-b)	19	16	3		
▲ G-2 2.0	SAND, silty to slightly clayey in parts					
★ G-2 2.1-7	SANDY SILT (ML) (A-4)	NP	NP	NP		
⊙ G-5 0.0-4	POORLY GRADED GRAVEL with SILTY CLAY (GP-GC) (A-1-a)	24	18	6	74.38	306.71


Specimen Identification	D100	D60	D30	D10	%Gravel	%Sand	%Silt	%Clay
● G-1 1.5-7	37.5	0.206			12.7	47.2		40.0
☒ G-2 0.3-2	37.5	6.068	0.147		46.0	30.7		23.3
▲ G-2 2.0	0.075							60.6
★ G-2 2.1-7	4.75				0.0	31.8		68.2
⊙ G-5 0.0-4	50	12.468	6.14		78.9	9.3		11.9

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

ROCKSOL PROJECT NUMBER 599.07

CLIENT PROJECT NUMBER Grand Junction, CO

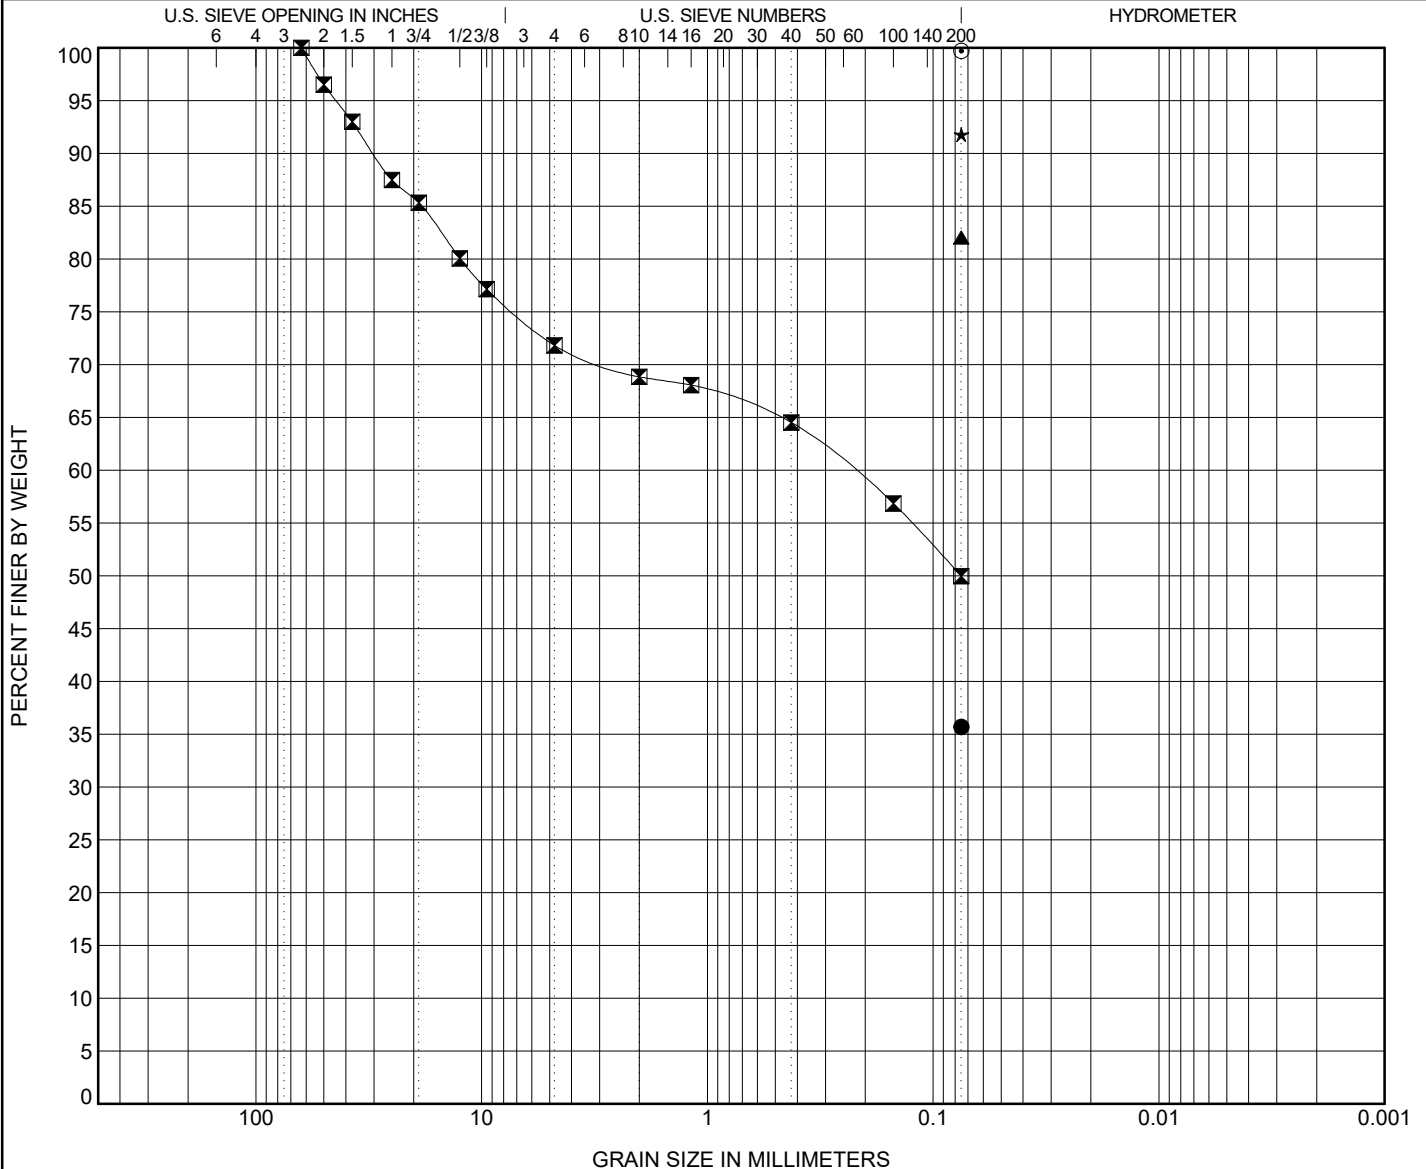

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Specimen Identification	Classification	LL	PL	PI	Cc	Cu
● G-5 2.0	(Fill) SAND, gravelly w silt and trace clay, w cobbles (A-4)	NP	NP	NP		
☒ G-6 0.0-4	SILTY GRAVEL with SAND (GM) (A-4)	NP	NP	NP		
▲ LC-1 4.0	CLAY, silty to sandy					
★ LC-1 14.0	CLAY, silty to sandy					
⊙ LC-1 24.0	CLAY, silty to sandy					

Specimen Identification	D100	D60	D30	D10	%Gravel	%Sand	%Silt	%Clay
● G-5 2.0	0.075							35.7
☒ G-6 0.0-4	63	0.23			28.2	21.8		50.0
▲ LC-1 4.0	0.075							82.0
★ LC-1 14.0	0.075							91.8
⊙ LC-1 24.0	0.075							99.7


GRADATION - CLIENT STANDARD 599.07 24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 11/5/20

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

ROCKSOL PROJECT NUMBER 599.07

CLIENT PROJECT NUMBER Grand Junction, CO

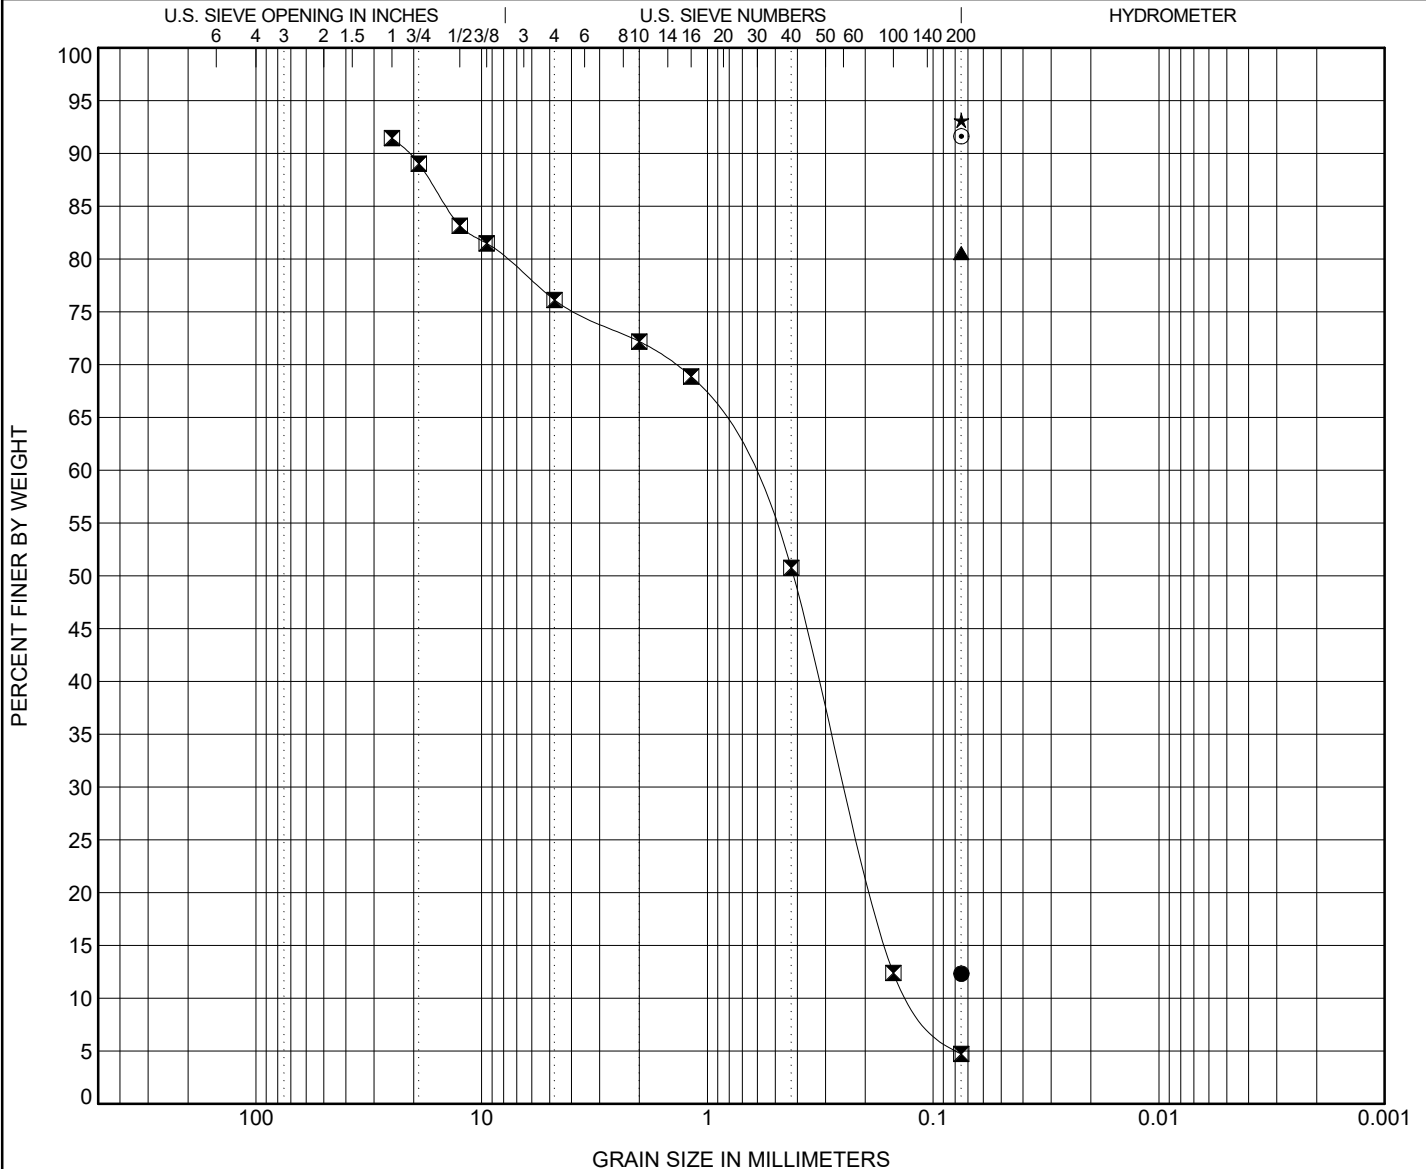

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Specimen Identification	Classification	LL	PL	PI	Cc	Cu
● LC-1 34.0	SAND, with gravel (A-2-4)	NP	NP	NP		
☒ LC-1 39.0	POORLY GRADED SAND with GRAVEL (SP) (A-3)	NP	NP	NP	0.68	5.92
▲ LC-1 48.0	(Bedrock) CLAYSTONE/SHALE					
★ LC-2 2.0	CLAY, sandy to silty					
⊙ LC-2 10.0	CLAY, sandy to silty					

Specimen Identification	D100	D60	D30	D10	%Gravel	%Sand	%Silt	%Clay
● LC-1 34.0	0.075							12.3
☒ LC-1 39.0	25	0.715	0.242	0.121	15.3	71.4		4.7
▲ LC-1 48.0	0.075							80.6
★ LC-2 2.0	0.075							93.1
⊙ LC-2 10.0	0.075							91.6


GRADATION - CLIENT STANDARD 599.07 24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 11/5/20

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

ROCKSOL PROJECT NUMBER 599.07

CLIENT PROJECT NUMBER Grand Junction, CO

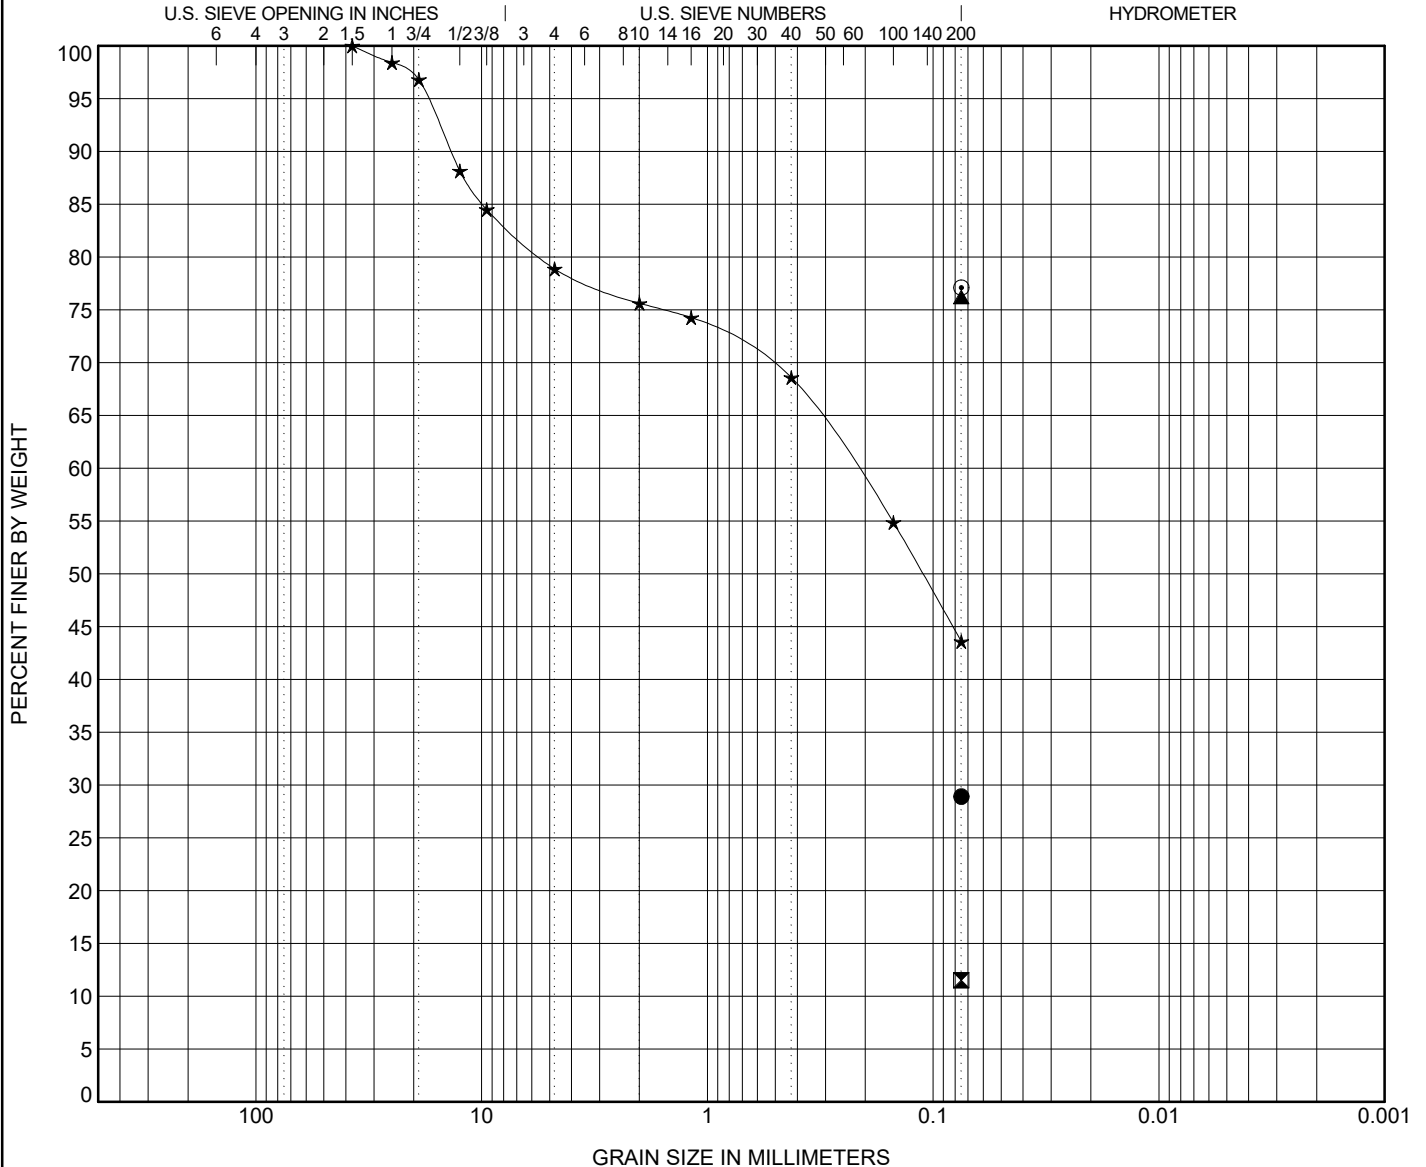

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	


Specimen Identification	Classification	LL	PL	PI	Cc	Cu		
● LC-2 34.0	SAND, with cobbles							
☒ LC-2 44.0	(Bedrock) CLAYSTONE/SHALE							
▲ LC-2 49.0	(Bedrock) CLAYSTONE/SHALE							
★ T-1 0.0-4	SILTY SAND with GRAVEL (SM) (A-4)	NP	NP	NP				
⊙ T-1 14.0	CLAY, sandy to silty w SAND lenses in parts							
Specimen Identification	D100	D60	D30	D10	%Gravel	%Sand	%Silt	%Clay
● LC-2 34.0	0.075							28.9
☒ LC-2 44.0	0.075							11.5
▲ LC-2 49.0	0.075							76.2
★ T-1 0.0-4	37.5	0.221			21.1	35.3		43.6
⊙ T-1 14.0	0.075							77.1

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

ROCKSOL PROJECT NUMBER 599.07

CLIENT PROJECT NUMBER Grand Junction, CO

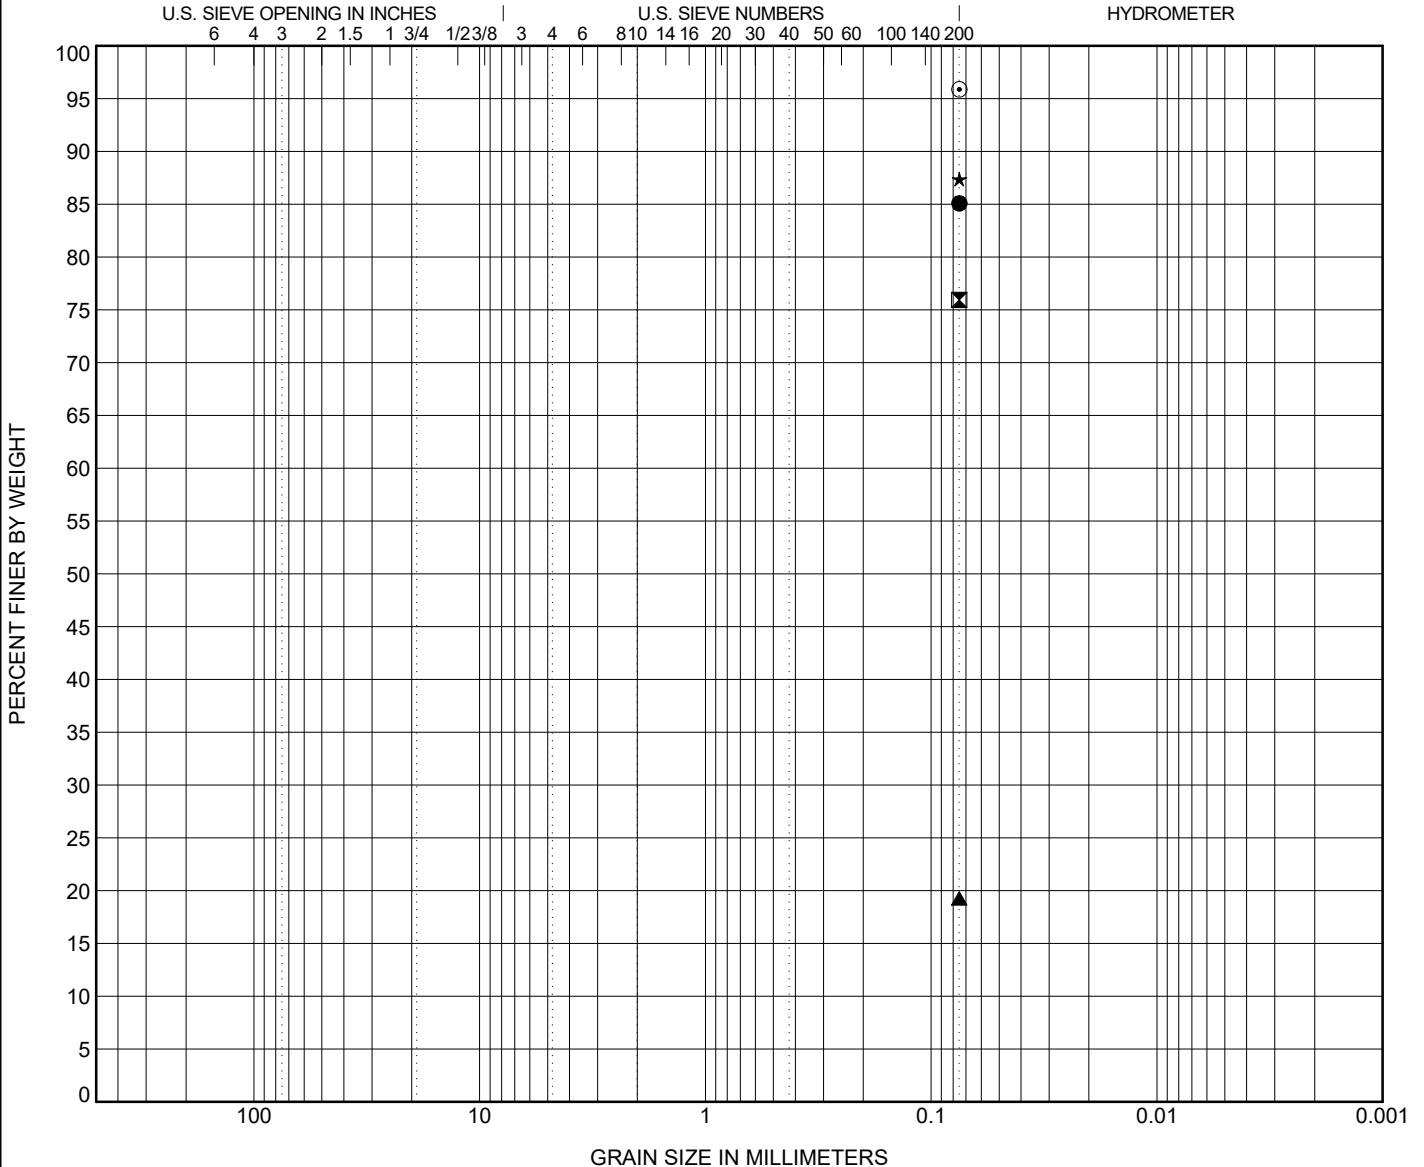

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Specimen Identification	Classification	LL	PL	PI	Cc	Cu
● T-1 34.0	CLAY, sandy to silty w SAND lenses in parts					
☒ T-1 45.0	CLAY, sandy (weathered CLAYSTONE)					
▲ T-1 46.0	CLAYSTONE, sandy					
★ T-2 4.0	SILT (ML) (A-4)	21	18	3		
◎ T-2 19.0	CLAY, w silt					

Specimen Identification	D100	D60	D30	D10	%Gravel	%Sand	%Silt	%Clay
● T-1 34.0	0.075						85.1	
☒ T-1 45.0	0.075						75.9	
▲ T-1 46.0	0.075						19.3	
★ T-2 4.0	0.075						87.4	
◎ T-2 19.0	0.075						95.9	


GRADATION - CLIENT STANDARD 599.07 24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 11/5/20

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

ROCKSOL PROJECT NUMBER 599.07

CLIENT PROJECT NUMBER Grand Junction, CO

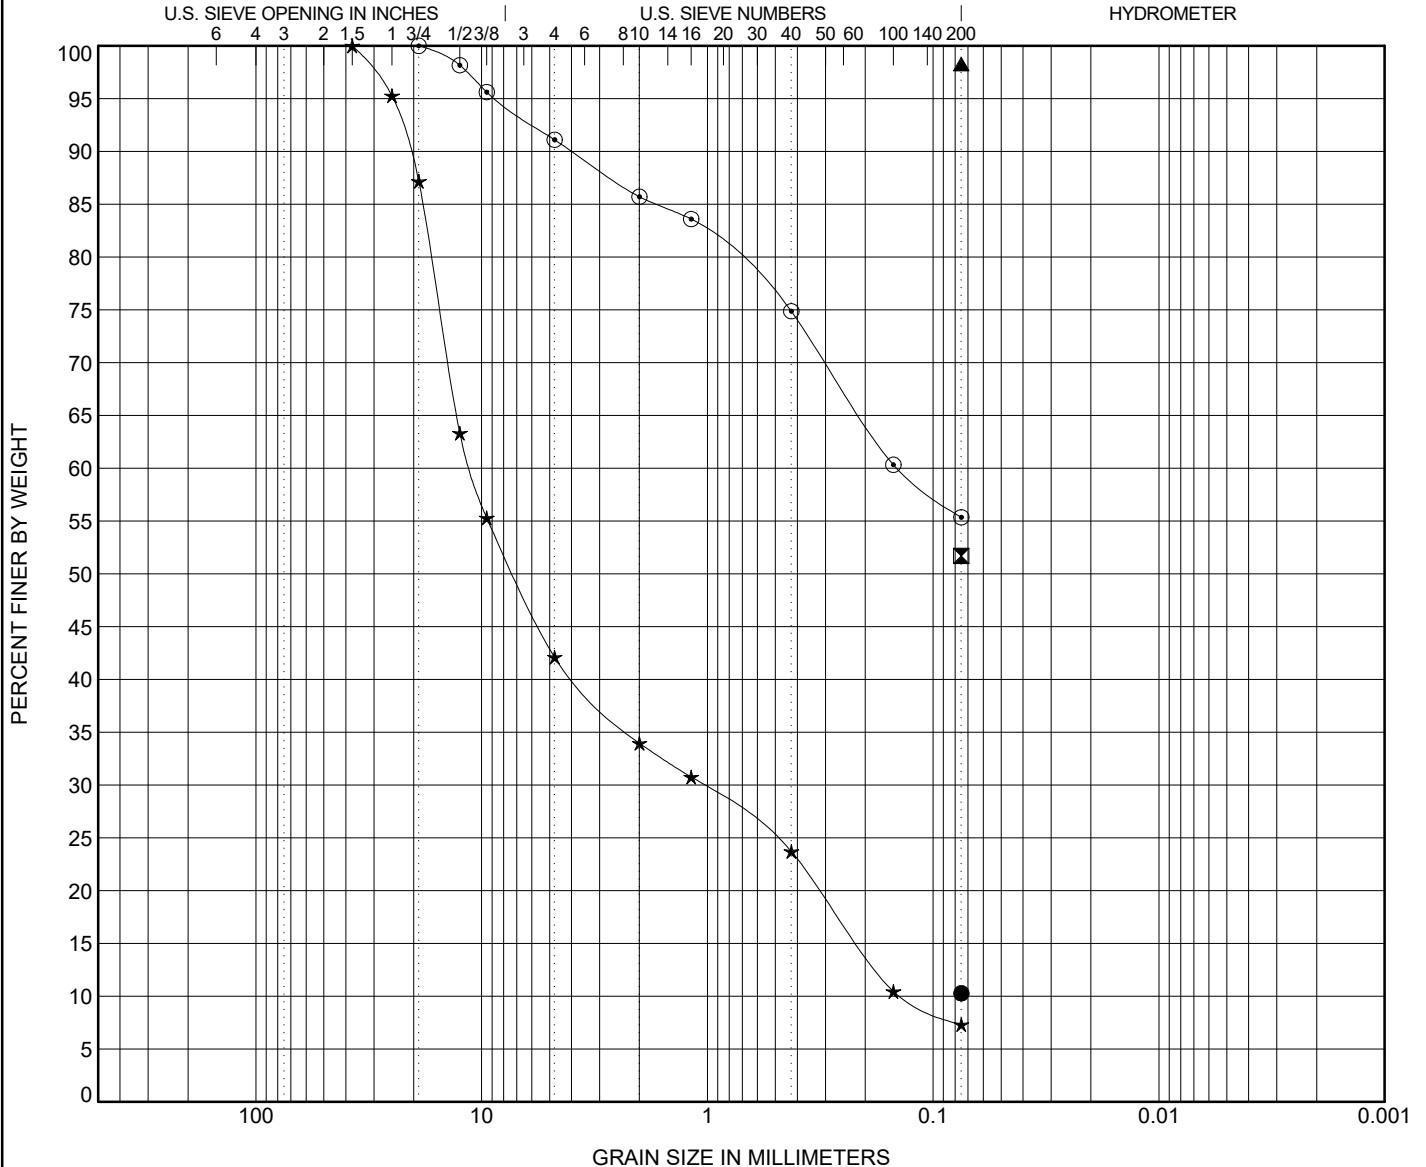

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Specimen Identification	Classification	LL	PL	PI	Cc	Cu
● T-2 39.0	GRAVEL, sandy to silty with cobbles (A-3)	NP	NP	NP		
☒ T-2 60.0	(Bedrock) SHALE/CLAYSTONE					
▲ T-3 19.0	CLAY, silty					
★ T-3 39.0	GRAVEL, sandy with cobbles (A-1-a)	NP	NP	NP	0.74	82.30
⊙ T-3 53.0-72	(Bedrock) SHALE/CLAYSTONE (A-6)	27	15	12		

Specimen Identification	D100	D60	D30	D10	%Gravel	%Sand	%Silt	%Clay
● T-2 39.0	0.075							10.3
☒ T-2 60.0	0.075							51.7
▲ T-3 19.0	0.075							98.3
★ T-3 39.0	37.5	11.156	1.057	0.136	57.9	34.8		7.3
⊙ T-3 53.0-72	19	0.143			8.9	35.8		55.4


GRADATION - CLIENT STANDARD 599.07 24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 11/5/20

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

ROCKSOL PROJECT NUMBER 599.07

CLIENT PROJECT NUMBER Grand Junction, CO

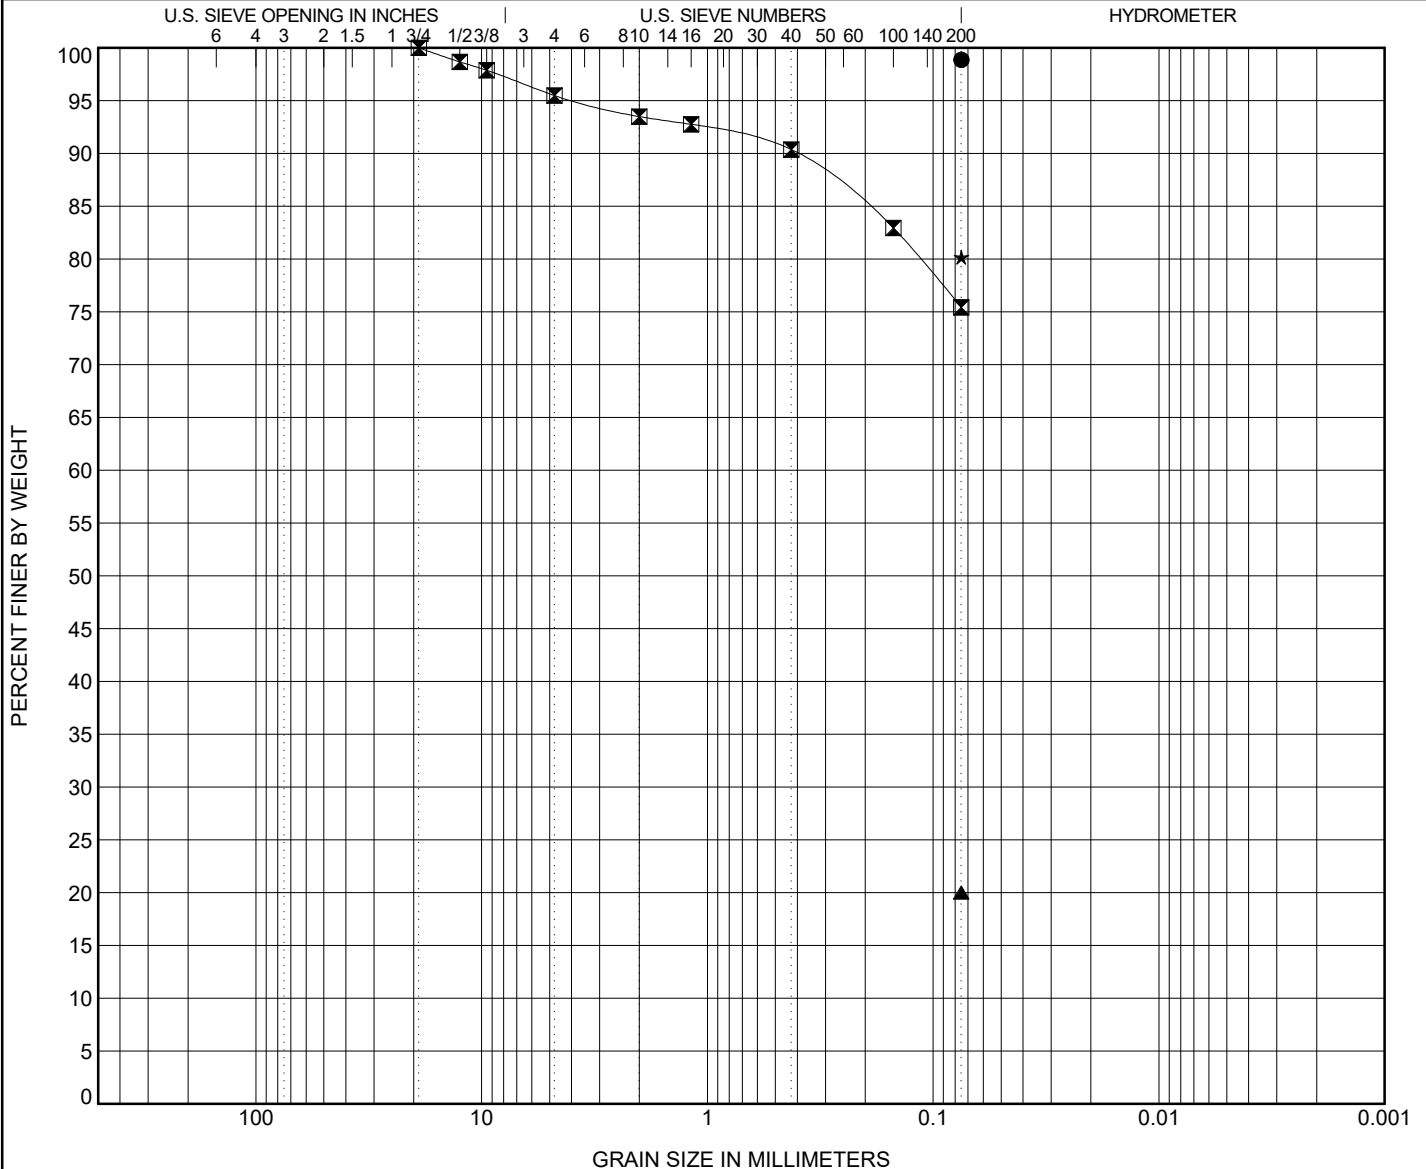

COBBLES	GRAVEL		SAND			SILT OR CLAY
	coarse	fine	coarse	medium	fine	

Specimen Identification	Classification	LL	PL	PI	Cc	Cu
● UP-1 4.0	CLAY, silty					
☒ UP-2 0.0-4	LEAN CLAY with SAND (CL) (A-4)	26	16	10		
▲ UP-2 2.0	SAND, silty to slightly clayey in parts					
★ UP-2 4.0	CLAY, silty w silty SAND lenses in parts					

Specimen Identification	D100	D60	D30	D10	%Gravel	%Sand	%Silt	%Clay
● UP-1 4.0	0.075						98.9	
☒ UP-2 0.0-4	19				4.5	20.0	75.4	
▲ UP-2 2.0	0.075						20.0	
★ UP-2 4.0	0.075						80.2	


GRADATION - CLIENT STANDARD 599.07 24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 11/5/20

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

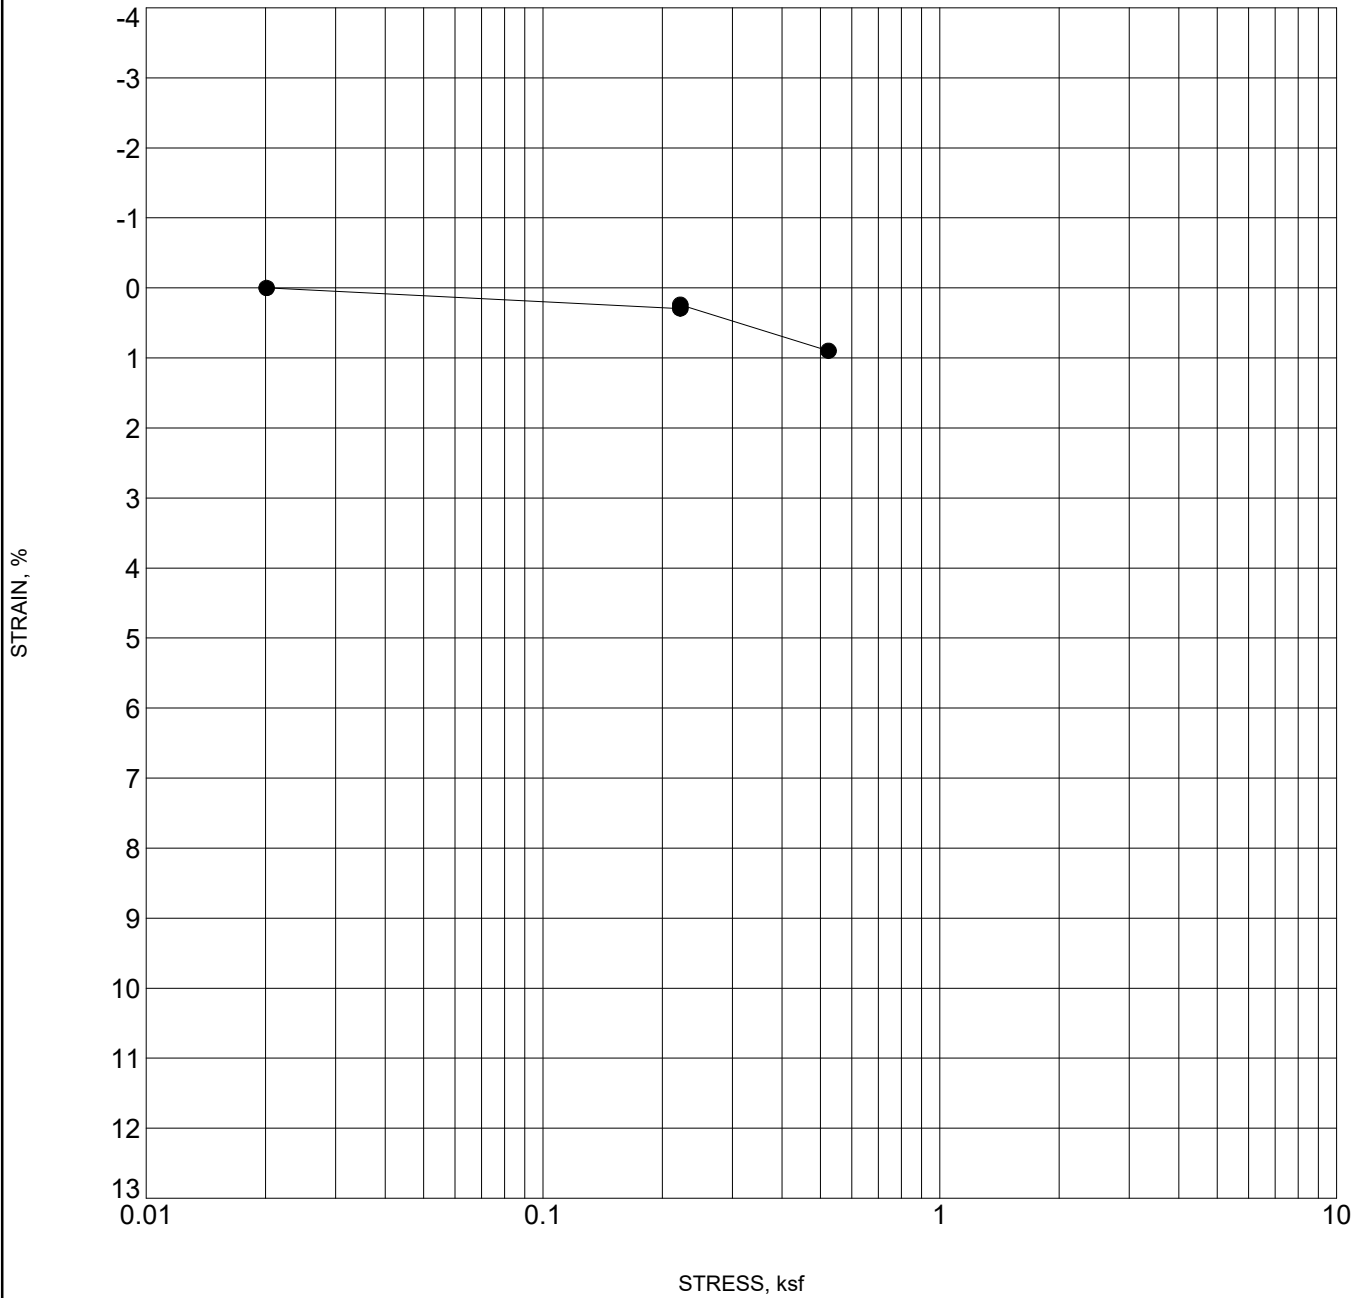

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● 24-2 4	CLAY, with sand	0.1	104.1	17.7

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

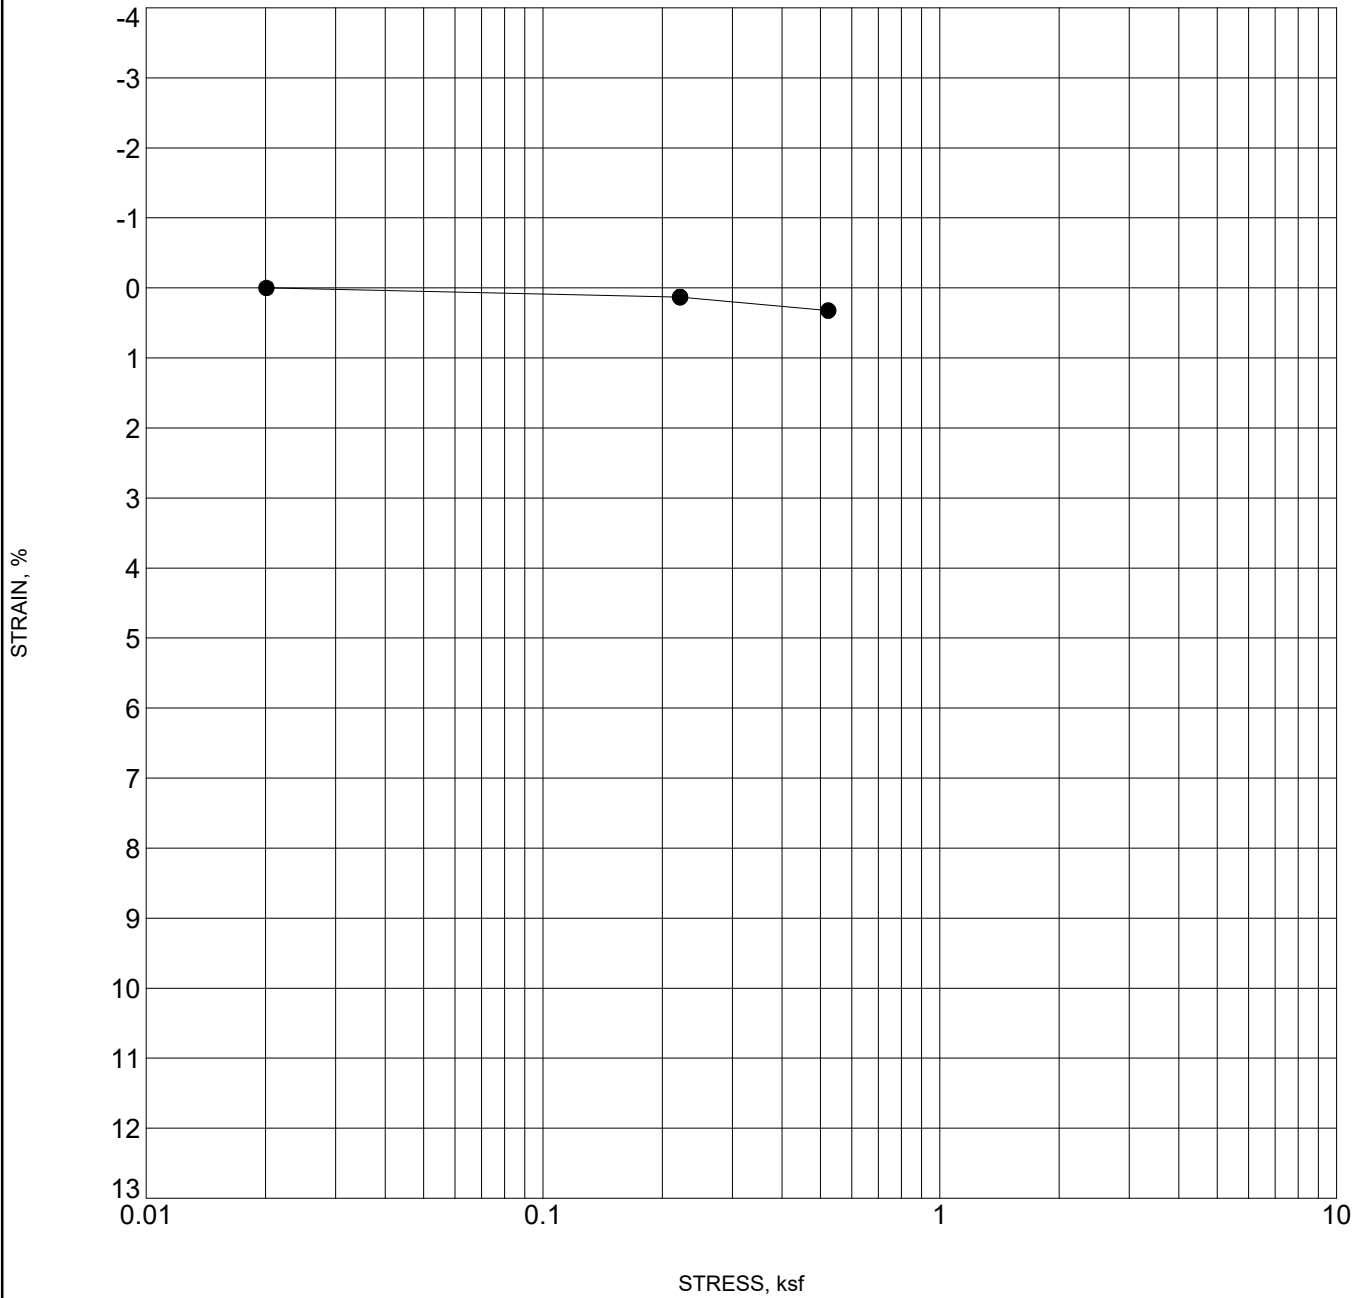

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● 24-4 2	SILT, sandy w clayey SAND in parts	0.0	127.5	10.0

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

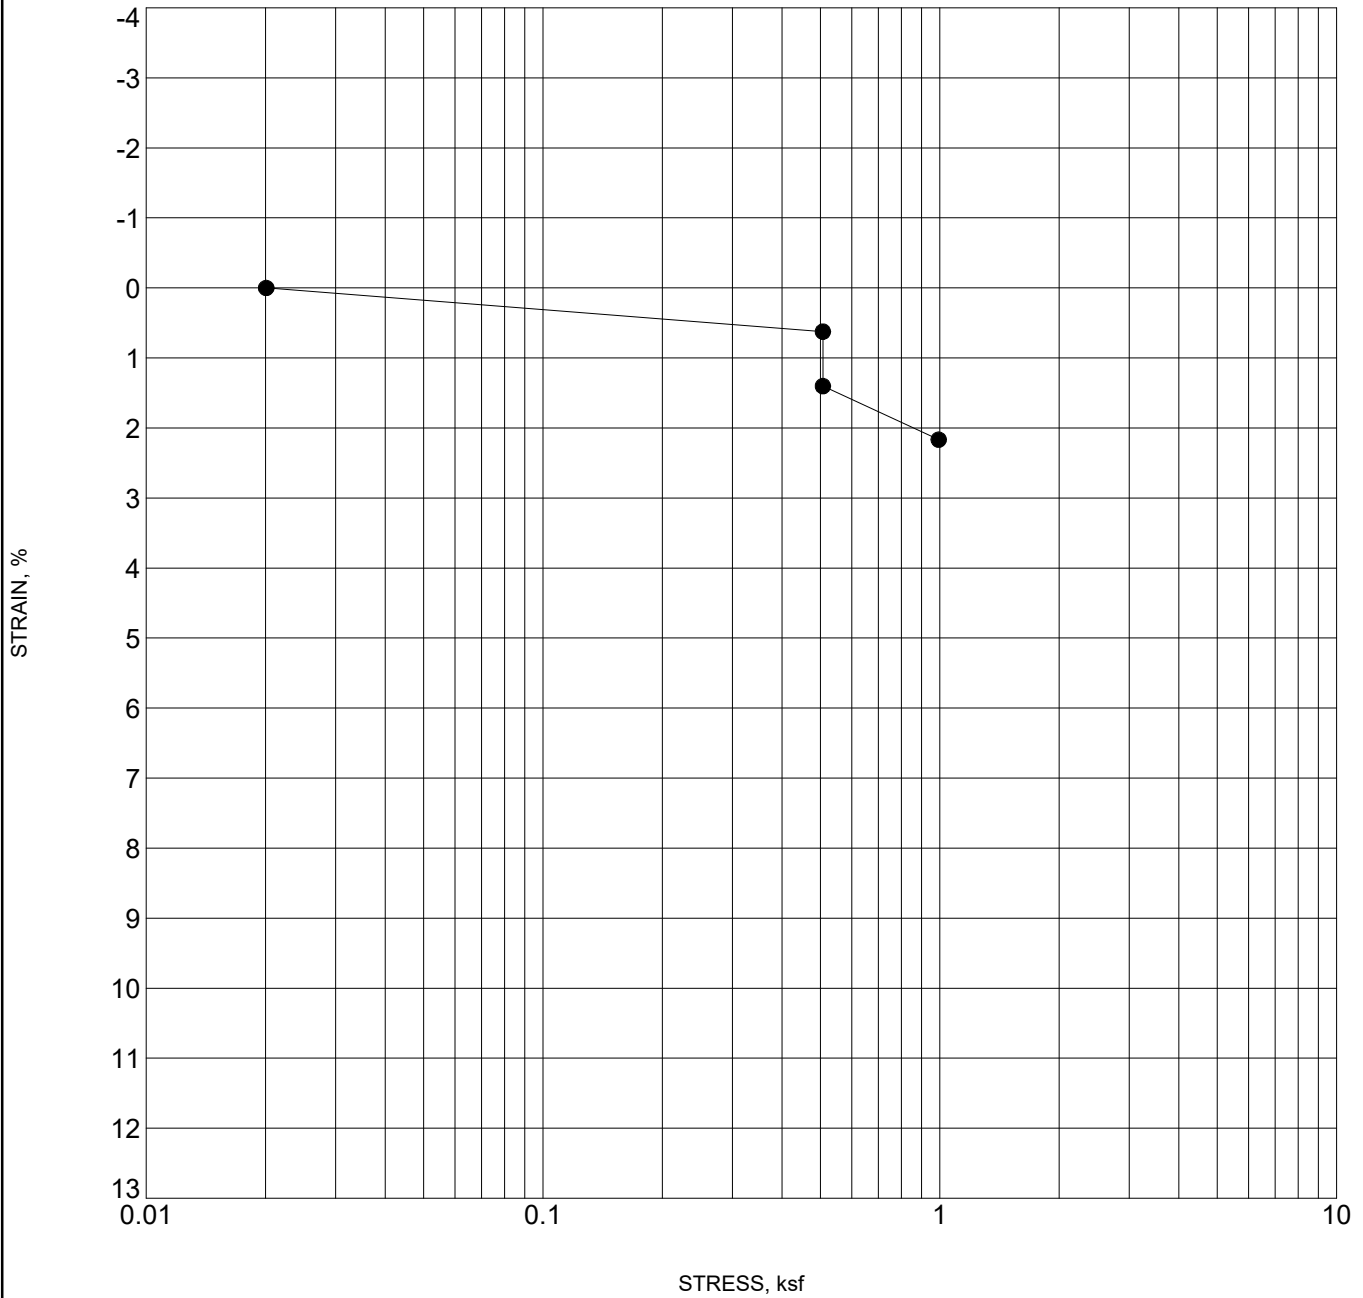

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● 24-6 4	SAND, clayey to silty	-0.8	111.9	16.2

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

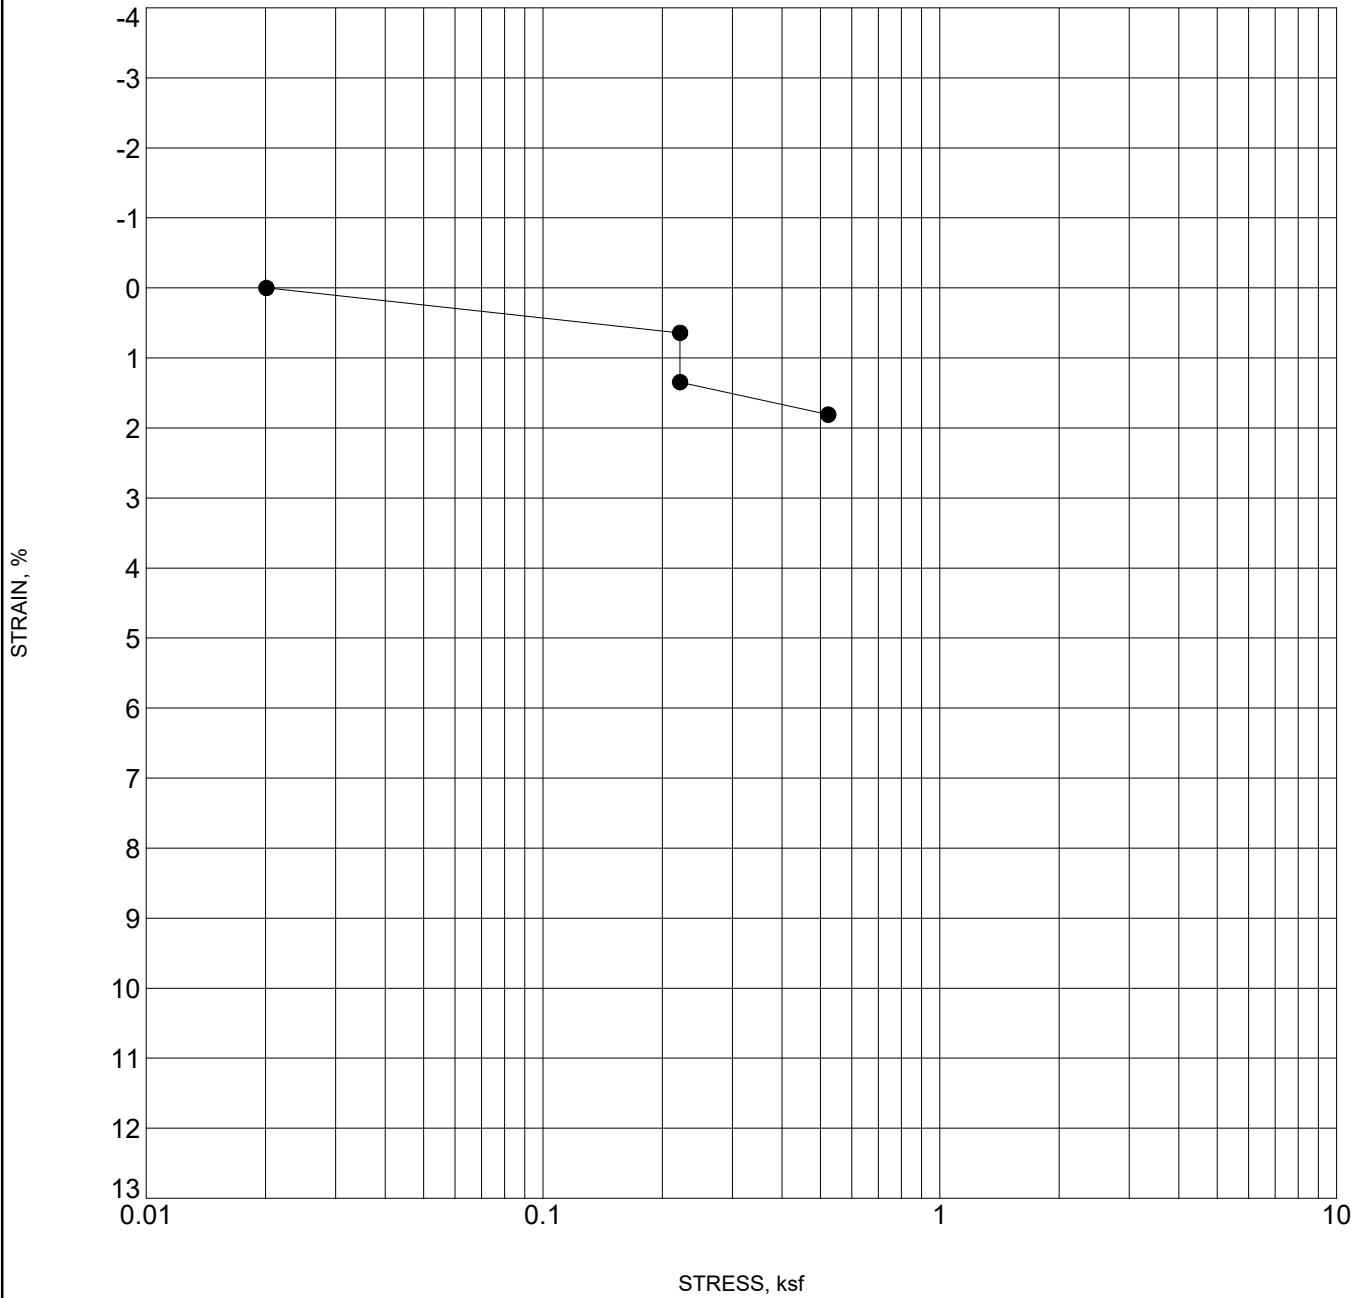

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● 24-7 4	CLAY, sandy	-0.7	111.8	18.0

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

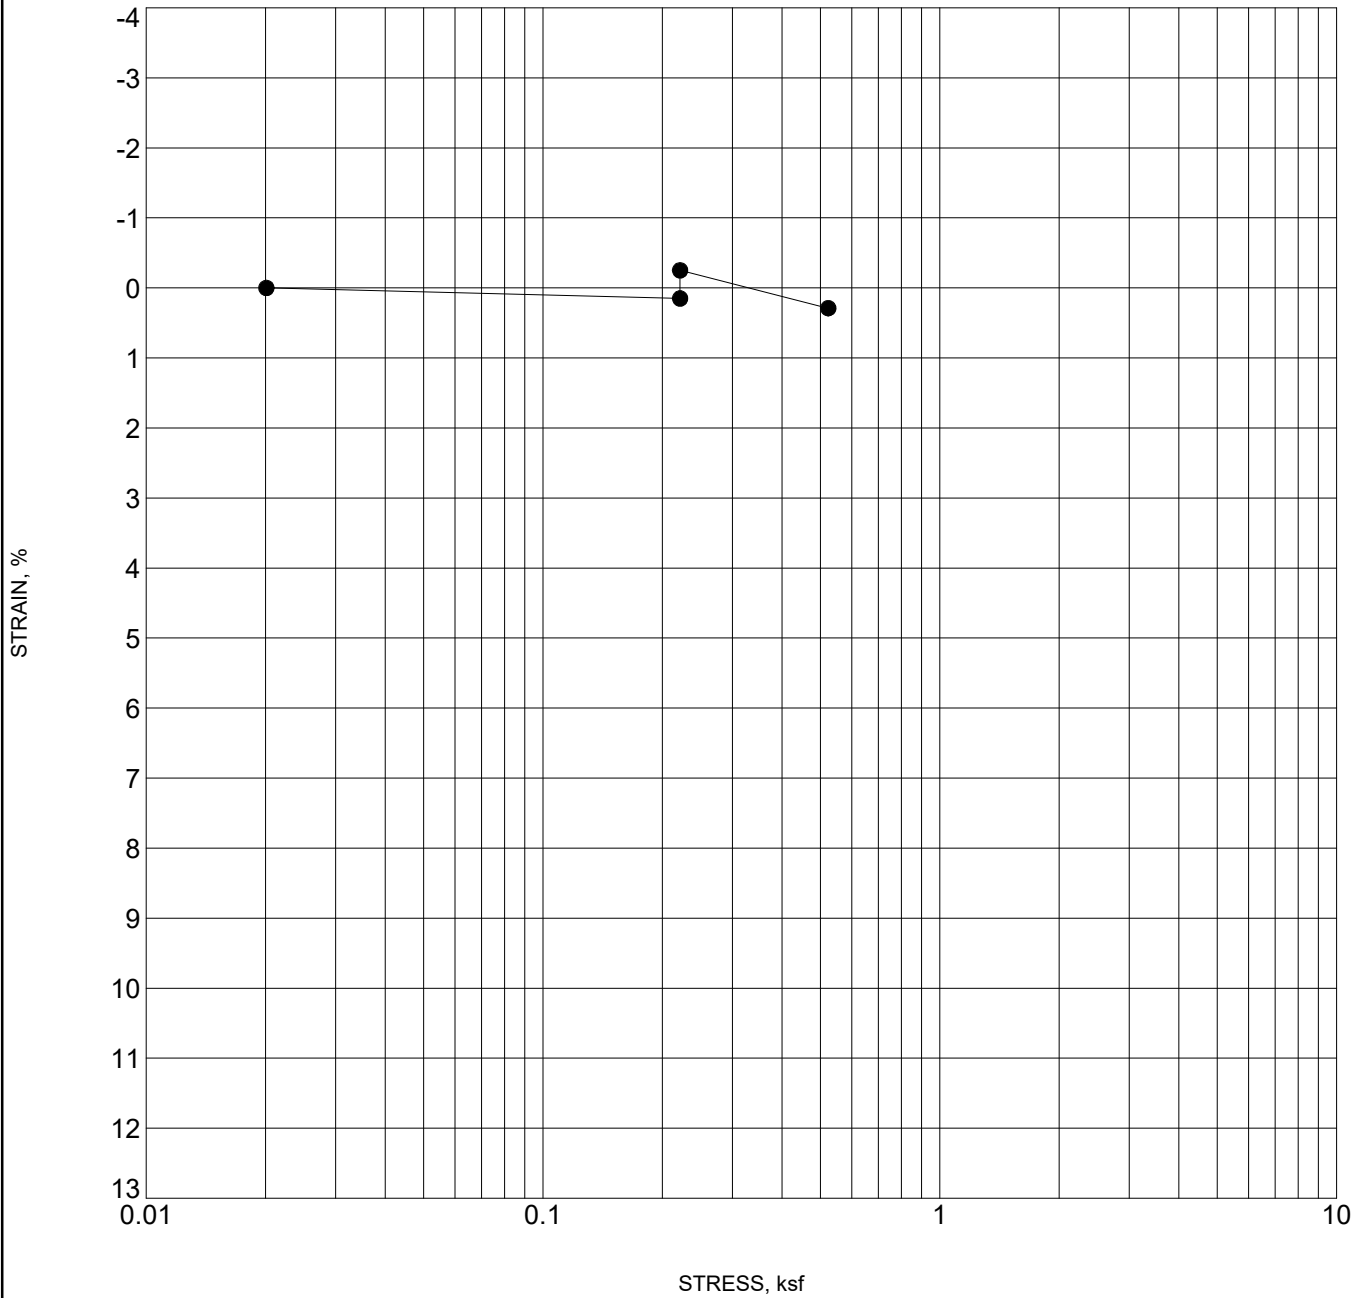

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● G-1 2	SAND, silty, fine to coarse grained	0.4	112.0	6.3

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

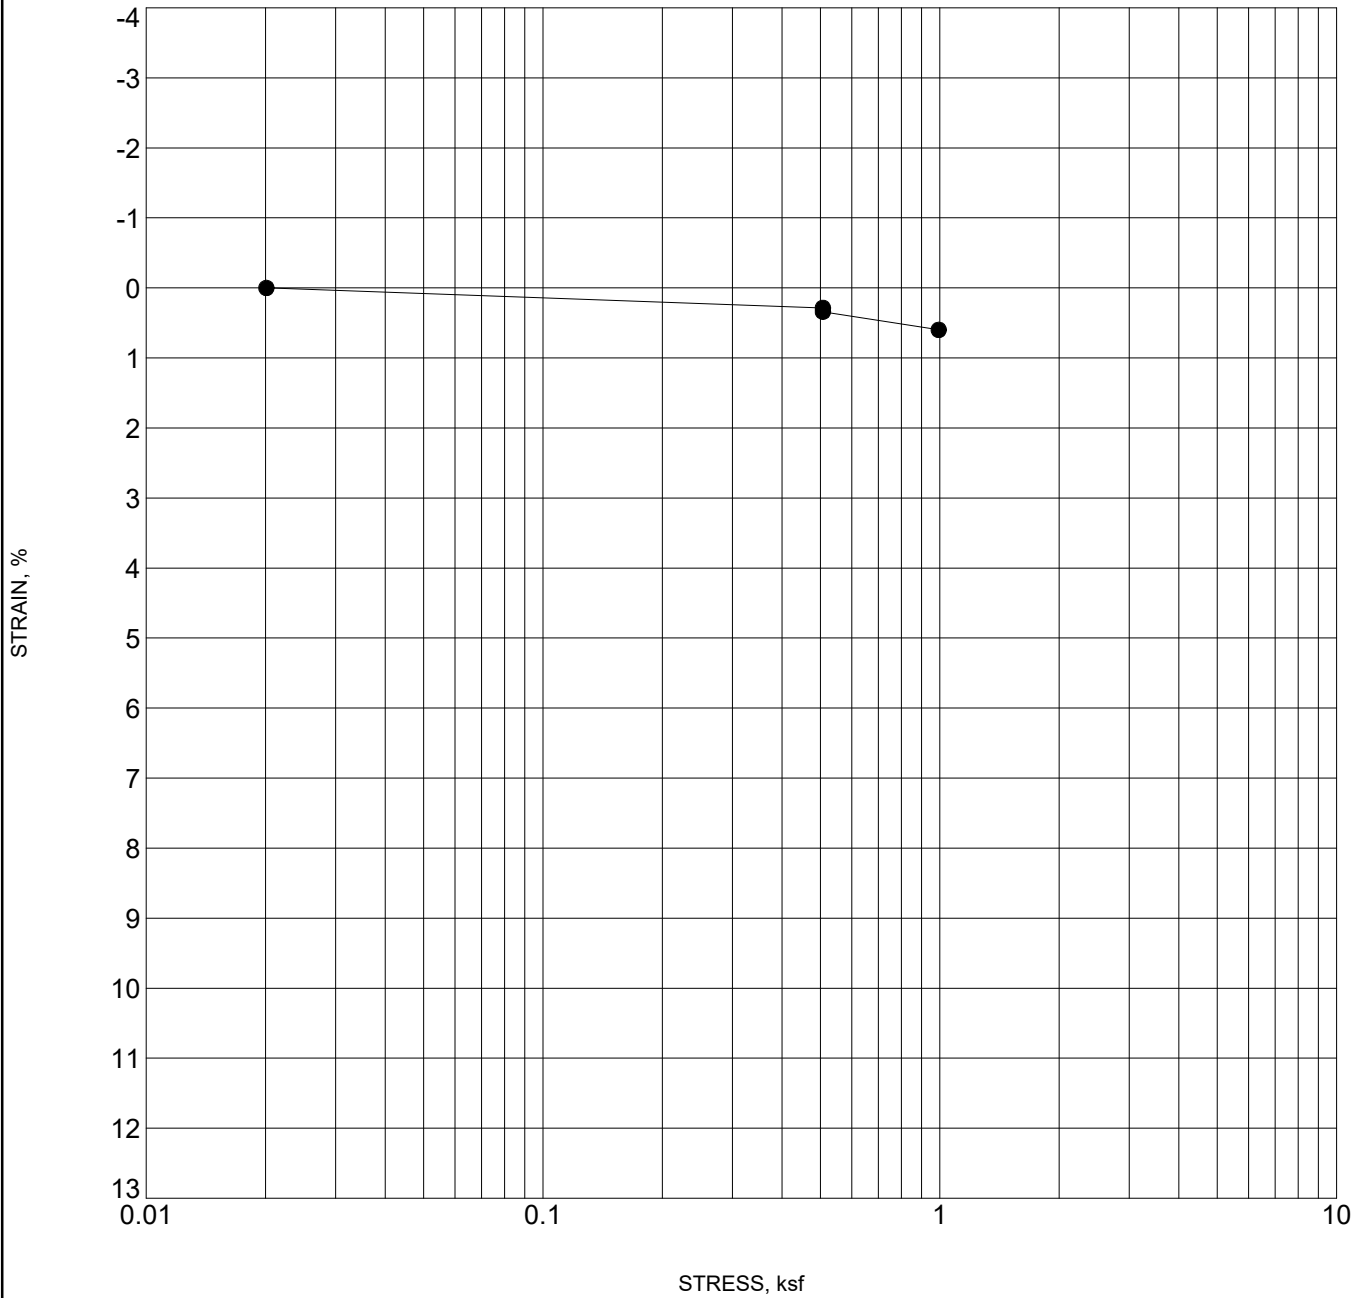

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● G-2 4	SAND, silty to slightly clayey in parts	-0.1	114.5	15.8

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

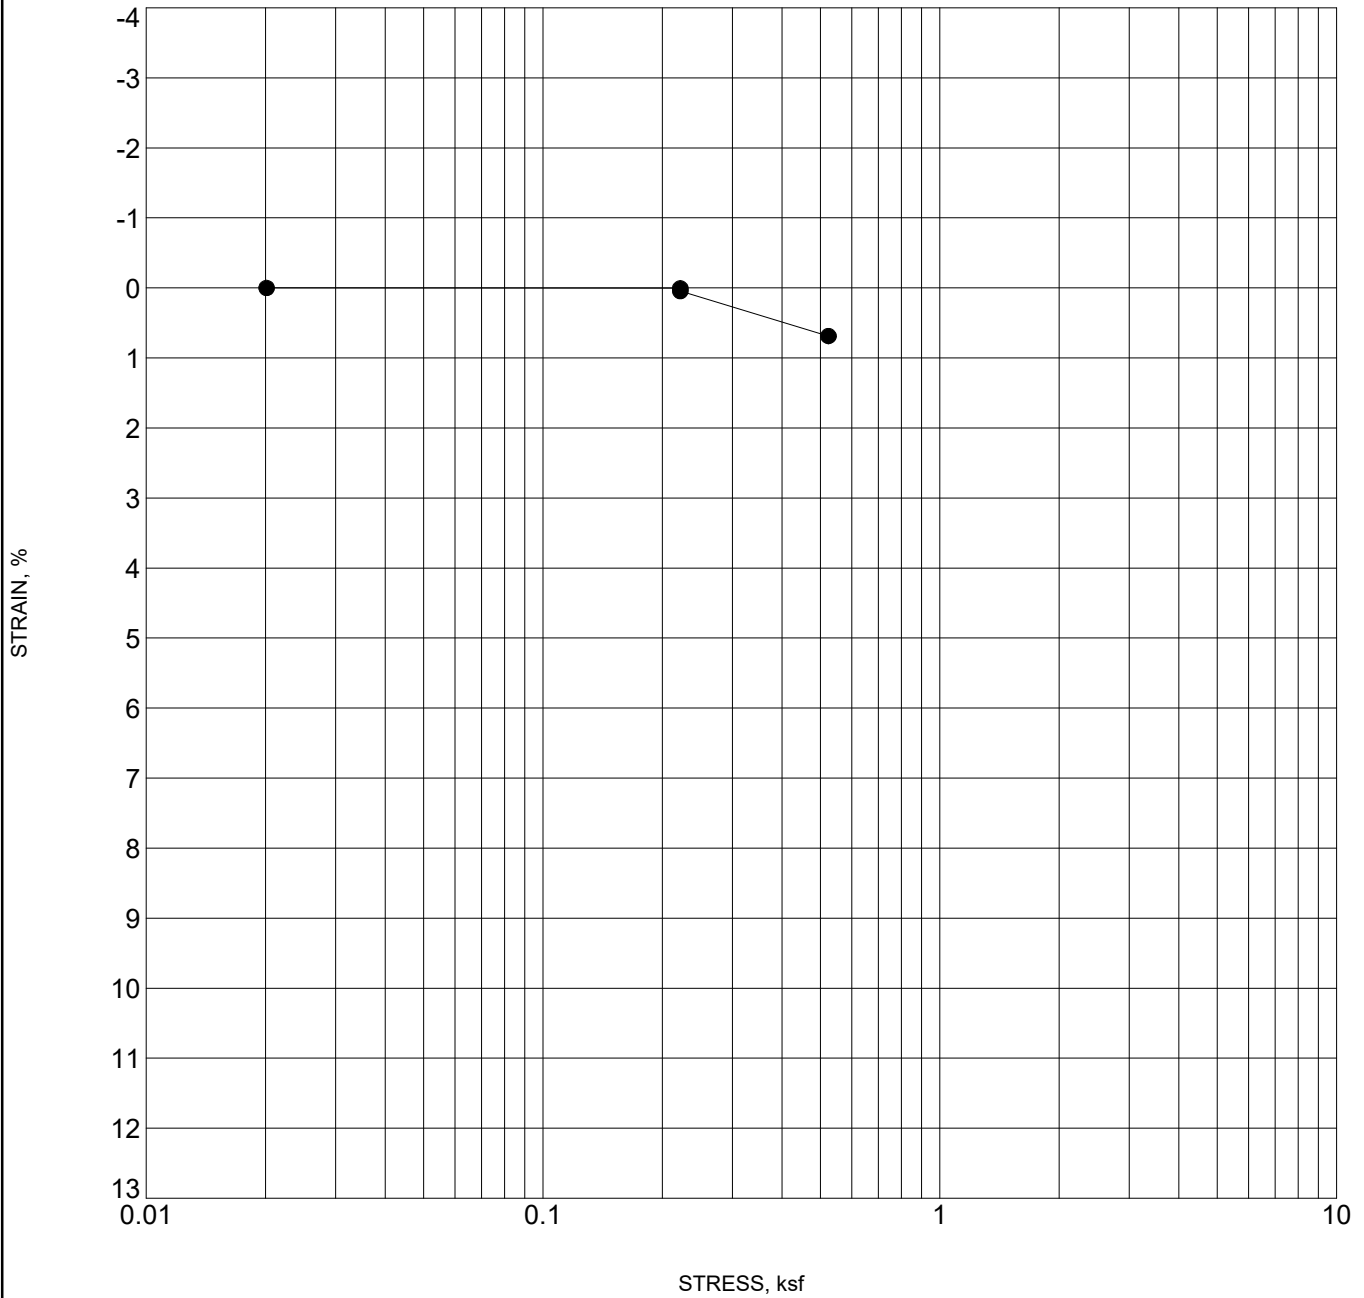

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● G-4 2	SAND, silty to slightly clayey in parts	0.0	108.4	18.7

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

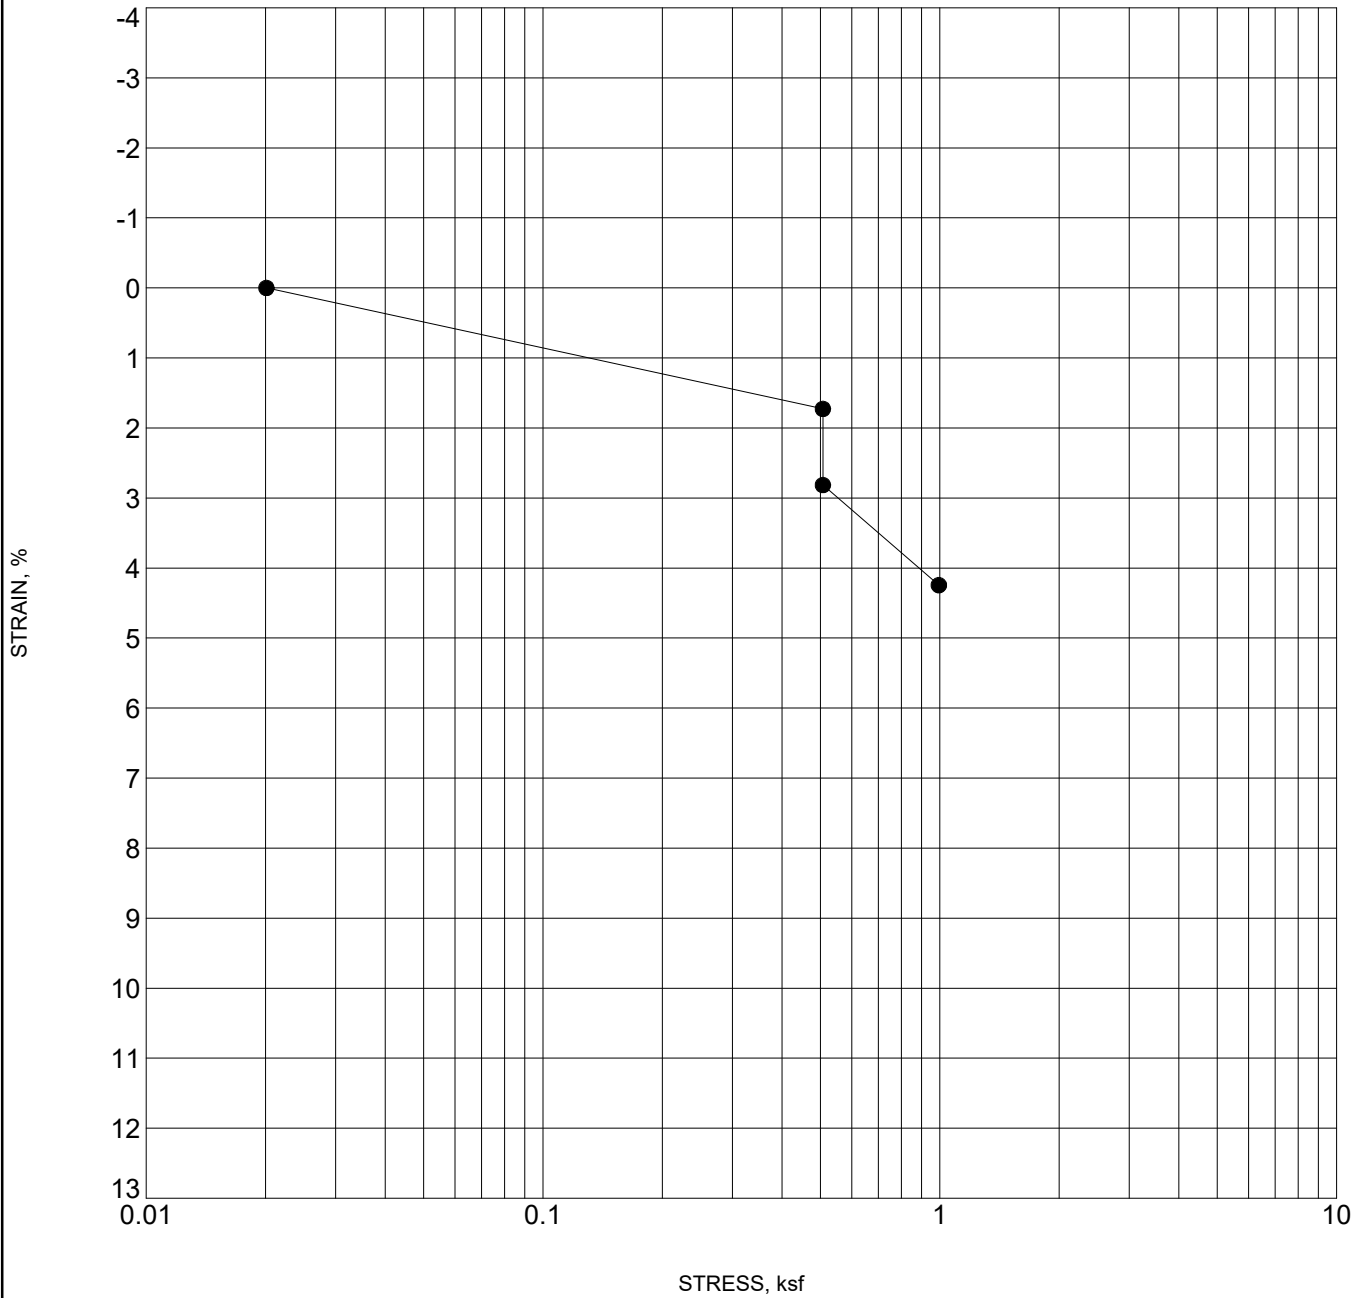

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● G-4 4	SAND, silty w sandy CLAY lenses in parts	-1.1	99.2	23.8

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

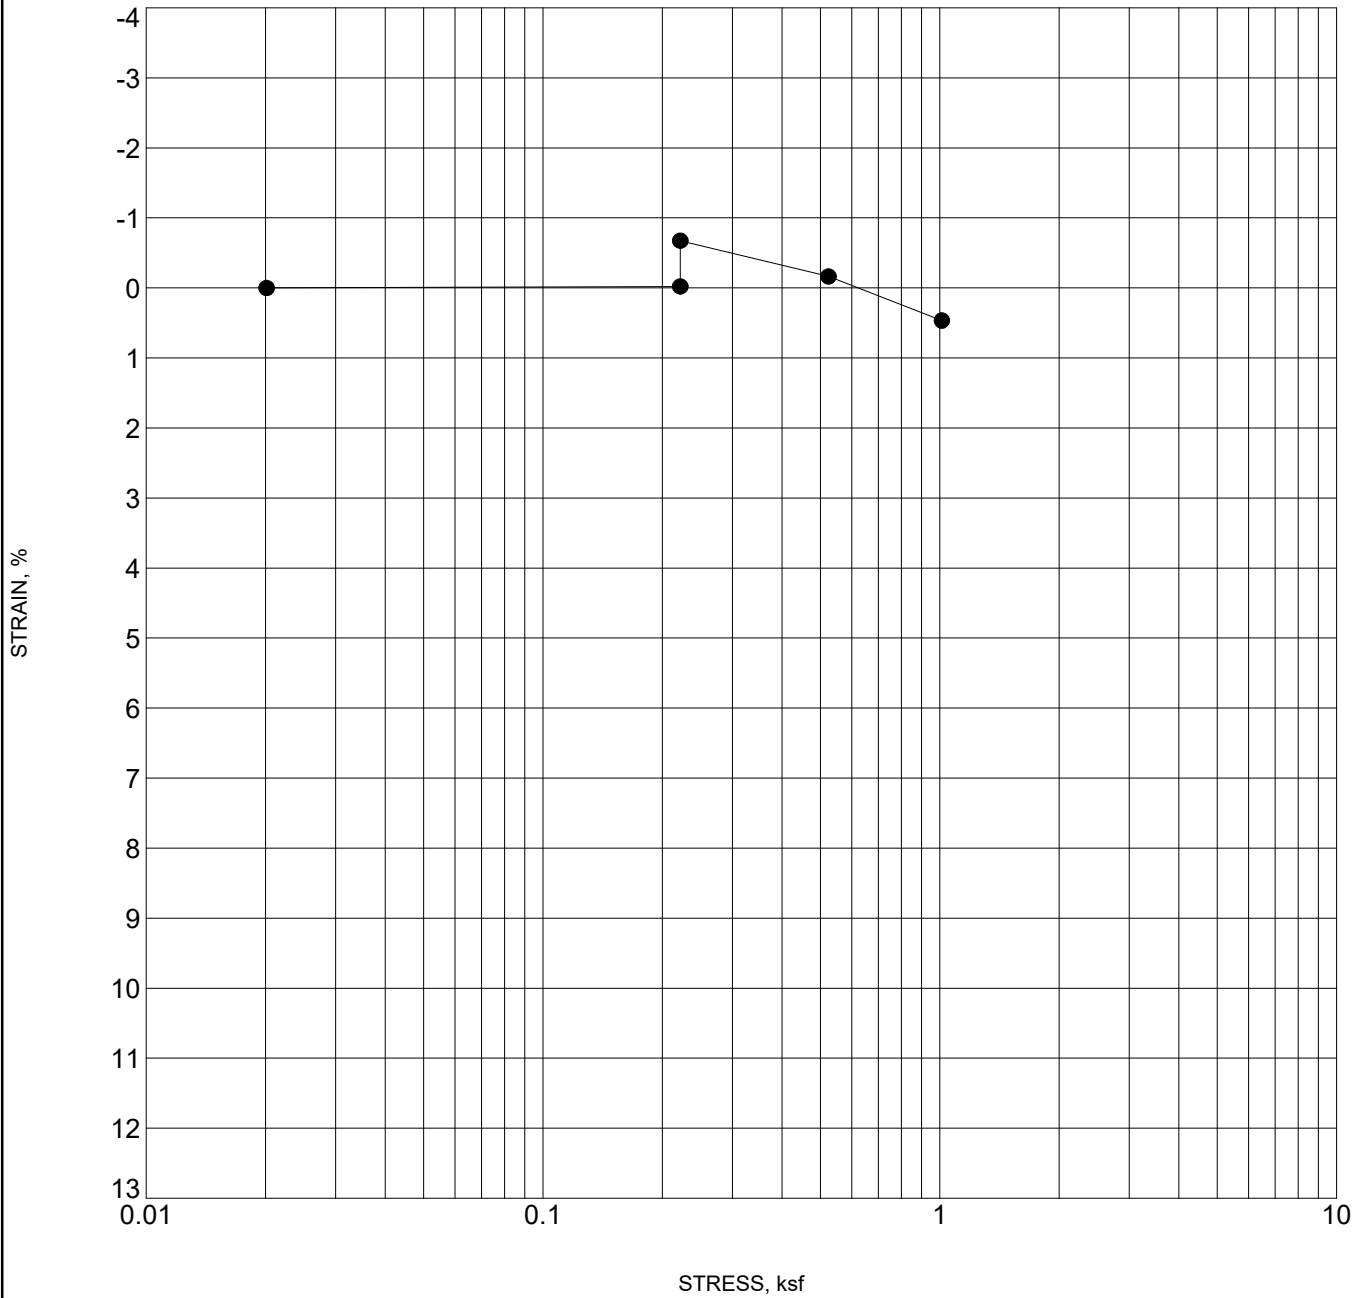

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● G-6 2	CLAY, sandy w silt	0.7	113.9	12.6

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

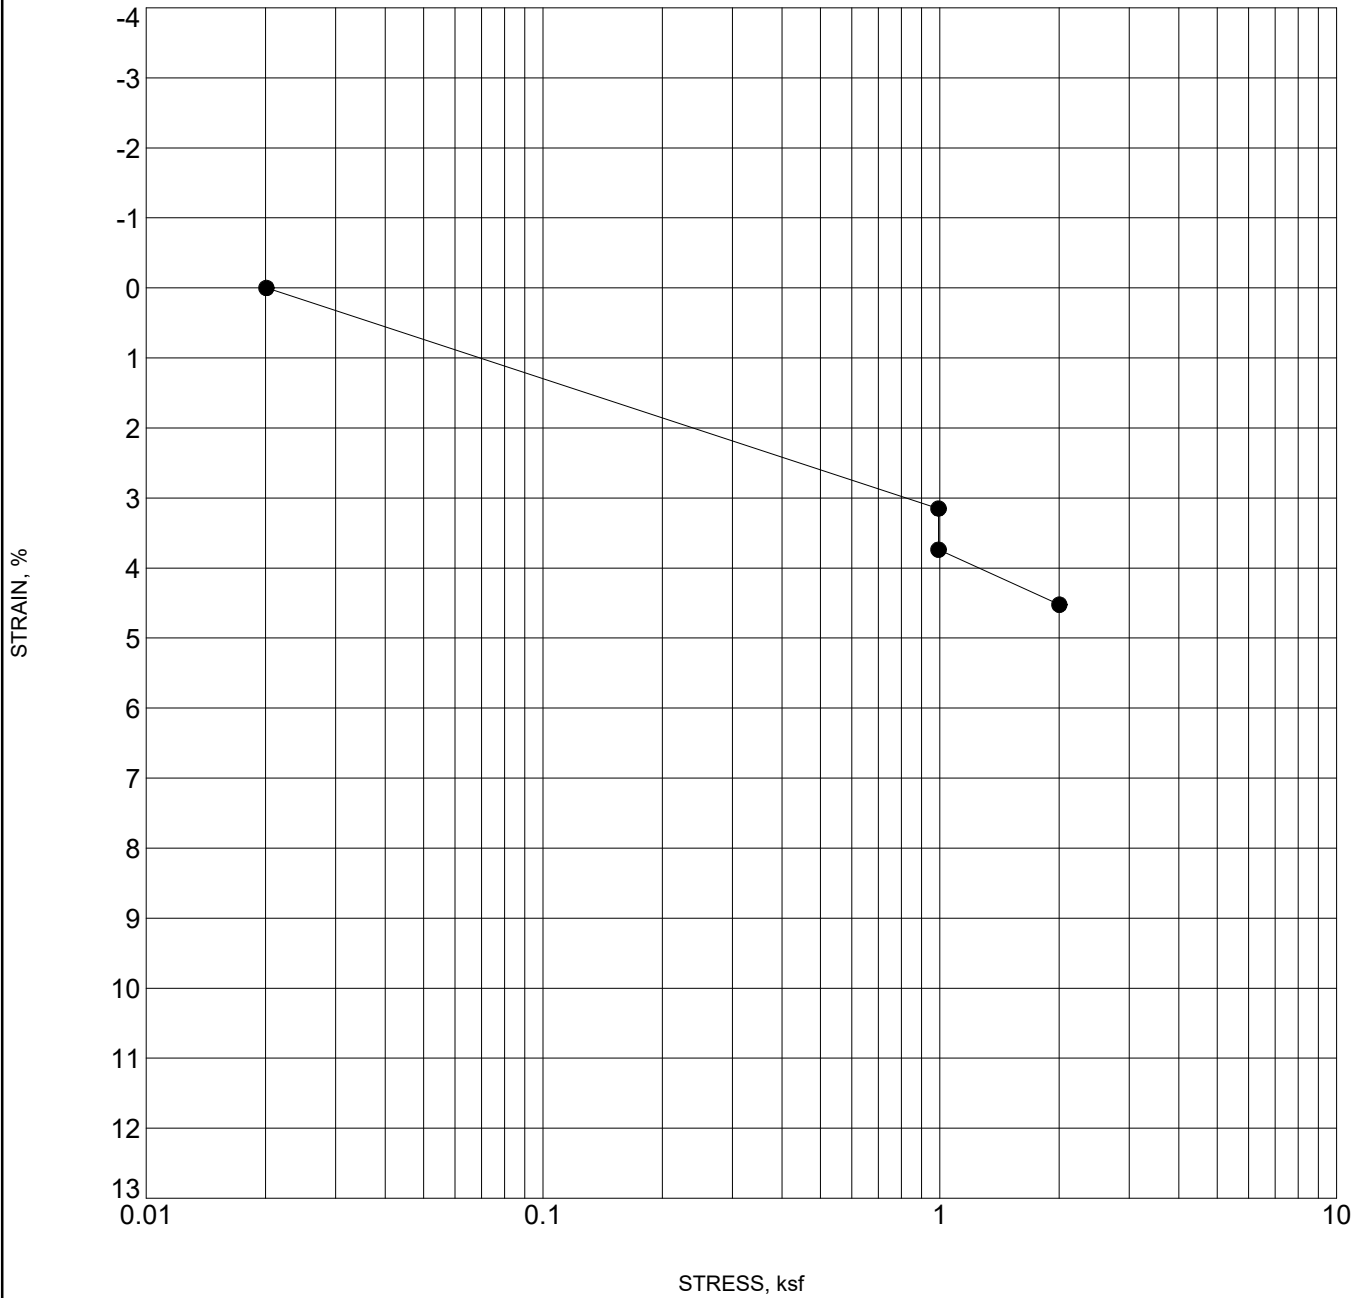

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● LC-1 9	CLAY, silty to sandy	-0.6	93.1	25.1

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

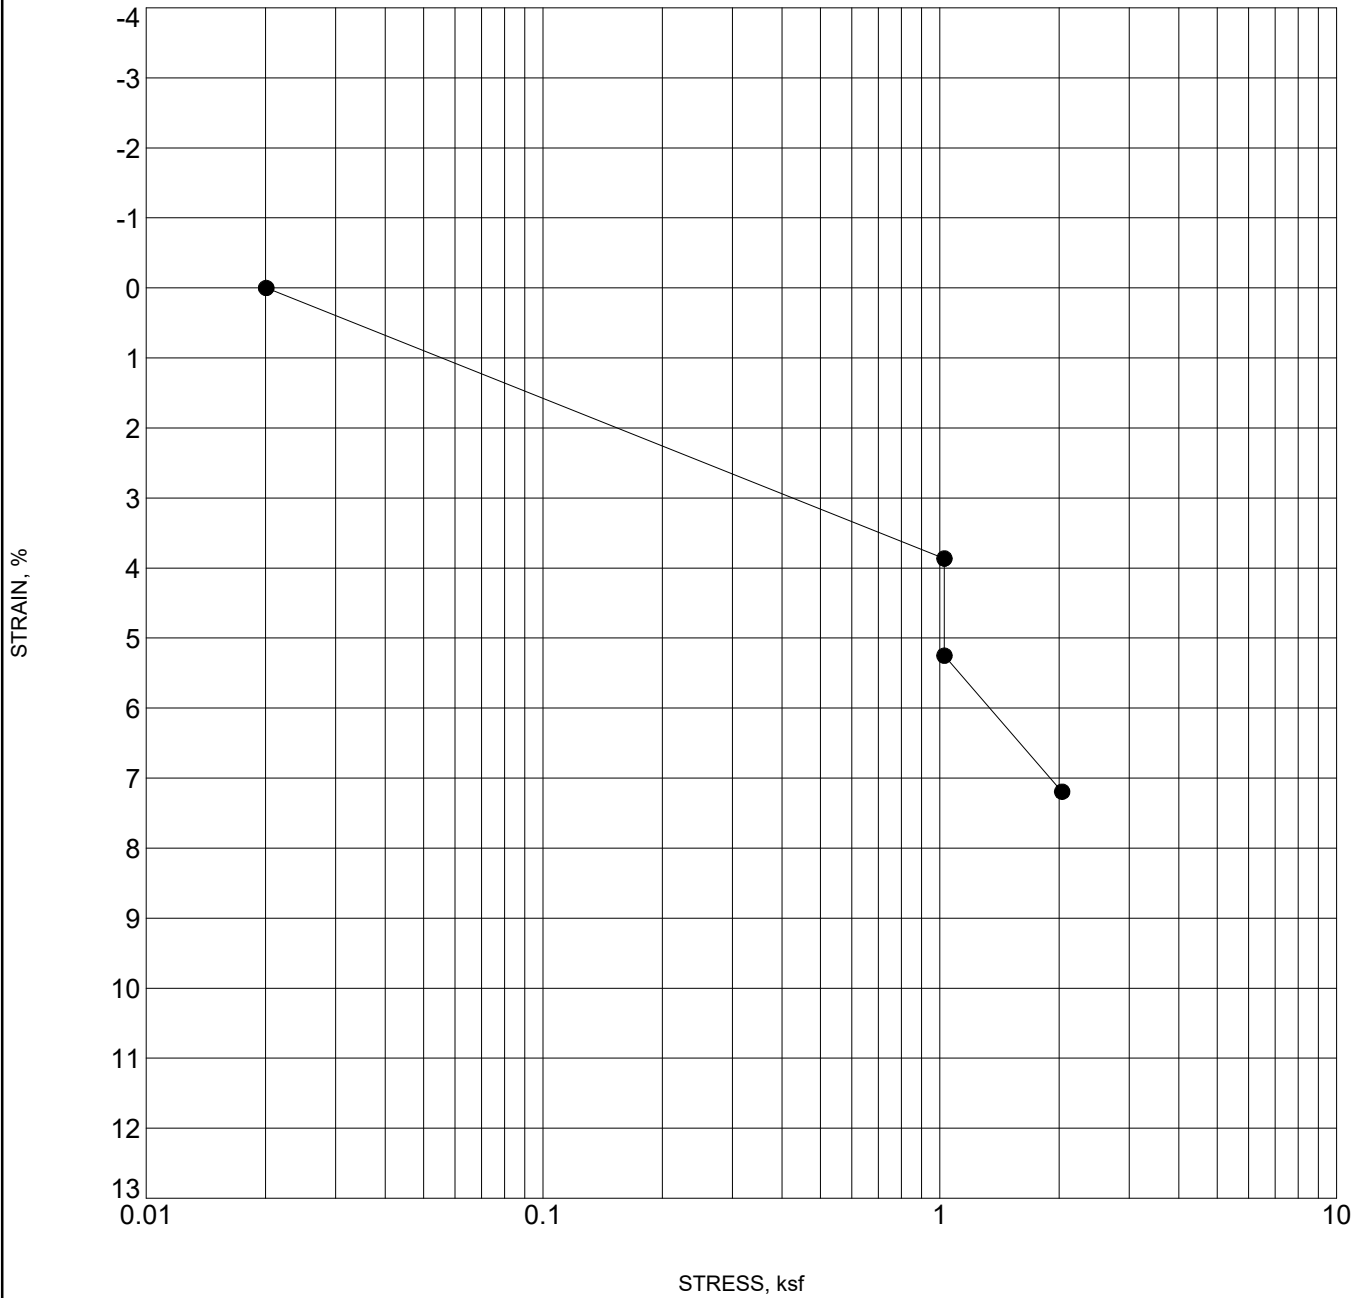

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL_TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● LC-1 19	CLAY, silty to sandy	-1.4	99.2	24.4

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

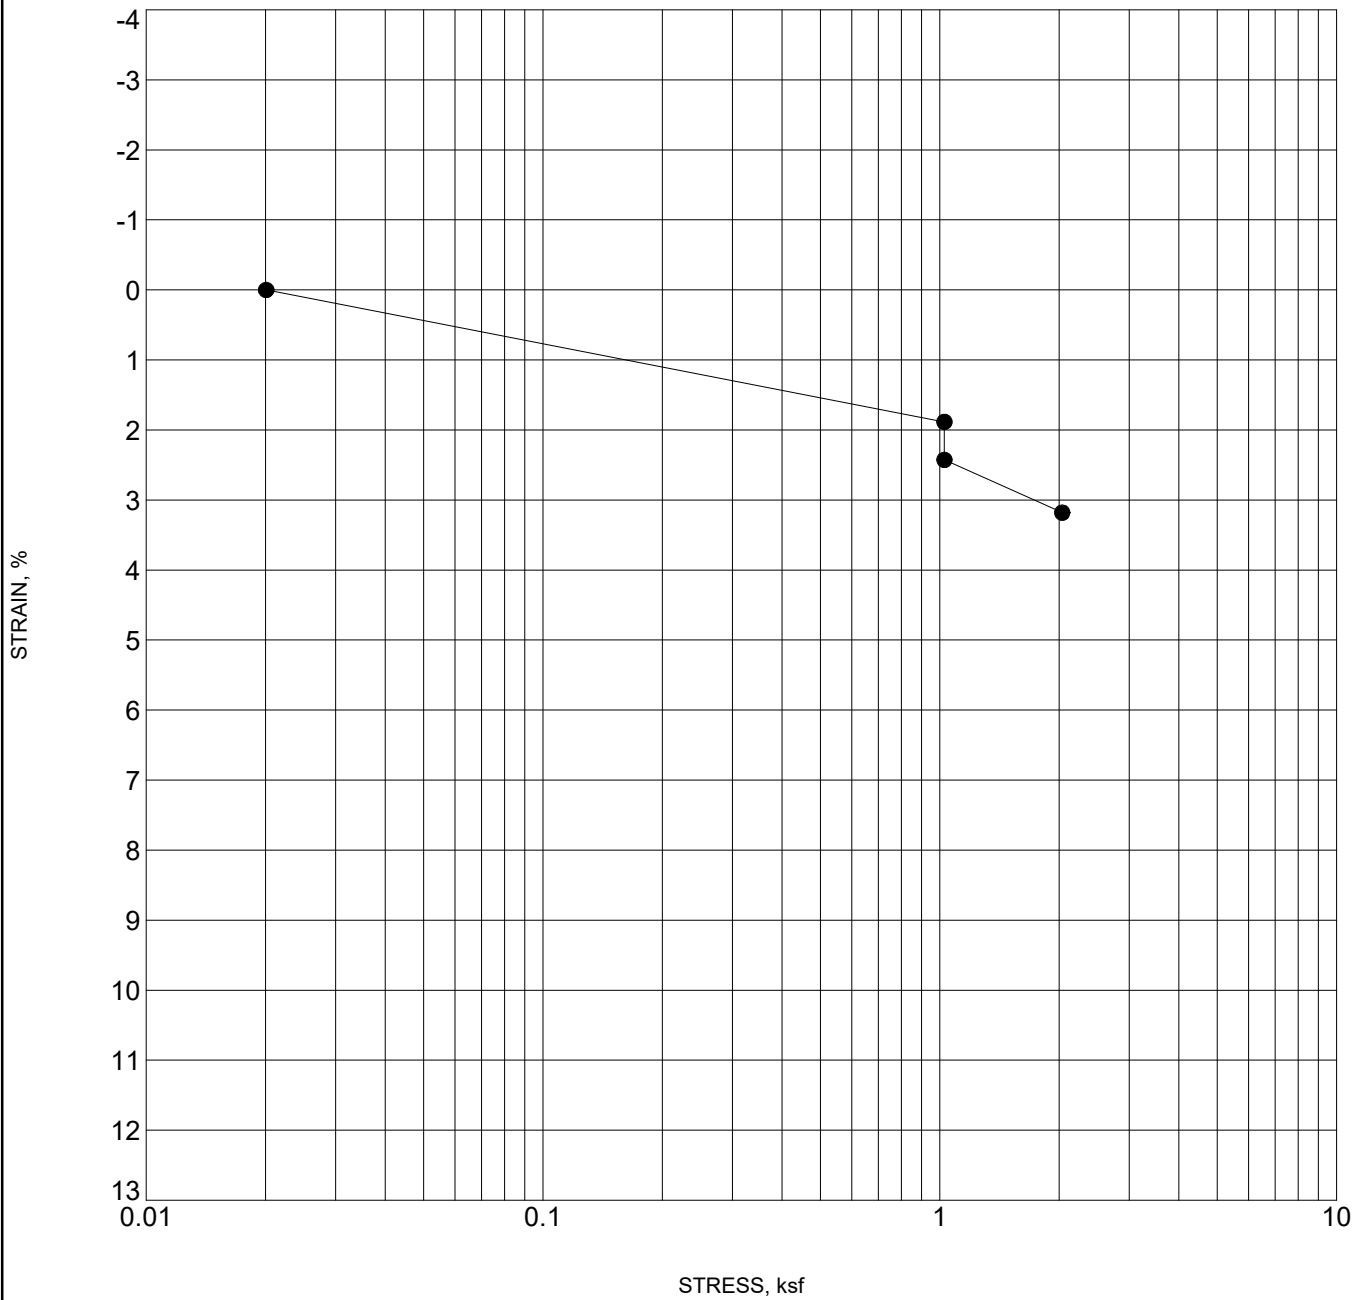

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● LC-2 4	CLAY, sandy to silty	-0.5	107.0	21.5

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

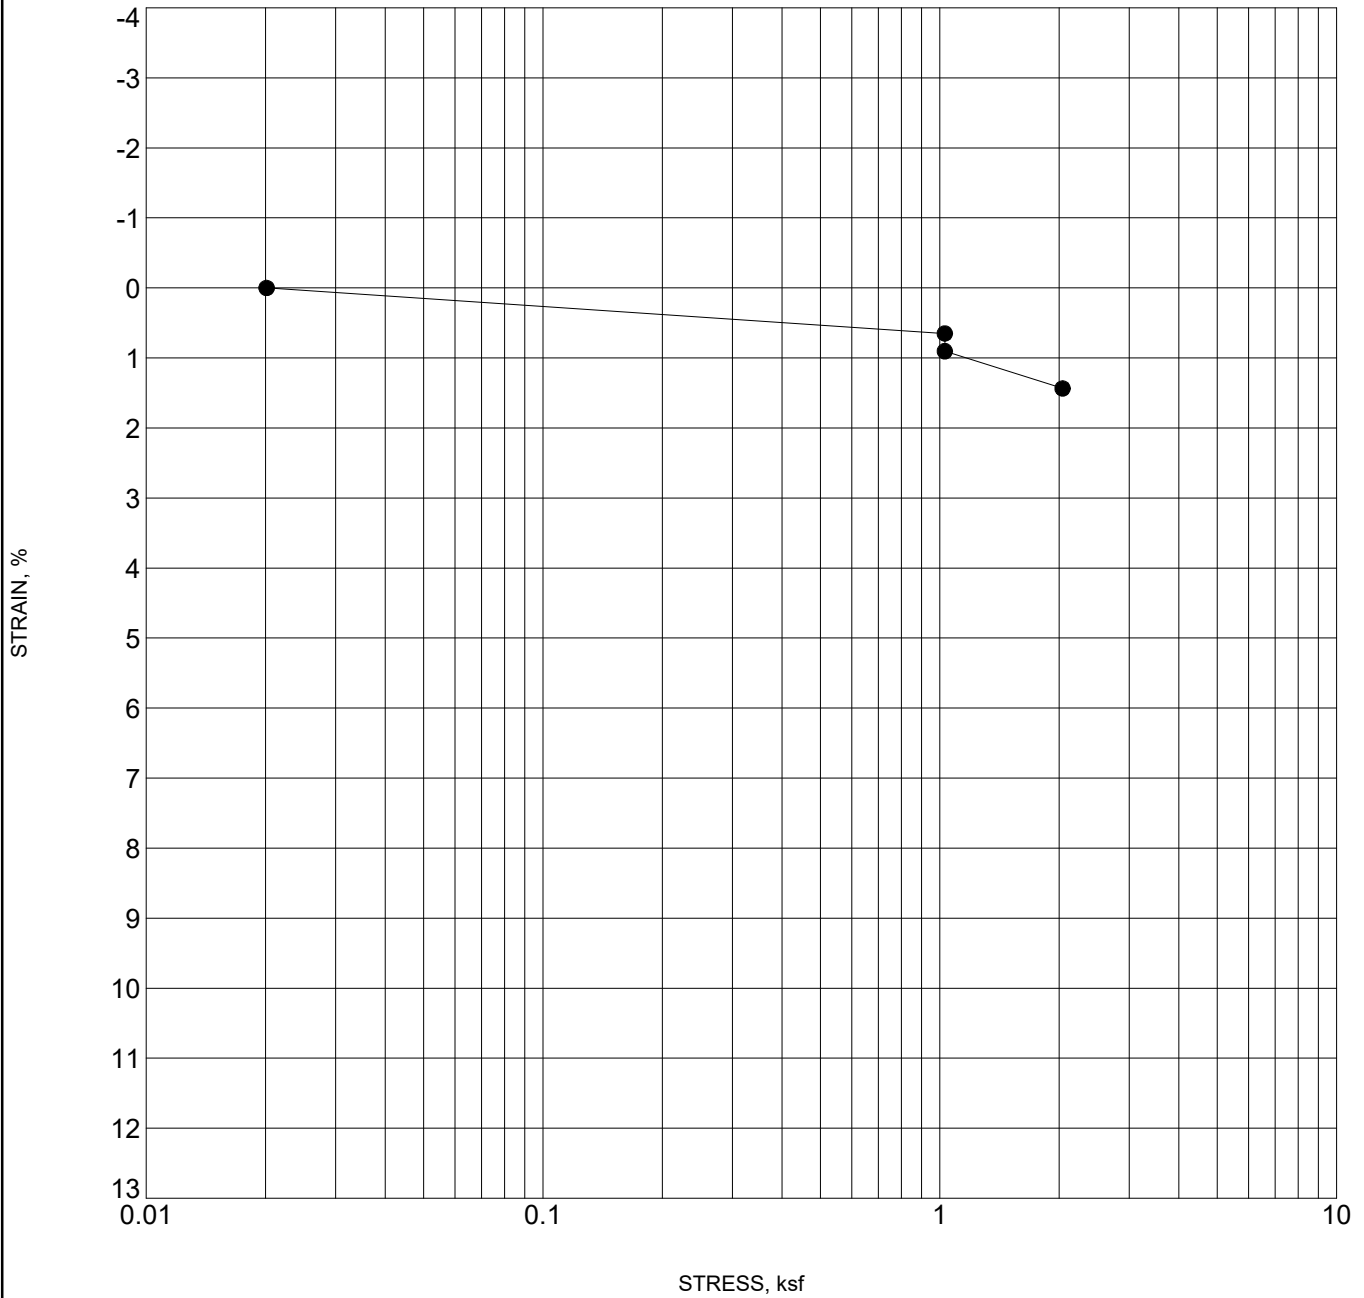

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● LC-2 14	CLAY, sandy to silty	-0.3	106.0	22.4

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

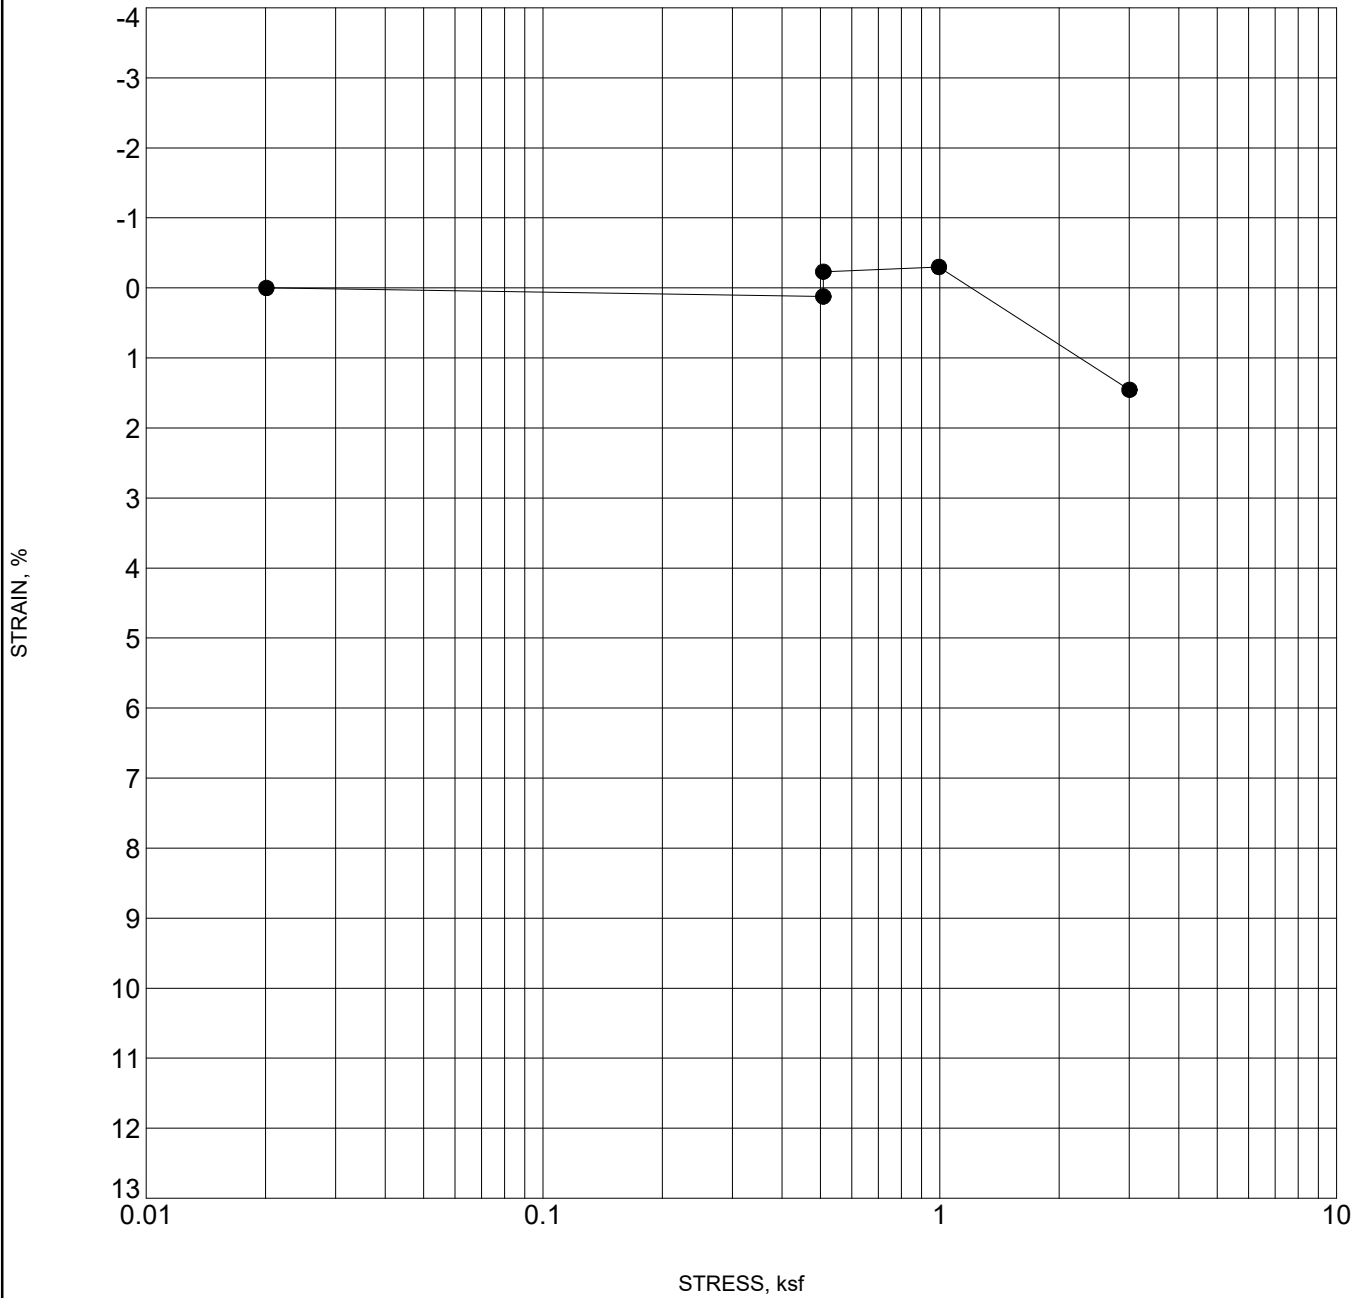

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● T-1 4	CLAY, sandy	0.4	110.7	14.2

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

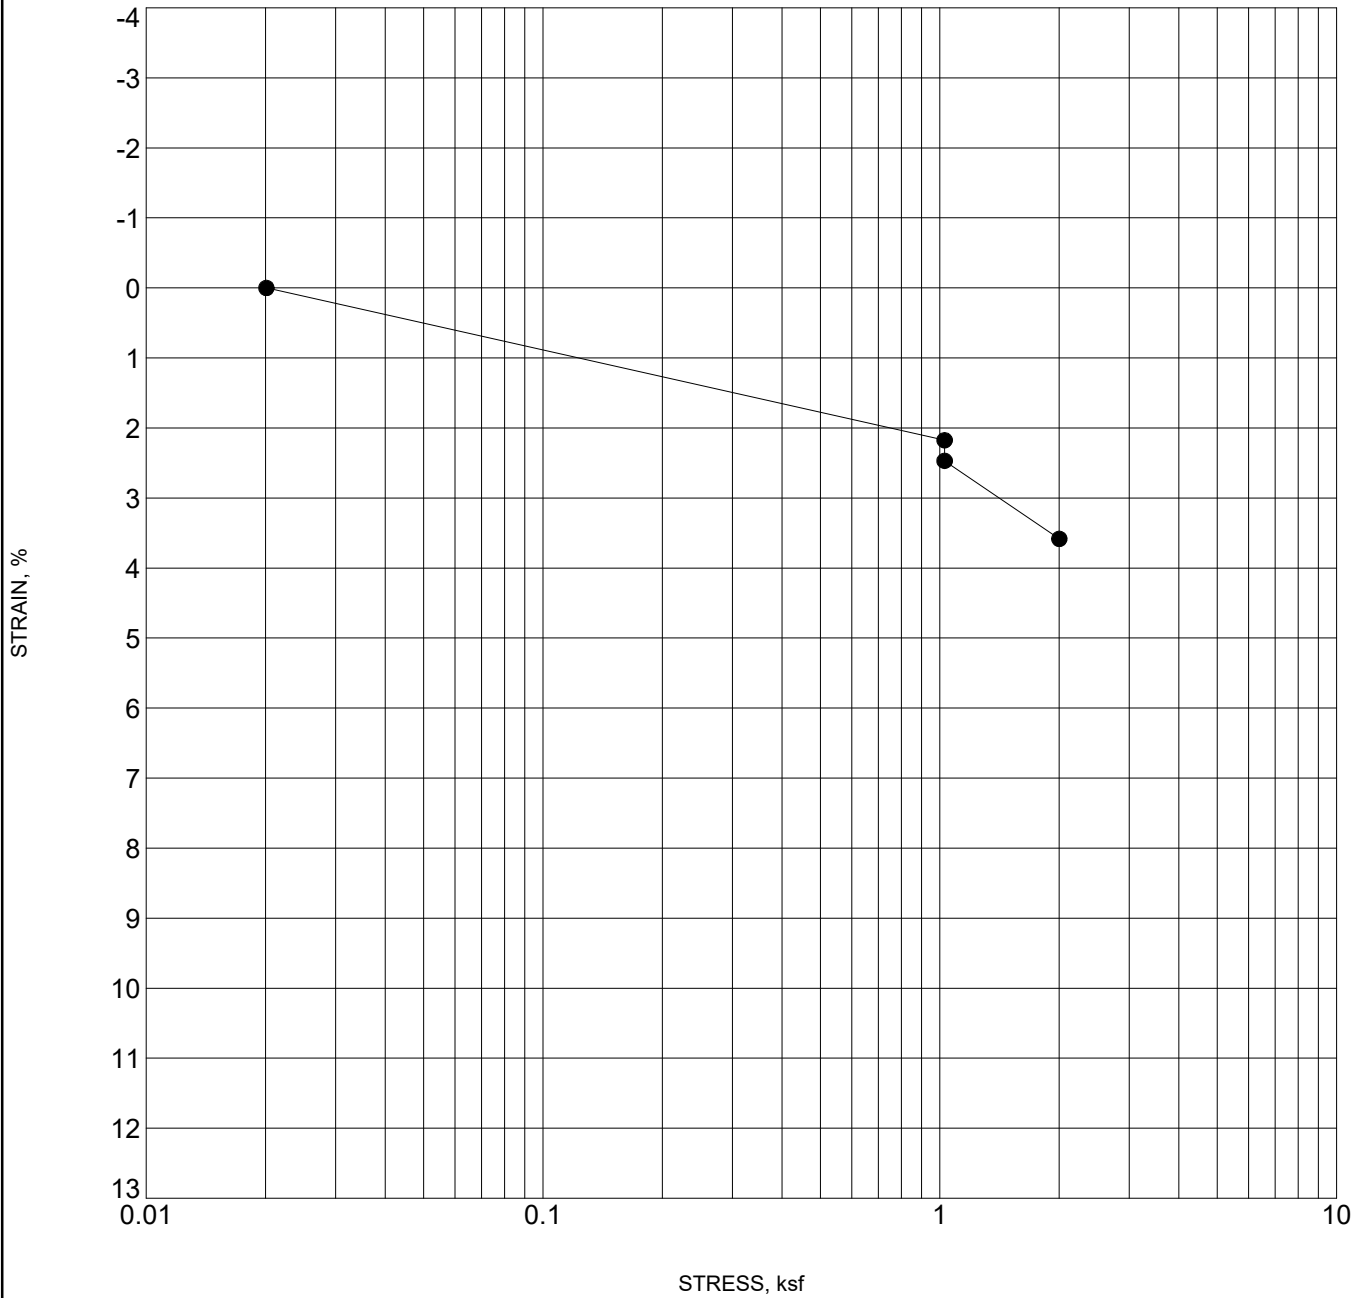

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● T-1 9	CLAY, sandy to silty w SAND lenses in parts	-0.3	98.2	26.8

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

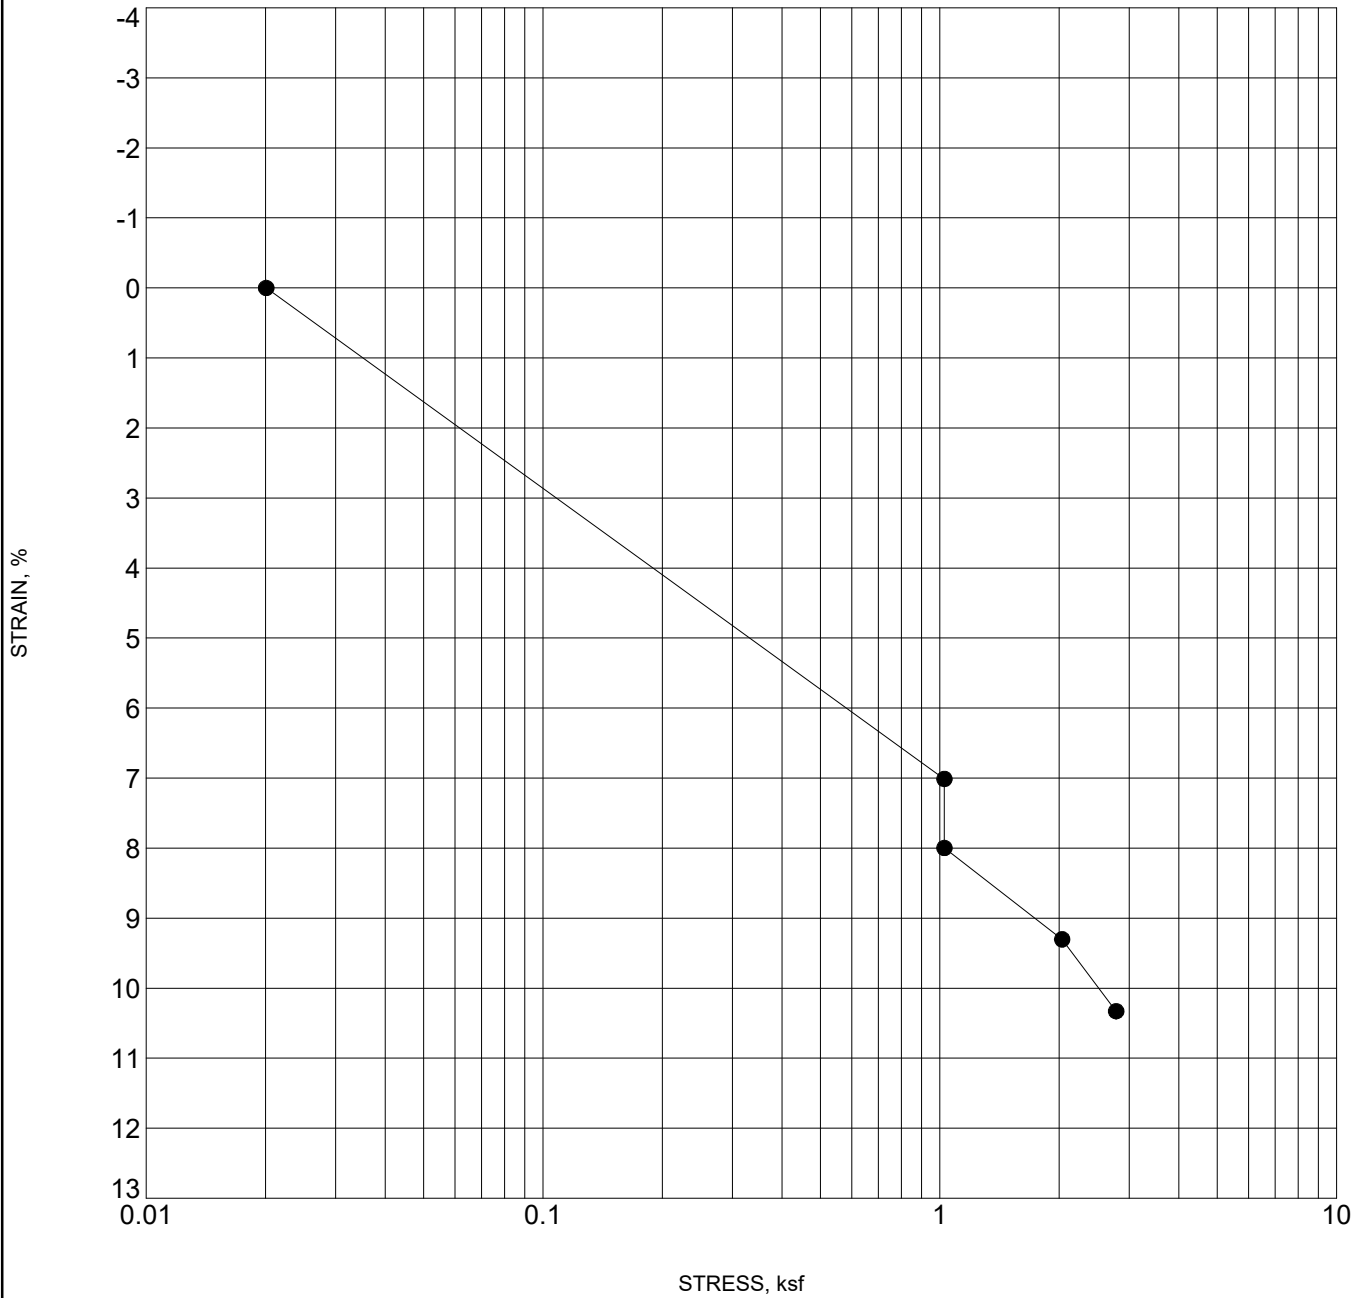

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● T-2 14	CLAY, w silt and sand, SAND lenses in parts	-1.0	94.7	26.7

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

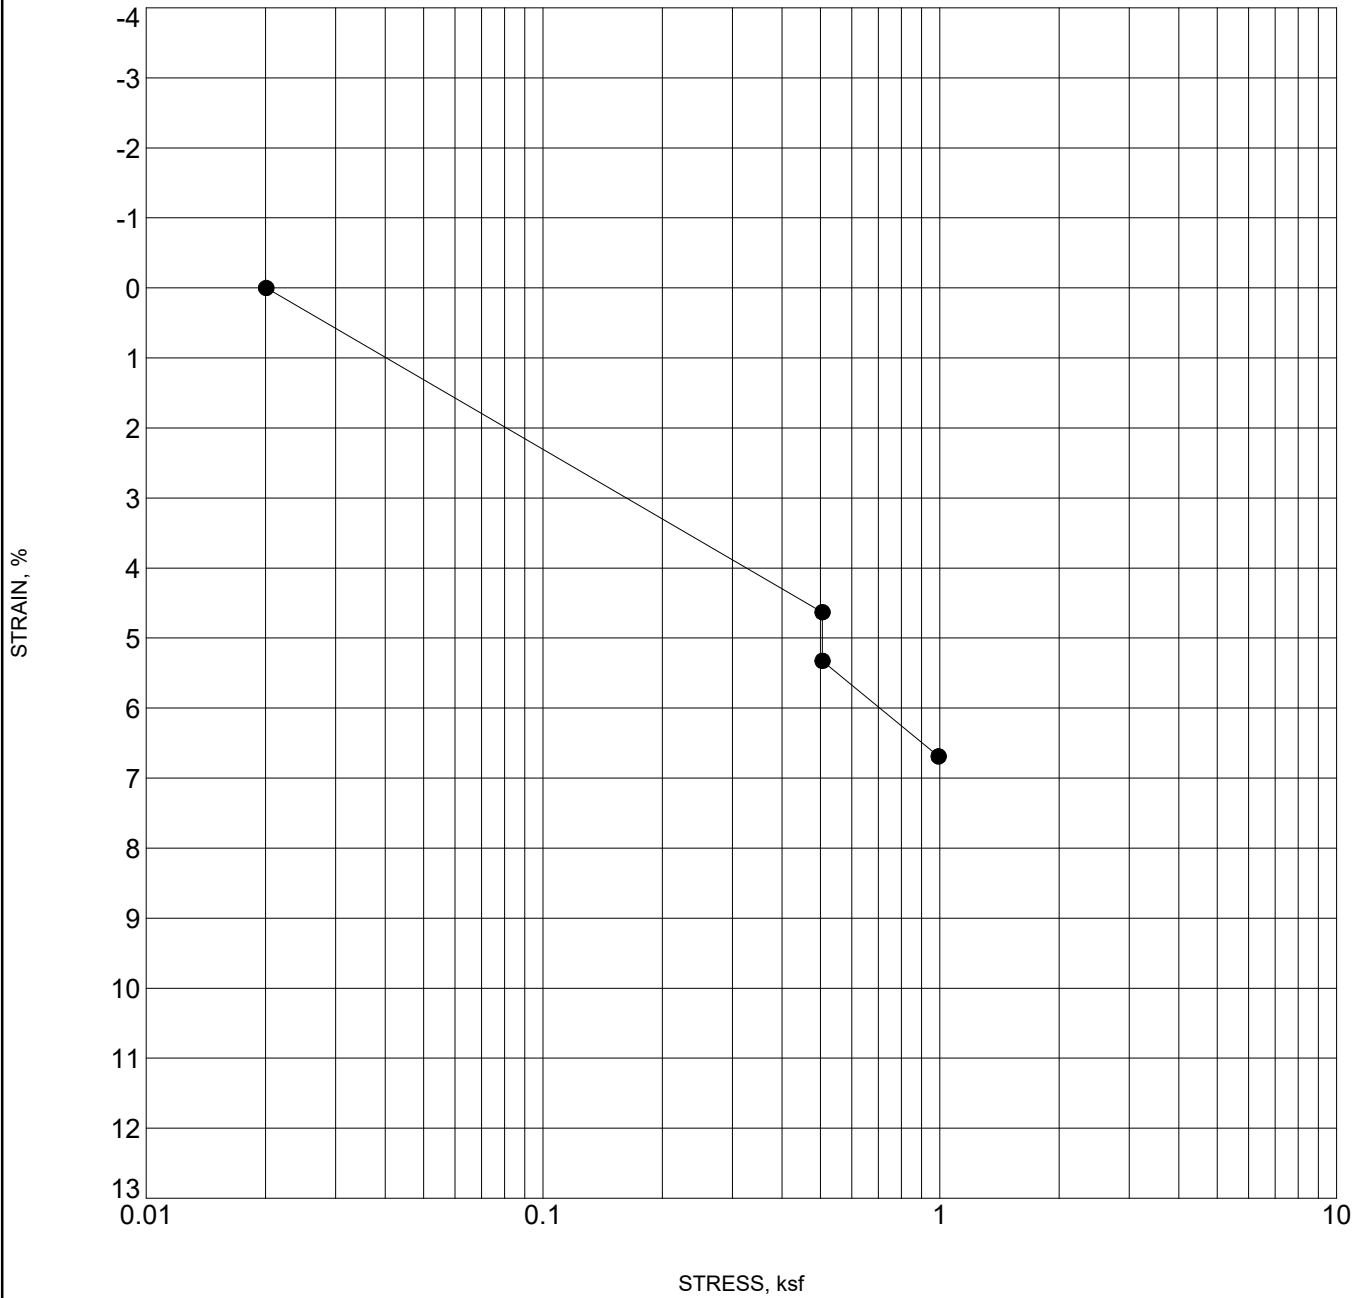

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● T-3 4	CLAY, silty	-0.7	97.1	25.2

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

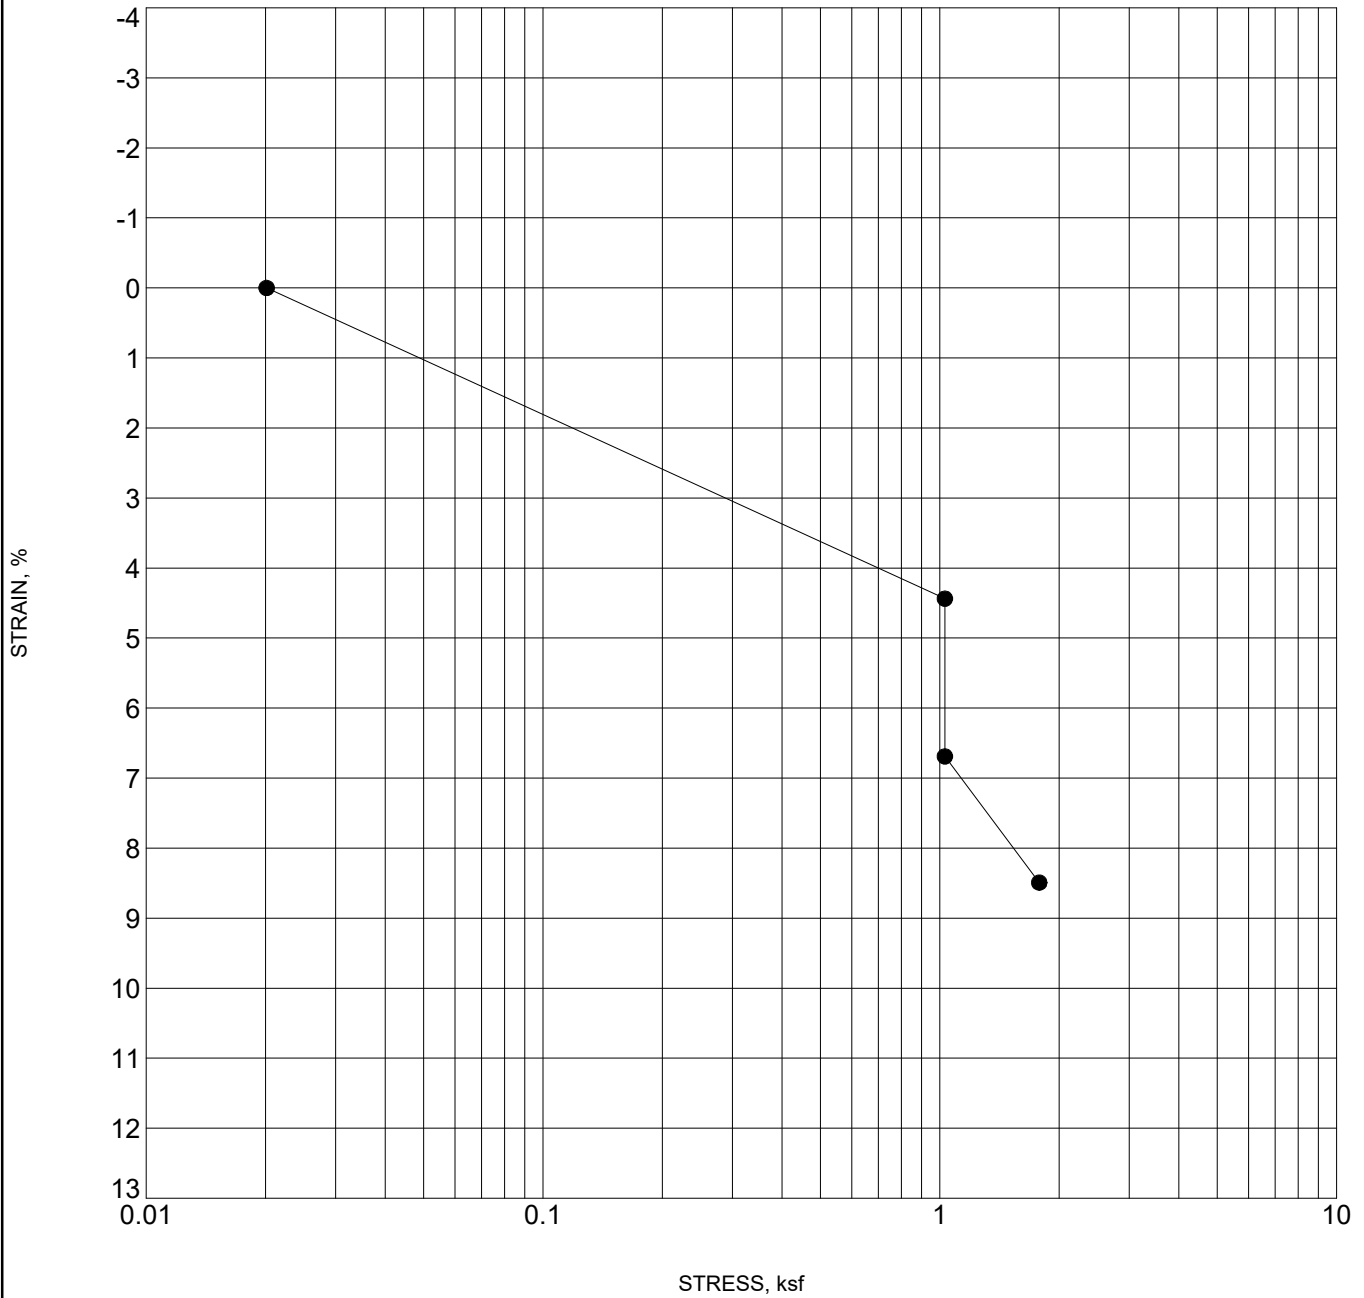

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL_TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● T-3 9	CLAY, silty	-2.3	95.3	29.1

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

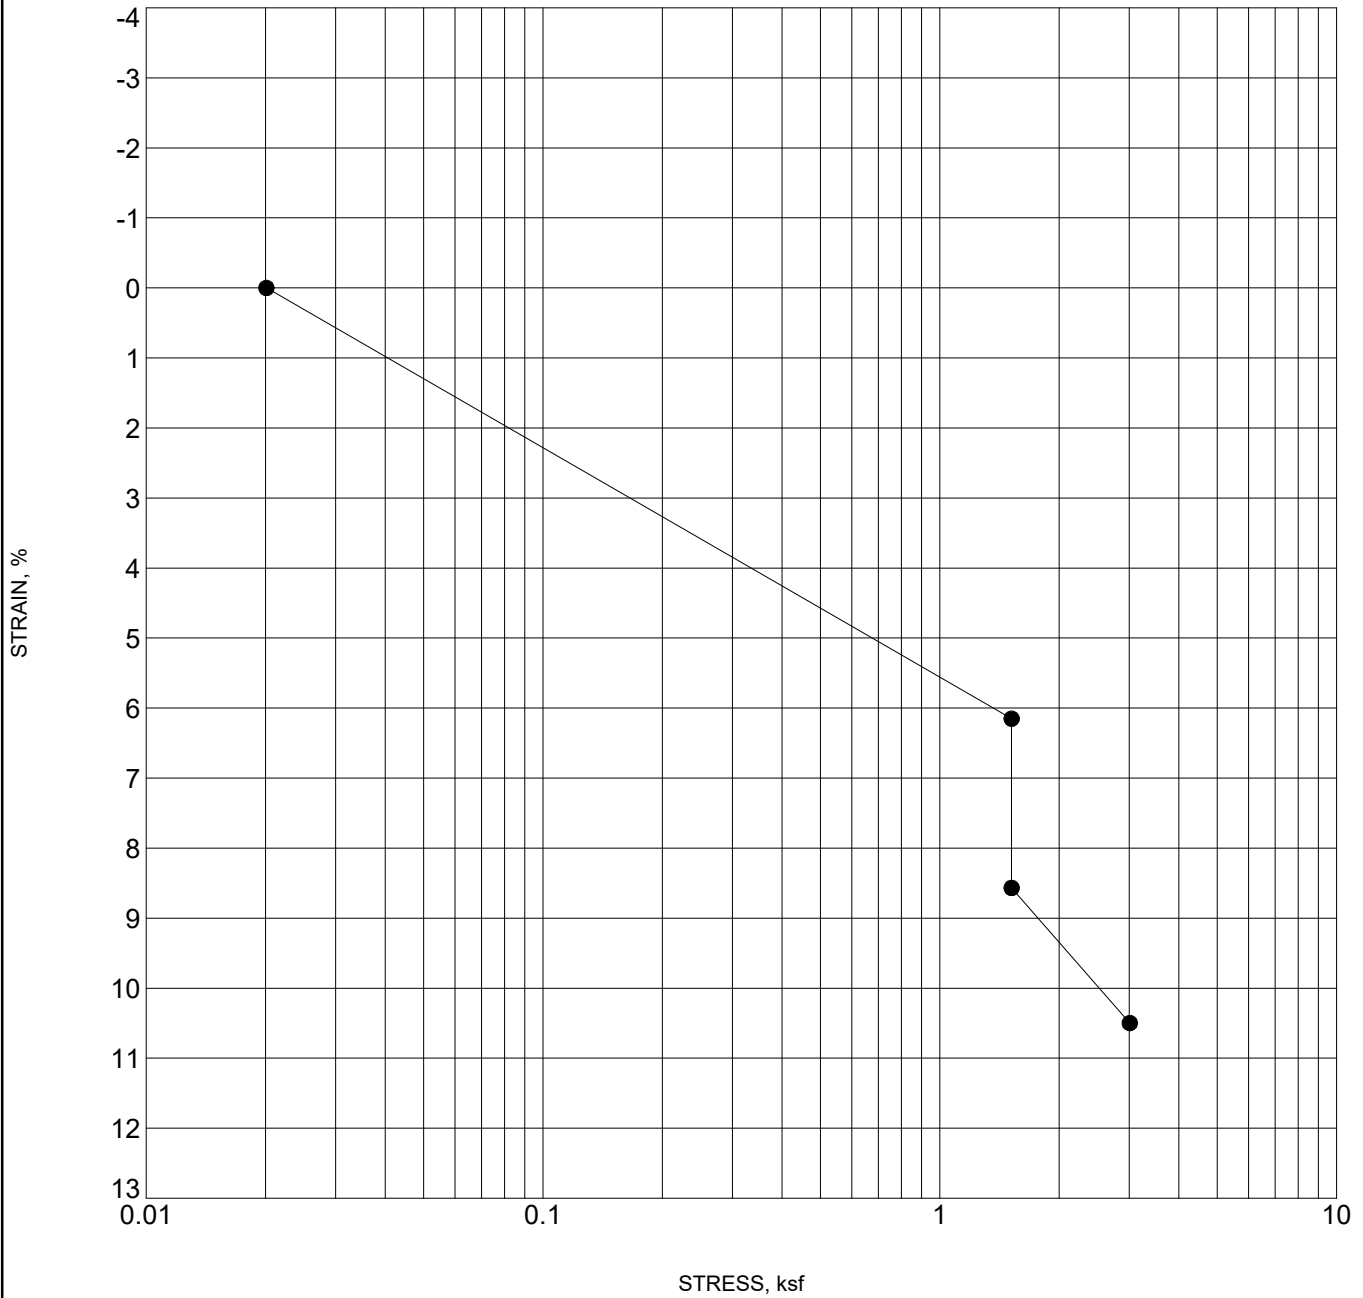

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● T-3 14	CLAY, silty	-2.4	100.1	25.2

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

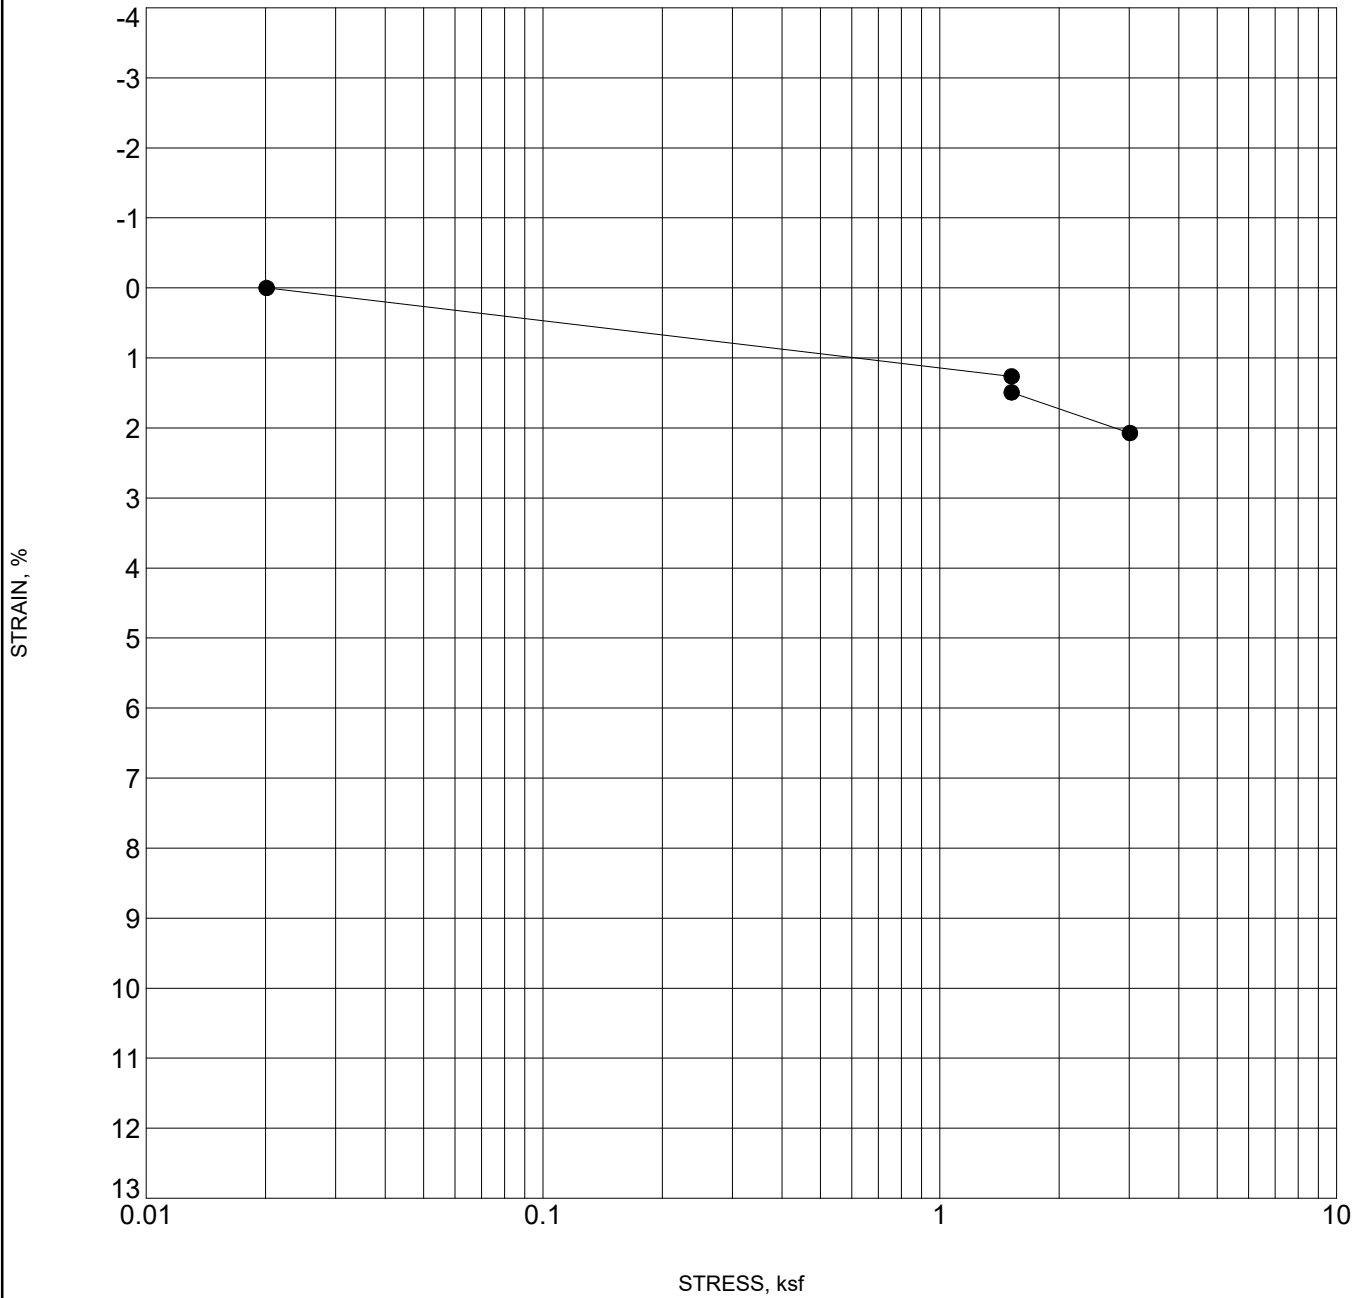

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● UP-1 14	SILT, clayey	-0.2	109.4	23.2

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

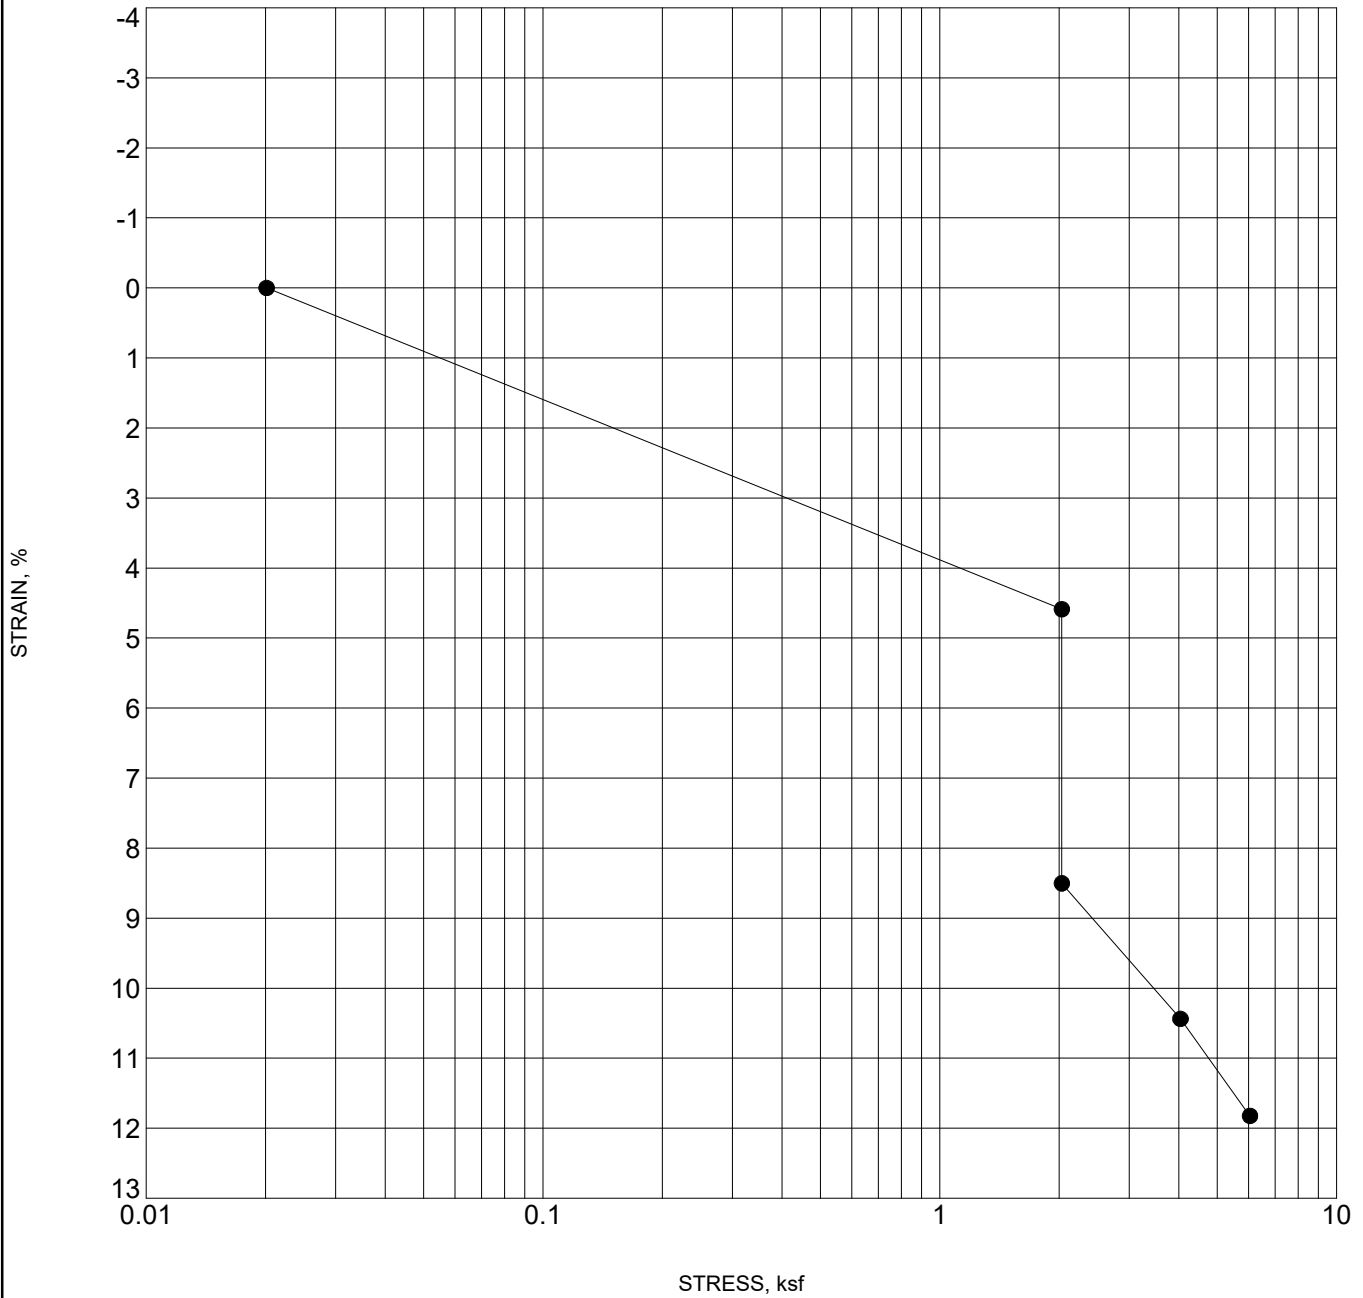

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL_TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● UP-1 19	CLAY, silty	-3.9	97.5	27.8

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

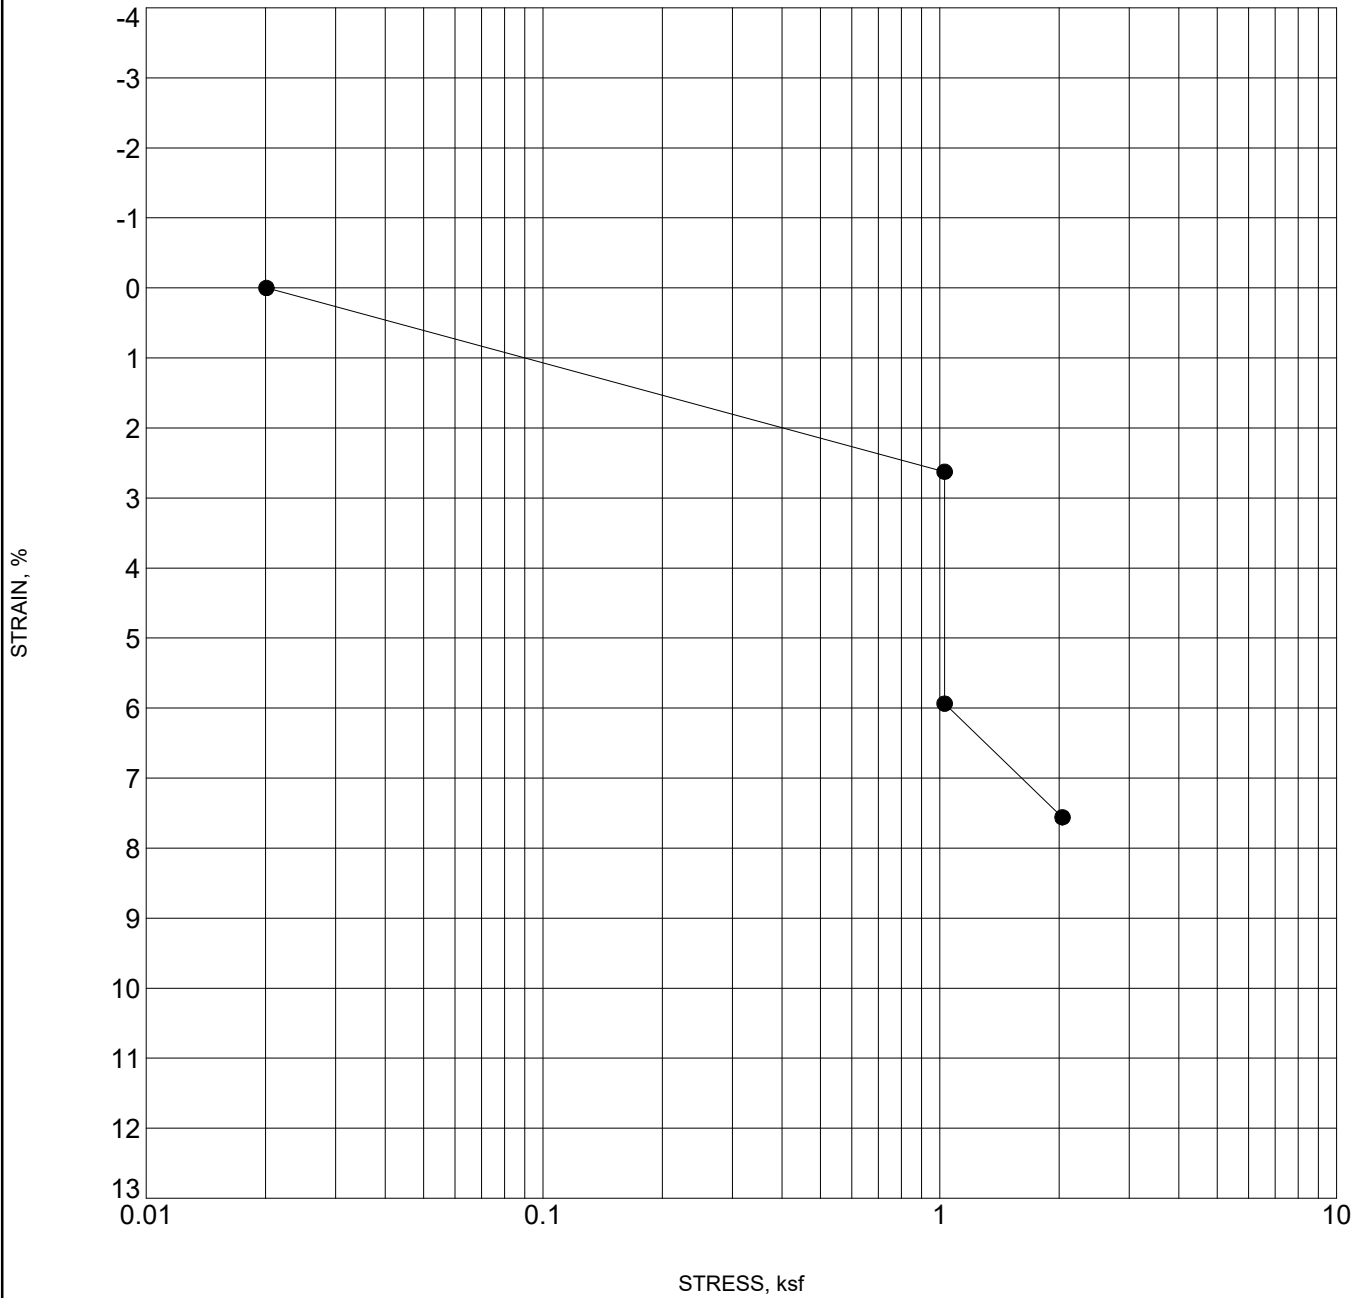

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL_TEMPLATE.GDT 9/17/20


Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● UP-2 9	CLAY, silty w silty SAND lenses in parts	-3.3	100.1	23.0

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

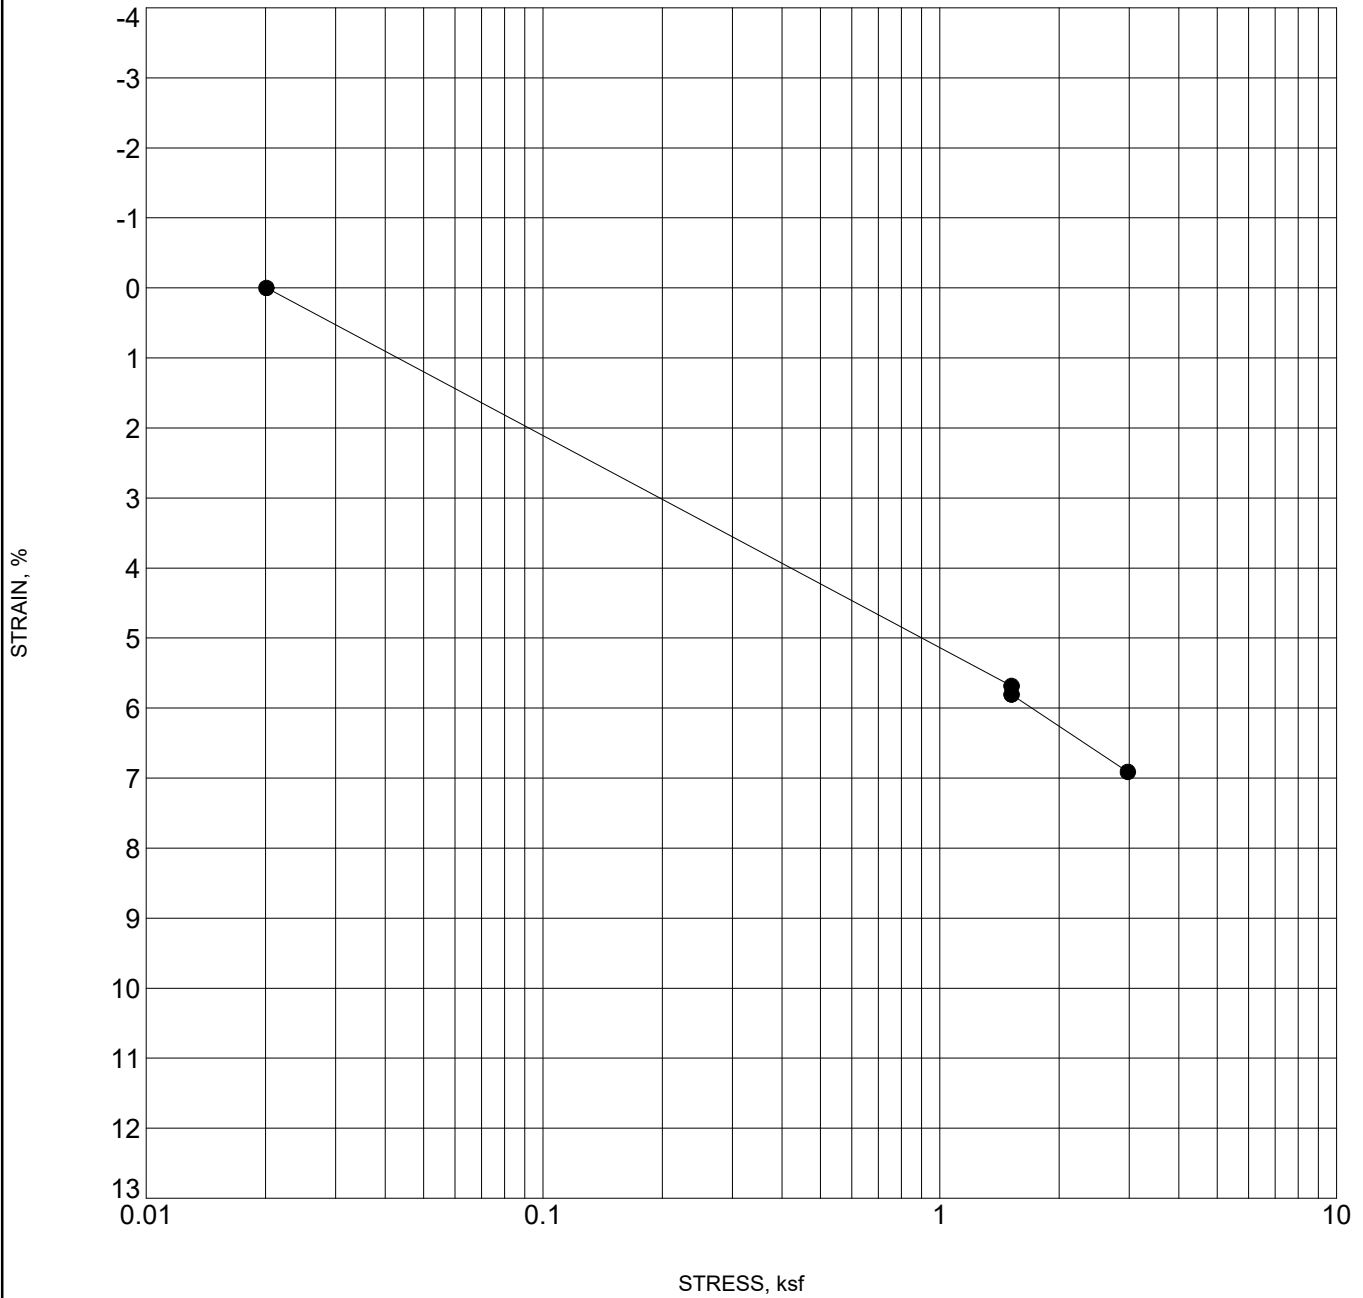

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20


Specimen Identification		Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● UP-2	14	SAND, silty with sandy CLAY in parts	-0.1	100.5	26.5

CLIENT City of Grand Junction

PROJECT NAME 24 Rd & G Rd Improvements

PROJECT NUMBER 599.07

PROJECT LOCATION Grand Junction, CO

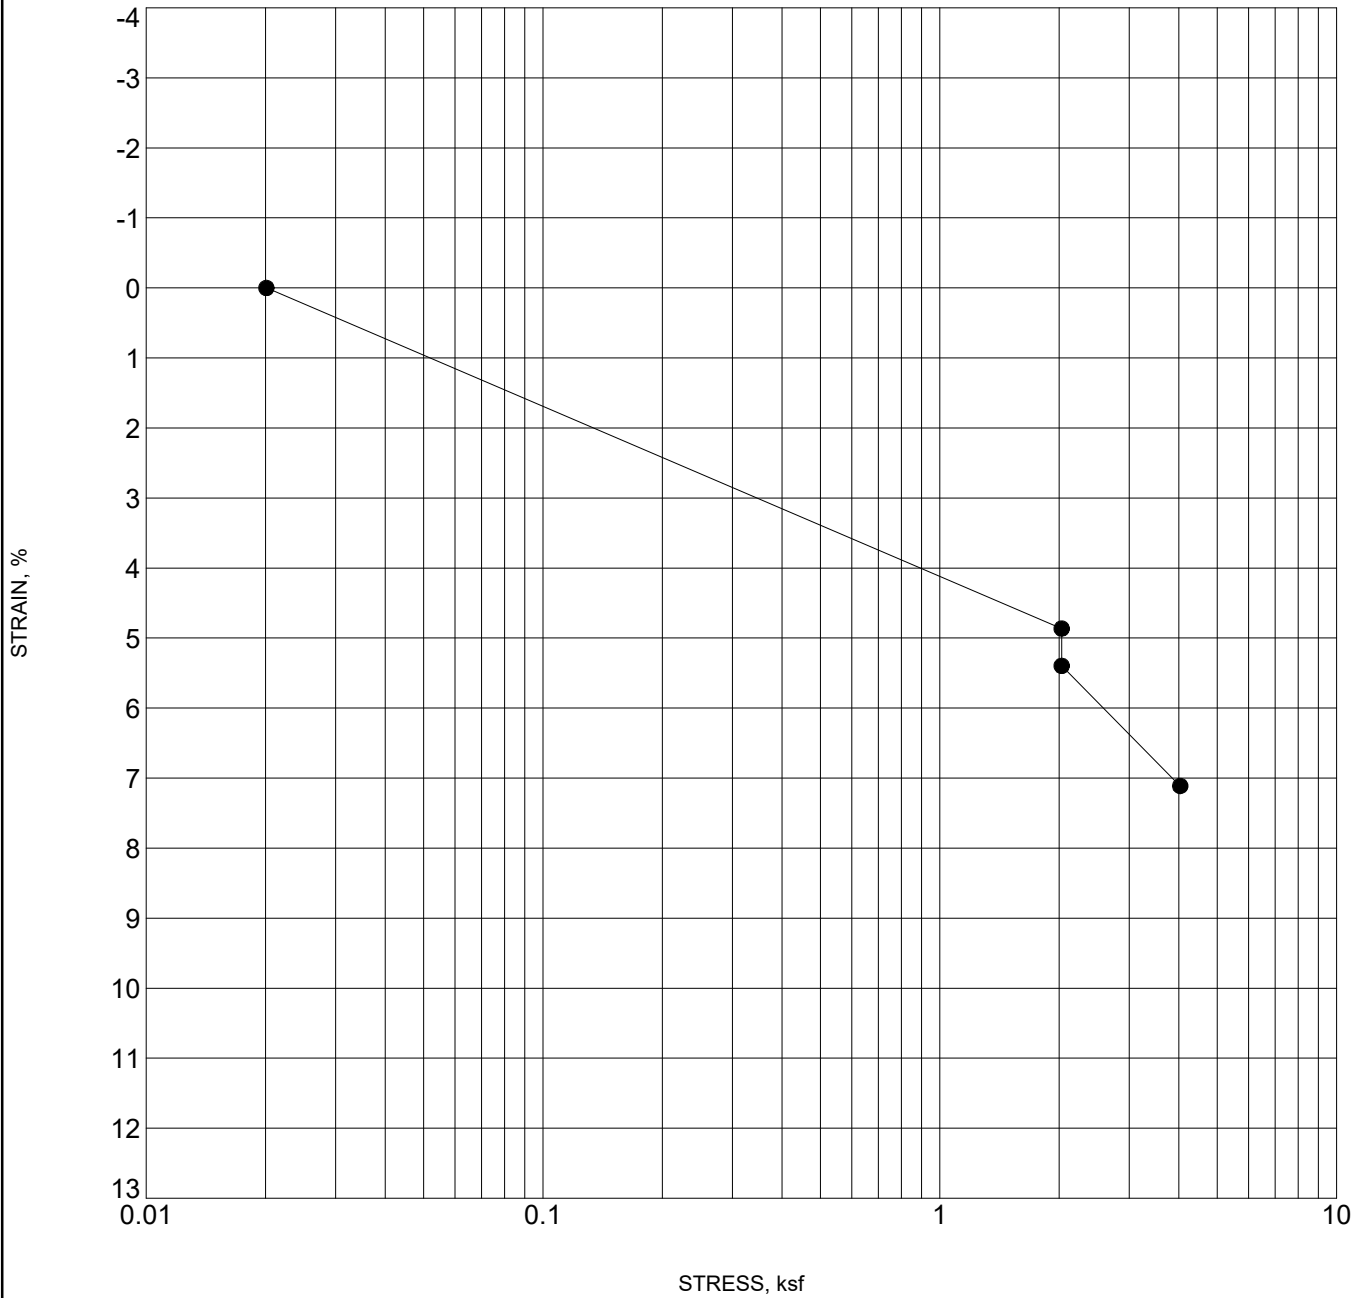

SWELL - STANDARD 599.07_24 RD & G RD IMPROVEMENTS.GPJ ROCKSOL TEMPLATE.GDT 9/17/20

Specimen Identification	Classification	Swell/Consol. (%)	γ_d (pcf)	MC%
● UP-2 19	CLAY, silty	-0.5	99.8	26.6

GRADATION - SOIL AND AGGREGATE

Project Number: 20.022, RockSol Consulting Date: 24-Jul-20
 Project Name: 24 & G Road Improvements (RockSol Project No. 599.07) Technician: J. De Los Santos
 Lab ID Number: 202879 Reviewer: G. Hoyos
 Sample Location: Composite: 24-2, 24-3B, 24-6, and G2
 Visual Description: CLAY, sandy, brown


AASHTO M 145 Classification: A-4 **Group Index:** _____
Unified Soil Classification System (ASTM D 2487): (CL) Lean clay with sand

Sieve Analysis (ASTM C 136 & AASHTO T 27)					-#200 Wash (D 1140, C 117 & T 11)	
sieve size	accum. mass, g	% retained	% passing	Criteria		
2"					dish ID	B
1.5"					dish mass, g	161.7
1"					wet soil bef. wash + dish, g	596.4
3/4"					dry soil bef. wash + dish, g	582.6
1/2"					dry soil aft. wash + dish, g	287.1
3/8"					-#200, %	70.2
Moisture Content						
#4	0.0	0.0	100		dish ID	E
#8					mass. of dish, g	176.1
#10	12.6	3.0	97		wet soil + dish, g	813.6
#16	14.3	3.4	97		dry soil + dish, g	793.4
#30					Moisture Content (%)	3.3
#40	28.5	6.8	93		Atterberg Limits (D 4318 & T 89/T90)	
#50	37.6	8.9	91		Liquid Limit (LL)	24
#100	69.4	16.5	84		Plastic Limit (PL)	15
#200	117.1	27.8	72.2		Plasticity Index (PI)	9
Total	420.9	grams			Criteria:	LL
Pan	125.3					PI
Split Gradation Sample Mass				Remarks:		
	wet	dry	%			
Total Mass, g						
+ #4 Mass, g						
- #4 Mass, g						
In-Situ Density (Unit Weight)						
diameter, in.		height (in.)		sample mass, g		
diameter, in.		height (in.)		sample moisture content, %	3.3	
diameter, in.		height (in.)		dry sample mass, g		
diameter, in.		height (in.)		wet density (unit weight), pcf		
avg. diameter		avg. height		in-situ dry density (unit weight), pcf		

GRADATION PLOT - SOIL & AGGREGATE


Project Number: 20.022, RockSol Consulting Date: 24-Jul-20
 Project Name: 24 & G Road Improvements (RockSol Project No. 599.07) Technician: J. De Los Santos
 Lab ID Number: 202879 Reviewer: G. Hoyos
 Sample Location: Composite: 24-2, 24-3B, 24-6, and G2
 Visual Description: CLAY, sandy, brown

AASHTO M 145 Classification: A-4 **Group Index:** _____
Unified Soil Classification System
(ASTM D 2487): (CL) Lean clay with sand

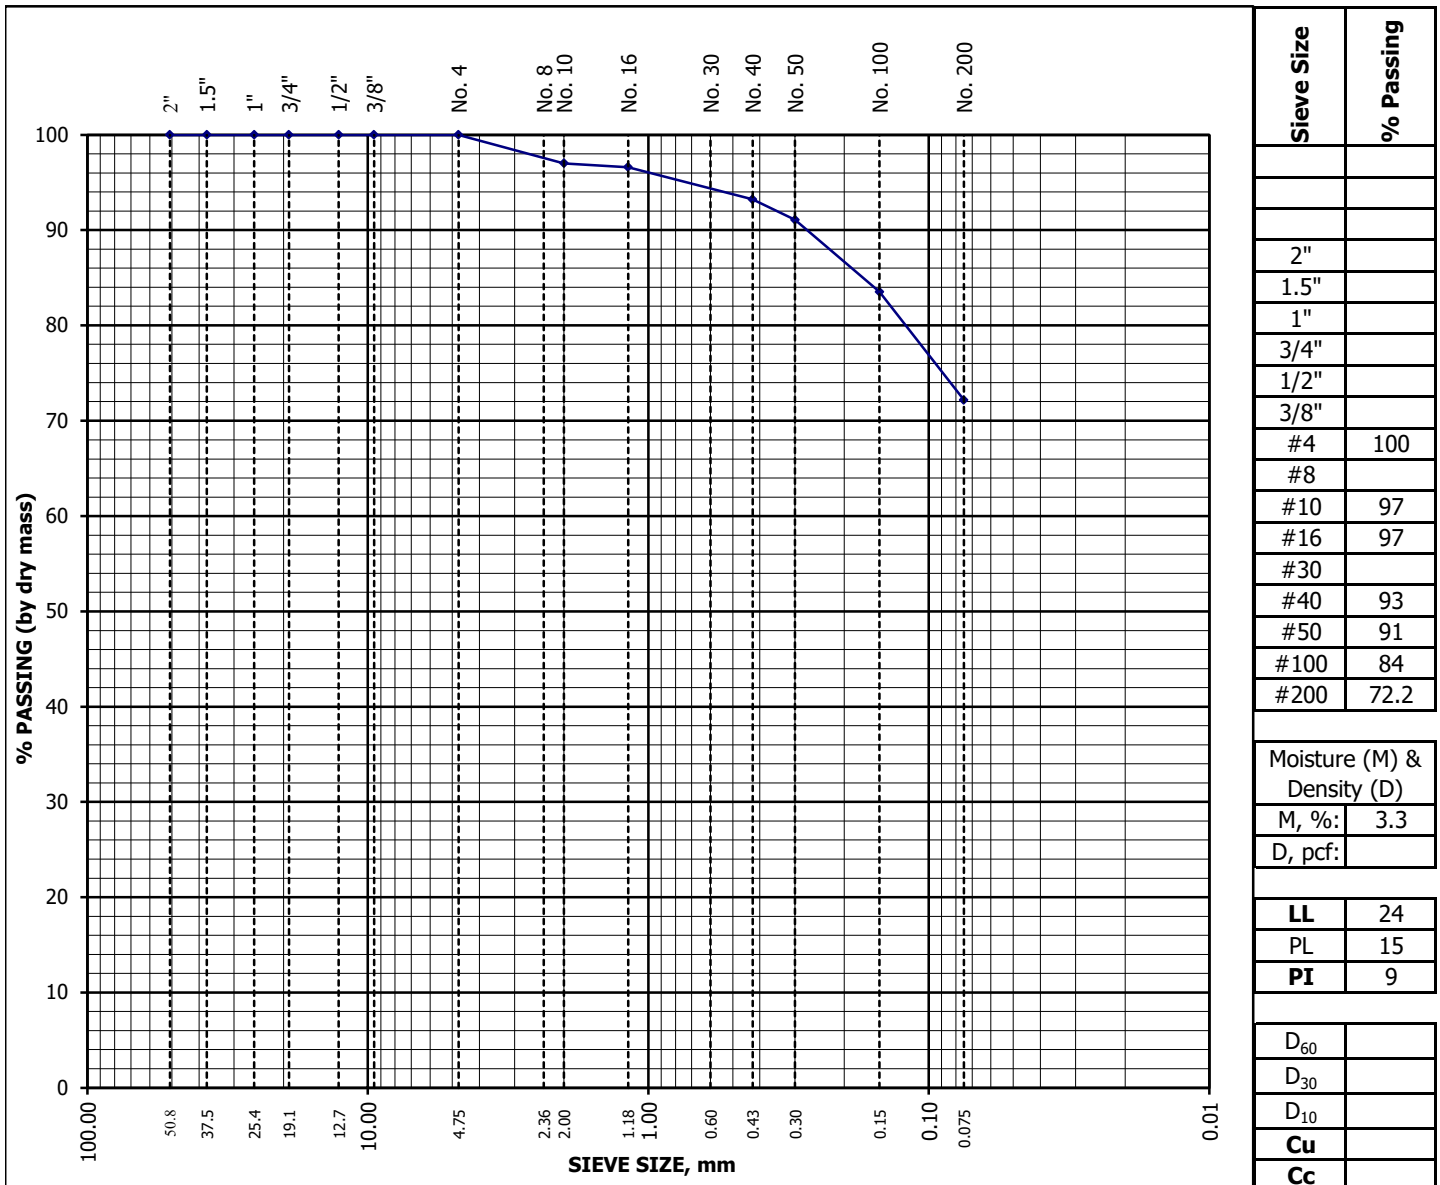

R-VALUE TEST GRAPH (AASHTO T190)

Project Number:	20.022, RockSol Consulting	Date:	27-Jul-20
Project Name:	24 & G Road Improvements (RockSol Project No. 599.07)	Technician:	G. Hoyos
Lab ID Number:	202879	Reviewer:	G. Hoyos
Sample Location:	Composite: 24-2, 24-3B, 24-6, and G2		
Visual Description:	CLAY, sandy, brown		

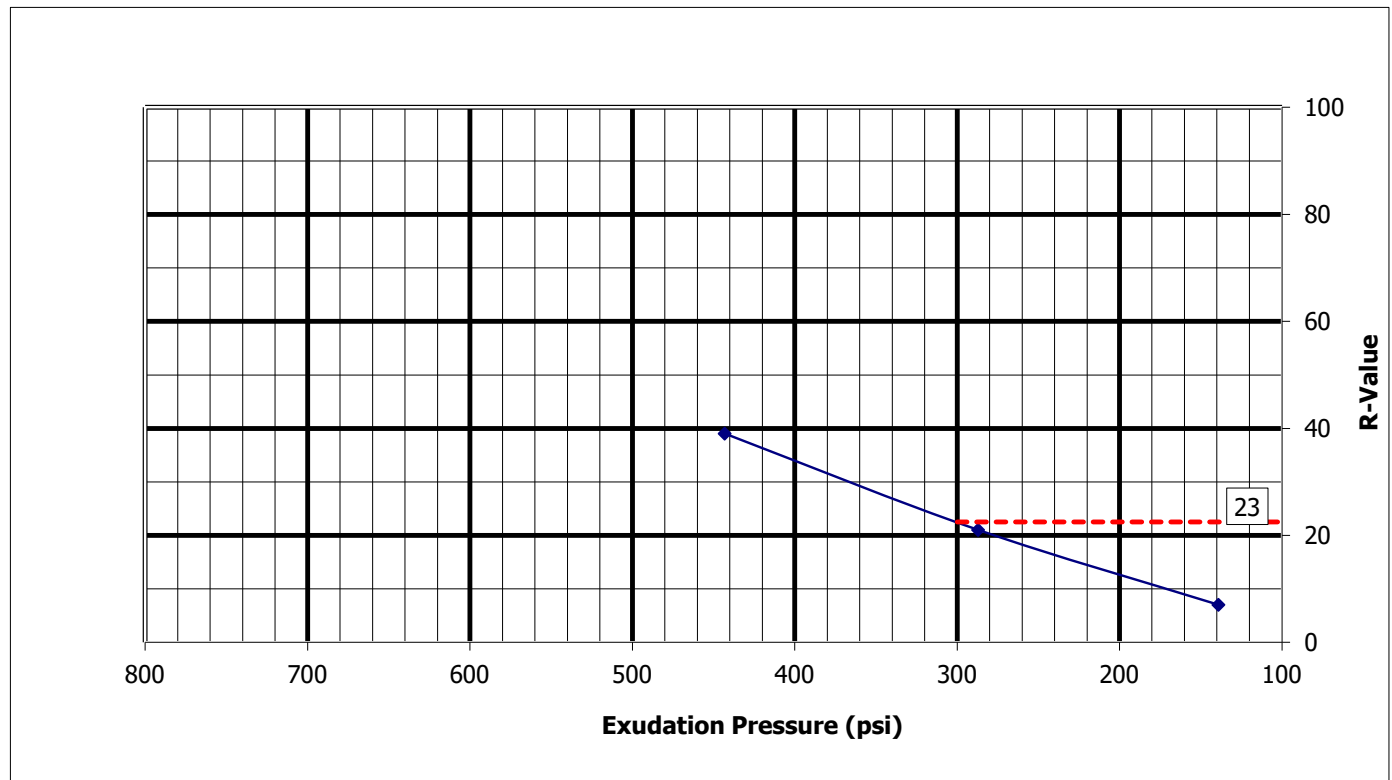

R-Value @ Exudation Pressure 300 psi: 23
 Specification:

CDOT Pavement Design Manual, 2011.
 Eq. 2.1 & 2.2, page 2-3.

$S_1 = [(R-5)/11.29]+3$ **$S_1 = 4.55$**
 $M_R = 10^{[(S_1 + 18.72)/6.24]}$ **$M_R = 5,360$**
 M_R = Resilient Modulus, psi
 S_1 = the Soil Support Value
 R = the R-Value obtained

Test Specimen:	1	2	3
Moisture Content, %:	11.7	14.0	16.0
Expansion Pressure, psi:	0.76	0.49	-0.03
Dry Density, pcf:	120.7	118.6	115.5
R-Value:	39	21	7
Exudation Pressure, psi:	443	287	139

Note: The R-Value is measured; the M_R is an approximation from correlation formulas.

APPENDIX C

PAVEMENT DESIGN OUTPUT SHEETS – 24 ROAD AND G ROAD ROUNDABOUT

Initial Values

Initial Serviceability Index= 4.5
 Final Serviceability Index= 2.5
 Overall Standard Deviation, So= 0.44
 Reliability, R (percent)= 90
 Standard Normal Deviate (ZR)= -1.282
 Structural Coefficient of HMA= 0.44
 Structural Coefficient of ABC= 0.11
 Design Life ESALs= 9790943
 R-Value= 20

Intermediate Calcs

Calculated Mr= 4940
 Design Mr= 4195 (substitute into E if necessary)
 Design Serviceability Loss (ΔPSI)= 2
 A= -0.56
 B= 7.53
 C= -0.20
 D= -0.28
 E= 0.50

Final Calcs

SN= 5.3768 (use: Data > What-If Analysis > Goal Seek)
 Such That:
 Log₁₀ESAL ≤ Thickness Equation
 6.9908 ≤ 6.9908
 Full HMA:
 Depth= 12.22 in
 HMA over ABC:
 Depth ABC= 8 in
 Depth HMA= 10.22 in

Roundabout

Total Traffic 35064
 Car 29804
 Single Unit 4558
 Heavy 702
 Daily ESALs Car 89.412
 Daily ESALs Single Unit 1134.942
 Daily ESALs Heavy 763.074
 Total ESALs 1987
 Design Period Total ESALs 21757650
 Design Lane ESAL's 9790943

(Use CDOT Pavement Design 2012, Section 1)

Table 1.4 Reliability and Standard Normal Deviate

Reliability, R (percent)	Standard Normal Deviate(Z _R)
50	0.000
60	-0.253
70	-0.524
75	-0.674
80	-0.841
85	-1.037
90	-1.282
91	-1.340
92	-1.405
93	-1.476
94	-1.555
95	-1.645
98	-2.054

$$\log_{10}(W_{18}) = Z_R S_o + 9.36 \log_{10}(SN + 1) - 0.20 +$$

$$\frac{\log_{10} \left[\frac{\Delta PSI}{4.2 - 1.5} \right]}{0.40 + \frac{1.094}{(SN + 1)^{5.19}}} + 2.32 \log_{10} M_R - 8.07$$

Initial Values

Initial Serviceability Index= 4.5
 Final Serviceability Index= 2.5
 Overall Standard Deviation, So= 0.44
 Reliability, R (percent)= 90
 Standard Normal Deviate (ZR)= -1.282
 Structural Coefficient of HMA= 0.44
 Structural Coefficient of ABC= 0.12
 Structural Coefficient of Subbase= 0.11
 Design Life ESALs= 9790943
 R-Value= 20

Intermediate Calcs

Calculated Mr= 4940
 Design Mr= 4195 (substitute into E if necessary)
 Design Serviceability Loss (ΔPSI)= 2
 A= -0.56
 B= 7.53
 C= -0.20
 D= -0.28
 E= 0.50

Final Calcs

SN= 5.3768 (use: Data > What-If Analysis > Goal Seek)
 Such That:
 Log₁₀ESAL ≤ Thickness Equation
 6.9908 ≤ 6.9908
 Full HMA:
 Depth= 12.22 in
 HMA over ABC:
 Depth Subbase= 16 in
 Depth ABC= 8 in
 Depth HMA= 6.04 in

Roundabout

Total Traffic 35064
 Car 29804
 Single Unit 4558
 Heavy 702
 Daily ESALs Car 89.412
 Daily ESALs Single Unit 1134.942
 Daily ESALs Heavy 763.074
 Total ESALs 1987
 Design Period Total ESALs 21757650
 Design Lane ESAL's 9790943

(Use CDOT Pavement Design 2012, Section 1)

Table 1.4 Reliability and Standard Normal Deviate

Reliability, R (percent)	Standard Normal Deviate(Z _R)
50	0.000
60	-0.253
70	-0.524
75	-0.674
80	-0.841
85	-1.037
90	-1.282
91	-1.340
92	-1.405
93	-1.476
94	-1.555
95	-1.645
98	-2.054

$$\log_{10}(W_{18}) = Z_R S_o + 9.36 \log_{10}(SN + 1) - 0.20 +$$

$$- \frac{\log_{10} \left[\frac{\Delta PSI}{1094} \right]}{0.40 + \frac{1}{(SN + 1)^{3.19}}} + 2.32 \log_{10} M_R - 8.07$$

Rigid Pavement Design - Based on AASHTO Supplemental Guide

Reference: *LTPP DATA ANALYSIS - Phase I: Validation of Guidelines for k-Value Selection and Concrete Pavement Performance Prediction*

I. General

Agency: RockSol Consulting Group, Inc.
Street Address: 12076 Grant Street
City: Thornton
State: Colorado

Project Number: 599.07

ID:

Description: 24 Road and G Road Roundabout

Location: Grand Junction, CO

II. Design

Serviceability

Initial Serviceability, P₁: 4.5
Terminal Serviceability, P₂: 2.5

PCC Properties

28-day Mean Modulus of Rupture, (S'_c): 650 psi
Elastic Modulus of Slab, E_c: 3,400,000 psi
Poisson's Ratio for Concrete, m: 0.15

Base Properties

Elastic Modulus of Base, E_b: 25,000 psi
Design Thickness of Base, H_b: 8.0 in
Slab-Base Friction Factor, f: 1.4

Reliability and Standard Deviation

Reliability Level (R): 90.0 %
Overall Standard Deviation, S₀: 0.34

Climatic Properties

Mean Annual Wind Speed, WIND: 8.8 mph
Mean Annual Air Temperature, TEMP: 50.3 °F
Mean Annual Precipitation, PRECIP: 8.3 in

Subgrade k-Value

150 psi/in

Design ESALs

9.8 million

Pavement Type, Joint Spacing (L)

- JPCP
 JRCP
 CRCP

Joint Spacing:

12.0 ft

JPCP

Effective Joint Spacing: 144 in

Edge Support

- Conventional 12-ft wide traffic lane
 Conventional 12-ft wide traffic lane + tied PCC
 2-ft widened slab w/conventional 12-ft traffic lane

Edge Support Factor: 0.94

Sensitivity Analysis

Slab Thickness used for
Sensitivity Analysis: 8.98 in

- Modulus of Rupture
 Elastic Modulus (Slab)
 Elastic Modulus (Base)
 Base Thickness
 k-Value
 Joint Spacing
 Reliability
 Standard Deviation

Calculated Slab Thickness for Above Inputs:

8.98 in

APPENDIX D

PAVEMENT DESIGN OUTPUT SHEETS – 24 ROAD

Initial Values

Initial Serviceability Index= 4.5
 Final Serviceability Index= 2.5
 Overall Standard Deviation, So= 0.44
 Reliability, R (percent)= 90
 Standard Normal Deviate (ZR)= -1.282
 Structural Coefficient of HMA= 0.44
 Structural Coefficient of ABC= 0.11
 Design Life ESALs= 6494445
 R-Value= 20

Intermediate Calcs

Calculated Mr= 4940
 Design Mr= 4195 (substitute into E if necessary)
 Design Serviceability Loss (ΔPSI)= 2
 A= -0.56
 B= 7.34
 C= -0.20
 D= -0.26
 E= 0.50

Final Calcs

SN= 5.0864 (use: Data > What-If Analysis > Goal Seek)
 Such That:
 Log₁₀ESAL ≤ Thickness Equation
 6.8125 ≤ 6.8125
 Full HMA:
 Depth= 11.56 in
 HMA over ABC:
 Depth ABC= 8 in
 Depth HMA= 9.56 in

24 Rd
 Total Traffic 23256
 Car 19768
 Single Unit 3023
 Heavy 465
 Daily ESALs Car 59.3028
 Daily ESALs Single Unit 752.7967
 Daily ESALs Heavy 505.5854
 Total ESALs 1318
 Design Period Total ESALs 14432100
 Design Lane ESAL's 6494445

(Use CDOT Pavement Design 2012, Section 1)

Table 1.4 Reliability and Standard Normal Deviate

Reliability, R (percent)	Standard Normal Deviate(Z _R)
50	0.000
60	-0.253
70	-0.524
75	-0.674
80	-0.841
85	-1.037
90	-1.282
91	-1.340
92	-1.405
93	-1.476
94	-1.555
95	-1.645
98	-2.054

$$\log_{10}(W_{18}) = Z_R S_o + 9.36 \log_{10}(SN + 1) - 0.20 +$$

$$\frac{\log_{10} \left[\frac{\Delta PSI}{4.2 - 1.5} \right]}{0.40 + \frac{1094}{(SN + 1)^{5.19}}} + 2.32 \log_{10} M_R - 8.07$$

Initial Values

Initial Serviceability Index= 4.5
 Final Serviceability Index= 2.5
 Overall Standard Deviation, So= 0.44
 Reliability, R (percent)= 90
 Standard Normal Deviate (ZR)= -1.282
 Structural Coefficient of HMA= 0.44
 Structural Coefficient of ABC= 0.12
 Structural Coefficient of Subbase= 0.11
 Design Life ESALs= 6494445
 R-Value= 20

Intermediate Calcs

Calculated Mr= 4940
 Design Mr= 4195 (substitute into E if necessary)
 Design Serviceability Loss (ΔPSI)= 2
 A= -0.56
 B= 7.34
 C= -0.20
 D= -0.26
 E= 0.50

Final Calcs

SN= 5.0864 (use: Data > What-If Analysis > Goal Seek)
 Such That:
 Log₁₀ESAL ≤ Thickness Equation
 6.8125 ≤ 6.8125
 Full HMA:
 Depth= 11.56 in
 HMA over ABC:
 Depth Subbase= 14 in
 Depth ABC= 8 in
 Depth HMA= 5.88 in

24 Rd
 Total Traffic 23256
 Car 19768
 Single Unit 3023
 Heavy 465
 Daily ESALs Car 59.3028
 Daily ESALs Single Unit 752.7967
 Daily ESALs Heavy 505.5854
 Total ESALs 1318
 Design Period Total ESALs 14432100
 Design Lane ESAL's 6494445

(Use CDOT Pavement Design 2012, Section 1)

Table 1.4 Reliability and Standard Normal Deviate

Reliability, R (percent)	Standard Normal Deviate(Z _R)
50	0.000
60	-0.253
70	-0.524
75	-0.674
80	-0.841
85	-1.037
90	-1.282
91	-1.340
92	-1.405
93	-1.476
94	-1.555
95	-1.645
98	-2.054

$$\log_{10}(W_{18}) = Z_R S_o + 9.36 \log_{10}(SN + 1) - 0.20 +$$

$$\frac{\log_{10} \left[\frac{\Delta PSI}{1094} \right]}{0.40 + \frac{1}{(SN + 1)^{3.19}}} + 2.32 \log_{10} M_R - 8.07$$

Rigid Pavement Design - Based on AASHTO Supplemental Guide

Reference: *LTPP DATA ANALYSIS - Phase I: Validation of Guidelines for k-Value Selection and Concrete Pavement Performance Prediction*

I. General

Agency: RockSol Consulting Group, Inc.
Street Address: 12076 Grant Street
City: Thornton
State: Colorado

Project Number: 599.07

ID:

Description: 24 Road

Location: Grand Junction, CO

II. Design

Serviceability

Initial Serviceability, P1: 4.5
Terminal Serviceability, P2: 2.5

PCC Properties

28-day Mean Modulus of Rupture, (S'_c): 650 psi
Elastic Modulus of Slab, E_c : 3,400,000 psi
Poisson's Ratio for Concrete, m: 0.15

Base Properties

Elastic Modulus of Base, E_b : 25,000 psi
Design Thickness of Base, H_b : 8.0 in
Slab-Base Friction Factor, f: 1.4

Reliability and Standard Deviation

Reliability Level (R): 90.0 %
Overall Standard Deviation, S_D : 0.34

Climatic Properties

Mean Annual Wind Speed, WIND: 8.8 mph
Mean Annual Air Temperature, TEMP: 50.3 °F
Mean Annual Precipitation, PRECIP: 8.3 in

Subgrade k-Value

150 psi/in

Design ESALs

6.5 million

Pavement Type, Joint Spacing (L)

- JPCP
 JRCP
 CRCP

Joint Spacing:

12.0 ft

JPCP

Effective Joint Spacing: 144 in

Edge Support

- Conventional 12-ft wide traffic lane
 Conventional 12-ft wide traffic lane + tied PCC
 2-ft widened slab w/conventional 12-ft traffic lane

Edge Support Factor: 0.94

Sensitivity Analysis

Slab Thickness used for
Sensitivity Analysis: 8.36 in

- Modulus of Rupture
 Elastic Modulus (Slab)
 Elastic Modulus (Base)
 Base Thickness
 k-Value
 Joint Spacing
 Reliability
 Standard Deviation

Calculated Slab Thickness for Above Inputs:

8.36 in

APPENDIX E

PAVEMENT DESIGN OUTPUT SHEETS – G ROAD

Initial Values

Initial Serviceability Index= 4.5
 Final Serviceability Index= 2.5
 Overall Standard Deviation, So= 0.44
 Reliability, R (percent)= 90
 Standard Normal Deviate (ZR)= -1.282
 Structural Coefficient of HMA= 0.44
 Structural Coefficient of ABC= 0.11
 Design Life ESALs= 3296498
 R-Value= 20

Intermediate Calcs

Calculated Mr= 4940
 Design Mr= 4195 (substitute into E if necessary)
 Design Serviceability Loss (ΔPSI)= 2
 A= -0.56
 B= 7.02
 C= -0.20
 D= -0.24
 E= 0.50

Final Calcs

SN= 4.6298 (use: Data > What-If Analysis > Goal Seek)
 Such That:
 Log₁₀ESAL ≤ Thickness Equation
 6.5181 ≤ 6.5182
 Full HMA:
 Depth= 10.52 in
 HMA over ABC:
 Depth ABC= 8 in
 Depth HMA= 8.52 in

G Rd
 Total Traffic 11808
 Car 10037
 Single Unit 1535
 Heavy 236
 Daily ESALs Car 30.1104
 Daily ESALs Single Unit 382.225
 Daily ESALs Heavy 256.7059
 Total ESALs 669
 Design Period Total ESALs 7325550
 Design Lane ESAL's 3296498

(Use CDOT Pavement Design 2012, Section 1)

Table 1.4 Reliability and Standard Normal Deviate

Reliability, R (percent)	Standard Normal Deviate(Z _R)
50	0.000
60	-0.253
70	-0.524
75	-0.674
80	-0.841
85	-1.037
90	-1.282
91	-1.340
92	-1.405
93	-1.476
94	-1.555
95	-1.645
98	-2.054

$$\log_{10}(W_{18}) = Z_R S_o + 9.36 \log_{10}(SN + 1) - 0.20 +$$

$$\frac{\log_{10} \left[\frac{\Delta PSI}{4.2 - 1.5} \right]}{0.40 + \frac{1.094}{(SN + 1)^{5.19}}} + 2.32 \log_{10} M_R - 8.07$$

Initial Values

Initial Serviceability Index= 4.5
 Final Serviceability Index= 2.5
 Overall Standard Deviation, So= 0.44
 Reliability, R (percent)= 90
 Standard Normal Deviate (ZR)= -1.282
 Structural Coefficient of HMA= 0.44
 Structural Coefficient of ABC= 0.12
 Structural Coefficient of Subbase= 0.11
 Design Life ESALs= 3296498
 R-Value= 20

Intermediate Calcs

Calculated Mr= 4940
 Design Mr= 4195 (substitute into E if necessary)
 Design Serviceability Loss (ΔPSI)= 2
 A= -0.56
 B= 7.02
 C= -0.20
 D= -0.24
 E= 0.50

Final Calcs

SN= 4.6298 (use: Data > What-If Analysis > Goal Seek)
 Such That:
 Log₁₀ESAL ≤ Thickness Equation
 6.5181 ≤ 6.5182
 Full HMA:
 Depth= 10.52 in
 HMA over ABC:
 Depth Subbase= 10 in
 Depth ABC= 8 in
 Depth HMA= 5.84 in

G Rd
 Total Traffic 11808
 Car 10037
 Single Unit 1535
 Heavy 236
 Daily ESALS Car 30.1104
 Daily ESALS Single Unit 382.225
 Daily ESALS Heavy 256.7059
 Total ESALS 669
 Design Period Total ESALS 7325550
 Design Lane ESAL's 3296498

(Use CDOT Pavement Design 2012, Section 1)

Table 1.4 Reliability and Standard Normal Deviate

Reliability, R (percent)	Standard Normal Deviate(Z _R)
50	0.000
60	-0.253
70	-0.524
75	-0.674
80	-0.841
85	-1.037
90	-1.282
91	-1.340
92	-1.405
93	-1.476
94	-1.555
95	-1.645
98	-2.054

$$\log_{10}(W_{18}) = Z_R S_o + 9.36 \log_{10}(SN + 1) - 0.20 +$$

$$- \frac{\log_{10} \left[\frac{\Delta PSI}{1094} \right]}{0.40 + \frac{1}{(SN + 1)^{3.19}}} + 2.32 \log_{10} M_R - 8.07$$

Rigid Pavement Design - Based on AASHTO Supplemental Guide

Reference: *LTPP DATA ANALYSIS - Phase I: Validation of Guidelines for k-Value Selection and Concrete Pavement Performance Prediction*

I. General

Agency: RockSol Consulting Group, Inc.
Street Address: 12076 Grant Street
City: Thornton
State: Colorado

Project Number: 599.07

ID:

Description: G Road

Location: Grand Junction, CO

II. Design

Serviceability

Initial Serviceability, P₁: 4.5
Terminal Serviceability, P₂: 2.5

PCC Properties

28-day Mean Modulus of Rupture, (S'_c): 650 psi
Elastic Modulus of Slab, E_c: 3,400,000 psi
Poisson's Ratio for Concrete, m: 0.15

Base Properties

Elastic Modulus of Base, E_b: 25,000 psi
Design Thickness of Base, H_b: 8.0 in
Slab-Base Friction Factor, f: 1.4

Reliability and Standard Deviation

Reliability Level (R): 90.0 %
Overall Standard Deviation, S₀: 0.34

Climatic Properties

Mean Annual Wind Speed, WIND: 8.8 mph
Mean Annual Air Temperature, TEMP: 50.3 °F
Mean Annual Precipitation, PRECIP: 8.3 in

Subgrade k-Value

150 psi/in

Design ESALs

3.3 million

Pavement Type, Joint Spacing (L)

JPCP

JRCP

CRCP

Joint Spacing:

12.0 ft

JPCP

Effective Joint Spacing: 144 in

Edge Support

Conventional 12-ft wide traffic lane

Conventional 12-ft wide traffic lane + tied PCC

2-ft widened slab w/conventional 12-ft traffic lane

Edge Support Factor: 0.94

Sensitivity Analysis

Slab Thickness used for
Sensitivity Analysis: 7.38 in

Modulus of Rupture

Elastic Modulus (Slab)

Elastic Modulus (Base)

Base Thickness

k-Value

Joint Spacing

Reliability

Standard Deviation

Calculated Slab Thickness for Above Inputs:

7.38 in