

ADDENDUM NO. 1

DATE: September 9, 2026
FROM: City of Grand Junction Purchasing Division
TO: All Offerors
RE: Storm Water Connection and Catch Basin 1st Street and Walnut Ave IFB-5975-26-DD

Offerors responding to the above referenced solicitation are hereby instructed that the requirements have been clarified, modified, superseded and supplemented as to this date as hereinafter described.

Please make note of the following clarifications:

1. Section 3.3.16 Schedule of Submittals: Change PVC Pipe to RCP Pipe. PVC pipe will not be installed as part of this project.
2. Repair Cold Patch Area with new concrete, as necessary, from previous potholing during project design. There are three locations of potholes. One of them was the one potholed for this project. All three locations will need to have new concrete as part of this project. Please see attached map and picture for location.

Quantities shall be paid for under:

- Item No. 8: Hot Bituminous Pavement (Patching)
- Item No. 9: Concrete Curb and Gutter (Match in Kind)

3. Alternate 1 has been added to the Plan Set. Please refer to the updated Plans dated 9/9/2026. Please refer to SP-1 in the IFB for potholing requirements and material ordering procedures.
4. An updated Bid Schedule has been provided to include quantities for Alternate 1. Please refer to the Bid Schedule dated 9/9/2026 and submit with your bid.
5. Calendar Days have been extended to 35 Days from Notice to Proceed. This shall encompass the potholing investigations and material order lead times for both the original and alternate project. All work and surface restoration must be completed before the closure of asphalt plants.

The original solicitation for the project noted above is clarified as noted. All other conditions of the subject remain the same.

Respectfully,



Dolly Daniels, Senior Buyer
City of Grand Junction, Colorado

Bid Schedule: 1st and Walnut Storm Sewer Improvement

Item No.	CDOT, City Ref.	Description	Quantity	Units	Unit Price	Total Price
1	102	Storm Drain Inlet with Vertical Curb Opening	1.	EA	\$ _____	\$ _____
2	108	Storm Drain Pipe - 12" concrete Pipe; Includes Type A bedding and haunching material and backfill of trench with native materials meeting 103.16 backfill material.	37.	LF	\$ _____	\$ _____
3	108	Connecto to Existing Inlet Structure	1.	EA	\$ _____	\$ _____
4	202	Removal of Concrete (Includes V-Pan and Curb and Gutter)	25.5	SY	\$ _____	\$ _____
5	202	Removal of Asphalt Mat (Planing (2" Depth)	8.1	SY	\$ _____	\$ _____
6	208	Storm Drain Inlet Protection (Type III)	1.	EA	\$ _____	\$ _____
7	401	Hot Bituminous Pavement (Patching) (2" T-Top) (Grading SX, Binder Grade PG 64-22)	3.4	TON	\$ _____	\$ _____
8	608	Concrete Curb and Gutter (Match In Kind) (City Std. Detail C-05)	12.	LF	\$ _____	\$ _____
9	608	Concrete Drainage Pan (Match In Kind) (Includes #5 rebar tie-bars) (City Std. Detail C-12)	34.7	LF	\$ _____	\$ _____
10	626	Mobilization	Lump	Sum	---	\$ _____
11	630	Traffic Control Plan	Lump	Sum	---	\$ _____
12	630	Traffic Control (Complete in Place)	Lump	Sum	---	\$ _____
13	630	Flagging	Lump	Sum	---	\$ _____
14		Potholing	---	---	---	\$ 10,000.00

Bid Schedule: 1st and Walnut Storm Sewer Improvement

Item No.	CDOT, City Ref.	Description	Quantity	Units	Unit Price	Total Price
Alt. 1	108	Storm Drain Pipe - 15" concrete Pipe; Includes Type A bedding and haunching material and backfill of trench with native materials meeting 103.16 backfill material.	45.	LF	\$ _____	\$ _____
Alt. 2	108	Connecto to Existing Structure	2.	EA	\$ _____	\$ _____
Alt. 3	202	Removal of Concrete (Includes V-Pan and Curb and Gutter)	26.3	SY	\$ _____	\$ _____
Alt. 4	202	Removal of Asphalt Mat (Planing (2" Depth)	41.7	SY	\$ _____	\$ _____
Alt. 5	208	Storm Drain Inlet Protection (Type III)	1.	EA	\$ _____	\$ _____
Alt. 6	401	Hot Bituminous Pavement (Patching) (2" T-Top) (Grading SX, Binder Grade PG 64-22)	12.6	TON	\$ _____	\$ _____
Alt. 7	608	Concrete Curb and Gutter (Match In Kind) (City Std. Detail C-05)	12.	LF	\$ _____	\$ _____
Alt. 8	608	Concrete Drainage Pan (Match In Kind) (Includes #5 rebar tie-bars) (City Std. Detail C-12)	17.	LF	\$ _____	\$ _____
Alt. 9	630	Traffic Control Plan	Lump	Sum	---	\$ _____
Alt. 10	630	Traffic Control (Complete in Place)	Lump	Sum	---	\$ _____
Alt. 11	630	Flagging	Lump	Sum	---	\$ _____
MCR		Minor Contract Revisions	---	---	---	\$ 15,000.00
Bid Amount:					\$ _____	


Bid Amount:

dollars

CITY OF GRAND JUNCTION

1ST AND WALNUT STORM SEWER IMPROVEMENT

September 9, 2026

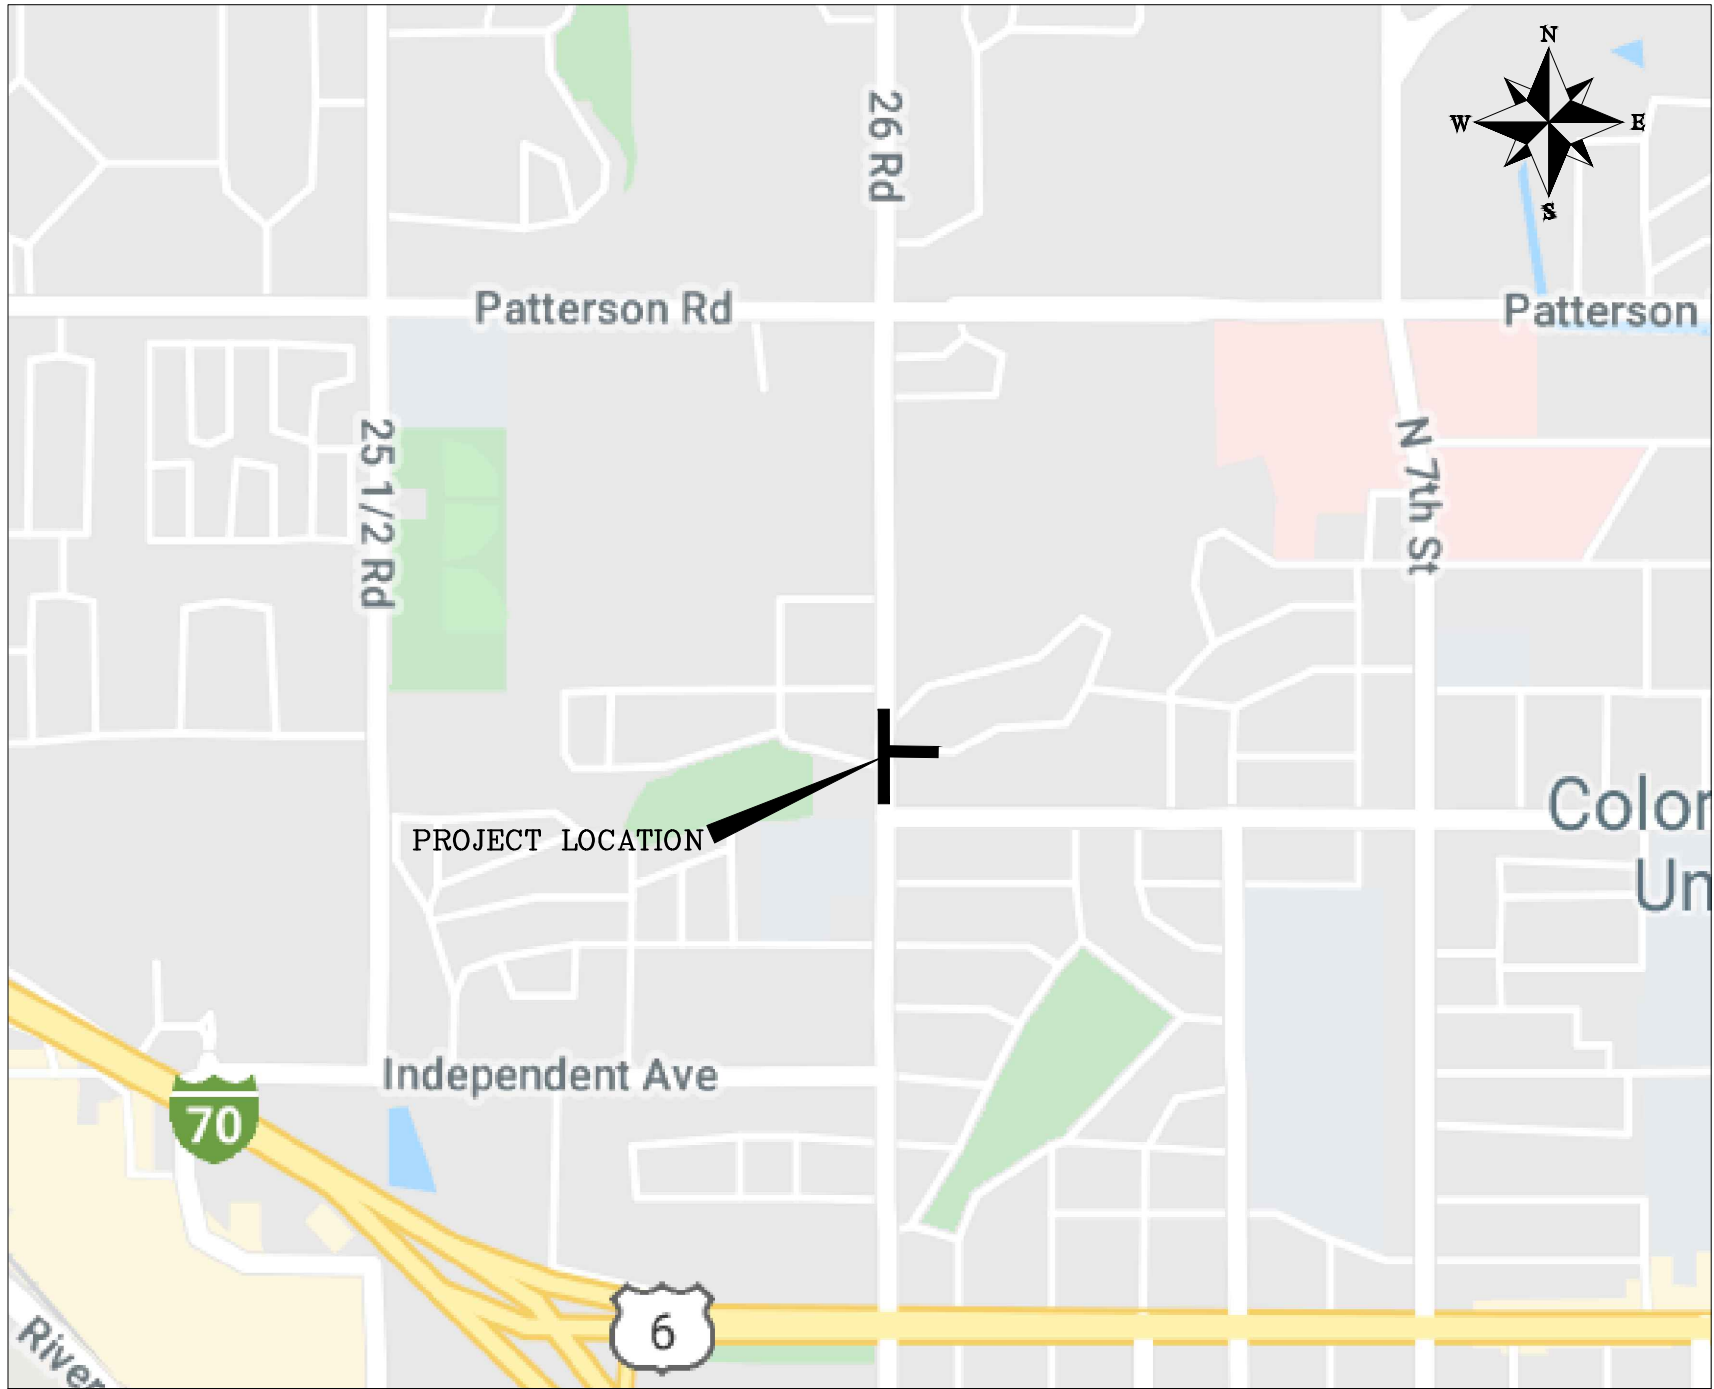

VICINITY MAP



*Engineering and
Transportation Department*

SHEET INDEX

- 1 COVER
- 2 STANDARD ABBREVIATIONS LEGENDS AND SYMBOLS
- 3 SUMMARY OF EARTHWORK QUANTITIES
- 4 EXISTING STORM PLAN & PROFILE 1ST STREET
- 5 STORM PLAN & PROFILE WALNUT AVE
- 6 STANDARD DETAILS
- 7 STANDARD DETAILS
- A1 STORM PLAN & PROFILE ALTERNATE 1

NOTE: NOTIFY AFFECTED UTILITY VENDOR 48 HOURS PRIOR TO EXCAVATIONS THAT WILL EXPOSE UTILITY LINES. THE COVER SHEET WILL HAVE A LISTING OF UTILITY VENDORS AND TELEPHONE NUMBERS.

REVISION	DESCRIPTION	DATE
REVISION		
REVISION		
REVISION		



Know what's below.
Call before you dig.

ABBREVIATIONS

AASHTO	AMERICAN ASSOCIATION OF STATE HIGHWAY & TRANSPORTATION OFFICIALS
ABC	AGGREGATE BASE COURSE
AC	ASBESTOS CEMENT
AP	ANGLE POINT
ASB	ANCHORED STRAW BALES
ASP	ALUMINIZED STEEL PIPE
ASTM	AMERICAN SOCIETY FOR TESTING MATERIALS
AWWA	AMERICAN WATER WORKS ASSOCIATION
BC	BACK OF CURB
BF	BUTTERFLY VALVE
BOW	BACK OF WALK
BCR	BEGIN CURB RETURN
BOT	BOTTOM
BSWMP	BETTER STORM WATER MANAGEMENT PRACTICES
CH	CHORD
CAP	CORRUGATED ALUMINUM PIPE
CDOT	COLORADO DEPARTMENT OF TRANSPORTATION
CI	CAST IRON
C.G.& SW	CURB, GUTTER & SIDEWALK
CL	CENTER LINE
CL	CLEAR
CMP	CORRUGATED METAL PIPE
CO	CLEAN OUT
COMB	COMBINATION (AS IN STORM SEWER AND SANITARY SEWER)
CONC	CONCRETE
CSM	CITY SURVEY MONUMENT
CSP	CORRUGATED STEEL PIPE
CU	COPPER
DI	DUCTILE IRON
DWY	DRIVEWAY
E	ELECTRIC
ECR	END CURB RETURN
EG	EDGE OF GUTTER
EL	ELEVATION
EP	EDGE OF PAVEMENT
EX	EXISTING
FB	FULL BODY
FC	FACE OF CURB
FG	FINISHED GRADE
FL	FLOW LINE
FL	FLANGE
FM	FORCE MAIN
FO	FIBER OPTICS
FS	FAR SIDE
FTG	FOOTING
G	GAS
GB	GRADE BREAK
GM	GAS METER
GV	GATE VALVE
HBP	HOT BITUMINOUS PAVEMENT
HDPE	HIGH DENSITY POLYETHYLENE
INV	INVERT
IRR	IRRIGATION
L	LENGTH OF ARC
LC	LONG CHORD
LF	LINEAR FEET
LL	LONG ARC
LS	SHORT ARC
LT	LEFT
MB	MAILBOX
MCSM	MESA COUNTY SURVEY MONUMENT
MH	MANHOLE
MJ	MECHANICAL JOINT
MW	MILL WRAP
N/A	NOT APPLICABLE
NIC	NOT IN CONTRACT
NOP	NO ONE PERSON
NRCP	NON-REINFORCED CONCRETE PIPE
NS	NEAR SIDE
NTS	NOT TO SCALE
OHP	OVERHEAD POWER
OHT	OVERHEAD TELEPHONE
PC	POINT OF CURVATURE
PCC	POINT OF COMPOUND CURVATURE
PE	POLYETHYLENE
PERF	PERFORATED
PI	POINT OF INTERSECTION
PIP	PLASTIC IRRIGATION PIPE
POC	POINT ON CURVE
POT	POINT ON TANGENT
PR	PROPOSED
PRC	POINT OF REVERSE CURVATURE
PT	POINT OF TANGENCY
PVC	POLYVINYL CHLORIDE
R	RADIUS
RCP	REINFORCED CONCRETE PIPE
REQ'D	REQUIRED
RG	RESTRAINED GLANDS
RL	LONG RADIUS
ROW	RIGHT OF WAY
RP	RADIUS POINT
RR	RAIL ROAD
RS	SHORT RADIUS
RT	RIGHT
S	SLOPE
SAN	SANITARY
SC	SHORT CHORD
SCD	STANDARD CONTRACT DOCUMENTS
SCH	SCHEDULE
SF	SILT FENCE
SL	SECTION LINE
SSRB	STANDARD SPECIFICATIONS FOR ROAD & BRIDGE CONSTRUCTION
SSUU	STANDARD SPECIFICATIONS FOR CONSTRUCTION OF UNDERGROUND UTILITIES
STA	STATION
STL	STEEL
STM	STORM
T	TELEPHONE
TAN	LENGTH OF TANGENT
TC	TOP OF CURB
TH	TEST HOLE
TV	TELEVISION
(TYP)	TYPICAL
UU	UNDERGROUND UTILITIES
VC	VERTICAL CURVE
VCP	VITRIFIED CLAY PIPE
VPC	VERTICAL POINT OF CURVATURE
VPCC	VERTICAL POINT OF COMPOUND CURVATURE
VPRC	VERTICAL POINT OF REVERSE CURVATURE
VPI	VERTICAL POINT OF INTERSECTION
VPT	VERTICAL POINT OF TANGENCY



LEGEND

BSWMP	
DRAINAGE BASIN BOUNDARY	
BSWMP	
ANCHORED STRAW BALES	ASB ASB ASB
BSWMP	
SILT FENCE	SF SF SF
BUILDING	
CONCRETE CURB AND GUTTER	2' CURB AND GUTTER
	7' C, G, & SW
CONCRETE CURB,GUTTER, & SIDEWALK	
CONCRETE DITCH	CONCRETE
CONCRETE SIDEWALK	4' SW
CULVERT	18" RCP
EARTH DITCH	EARTH
EDGE OF GRAVEL	
EDGE OF PAVEMENT	
FENCE (HT & MATL NOTED)	6' CHAINLINK
GUARD RAIL	
HATCHING: INDICATES ASPHALT REMOVAL	
HATCHING: INDICATES CONCRETE REMOVAL	
HATCHING: INDICATES STAGING AREA	*STAGING AREA*
LINE (CENTER OF IMPROVEMENTS)	CENTERLINE
LINE (CITY LIMITS)	CITY LIMITS
LINE (CONTROL)	CONTROL LINE
LINE (EASEMENT)	
LINE (MONUMENT/SECTION)	MONUMENT/SECTION LINE
LINE (PROPERTY)	
LINE (RIGHT OF WAY)	
MATCH LINE	MATCH LINE
PIPE (IRRIGATION)	
PIPE (SIPHON)	

PROPOSED CONCRETE CURB AND GUTTER	
PROPOSED CONCRETE CURB,GUTTER,& SIDEWALK	
PROPOSED CONCRETE SIDEWALK	
PROPOSED "WET" UTILITIES (CONSTRUCTION NOTE WILL INDICATE TYPE, SIZE, AND MATERIAL OF NEW MAIN)	8" PVC SANITARY SEWER
ALL PROPOSED FEATURES NOT SHOWN IN LEGEND WILL BE SHOWN THE SAME AS THEIR EXISTING COUNTERPART, BUT INDICATED BY BOLDER LINETYPE	
RAIL ROAD	
RETAINING WALL	1' RETAINING WALL
STRIPING (CONTINUOUS WHITE)	WHITE
STRIPING (DASHED WHITE)	WHITE
STRIPING (CONTINUOUS YELLOW)	YELLOW
STRIPING (DASHED YELLOW)	YELLOW
TOP OF SLOPE	4580
CONTOUR LINES (SHOWN BETWEEN TOP & TOE)	4570
TOE OF SLOPE	
TRAFFIC DETECTOR LOOP	
UTILITY LINE (ABANDON) (THIS CASE A WATER LINE)	(ABANDONED)
UTILITY LINE (CABLE TV)	TV TV
UTILITY LINE (ELECTRIC)	E E
UTILITY LINE (FIBER OPTIC)	FO QWEST FO
UTILITY LINE (GAS)	G 1.1/4" MW G
UTILITY LINE (HIGH VOLTAGE OVERHEAD POWER)	HVHWP
UTILITY LINE (OVERHEAD POWER)	OHP
UTILITY LINE (OVERHEAD TELEPHONE)	OHT
UTILITY LINE (SANITARY SEWER)	8" SAN
UTILITY LINE (SANITARY SEWER FORCE MAIN)	8" FM
UTILITY LINE (SANITARY SEWER SERVICE)	SS
UTILITY LINE (STORM SEWER)	8" STM
UTILITY LINE (STORM SEWER, PERFORATED)	6" PERF
UTILITY LINE (STORM/SANITARY SEWER SEWER COMBINATION)	18" COMB
UTILITY LINE (TELEPHONE)	T T
UTILITY LINE (WATER)	W 8" W

SYMBOLS

BENCH MARK	A
CATCH BASIN	
CLEAN OUT	550
CURB STOP	◄
FIRE HYDRANT	⊕
GUY WIRE ANCHOR	→
HEADGATE	田
IRRIGATION PUMP	田
MAILBOX	MB
MANHOLE (ELECTRIC)	E
MANHOLE (GAS)	G
MANHOLE (SANITARY/STORM)	O
MANHOLE (TELEPHONE)	T
MANHOLE (WATER)	W
METER (GAS)	GM
METER (WATER)	O
PEDESTAL (TELEPHONE)	Δ
PEDESTAL (TV)	ΔTV
PROPERTY PIN	PR
PULL BOX	☒
REDUCER FITTING	◄
SIGN OR POST (SIGN TYPE NOTED)	↑STOP
SPRINKLER HEAD	☼
STREET LIGHT	O-O
SURVEY MONUMENT (CITY)	CSM
SURVEY MONUMENT (TYPE NOTED)	MCSM
TEST HOLE	TH #1
TRAFFIC PAINT MARKING	➡
TRAFFIC SIGNAL POLE AND MAST ARM	TS
UTILITY POLE	○
VALVE (GAS)	GV
VALVE (IRRIGATION)	IV
VALVE (WATER)	WV
VEGETATION (HEDGE OR BUSH)	☁
VEGETATION (TREE STUMP)	☪
VEGETATION (TREE) (CALIPER SIZE NOTED)	6"
WATER HYDRANT	⊕
WEIR	≡
YARD LIGHT	☼

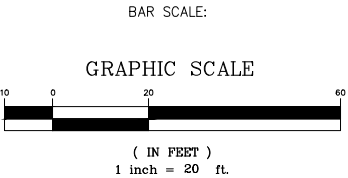

REVISION	Δ	DESCRIPTION	DATE	DRAWN BY	HMC	DATE	2025
REVISION	Δ			DESIGNED BY	RW	DATE	2025
REVISION	Δ			CHECKED BY	RW	DATE	2025
REVISION	Δ			APPROVED BY	RW	DATE	2025

SCALES:
NO SCALE



ENGINEERING AND
TRANSPORTATION DEPARTMENT

PROJECT NO. C1148

1ST AND WALNUT STORM SEWER IMPROVEMENT
STANDARD ABBREVIATIONS LEGENDS AND SYMBOLS
September 9, 2026

Instr. Instr. (2)

Instr. (3) Spell ck

Bid Schedule: 1st and Walnut Storm Sewer Improvement

Item No.	CDOT, City Ref.	Description	Quantity	Units	Unit Price	Total Price
1	102	Storm Drain Inlet with Vertical Curb Opening	1.	EA	\$ _____	\$ _____
2	108	Storm Drain Pipe - 12" concrete Pipe; Includes Type A bedding and haunching material and backfill of trench with native materials meeting 103.16 backfill material.	37.	LF	\$ _____	\$ _____
3	108	Connecto to Existing Inlet Structure	1.	EA	\$ _____	\$ _____
4	202	Removal of Concrete (Includes V-Pan and Curb and Gutter)	25.5	SY	\$ _____	\$ _____
5	202	Removal of Asphalt Mat (Planing (2" Depth)	8.1	SY	\$ _____	\$ _____
6	208	Storm Drain Inlet Protection (Type III)	1.	EA	\$ _____	\$ _____
7	401	Hot Bituminous Pavement (Patching) (2" T-Top) (Grading SX, Binder Grade PG 64-22)	3.4	TON	\$ _____	\$ _____
8	608	Concrete Curb and Gutter (Match In Kind) (City Std. Detail C-05)	12.	LF	\$ _____	\$ _____
9	608	Concrete Drainage Pan (Match In Kind) (Includes #5 rebar tie-bars) (City Std. Detail C-12)	34.7	LF	\$ _____	\$ _____
10	626	Mobilization	Lump Sum		---	\$ _____
11	630	Traffic Control Plan	Lump Sum		---	\$ _____
12	630	Traffic Control (Complete in Place)	Lump Sum		---	\$ _____
13	630	Flagging	Lump Sum		---	\$ _____
14		Potholing	---	---	---	\$ 10,000.00

Item No.	CDOT, City Ref.	Description	Quantity	Units	Unit Price	Total Price
Alt. 1	108	Storm Drain Pipe - 15" concrete Pipe; Includes Type A bedding and haunching material and backfill of trench with native materials meeting 103.16 backfill material.	45.	LF	\$ _____	\$ _____
Alt. 2	108	Connecto to Existing Structure	2.	EA	\$ _____	\$ _____
Alt. 3	202	Removal of Concrete (Includes V-Pan and Curb and Gutter)	26.3	SY	\$ _____	\$ _____
Alt. 4	202	Removal of Asphalt Mat (Planing (2" Depth)	41.7	SY	\$ _____	\$ _____
Alt. 5	208	Storm Drain Inlet Protection (Type III)	1.	EA	\$ _____	\$ _____
Alt. 6	401	Hot Bituminous Pavement (Patching) (2" T-Top) (Grading SX, Binder Grade PG 64-22)	12.6	TON	\$ _____	\$ _____
Alt. 7	608	Concrete Curb and Gutter (Match In Kind) (City Std. Detail C-05)	12.	LF	\$ _____	\$ _____
Alt. 8	608	Concrete Drainage Pan (Match In Kind) (Includes #5 rebar tie-bars) (City Std. Detail C-12)	17.	LF	\$ _____	\$ _____
Alt. 9	630	Traffic Control Plan	Lump Sum		---	\$ _____
Alt. 10	630	Traffic Control (Complete in Place)	Lump Sum		---	\$ _____
Alt. 11	630	Flagging	Lump Sum		---	\$ _____
MCR		Minor Contract Revisions	---	---	---	\$ 15,000.00
Bid Amount:					\$ _____	

Bid Amount: _____ dollars

REVISION	DESCRIPTION	DATE	DRAWN BY	HMC	DATE	2025
REVISION			DESIGNED BY	RW	DATE	2025
REVISION			CHECKED BY	RW	DATE	2025
REVISION			APPROVED BY	RW	DATE	2025


SCALES:

NO SCALE




ENGINEERING AND
TRANSPORTATION DEPARTMENT
PROJECT NO. C1148


1ST AND WALNUT STORM SEWER IMPROVEMENT
SUMMARY OF EARTHWORK QUANTITIES - 1
September 9, 2026

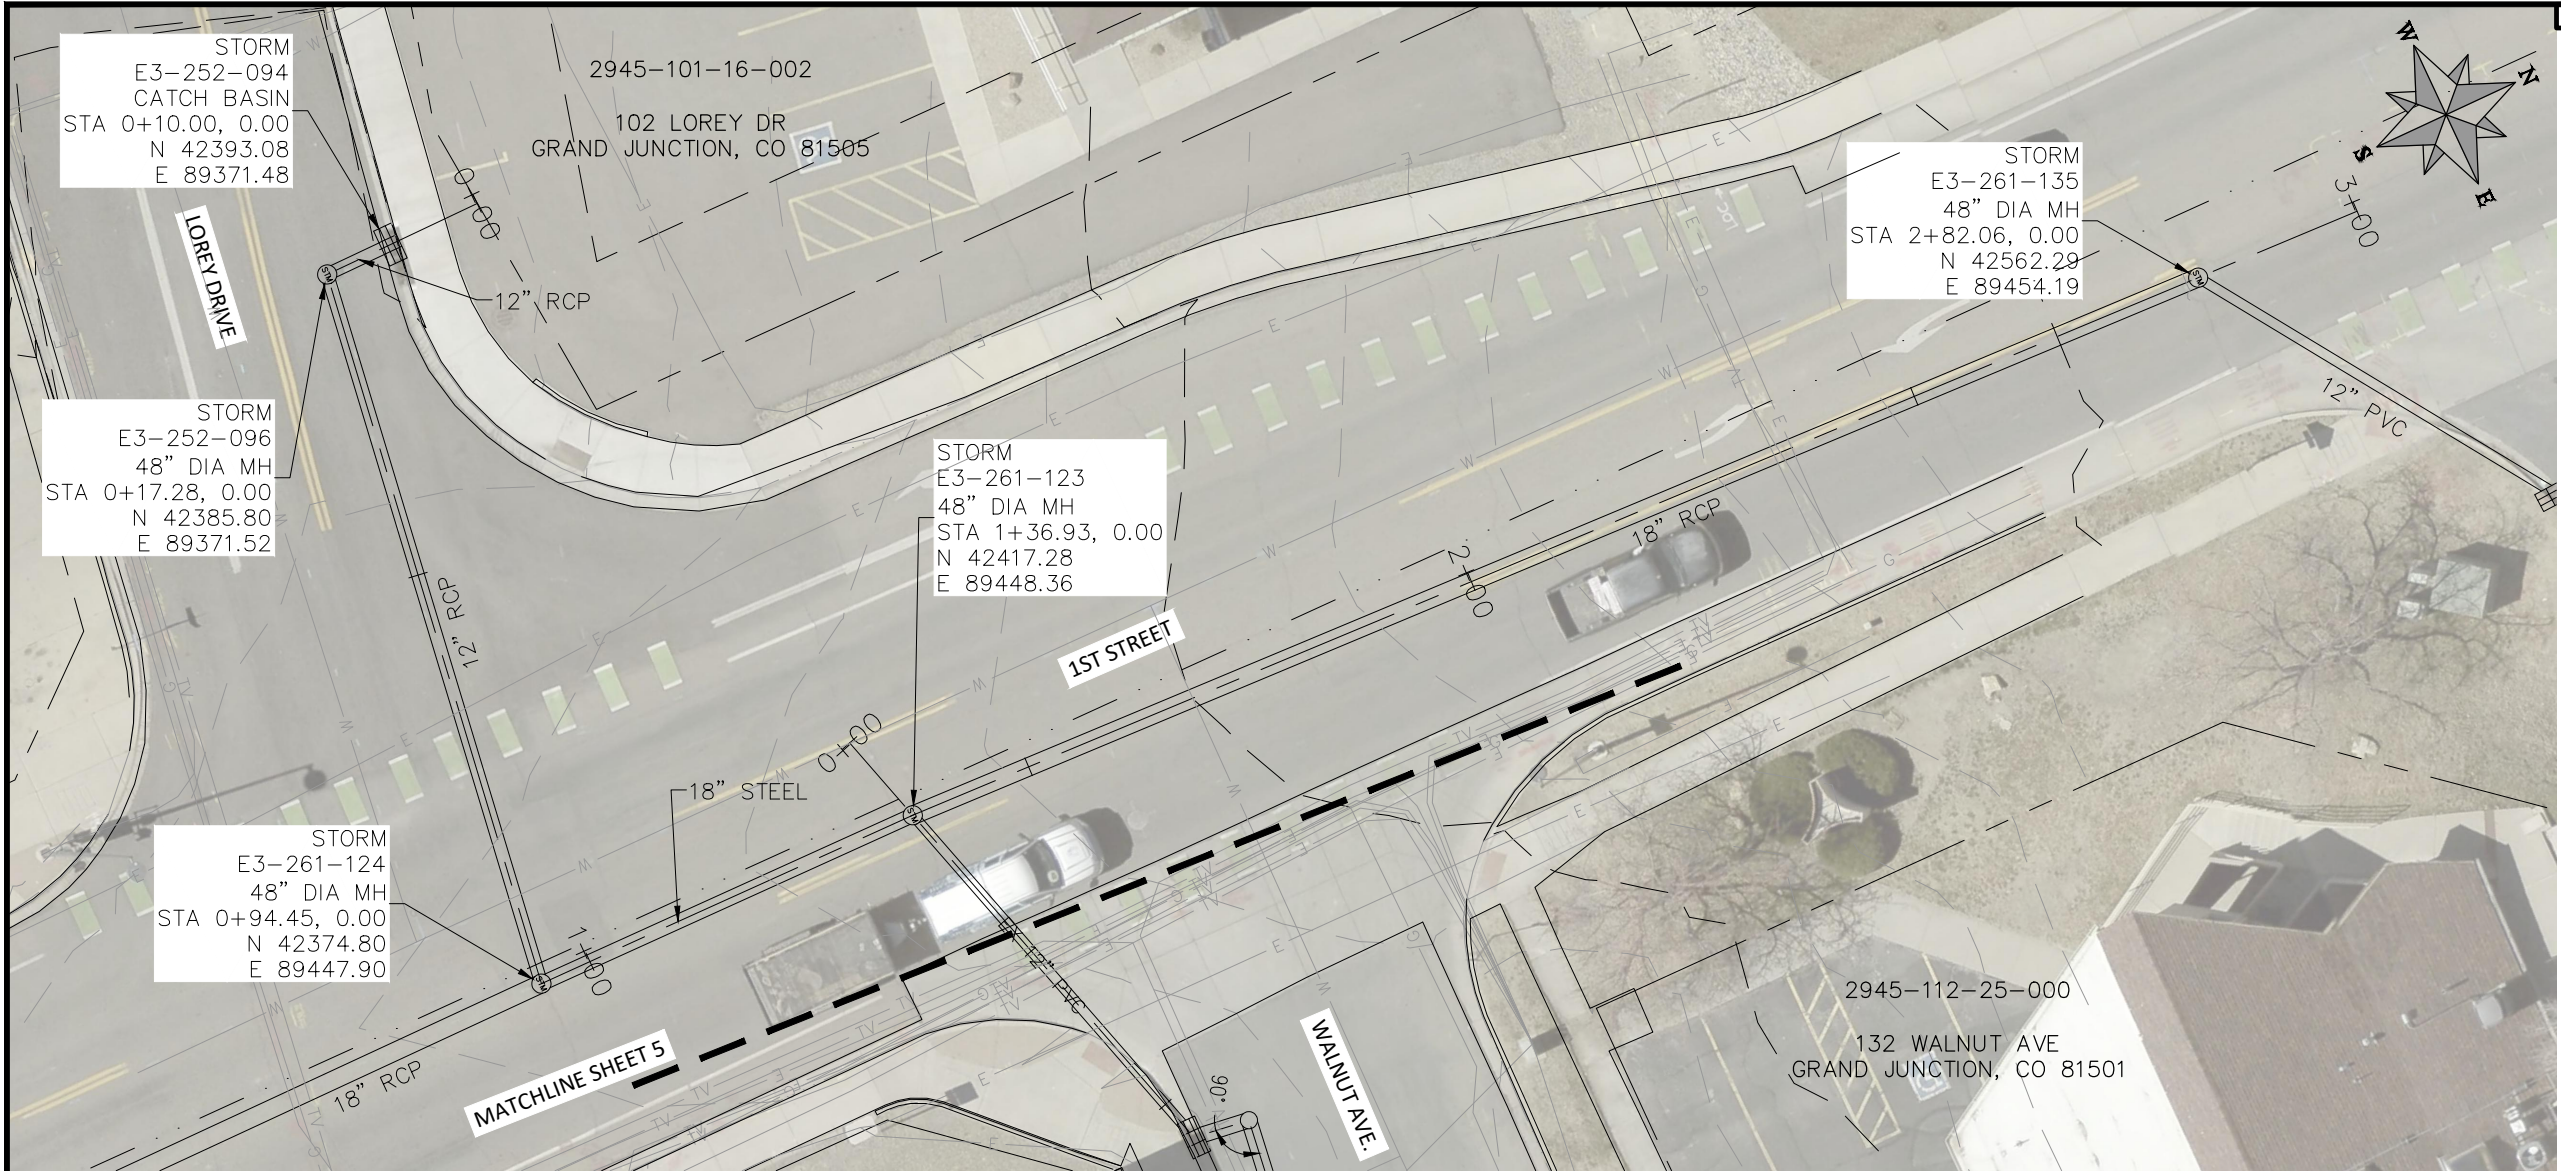

- NOTES**
- 1 CONTRACTOR TO VERIFY ALL FIELD UTILITY LOCATIONS.
 - 2 ALL WORK TO BE DONE IN ACCORDANCE TO CITY OF GRAND JUNCTION STANDARD SPECIFICATIONS AND STANDARD DETAILS.

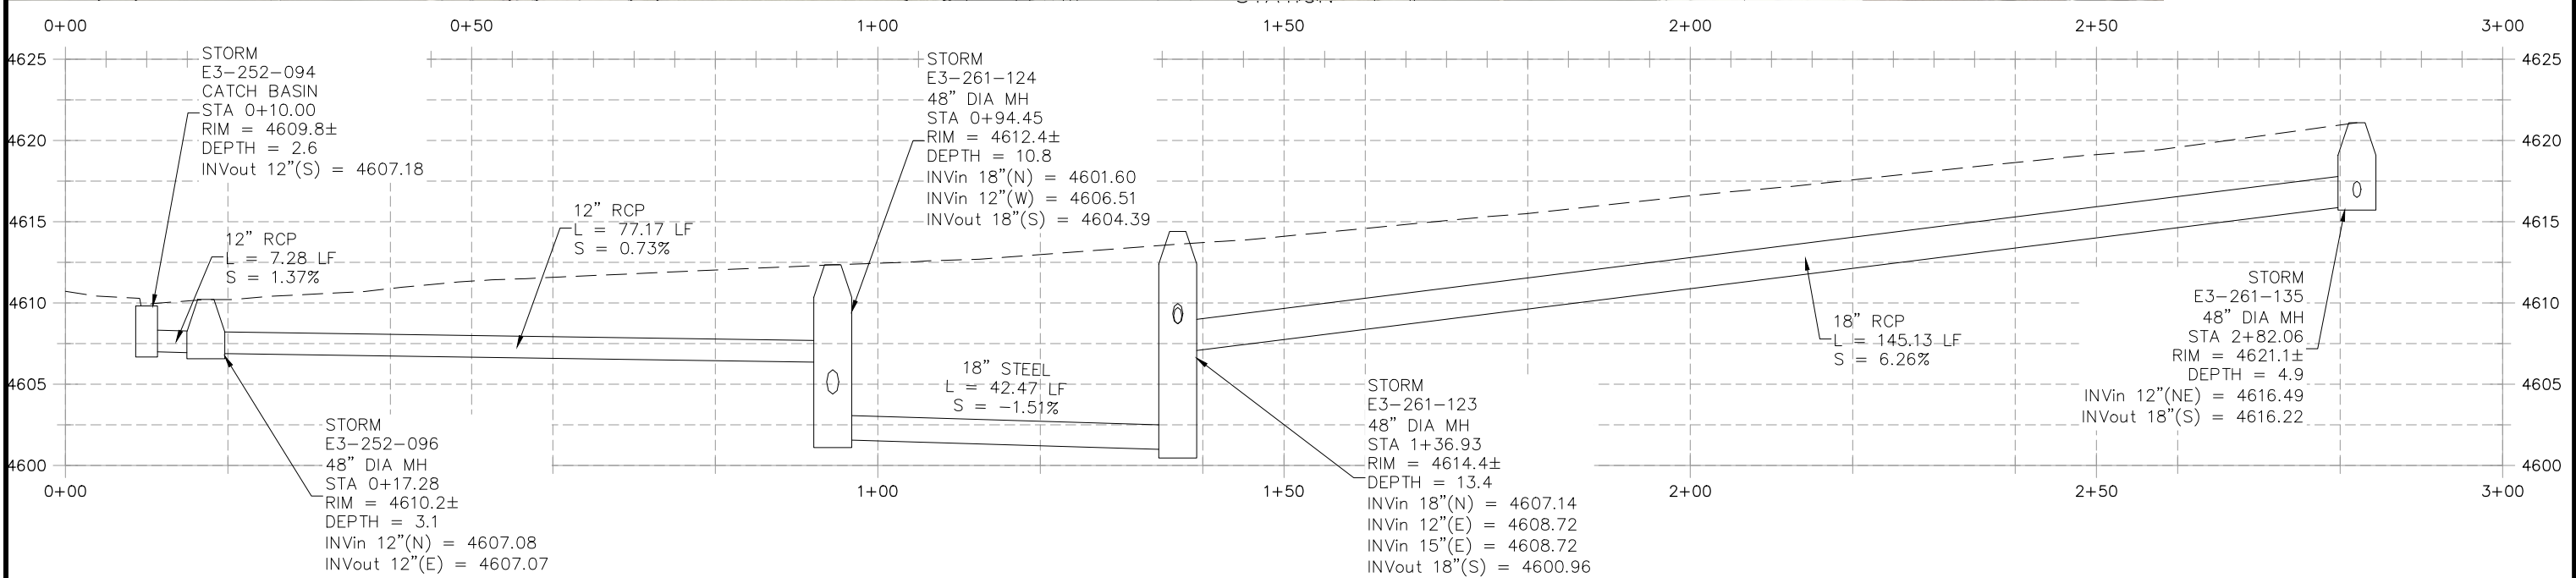


REVISION	DESCRIPTION	DATE	DRAWN BY	HMC	DATE	2025
REVISION			DESIGNED BY	RW	DATE	2025
REVISION			CHECKED BY	RW	DATE	2025
REVISION			APPROVED BY	RW	DATE	2025



**ENGINEERING AND
TRANSPORTATION DEPARTMENT**
PROJECT NO. C1148

**1ST AND WALNUT STORM SEWER IMPROVEMENT
EXISTING STORM PLAN & PROFILE 1ST STREET**
September 9, 2026

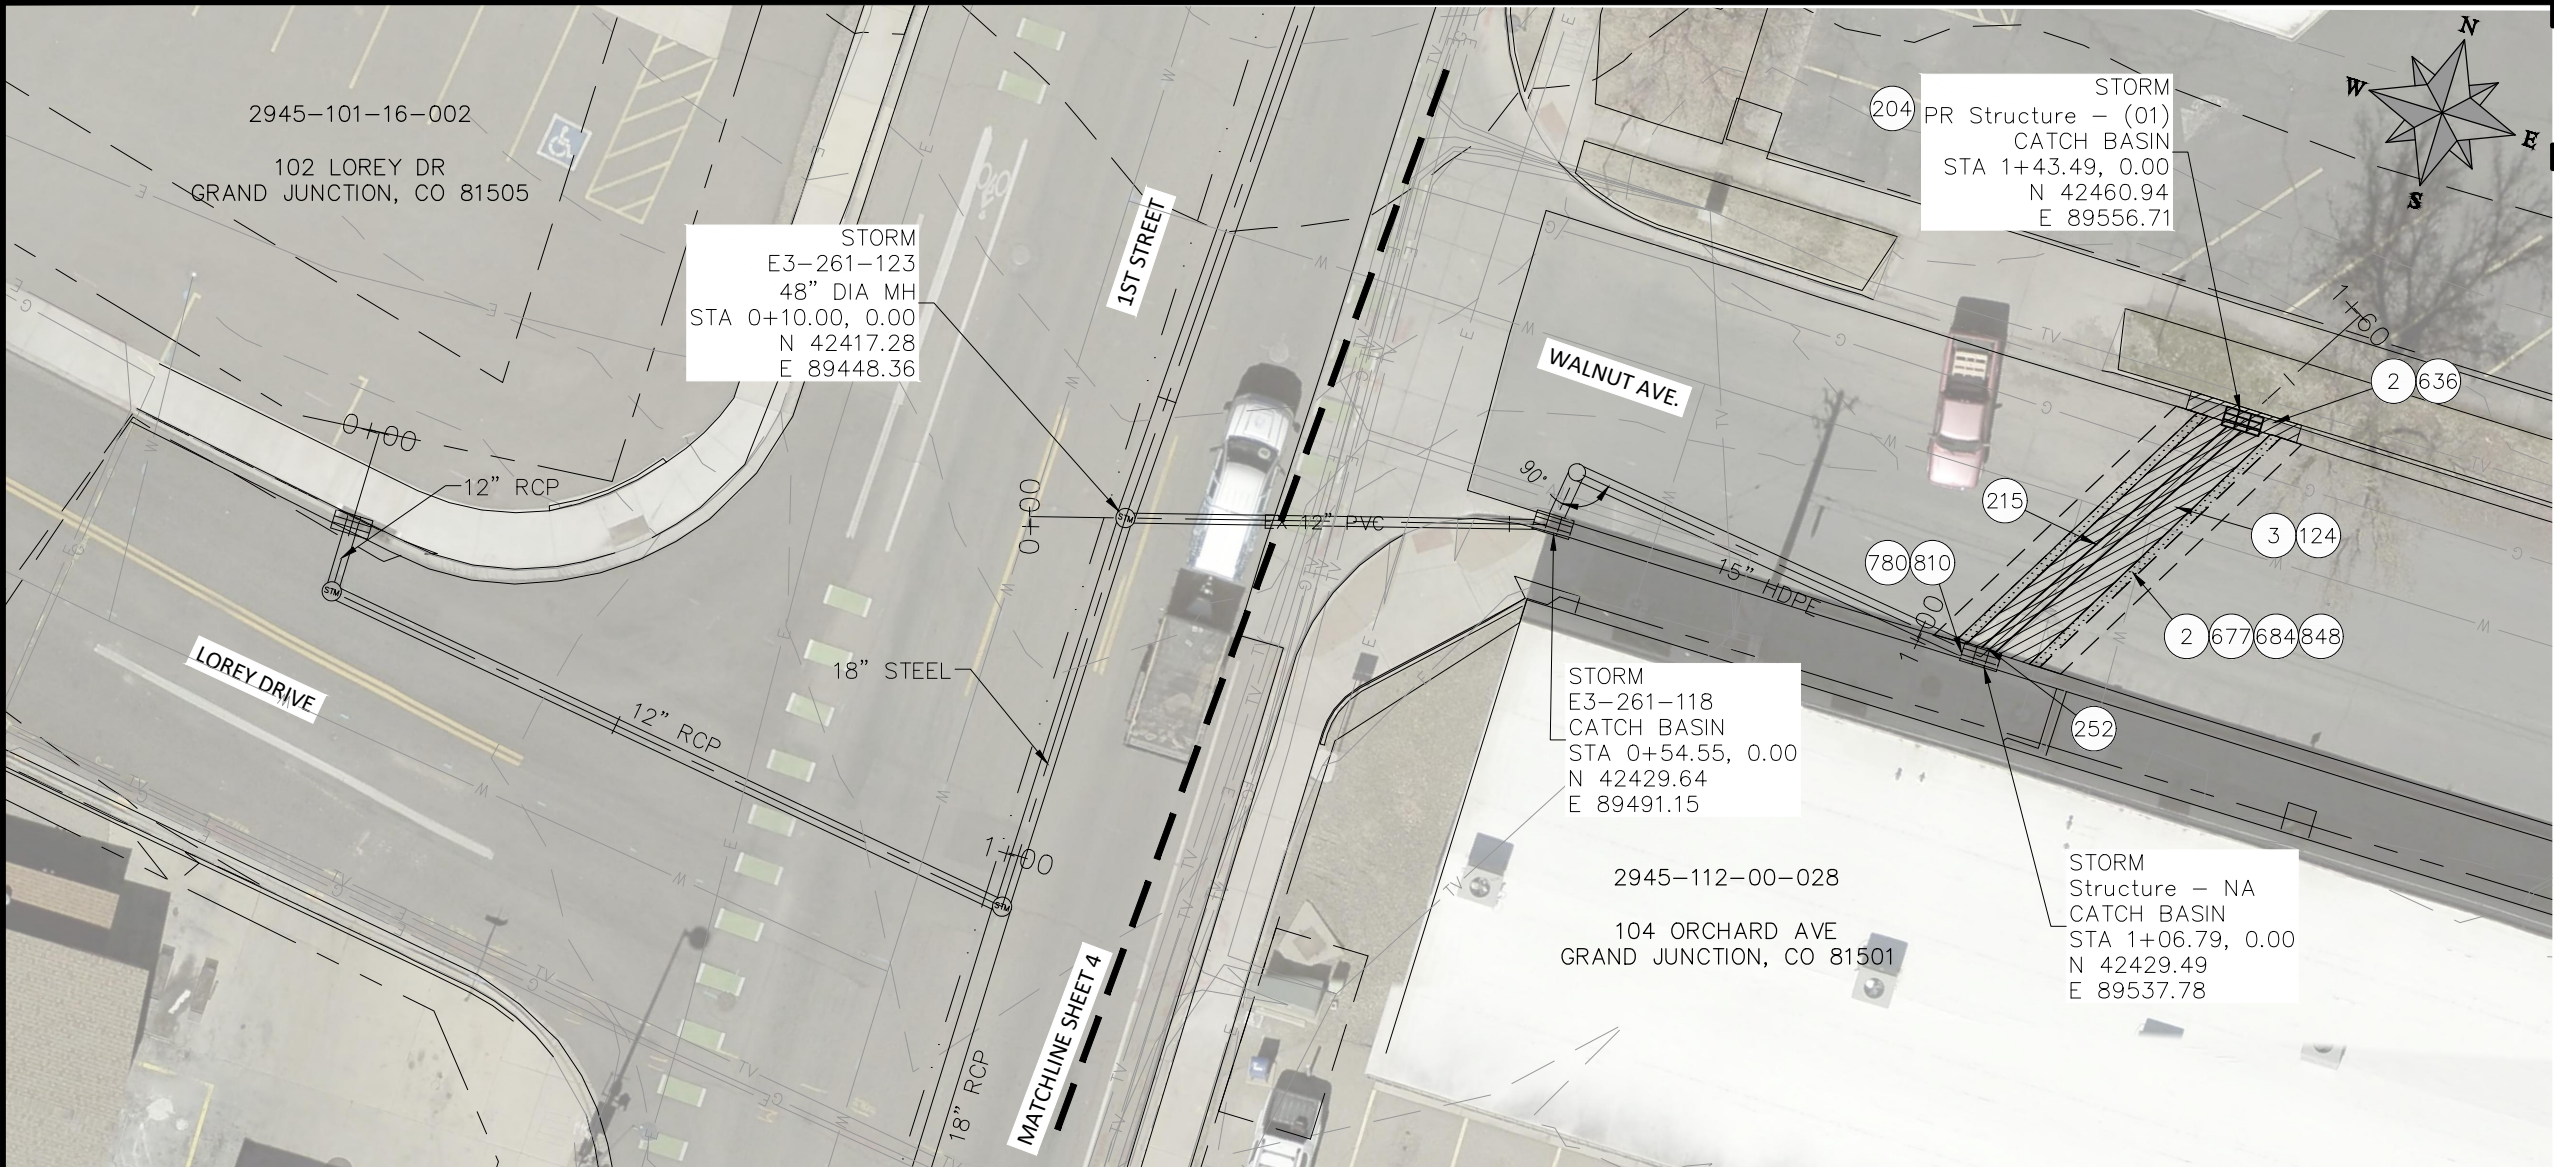

- NOTES
- 1

CONTRACTOR TO VERIFY ALL FIELD UTILITY LOCATIONS.
- 2

ALL WORK TO BE DONE IN ACCORDANCE TO CITY OF GRAND JUNCTION STANDARD SPECIFICATIONS AND STANDARD DETAILS.
- CONSTRUCTION NOTES
- 2

202.09 REMOVAL OF ASPHALT MAT (PLANING)(2\"/>

3

202 REMOVAL OF CONCRETE. SAW CUT AND REMOVE CONCRETE AS SHOWN. (INDICATED BY CROSS HATCH PATTERN) INCLUDES BUT NOT LIMITED TO CURB, GUTTER, SIDEWALK, DRIVEWAY, SLABS, V-PAN, CURB RAMPS, INTERSECTION CORNERS, APRONS, AND LANDSCAPE BORDER.

124

REPLACE CONCRETE IN-KIND. SEE COPY OF GRAND JUNCTION STANDARD DETAILS C-05 & C-12.

204

102.13/108.6 SINGLE STORM DRAIN INLET (VERTICAL CURB) (SEE COPY OF GRAND JUNCTION STANDARD DETAIL D-07)

215

102.10/108.2 12\"/>

252

CONNECT TO EXISTING STORM CATCH BASIN

636

608.06 – MONOLITHIC VERTICAL CURB AND GUTTER

677

401.08 – HOT BITUMINOUS PAVEMENT (4\"/>

684

401.08 HOT BITUMINOUS PAVEMENT (PATCHING) (2\"/>

780

208 – STORM DRAIN INLET PROTECTION (TYPE III)

810

PROTECT STORM DRAIN INLET

848

ADDITIONAL INFORMATION REGARDING PAVEMENT PLACEMENT FOR \"T-TOP\" : TOP PAVEMENT LIFT SHALL BE EXTENDED OUTSIDE PREVIOUS LIFT TO MILLED EDGE. (REFER TO PAGE GU-03 OF THE STANDARD CONTROL DOCUMENTS)

851

DEPTH OF UTILITY ASSUMED, CONTRACTOR TO VERIFY.

REVISION

DESCRIPTION

DATE

DRAWN BY HMC

DATE 2025

DESIGNED BY RW

DATE 2025

CHECKED BY RW

DATE 2025

APPROVED BY RW

DATE 2025

SCALES:

PLAN & PROFILE

HORIZONTAL 1\"/>

VERTICAL 1\"/>

CITY OF

Grand Junction

COLORADO

ENGINEERING AND

TRANSPORTATION DEPARTMENT

PROJECT NO. C1148


1ST AND WALNUT STORM SEWER IMPROVEMENT

STORM PLAN & PROFILE WALNUT AVE


September 9, 2026

5

N:\EngPro\S\STORMWATER\C1148(1st & Walnut Drainage Improvements)\60CAD\DESIGN\1st and Walnut Existing Plan and Profile.dwg -- PLOTTED 9/9/2026 10:04:40 AM

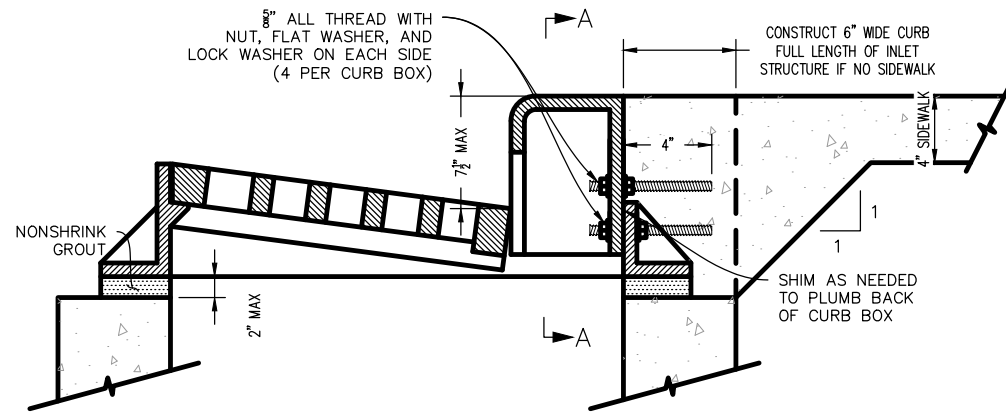


SIDE VIEW
N.T.S.

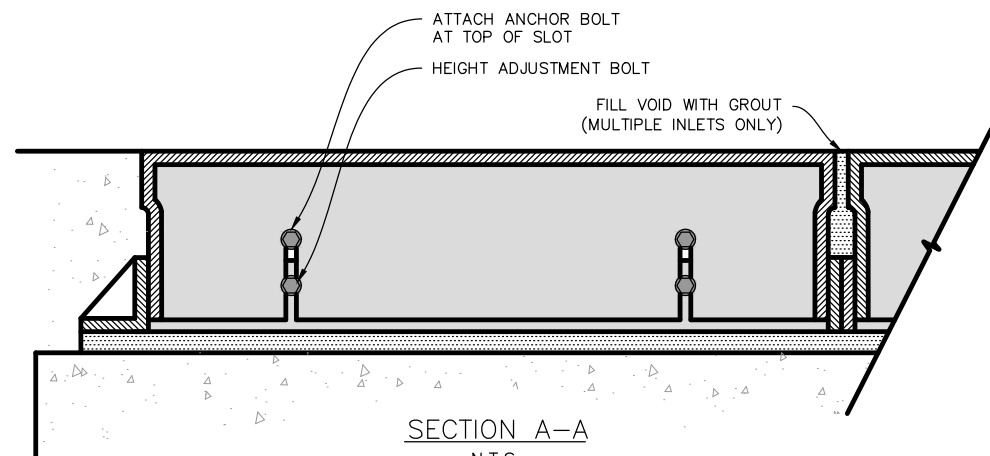


SECTION A-A
N.T.S.

INLET CURB BOX DETAIL

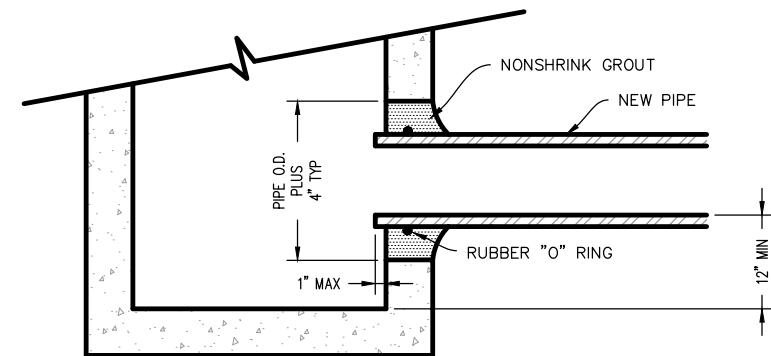

GROUTED PIPE CONNECTION
(FOR CONNECTIONS TO EXISTING STRUCTURES)

GROUT FOR PIPE CONNECTIONS SHALL BE ALL-CRETE (5 OR 20 MINUTE SET) MANUFACTURED BY FOSROC INC. OR AN APPROVED SUBSTITUTE.

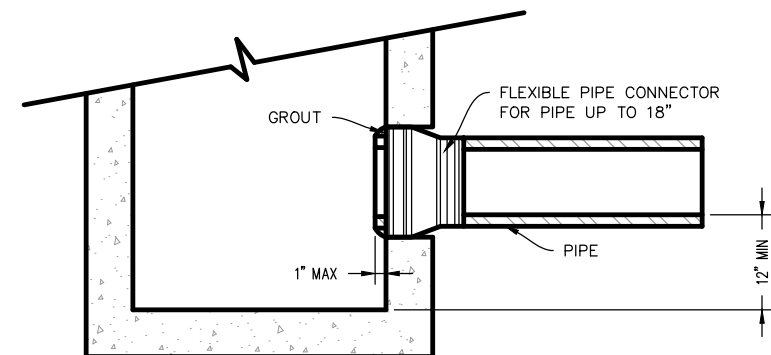

PVC PIPE CONNECTION


CONNECTION TO EXISTING PIPE, MANHOLE OR INLET BOX

REVISION	DESCRIPTION	DATE	DRAWN BY	HMC	DATE	2025	SCALES:
REVISION			DESIGNED BY	RW	DATE	2025	
REVISION			CHECKED BY	RW	DATE	2025	NO SCALE
REVISION			APPROVED BY	RW	DATE	2025	




ENGINEERING AND
TRANSPORTATION DEPARTMENT
PROJECT NO. C1148

1ST AND WALNUT STORM SEWER IMPROVEMENT
STANDARD DETAILS
September 9, 2026

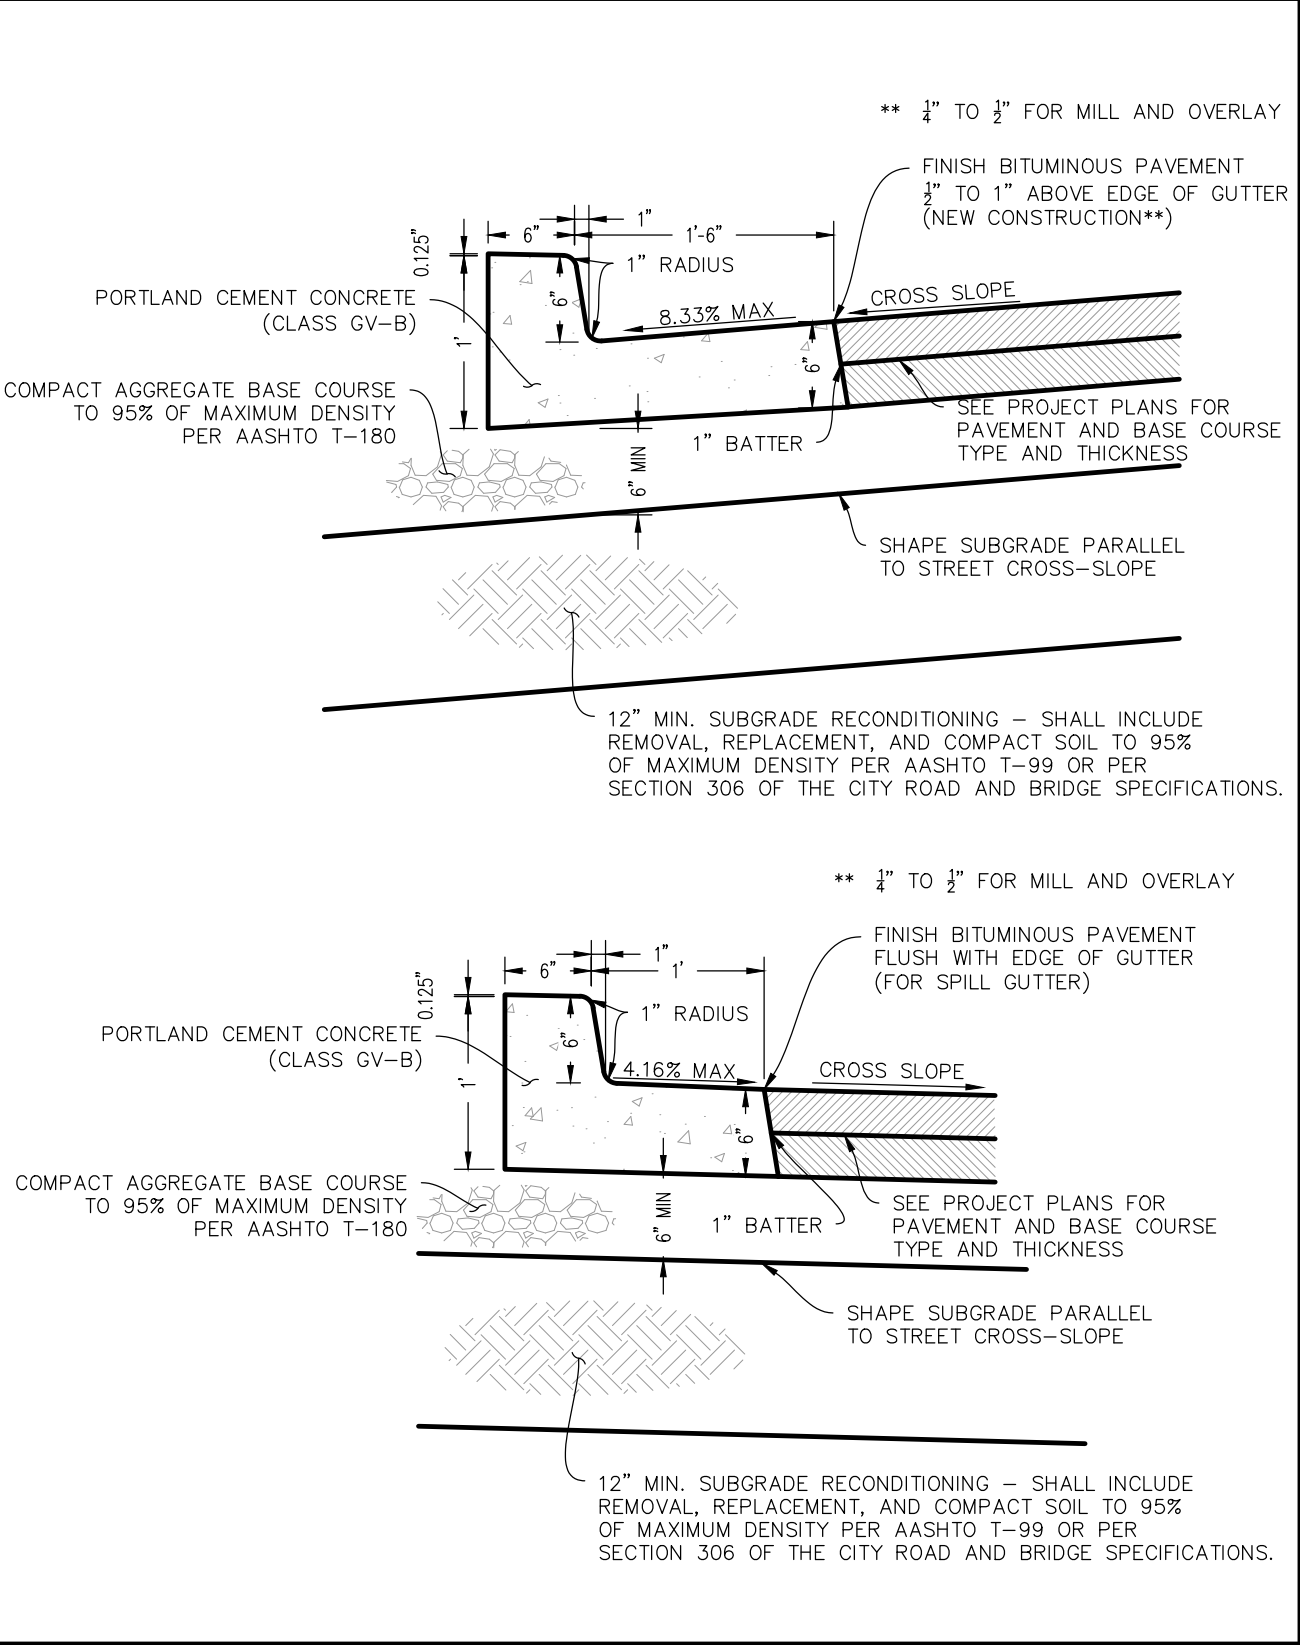

VERTICAL CURB AND GUTTER				
	DEPARTMENT OF ENGINEERING AND TRANSPORTATION	STANDARD CONCRETE DETAIL	APPROVED: <u>KH</u> REVISED: <u>FEB 2024</u> DRAWN: <u>IDG</u>	PAGE C-05

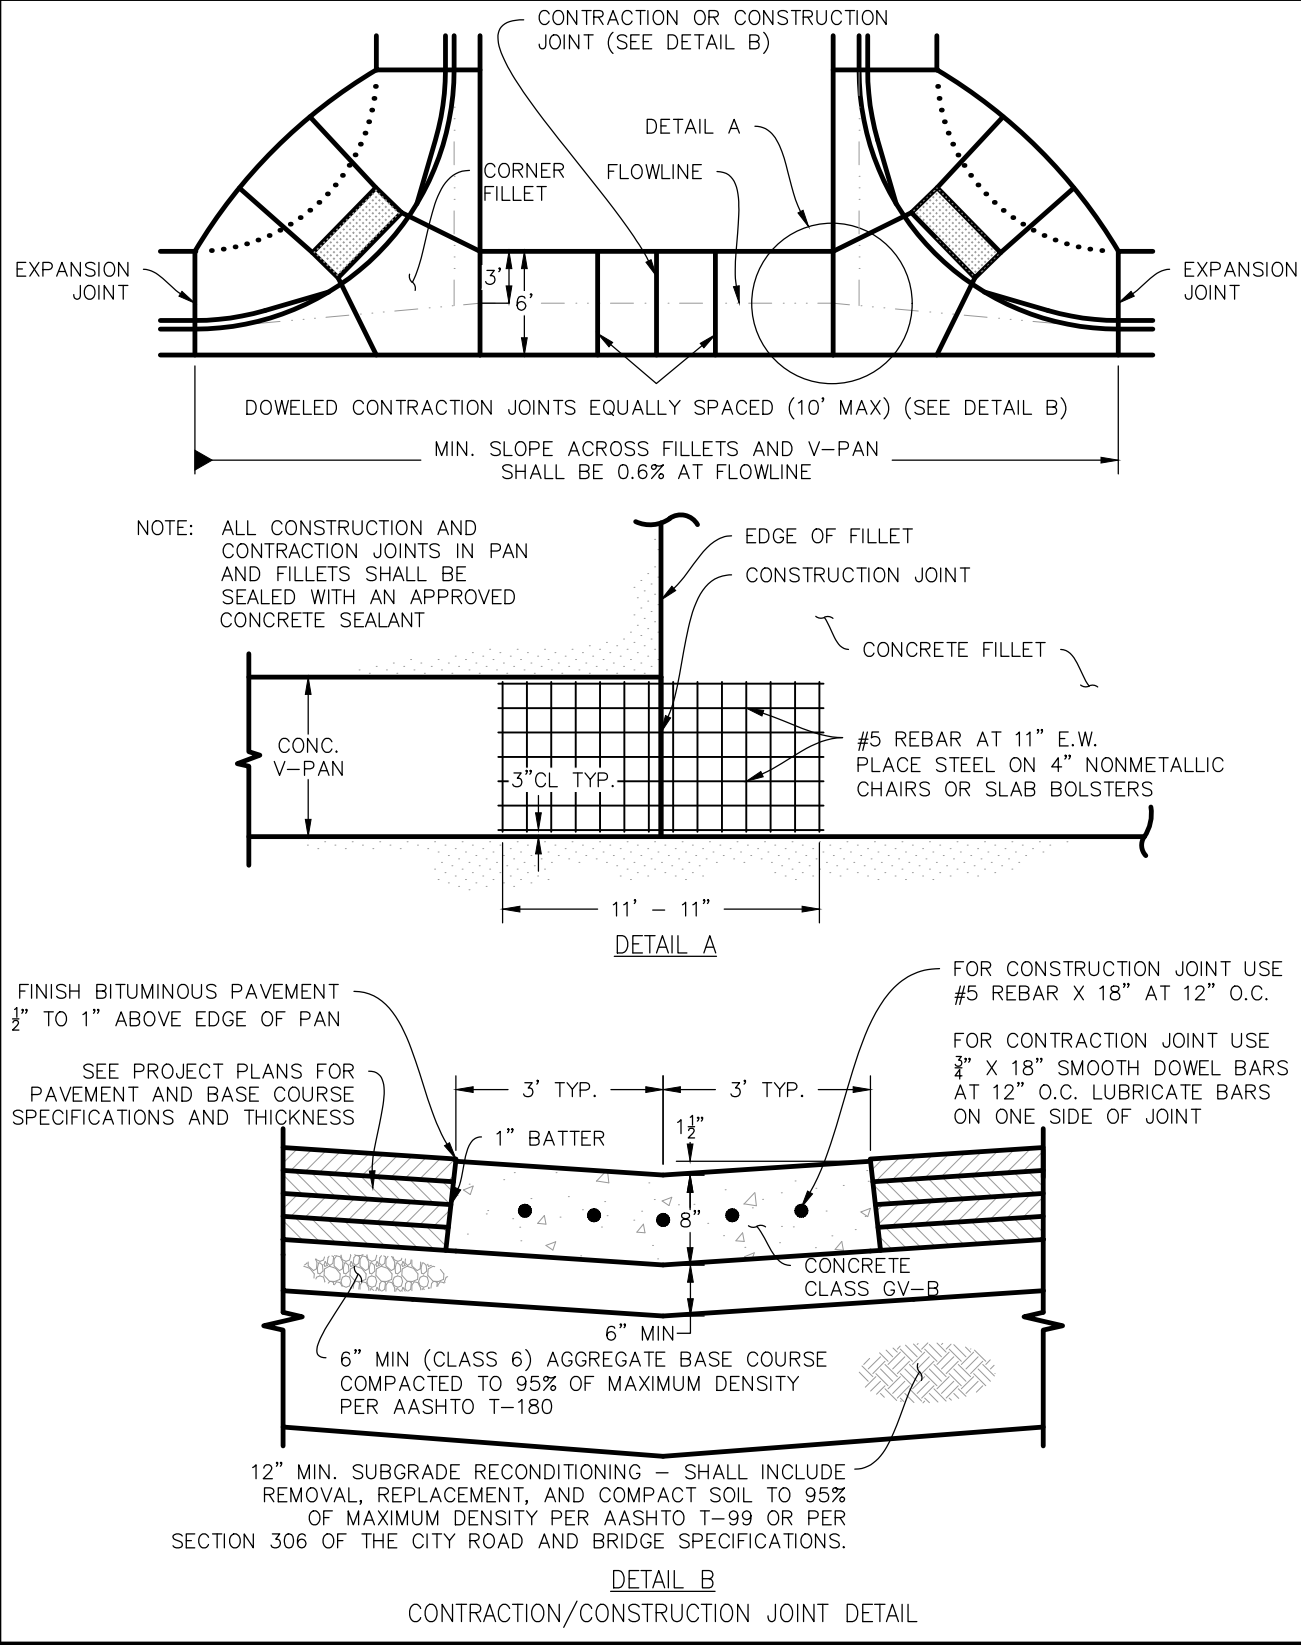

V-PAN DETAIL AND JOINT REINFORCEMENT				
	DEPARTMENT OF ENGINEERING AND TRANSPORTATION	STANDARD CONCRETE DETAIL	APPROVED: <u>KH</u> REVISED: <u>FEB 2024</u> DRAWN: <u>IDG</u>	PAGE C-12

REVISION	DESCRIPTION	DATE	DRAWN BY	HMC	DATE	2025	SCALES:
REVISION			DESIGNED BY	RW	DATE	2025	NO SCALE
REVISION			CHECKED BY	RW	DATE	2025	
REVISION			APPROVED BY	RW	DATE	2025	



ENGINEERING AND TRANSPORTATION DEPARTMENT

PROJECT NO. C1148

1ST AND WALNUT STORM SEWER IMPROVEMENT

STANDARD DETAILS

September 9, 2026

