



Purchasing Division

## **ADDENDUM NO. 1**

**DATE:** March 15, 2016  
**FROM:** City of Grand Junction Purchasing Division  
**TO:** All Offerors  
**RE:** City Hall I.T. Server Room Fire Suppression System Project IFB-4201-16-DH

Offerors responding to the above referenced solicitation are hereby instructed that the requirements have been clarified, modified, superseded and supplemented as to this date as hereinafter described.

Please make note of the following clarifications:

1. Server room has not been tested yet, therefore, it is unknown if the existing work done will pass tests. If existing work fails, a change order will be issued to bring existing work up to passing standards.
2. Q. Will the City be willing to accept a "Brand Name or Equal to" option for equipment for this project.  
A. Yes.
3. Power for the system can be tied to UPS.
4. Q. Can we use the existing tank in the current server room for the new downstairs server room?  
A. No.
5. Q. Is putting sprinkler back into the existing server room part of this project?  
A. No.
6. Q. Is the water line going to be in the way of future wire racks for servers?  
A. No.
7. EPO doesn't need to be tied to the system.
8. Smoke detectors will be required to be installed by Contractor under the plexiglass tops covering the equipment racks, after the racks are installed.

9. See attached drawing with additional information for this project.
10. The system shall not go active until after the HVAC system is installed. The Contractor shall be required to return to activate the system.
11. Mag door holders need to be included for this project, for both leaves, just for inside room doors.

The original solicitation for the project noted above is amended as noted.

All other conditions of subject remain the same.

Respectfully,

A handwritten signature in black ink, appearing to read "Duane Hoff Jr.", written in a cursive style.

Duane Hoff Jr., Senior Buyer  
City of Grand Junction, Colorado

DO NOT REPRODUCE THESE DRAWINGS AND SPECIFICATIONS WITHOUT THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER. THE DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF THE SERVICE AND SHALL REMAIN THE PROPERTY OF THE DESIGNER. WHENEVER THE PROJECT FOR WHICH THEY ARE MADE IS REPRODUCED OR NOT, THESE DRAWINGS AND SPECIFICATIONS SHALL NOT BE USED BY ANYONE ON ANY OTHER PROJECTS FOR ADDITION TO THE PROJECT BY OTHERS EXCEPT BY THE EXPRESSED WRITTEN PERMISSION OF THE DESIGNER.


**Bighorn Consulting Engineers, Inc.**  
 Mechanical & Electrical Engineers  
 569 S. Westgate Dr., Suite 1  
 Grand Junction, CO 81505  
 phone: 970-241-8709, fax: 970-241-9514

**GRAND JUNCTION, CITY HALL  
 SERVER ROOM**  
 250 N. 5TH STREET  
 GRAND JUNCTION, COLORADO



DATE:	ISSUED FOR:
2-27-16	CONSTRUCTION DRAWINGS



DATE:	2-27-16
JOB NO:	15-156
DRAWN BY:	BCE
CHECKED BY:	BCE
SCALE:	AS SHOWN
SHEET NUMBER:	M1-4

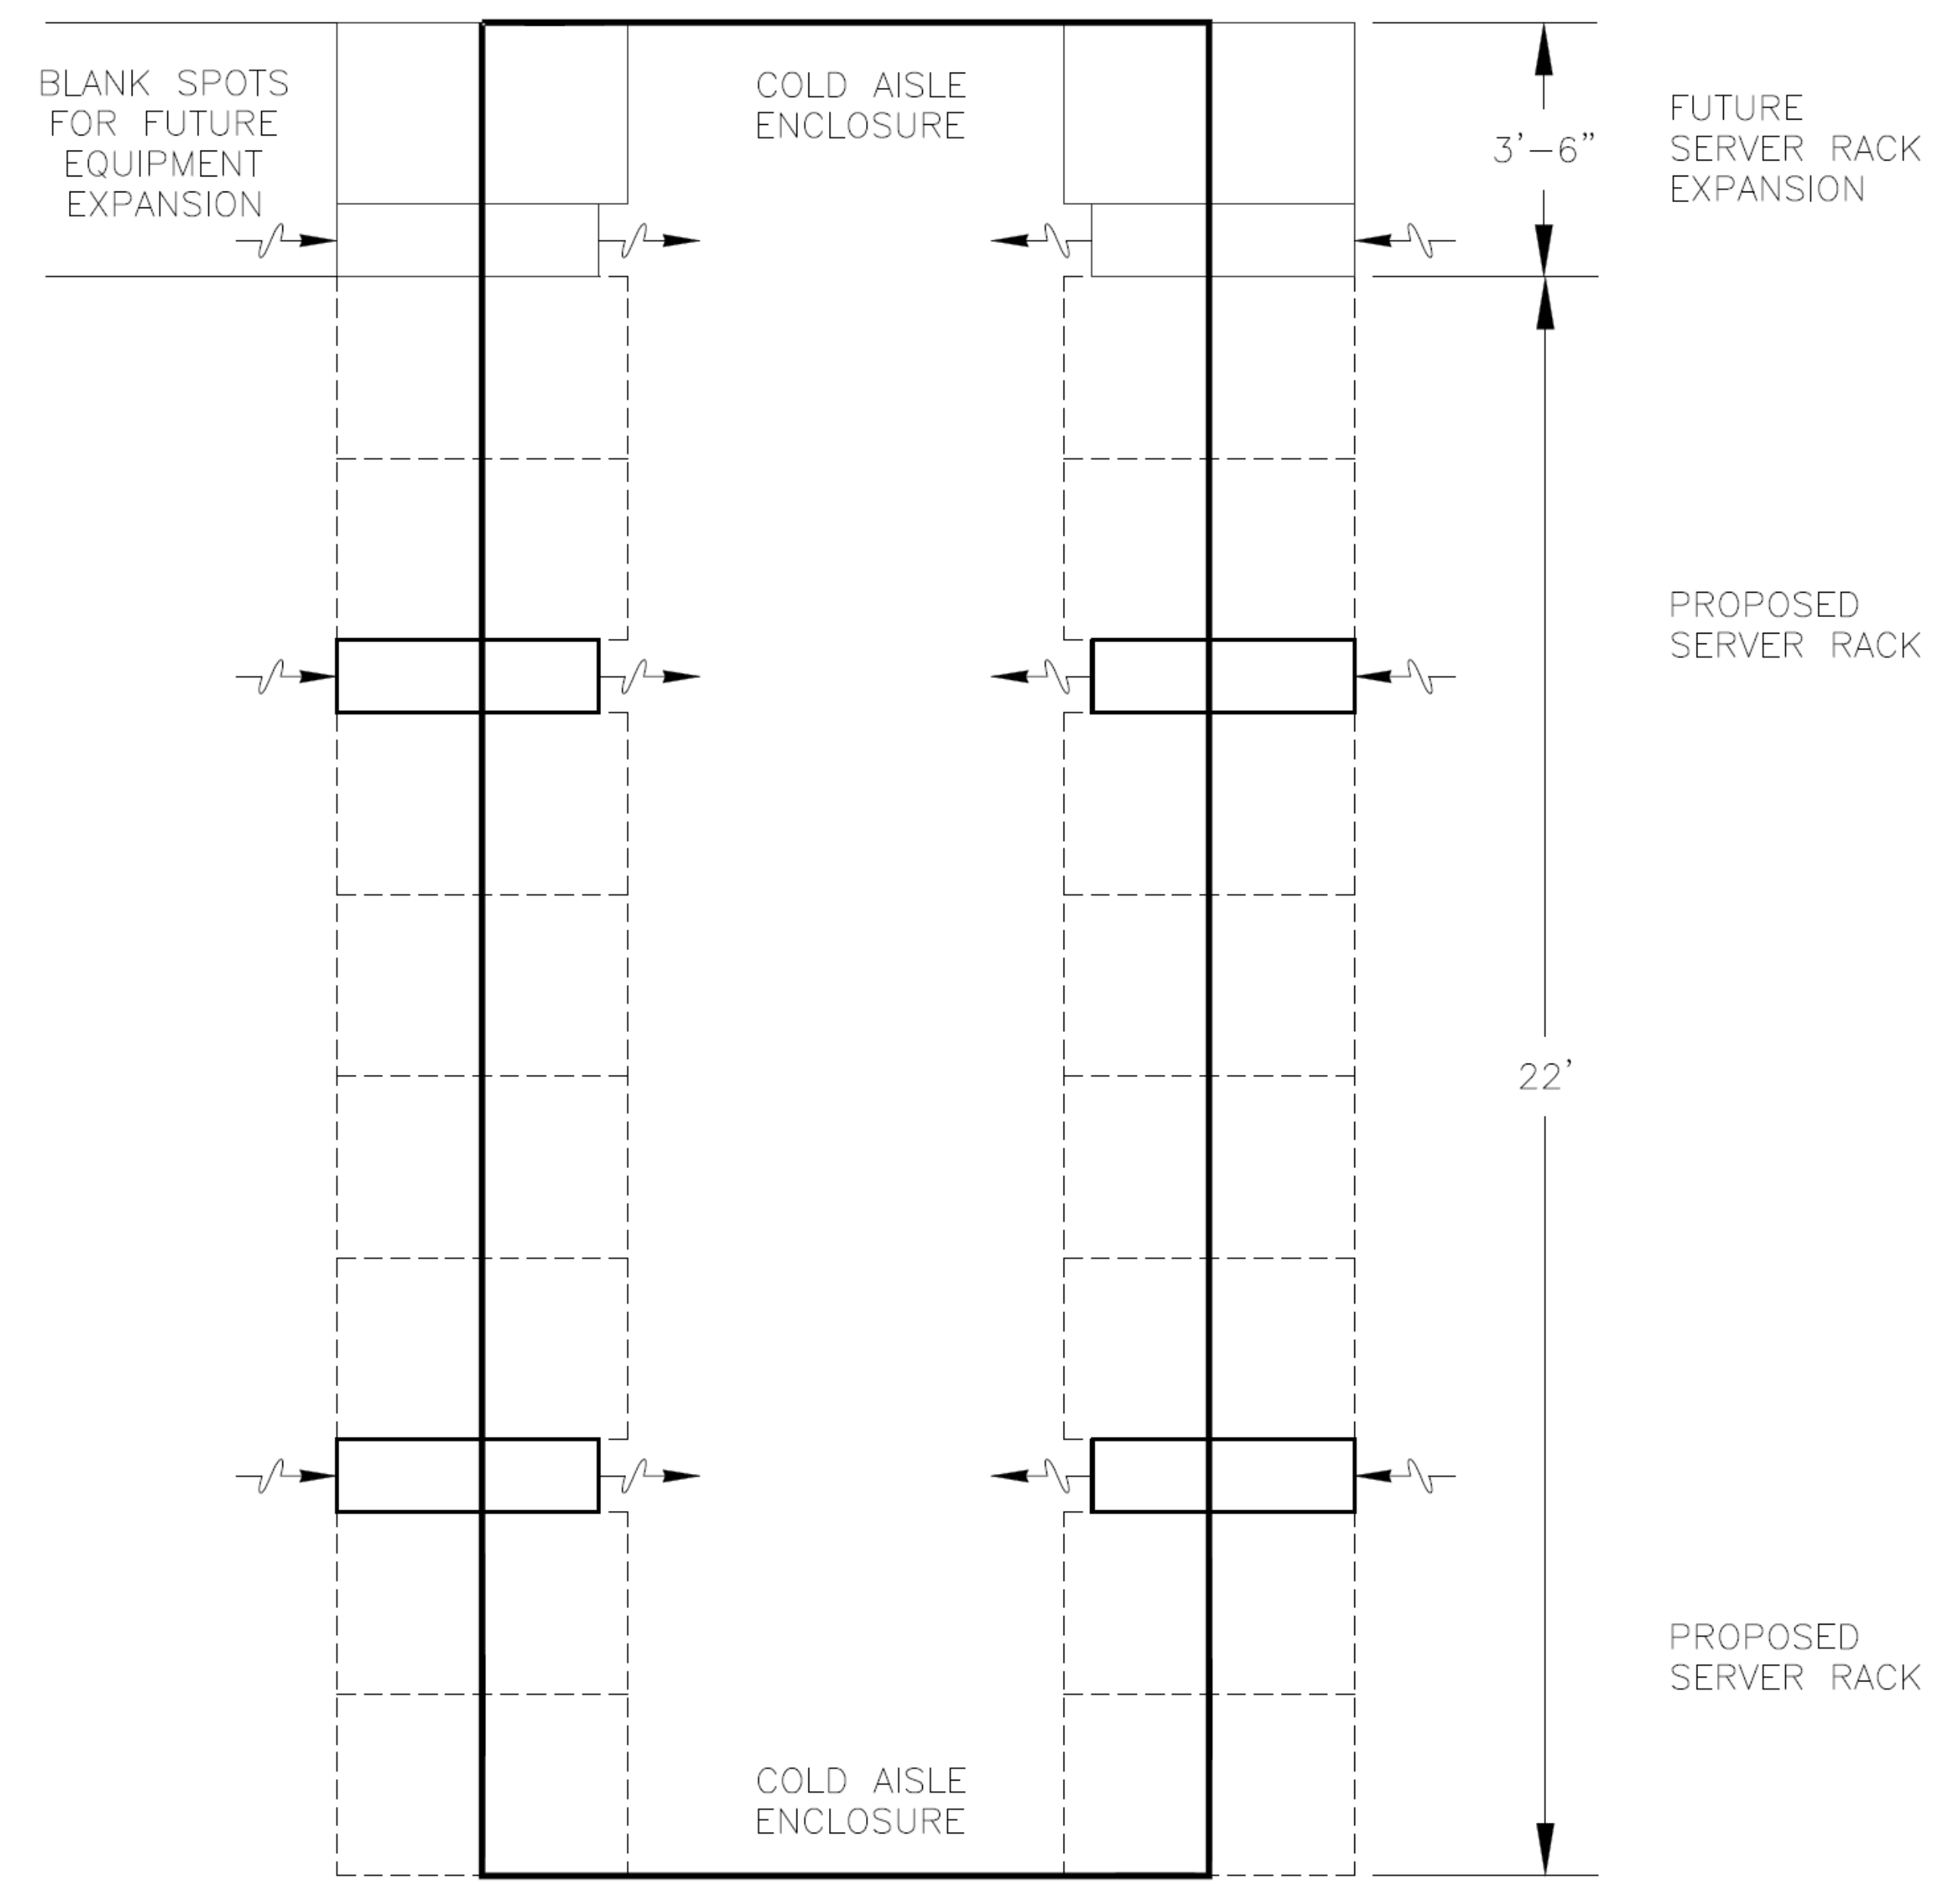

TOP

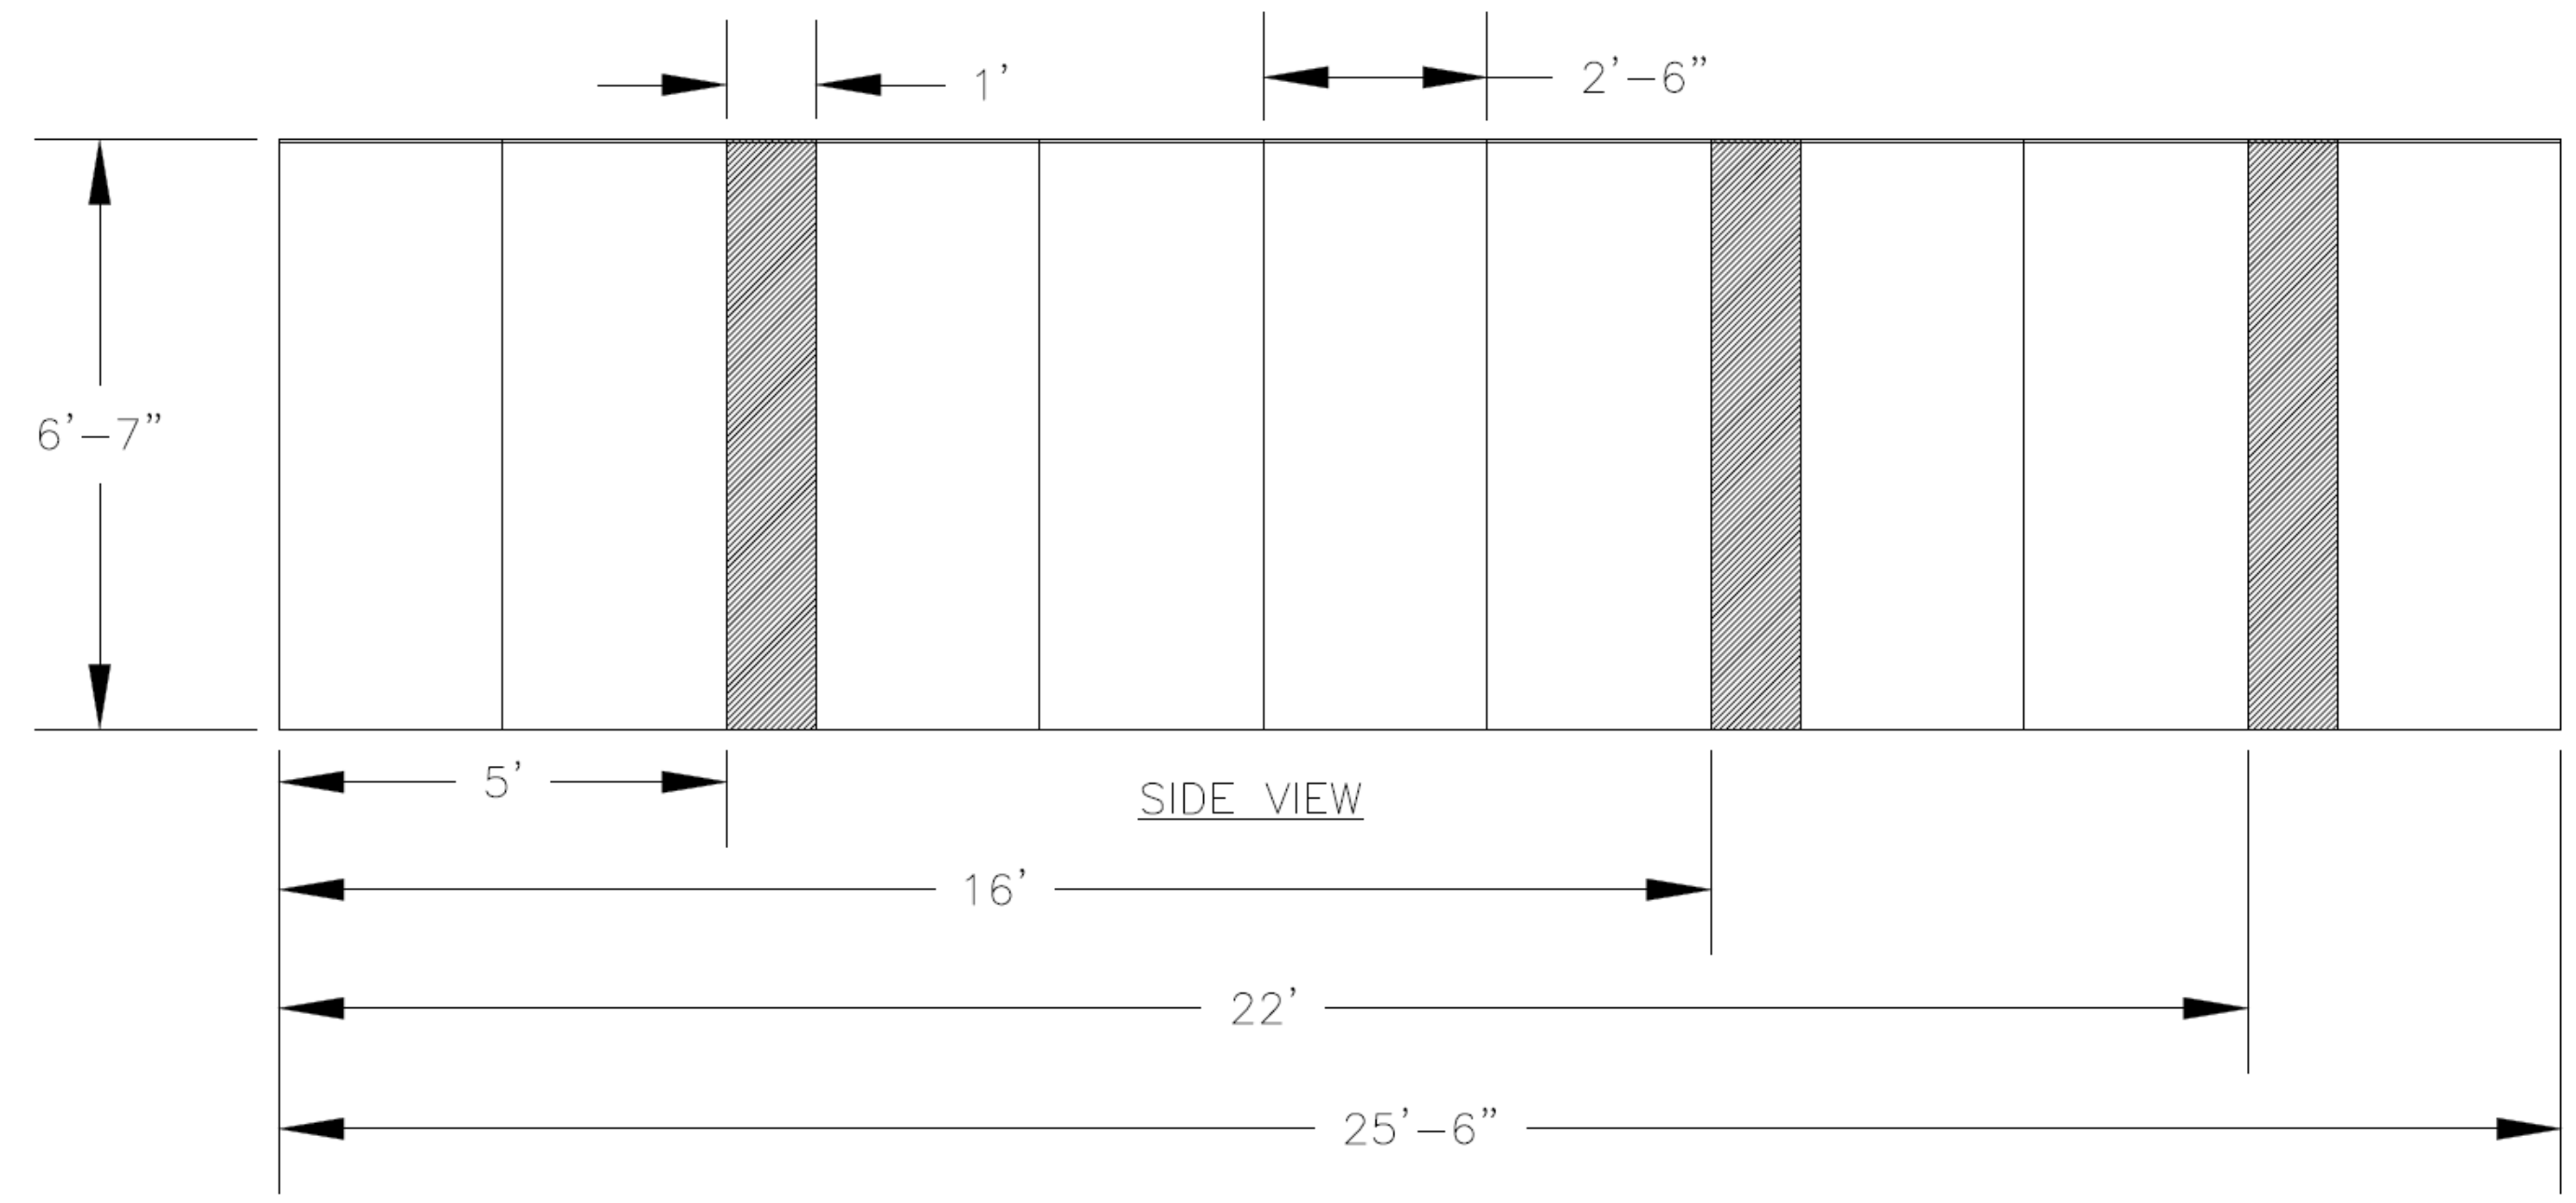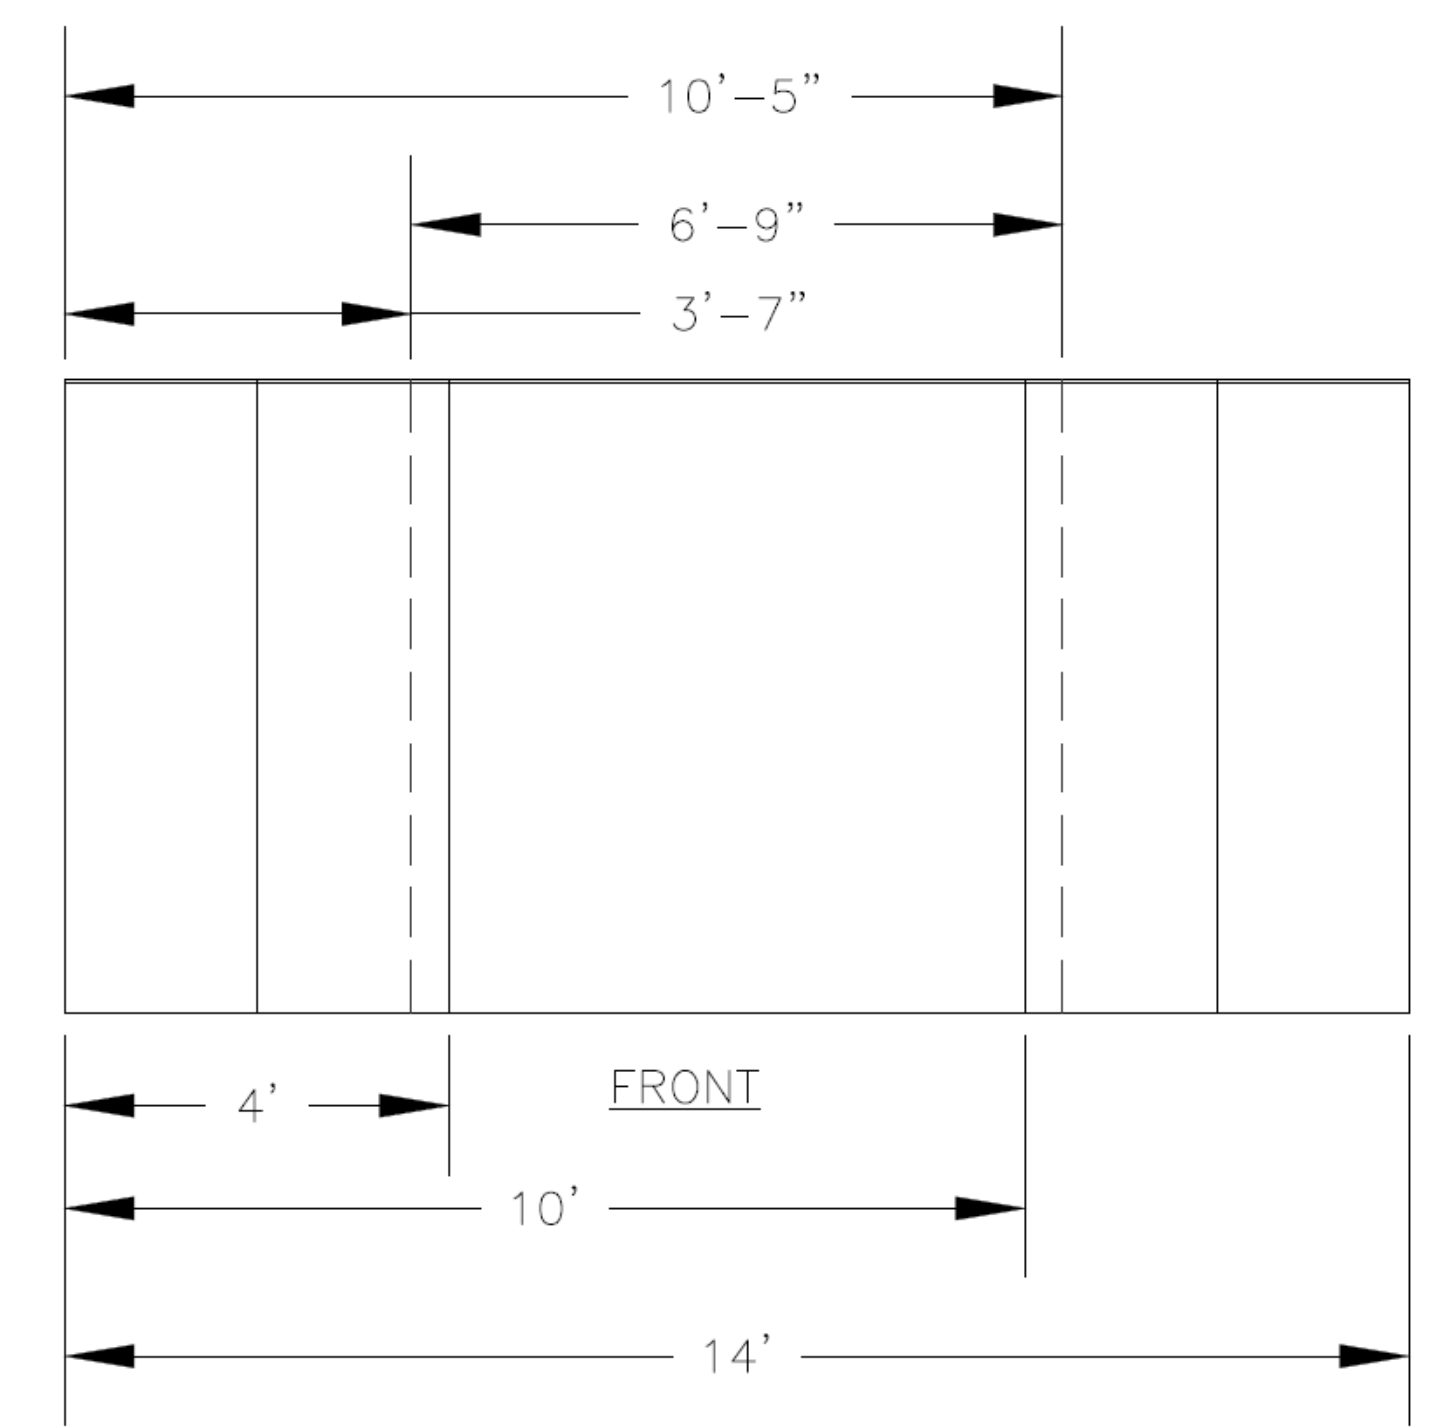

ORTHOGRAPHIC VIEWS OF SERVER RACK

SCALE: 1/2"=1'-0"