



## ADDENDUM NO. 1

**DATE:** July 7, 2016  
**FROM:** City of Grand Junction Purchasing Division  
**TO:** All Offerors  
**RE:** Justice Center Security Management System IFB-4253-16-NJ

Offerors responding to the above referenced solicitation are hereby instructed that the requirements have been clarified, modified, superseded and supplemented as to this date as hereinafter described.

Please make note of the following clarifications:

- 1. Site Visit Sign-In Sheet:** The Sign-In Sheet for the Mandatory Pre-Bid Meeting is attached to this Addendum 1.
- 2. Question 1:** "Whether companies from Outside USA can apply for this? (like, from India or Canada)"  
**Response:** There are no restrictions on whether companies outside the USA can provide a response or not. As long as they are able to meet the requirements of the solicitation, then there are no further restrictions.
- 3. Question 2:** "Whether we need to come over there for meetings?"  
**Response:** There is a mandatory site-visit prior to responses being due. Also the awarded contractor will be required to perform installation and maintenance services on-site. Please see the solicitation document for further details.
- 4. Question 3:** "Can we perform the tasks (related to RFP) outside USA?"  
**Response:** Please refer to Question and Response 2 of this Addendum 1, and refer to the solicitation for further details.
- 5. Question 4:** "Can we submit the proposals via email?????"  
**Response:** Responses cannot be submitted via email. Responses must be submitted electronically via the Rocky Mountain E-Purchasing website <https://www.rockymountainbidsystem.com/City-of-Grand-Junction.asp?AgencyID=1123&PageType=open#openSolicitations>. Documents can also be accessed via our website below. You must be registered with the RMEPS website to submit a response to the solicitation. The site offers free and paying registration for vendors. A Vendor Registration Guide for the free registration option can be found on our website at: <http://www.gjcity.org/bids/>. You may run into issues with registration from outside the USA, and in that case, please contact the 800 vendor help line and they will assist you through the registration process.

6. **Question 5:** “Quick question will you accept substitutions to the RS2 Technologies, like Lennel?”

**Response:** The Owner will not accept substitutions to the RS2 Technologies and are doing so to retain consistency of the infrastructure throughout the Owners facilities.

7. **Question 6:** “What is the plan for management of the Infographics Security Management System software during the transition to the new system (during cutover). Meaning disabling, silencing, removal of devices and systems as they are moved over to the new system. It is our assumption that will be managed by others.”

**Response:** This is the responsibility of the awarded contractor.

8. **Question 7:** “Do we have drawings and other technical documents on the existing system? Looking for I/O point assignments, device counts per floor, where they are terminated, etc.”

**Response:** The available drawings have been attached to this Addendum 1.

9. **Question 8:** “Need a list of devices for which new wire will be required versus using the existing wiring.”

**Response:** If existing wire is long enough to reach new RS2 cabinet, without splicing the wires. Then new wire doesn't need to be pulled.

The original solicitation for the project noted above is amended as noted.

All other conditions of subject remain the same.

Respectfully,



Nicholas C Jones, Buyer  
City of Grand Junction, Colorado



### SITE/VISIT SIGN-IN SHEET

SOLICITATION TITLE: Justice Center Security Management System

SOLICITATION NUMBER: IFB-4253-16-NJ

SITE VISIT DATE: Wednesday, June 29, 2016

SITE VISIT TIME: 9:00 AM MDT

Company Name

Representative Name

Phone Number

Email

1 *Sierra Detection Systems* *Jamie Whisner* *720-881-6802* *Jwhisner@sierradetection.com*

2 *REDI AUTOMATION* *RANDY KIRKENDOLL* *303-809-9019* *RKIRKENDOLL@REDI-AUTOMATION.COM*

3 *Current Solutions* *Troy Polson* *970-256-1175* *troy@currentsolutionsgj.com*

4 *FIRE TEAM SECURITY, INC* *MERRILL KIDDLE* *970-260-0959* *merrill@fireteamsecurity.com*

5

6

7

8

9

10

11

12

13

14

15










16

17







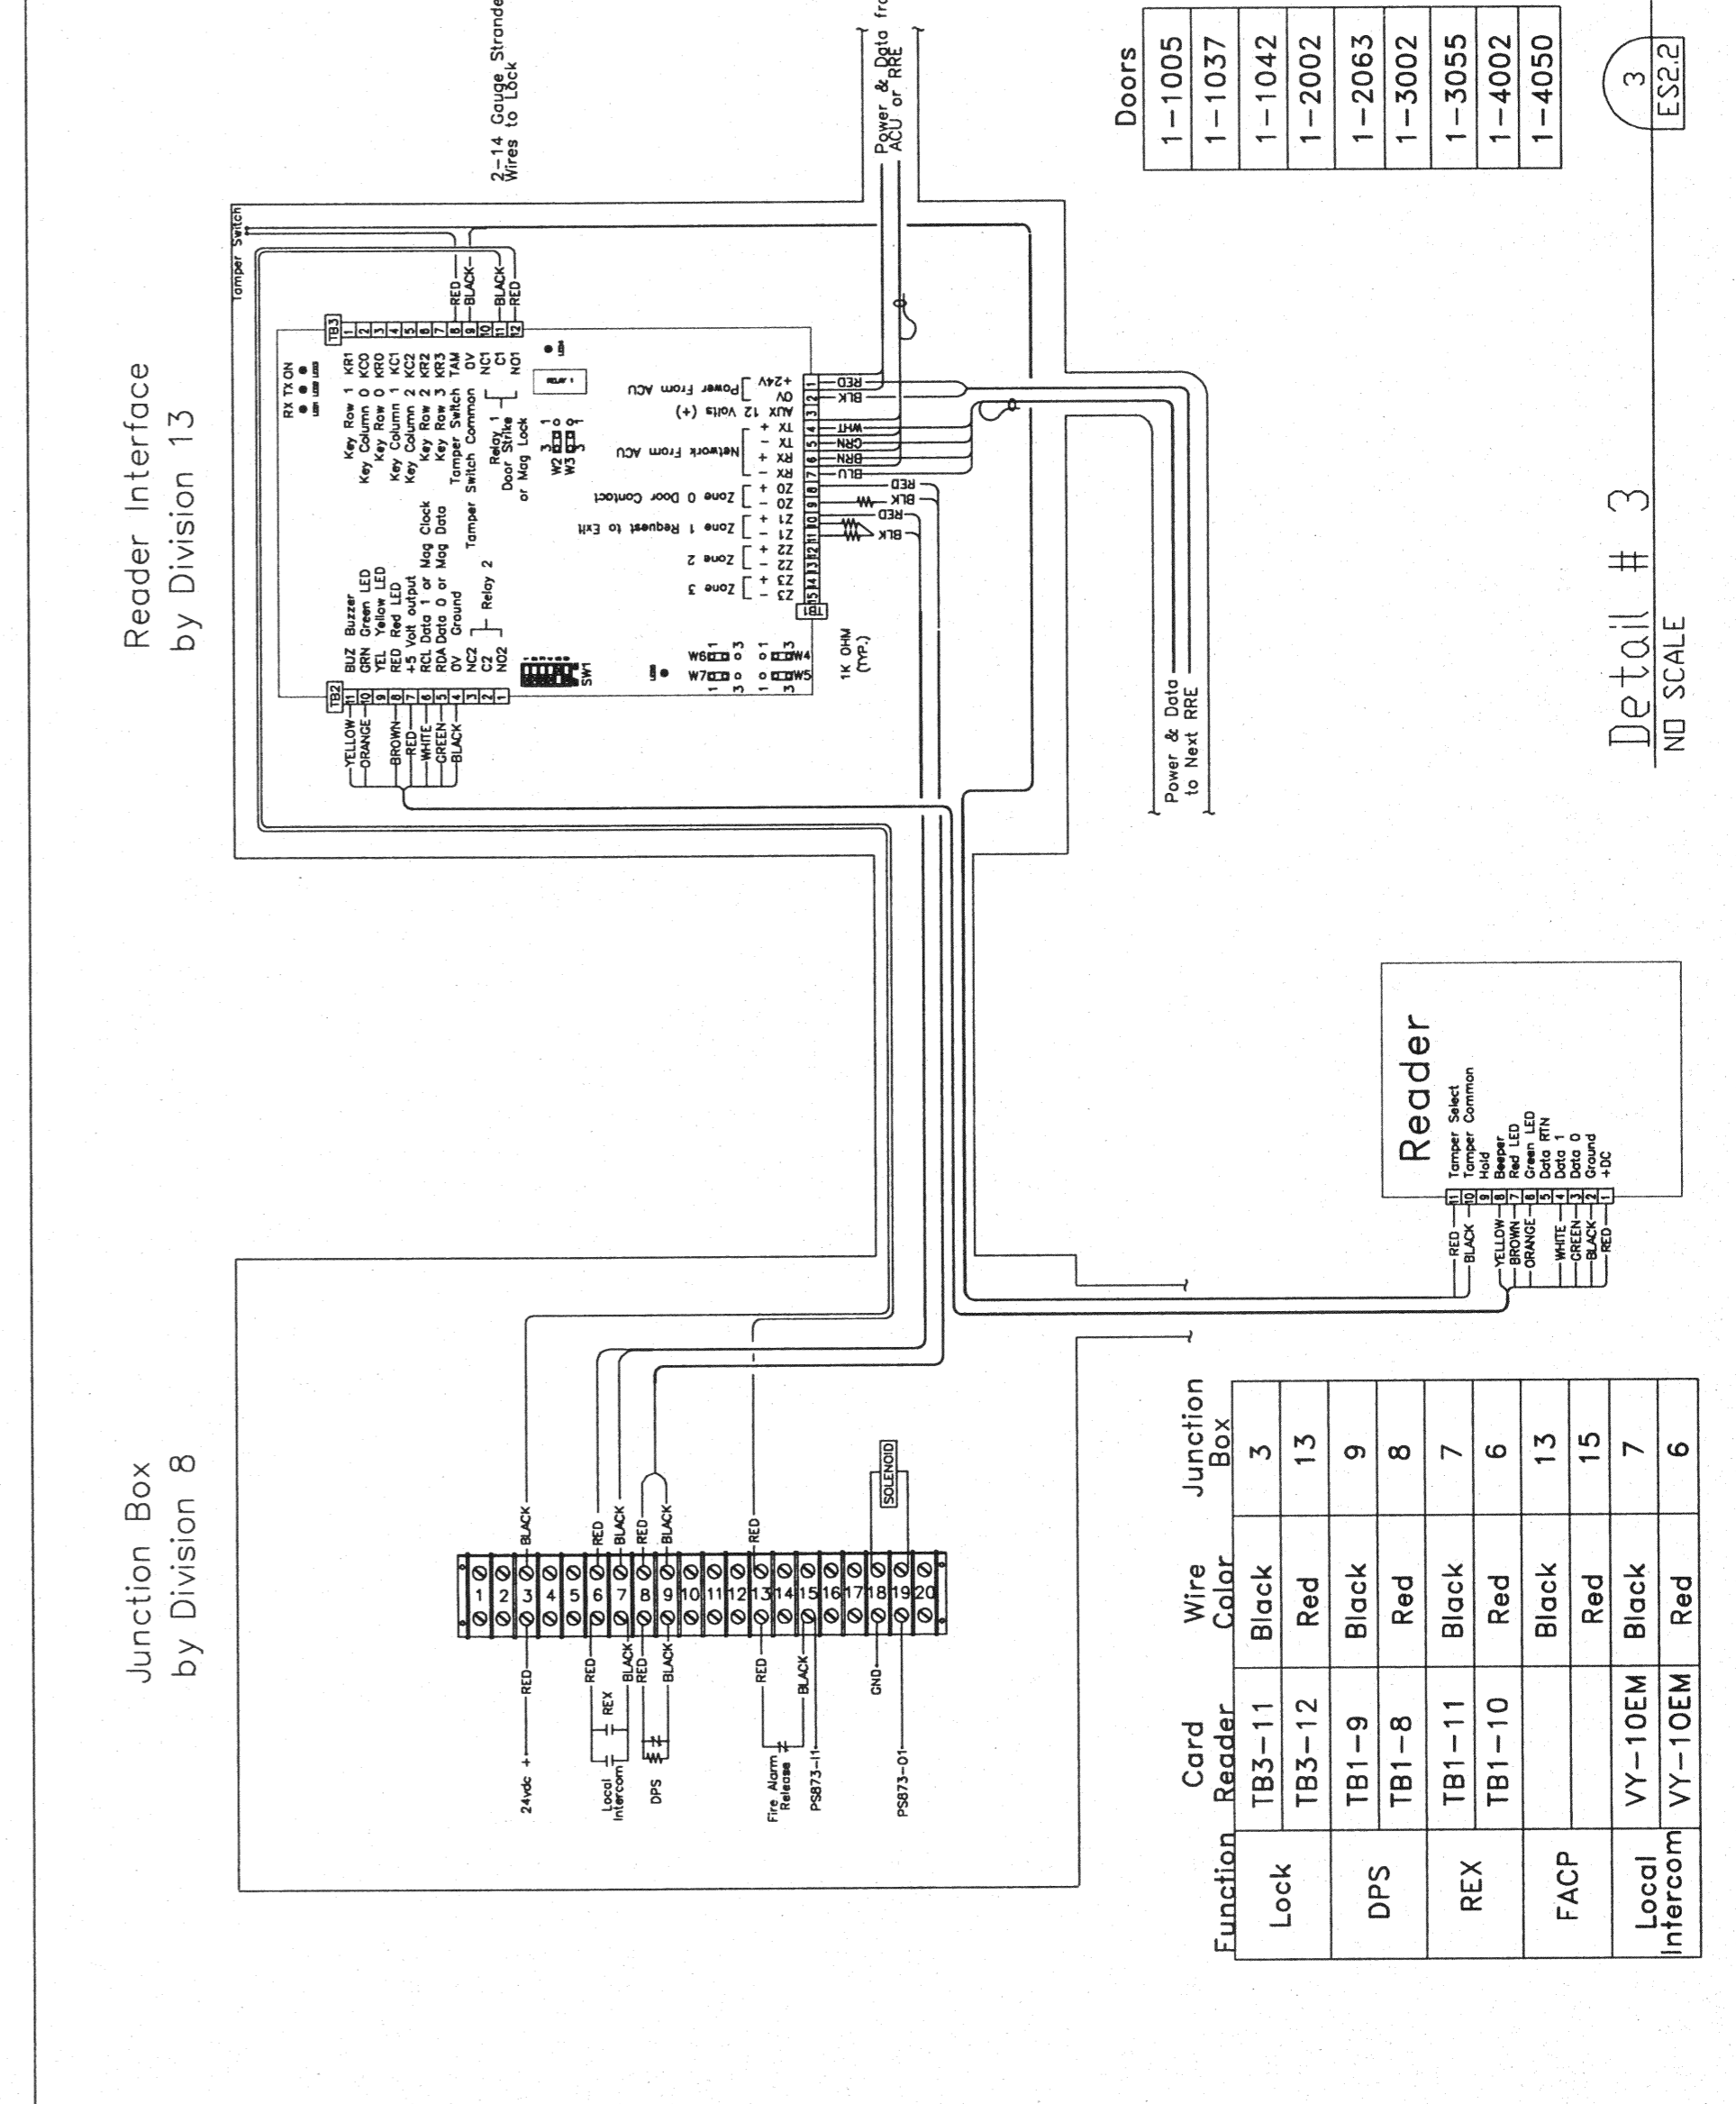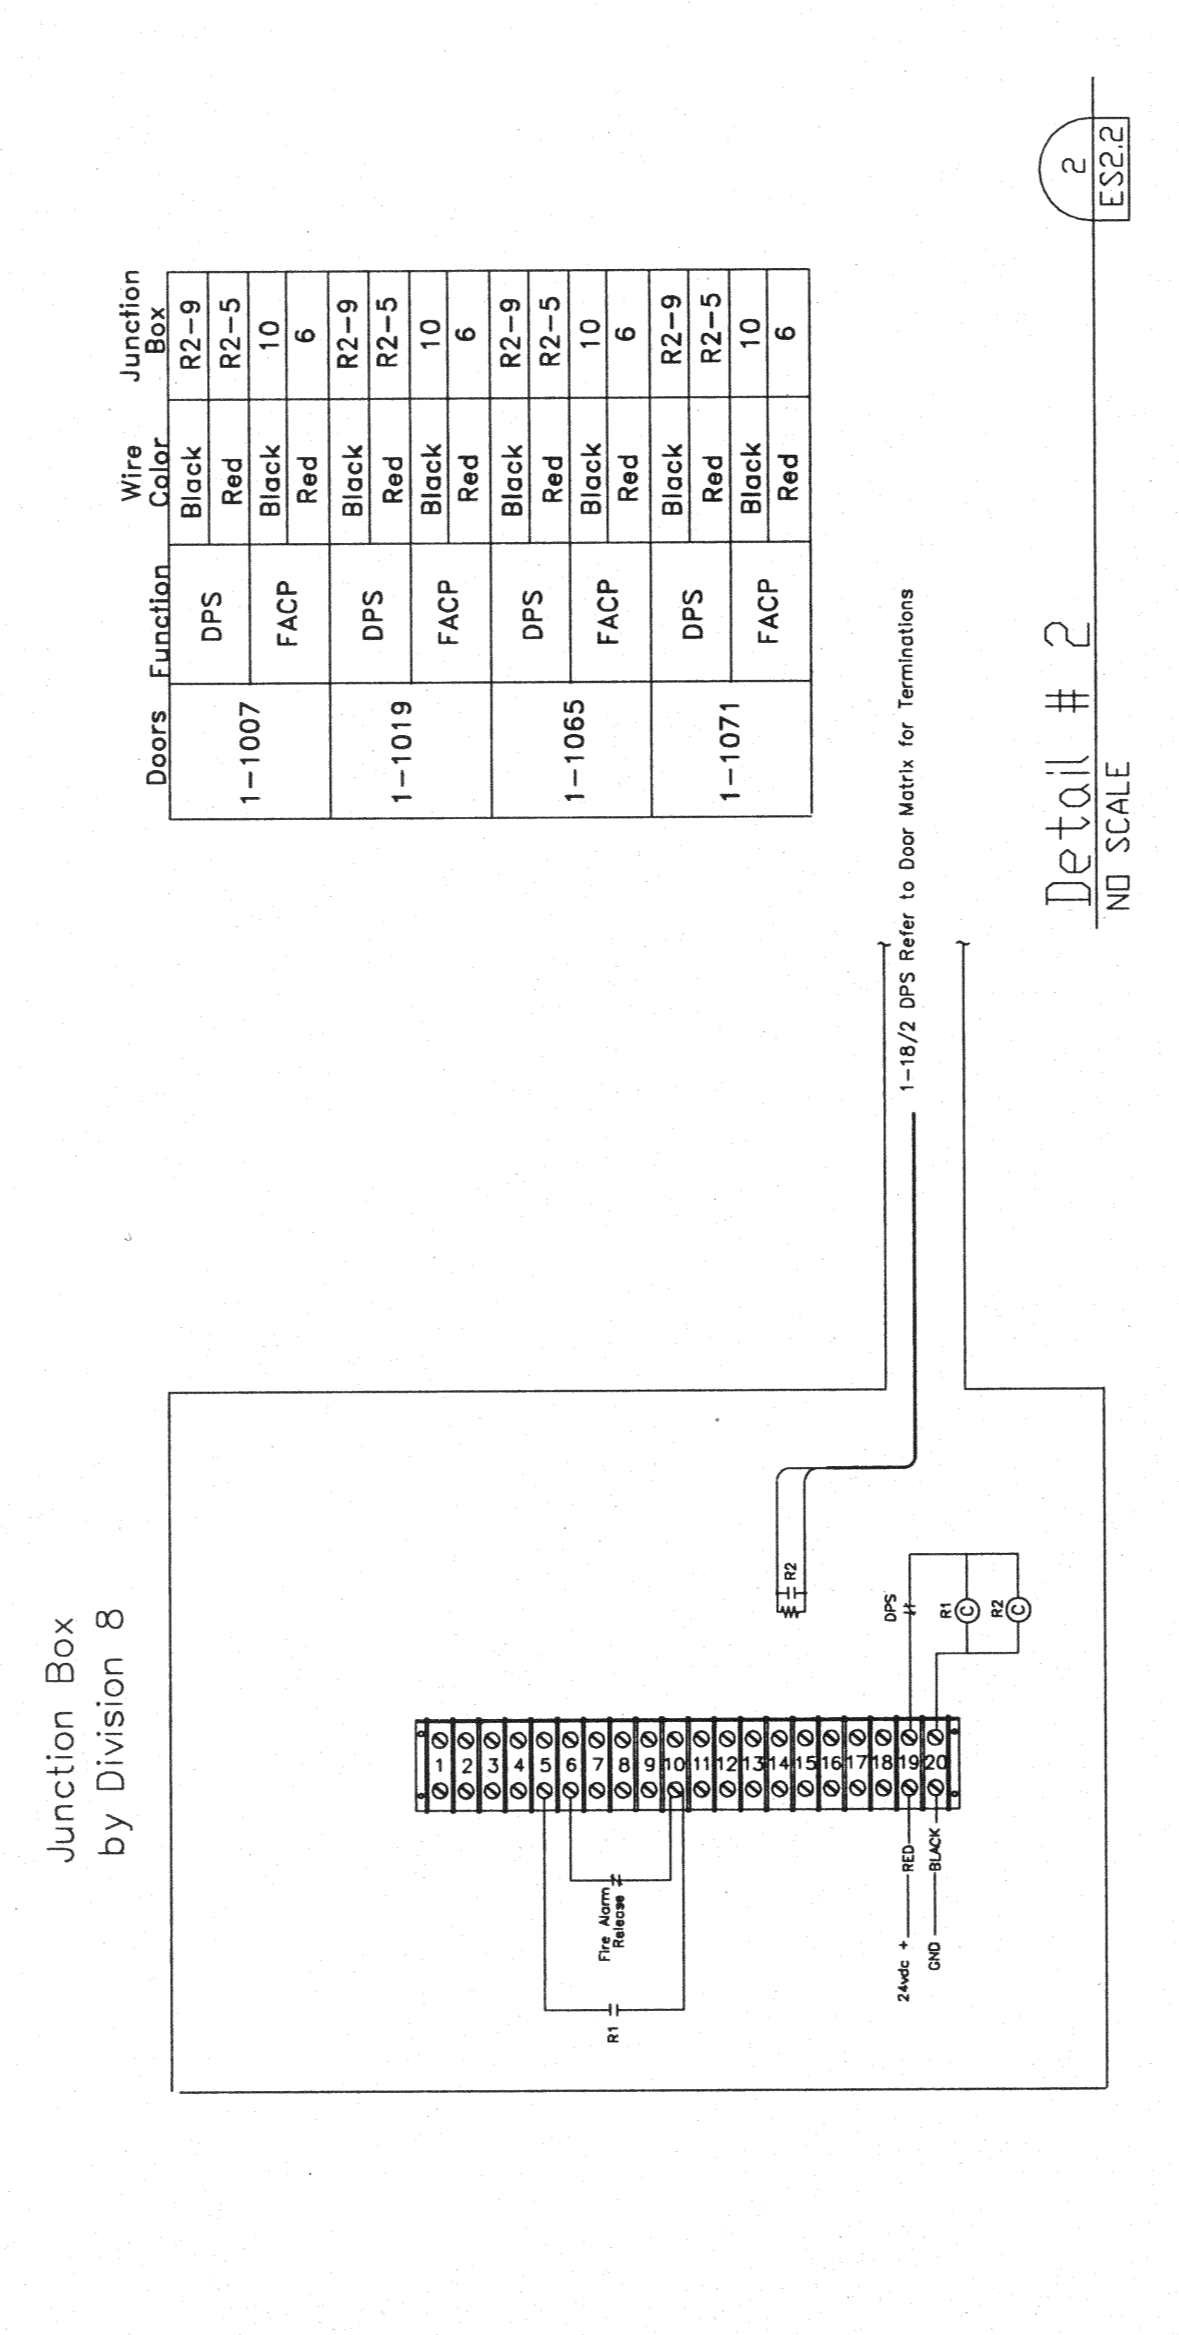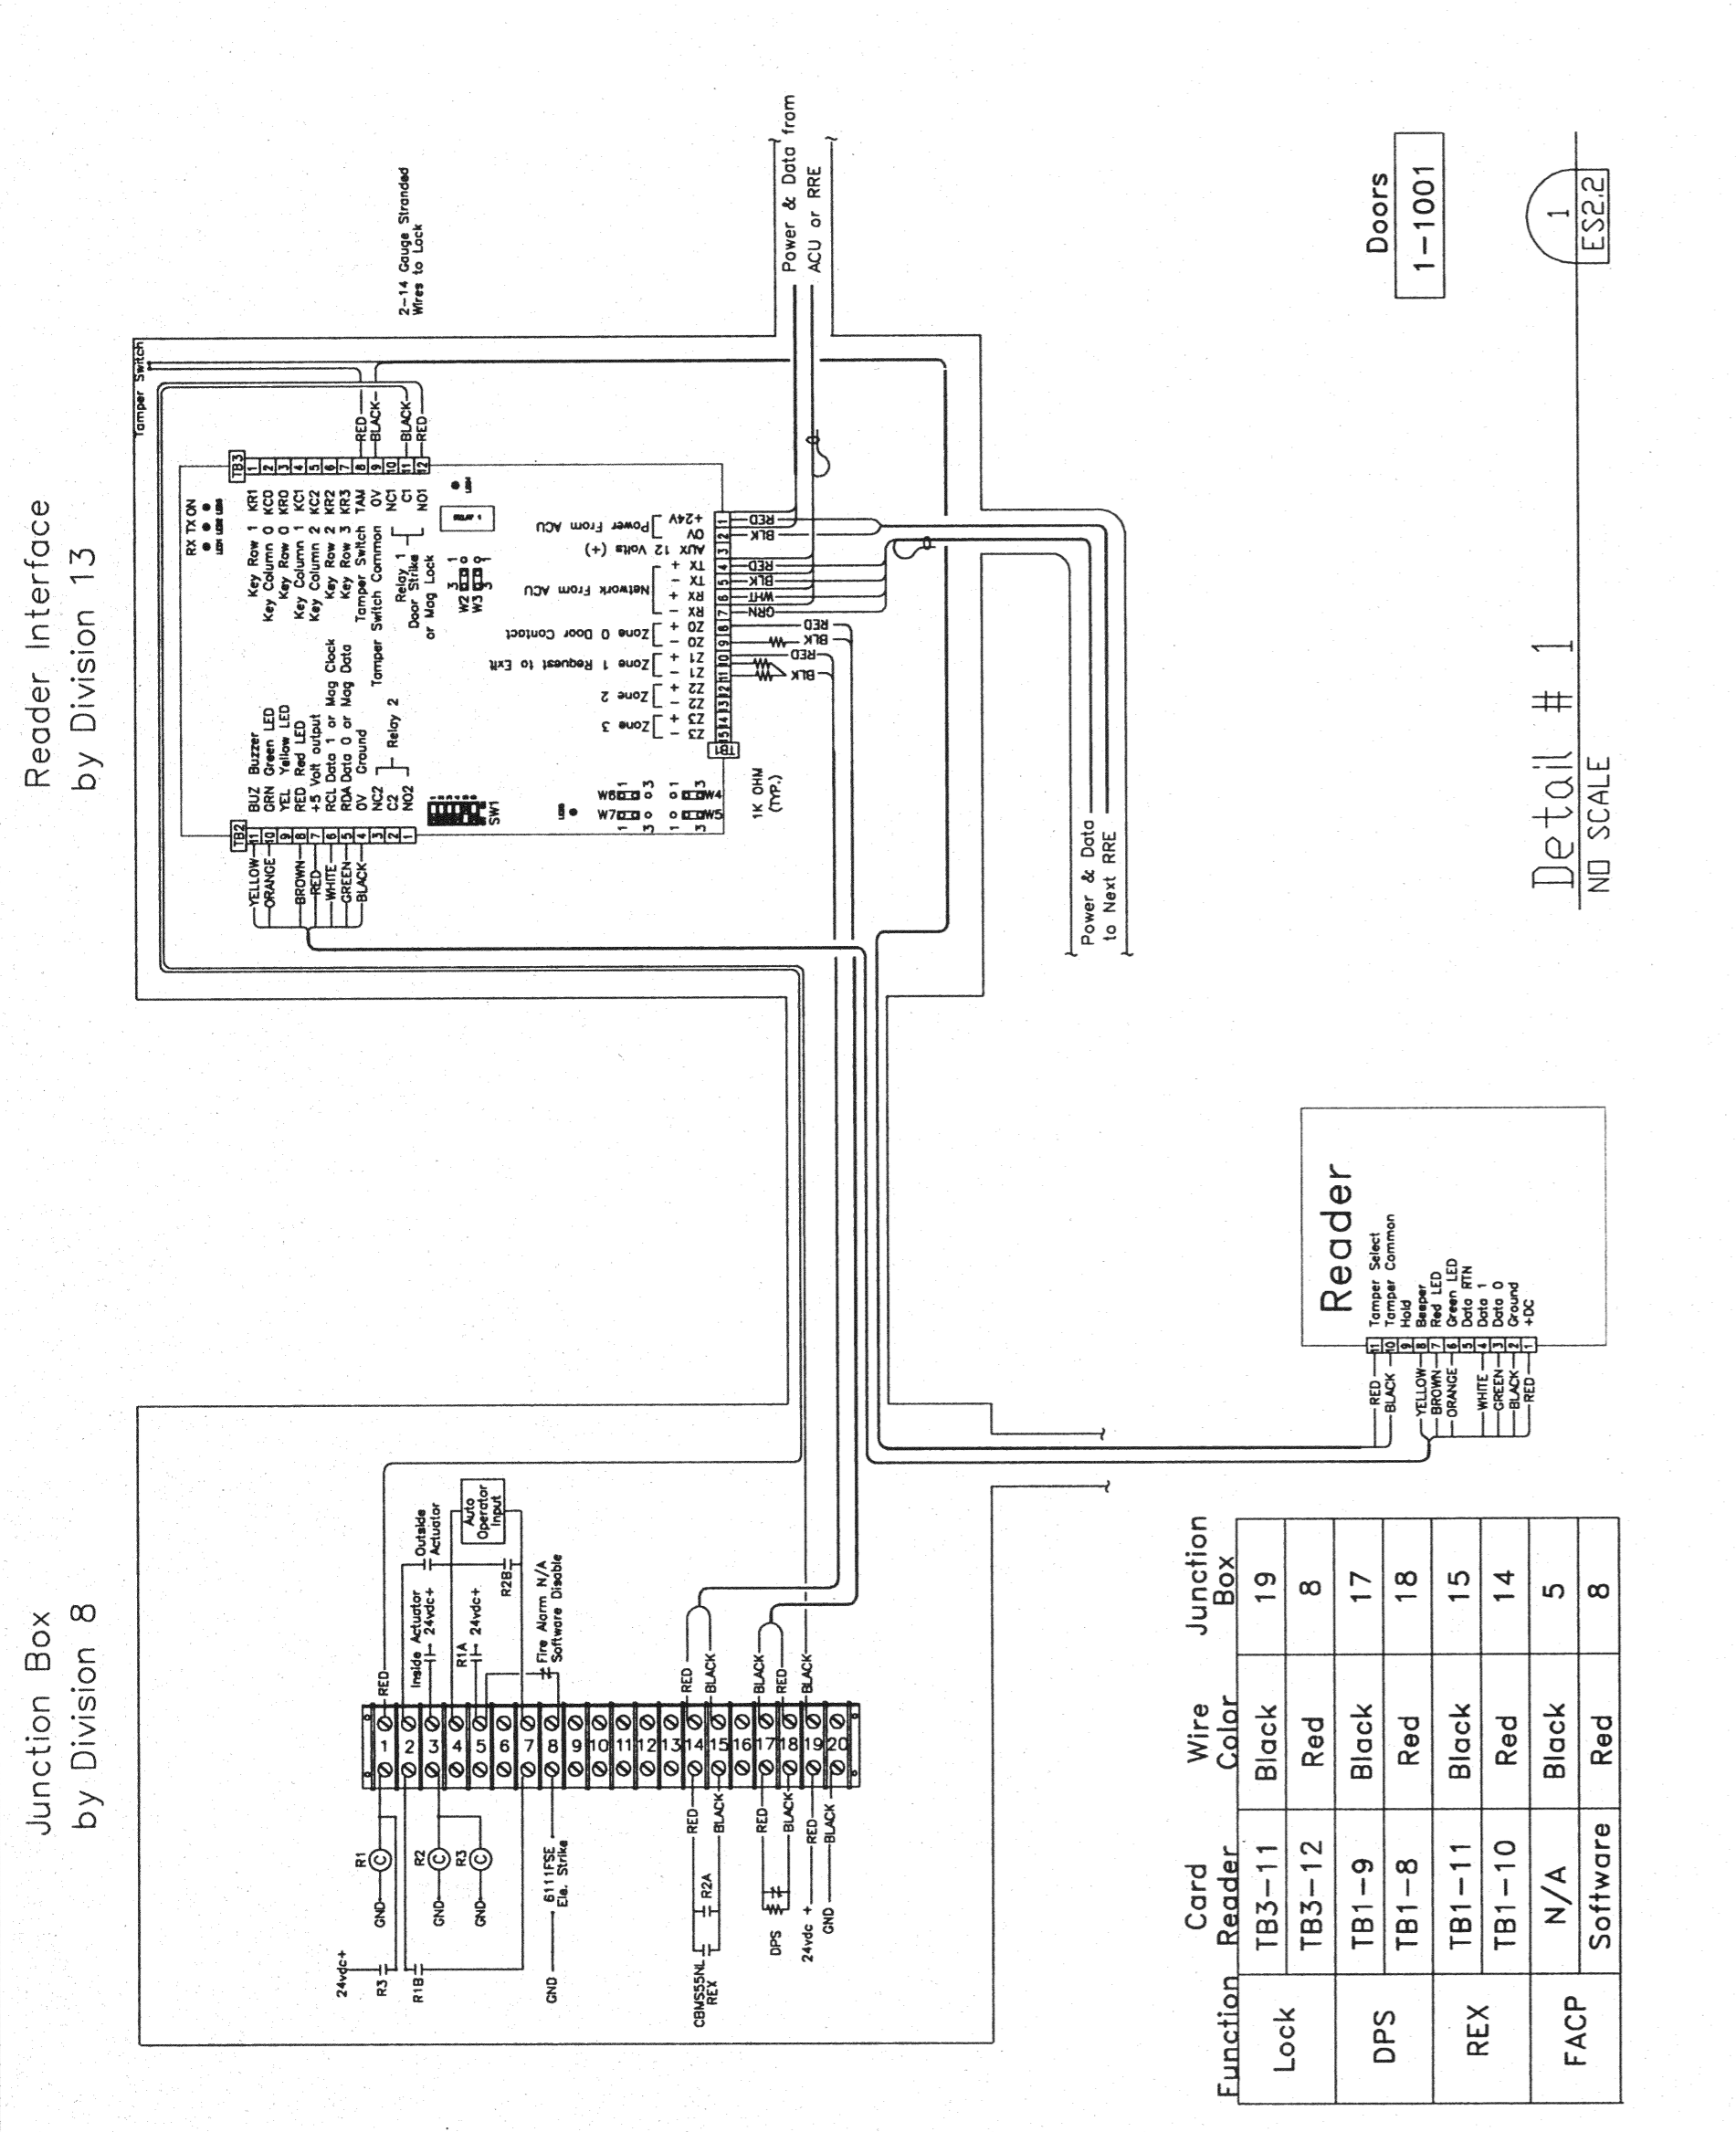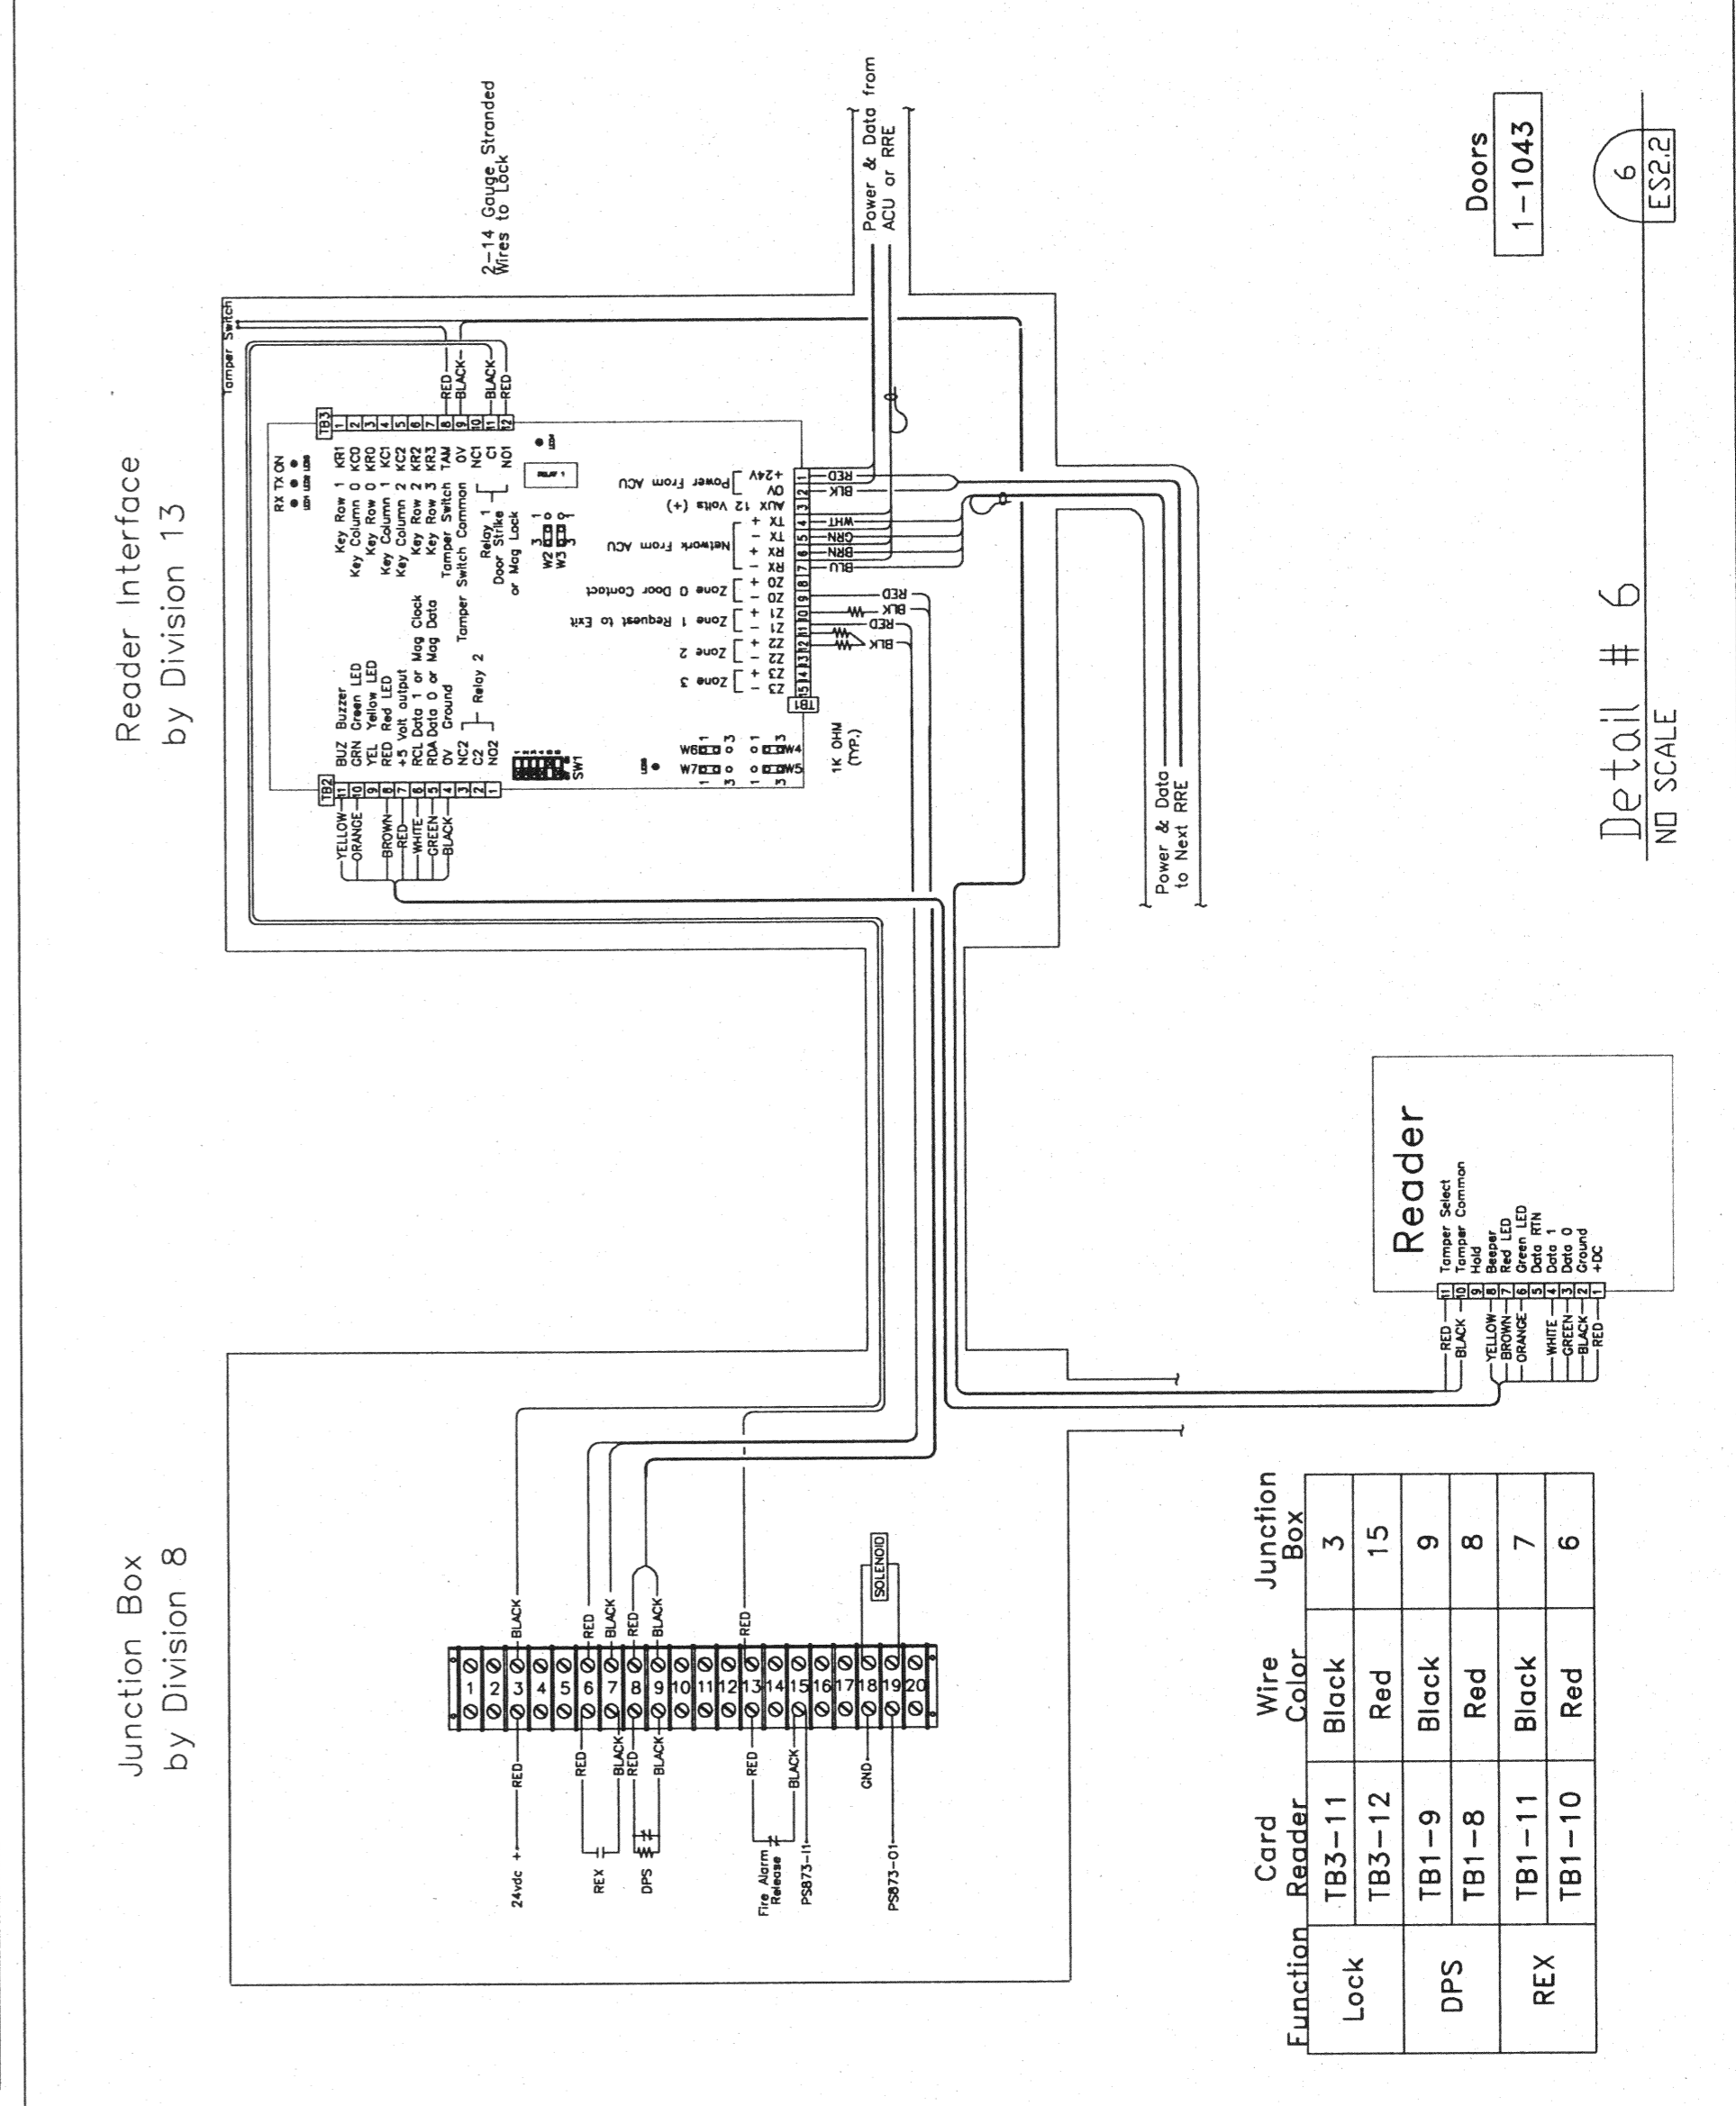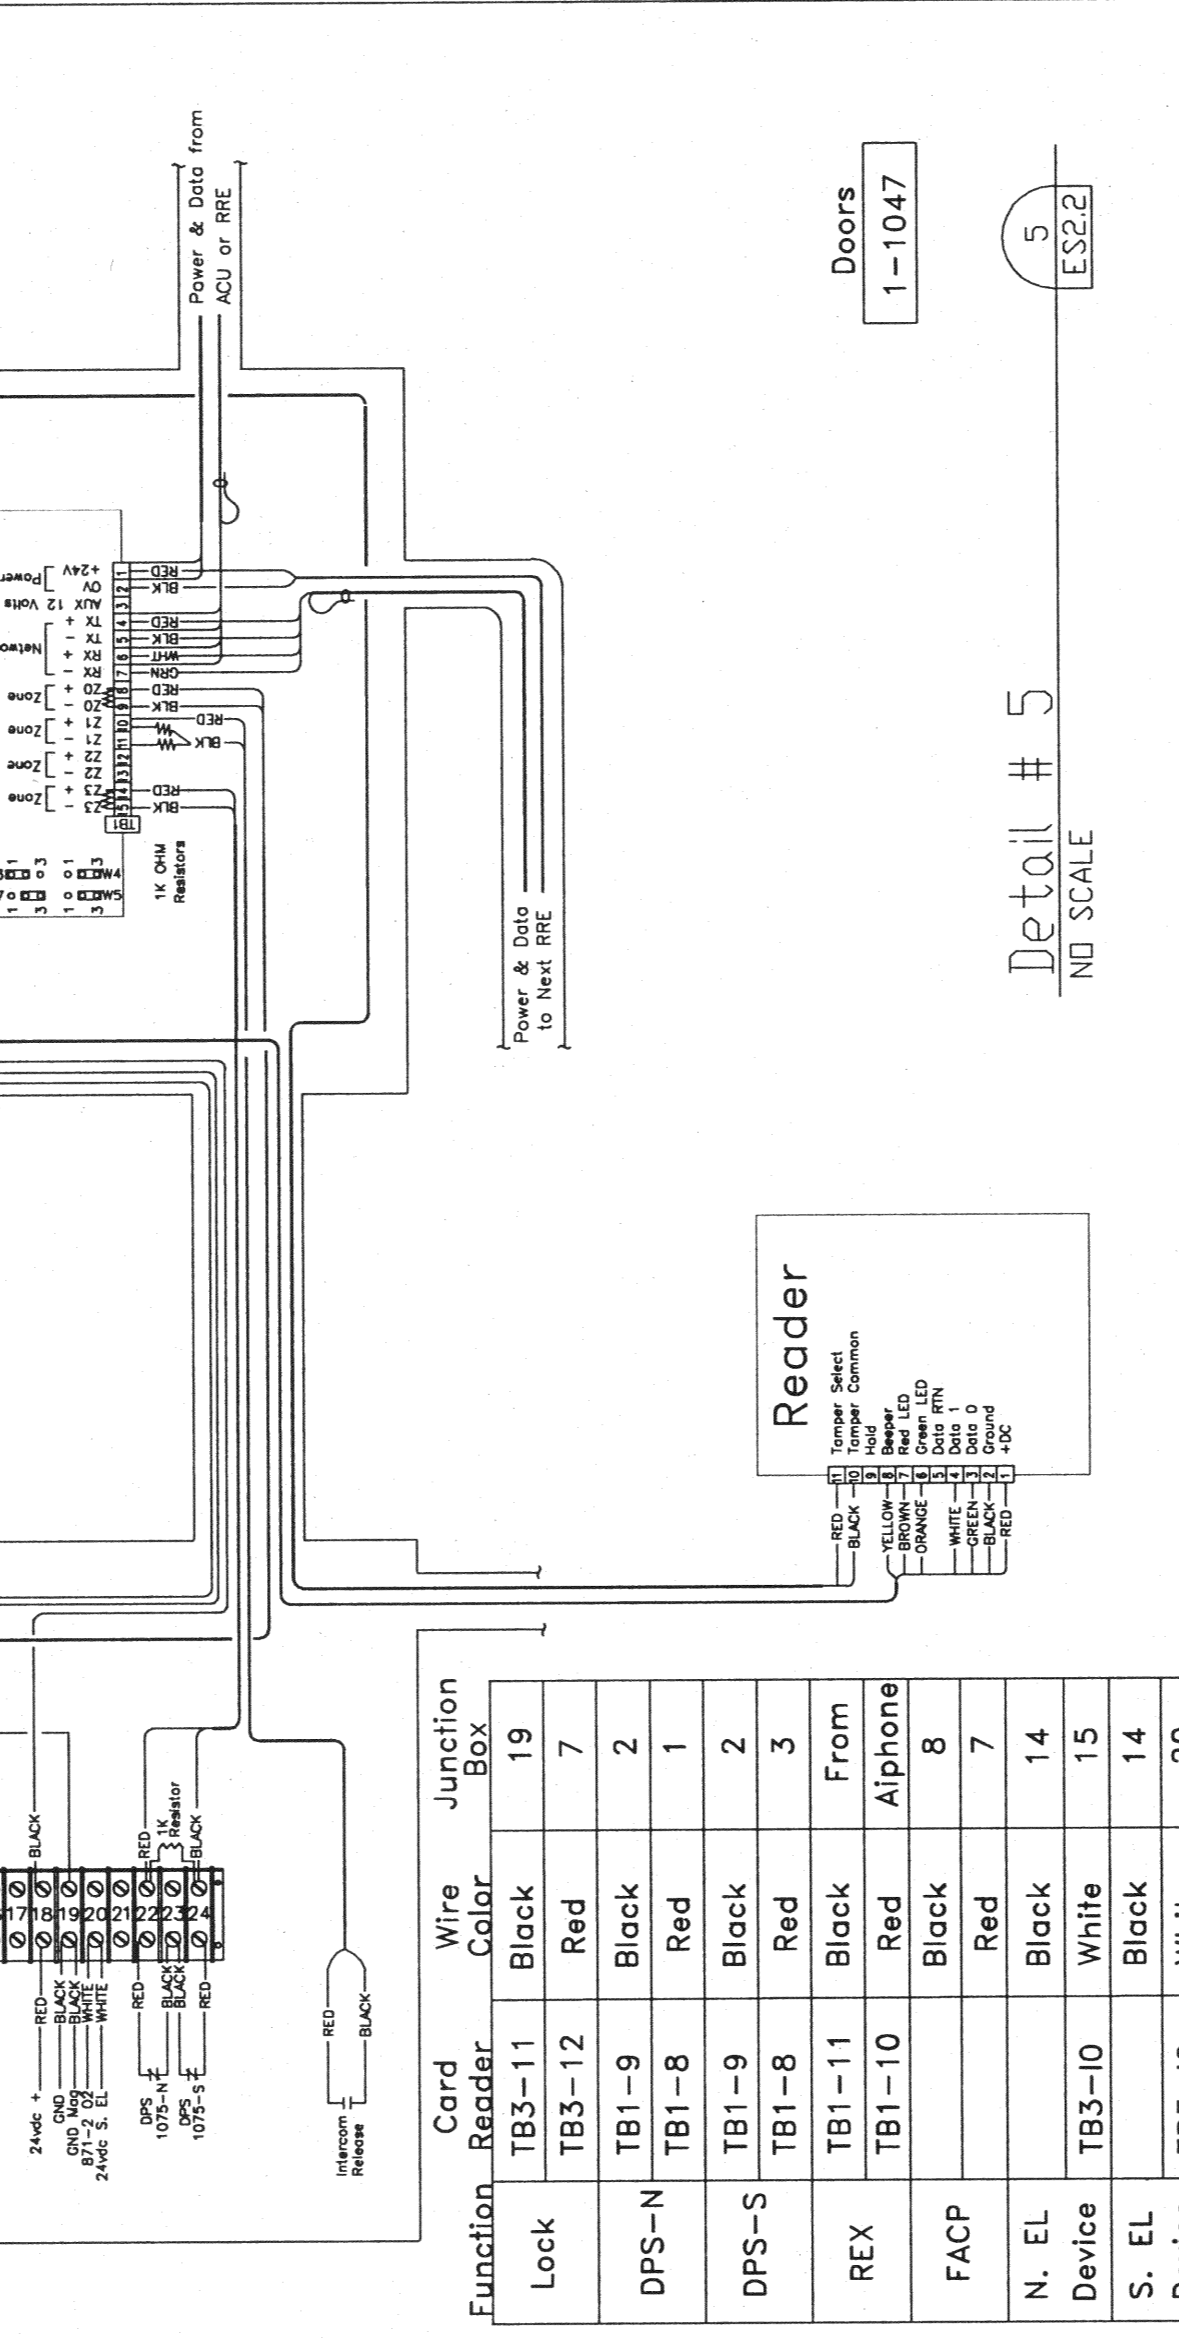
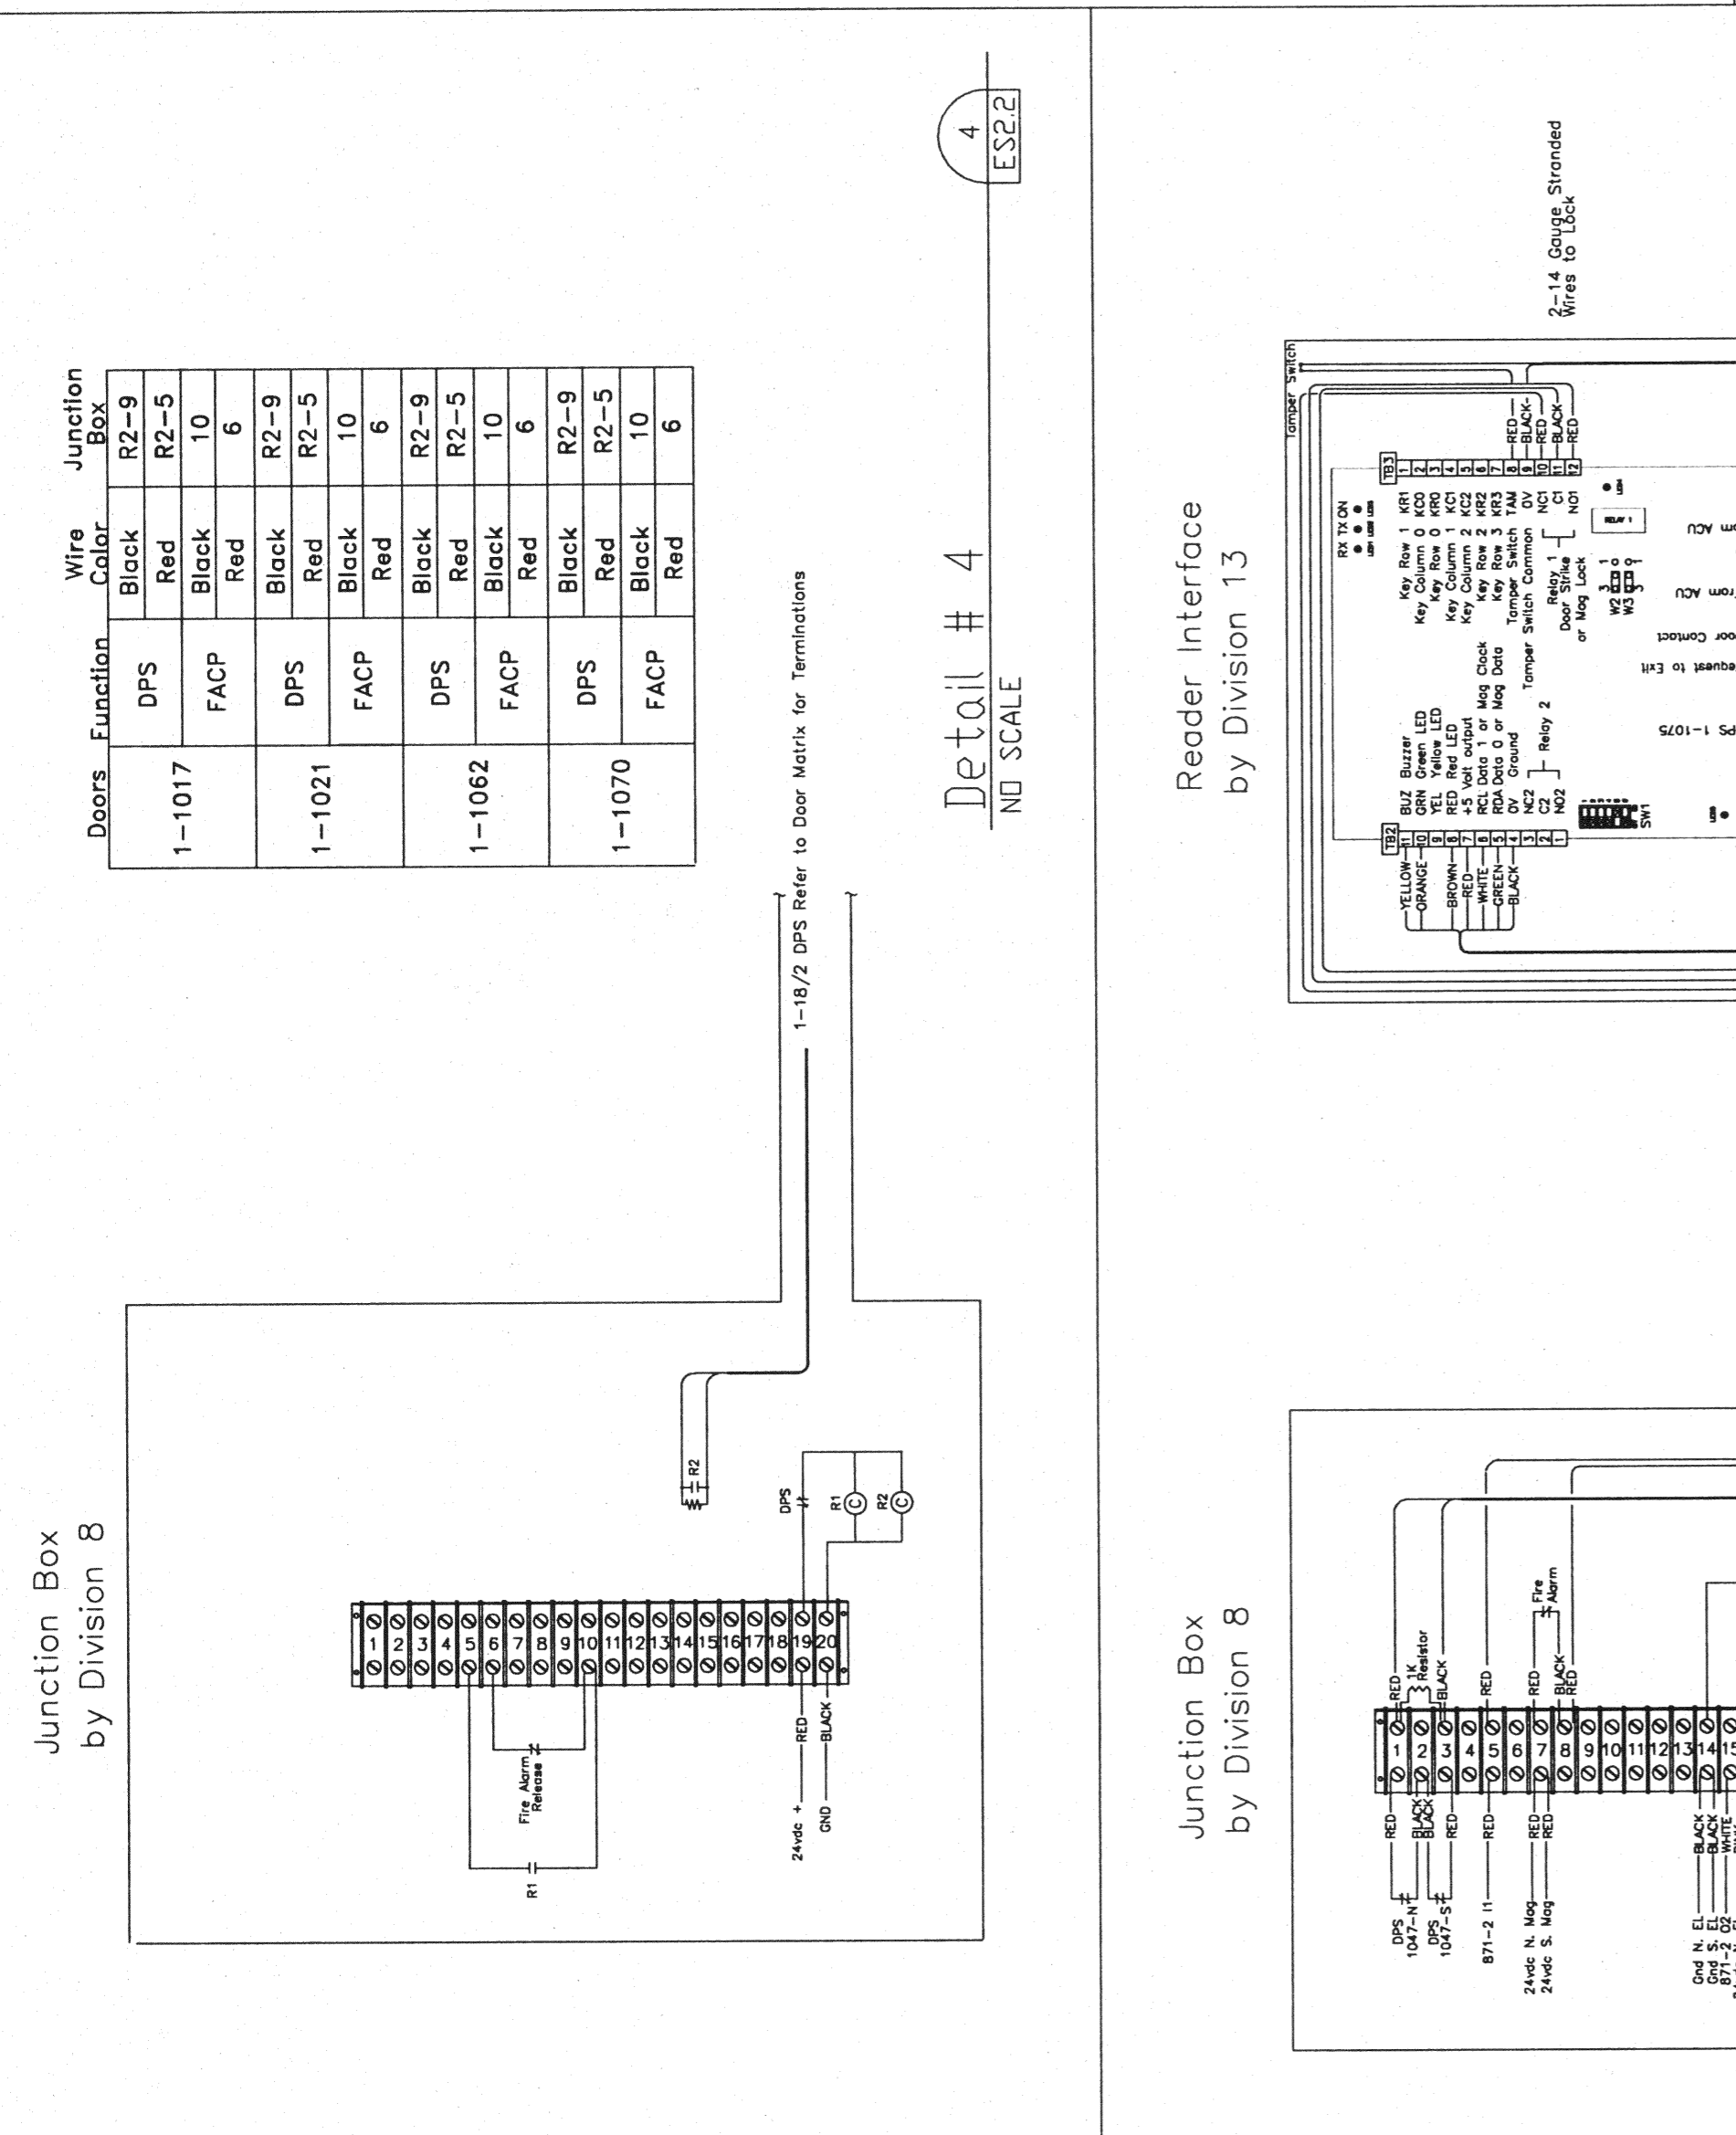
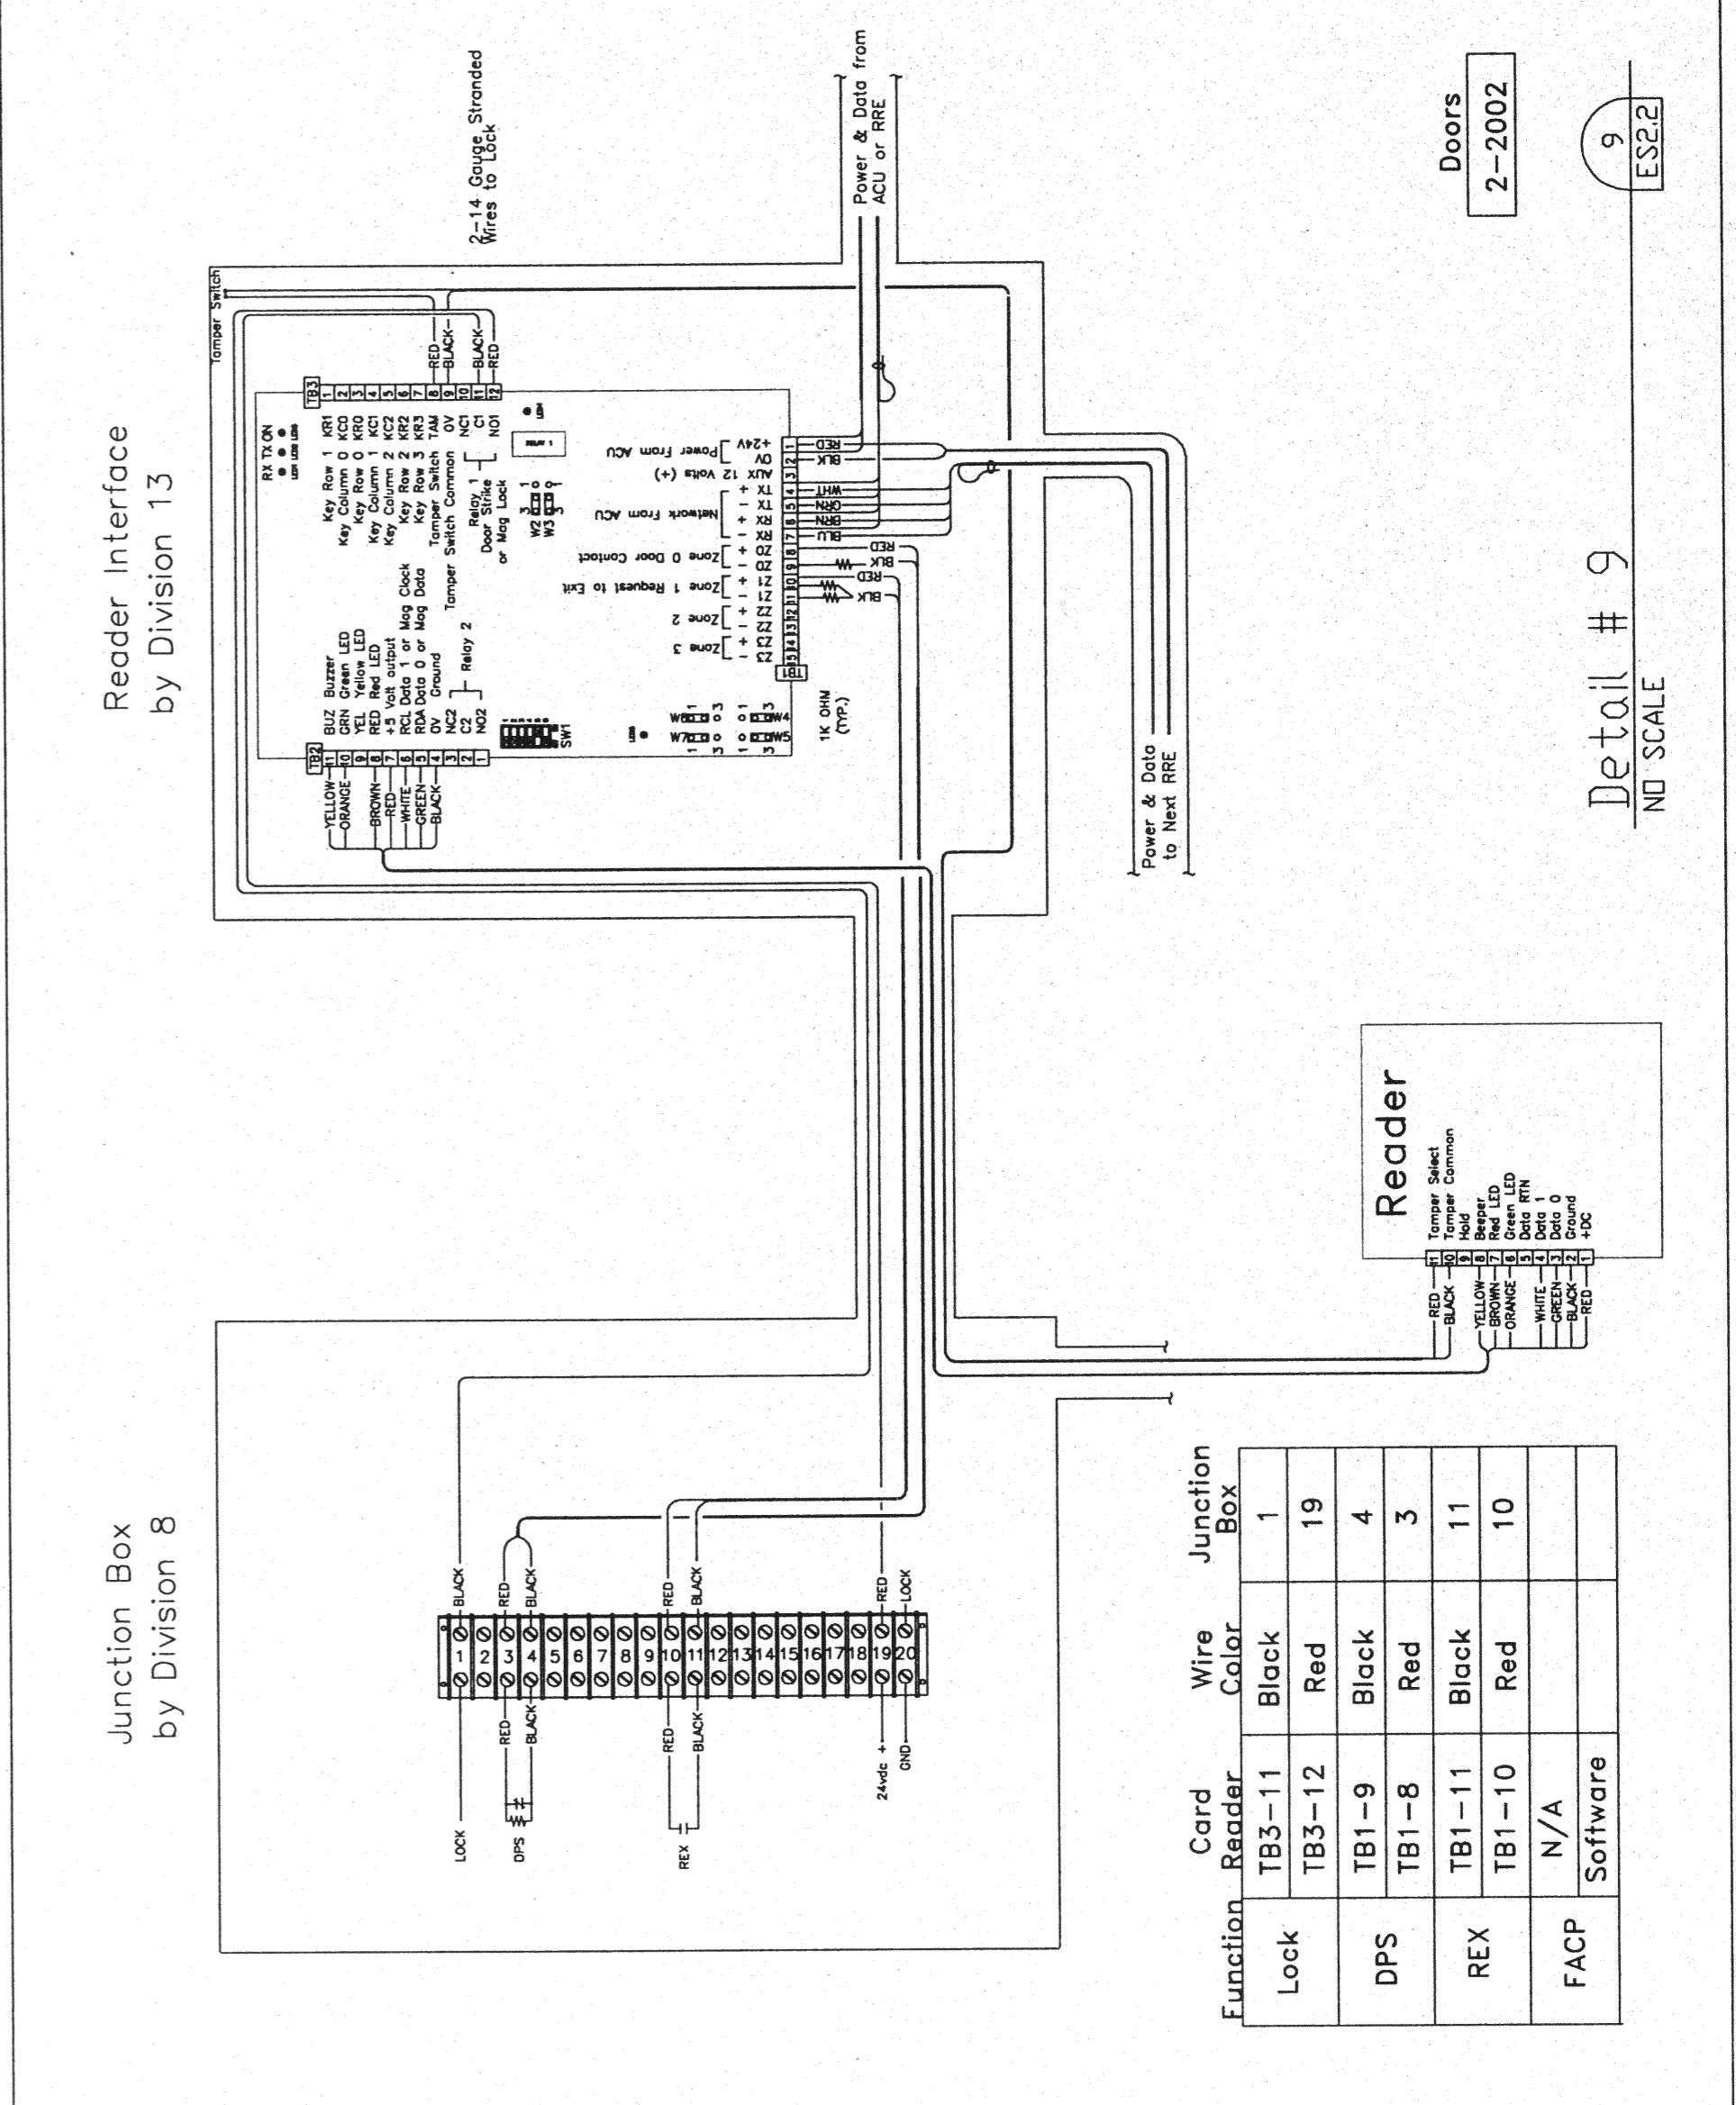
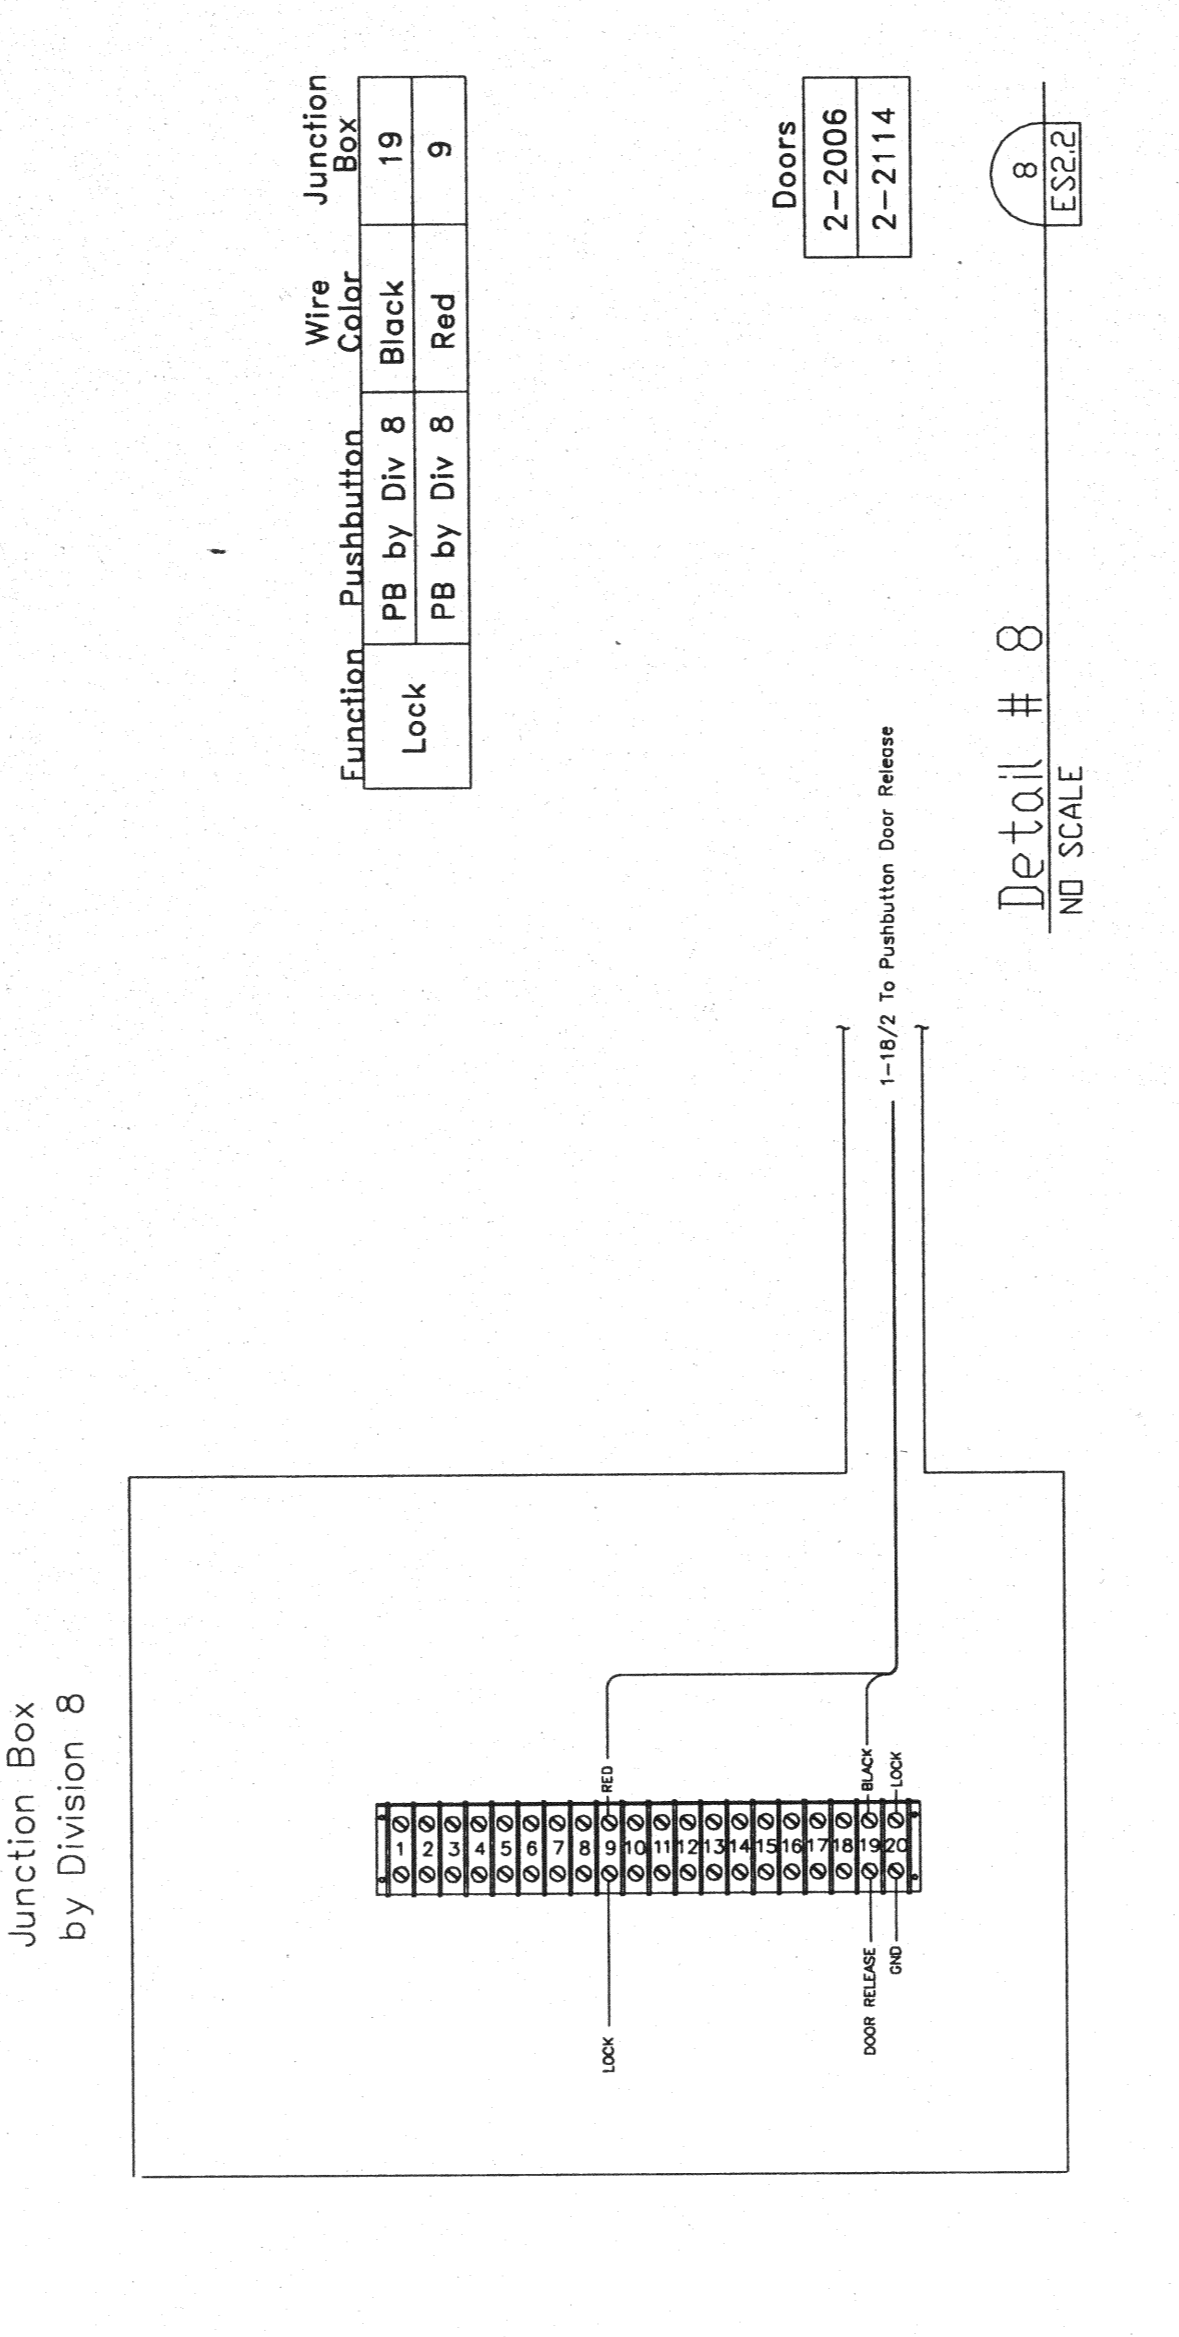
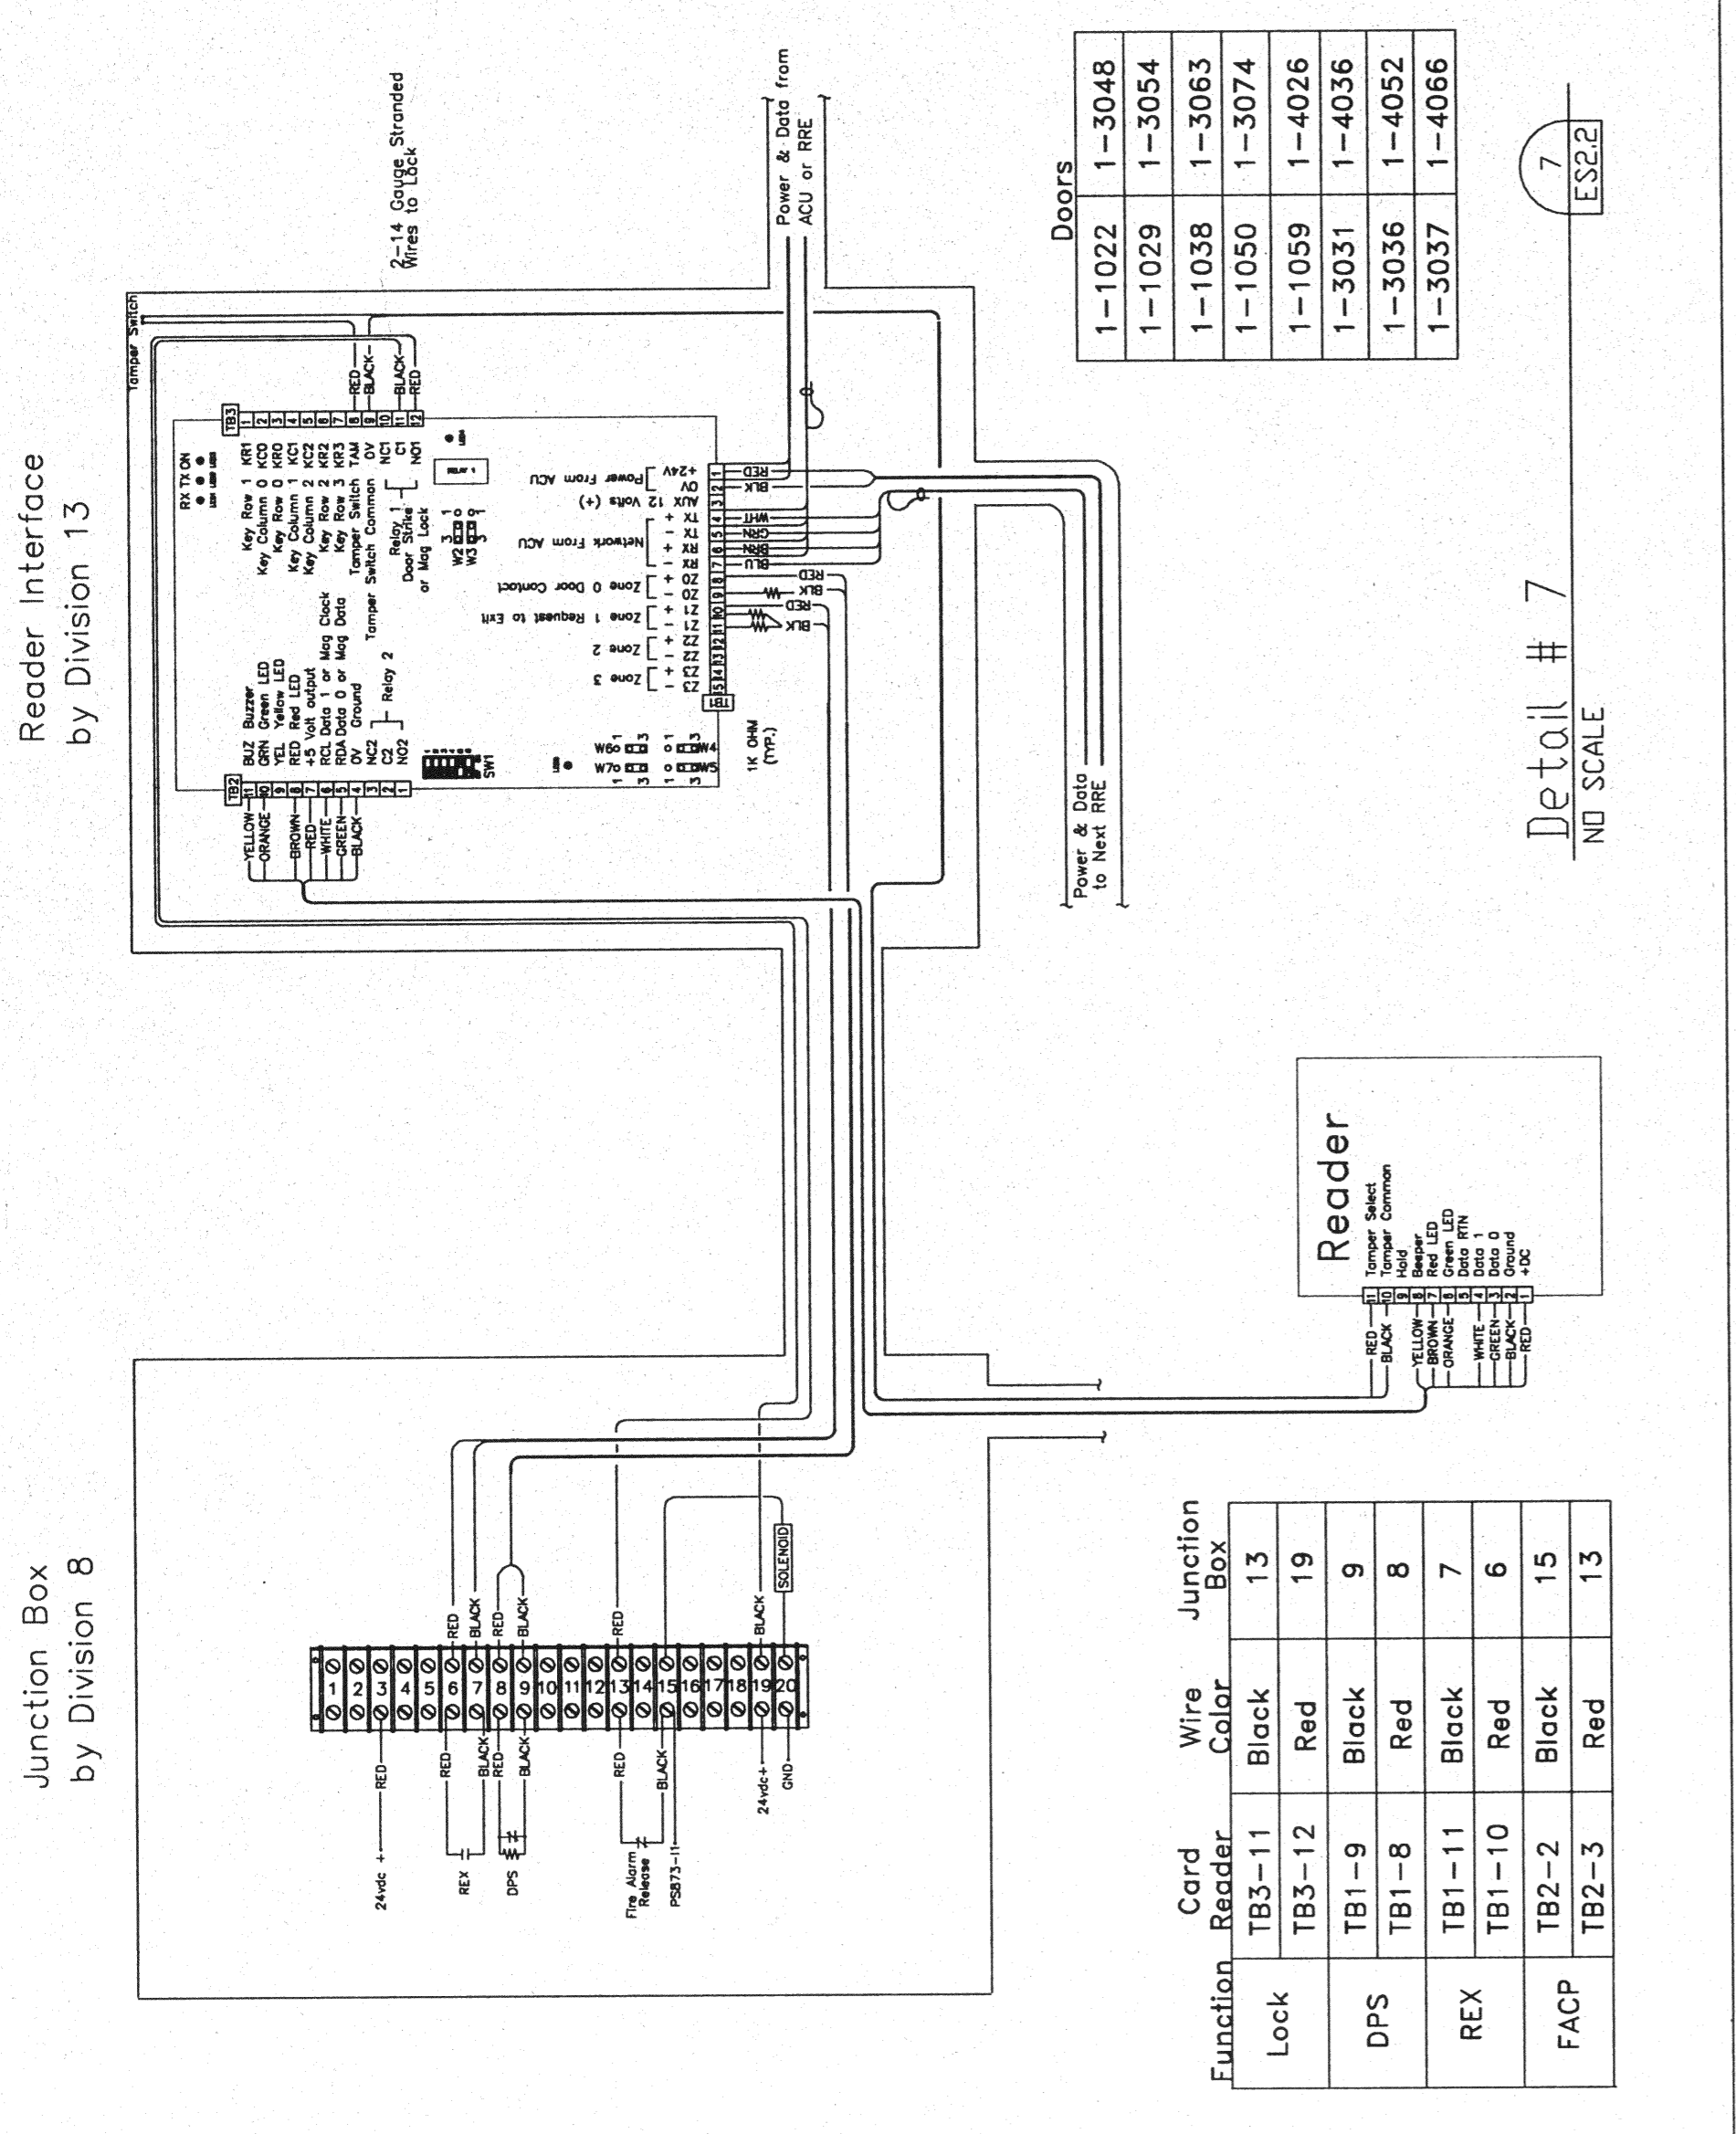




# Glassbreak, Motion & Panic Alarms

Room #	Address	Cameras	Panic	Glassbreak	Motion	Detail #
1002	ACU1-5	17	9			15
1003	ACU1-4	18	10			15
1004	ACU1-10				4	14
1004	ACU1-11				5	14
1007	ACU1-7	45			1	14
1007	ACU1-8				2	14
1007	ACU1-9				3	14
1009	ACU0-141	21	7			15
1009	ACU0-142	21	8			15
1018	ACU0-131	38	1			15
1018	ACU0-132	38	2			15
1019	ACU0-130				9	14
1022	ACU0-133		3			15
1022	ACU0-134				1	13
1027	ACU0-135	38	4			15
1027	ACU0-136				2	13
1027	ACU0-137				3	13
1027	ACU0-138				5	15
1029	ACU0-139					13
1029	ACU0-140				6	15
1059	ACU1-23				11	15
1065	ACU1-197	19	12			15
1065	ACU1-198	19	13			15
1065	ACU1-199	19	14			15
1065	ACU1-200	19	15			15
1065	ACU1-201	19	16			15
1065	ACU1-202	19	17			15
1065	ACU1-203	19	18			15
1065	ACU1-204				10	14
1071	ACU1-193				6	14
1071	ACU1-194				7	14
1071	ACU1-195				8	14
2008	ACU2-0	27	19			15
2110	ACU2-43	28	20			15
3004	ACU3-9				34	15
3011	ACU3-128	33	30			15
3011	ACU3-129	33	31			15
3014	ACU3-5	32	28			15
3014	ACU3-4	32	29			15
3027	ACU3-7	30	22			15
3027	ACU3-8	30	21			15
3031	ACU3-6				23	15
3032	ACU3-1				25	15
3032	ACU3-0				24	15
3037	ACU3-2				26	15
3039	ACU3-3				27	15
3039	ACU3-130				32	15
3048	ACU3-131				33	15
3054	ACU3-132				35	15
3058	ACU3-133				36	15
3058	ACU3-136				41	15
3061	ACU3-134	34	37			15
3061	ACU3-135	34	38			15
3062	ACU3-137	35	39			15
3062	ACU3-138	35	40			15
3063	ACU3-139				42	15
3064	ACU3-140				43	15
3074	ACU3-143				46	15
3079	ACU3-141	37	44			15
3079	ACU3-142	37	45			15
4006	ACU4-141	39	47			15
4006	ACU4-142	39	48			15
4021	ACU4-0				63	15
4021	ACU4-1	44	64			15
4026	ACU4-2	44	65			15
4031	ACU4-143				49	15
4031	ACU4-150				50	15
4034	ACU4-128	41	51			15
4036	ACU4-129	41	52			15
4052	ACU4-131				53	15
4053	ACU4-132				54	15
4057	ACU4-136	42	58			15
4063	ACU4-137	42	59			15
4066	ACU4-138	42	60			15
4071	ACU4-139				61	15
4071	ACU4-140				62	15
4086	ACU4-133				55	15
4086	ACU4-134				56	15
4086	ACU4-135				57	15


Refer to System Plans ES1.1 thru ES1.6 for Zone #s.

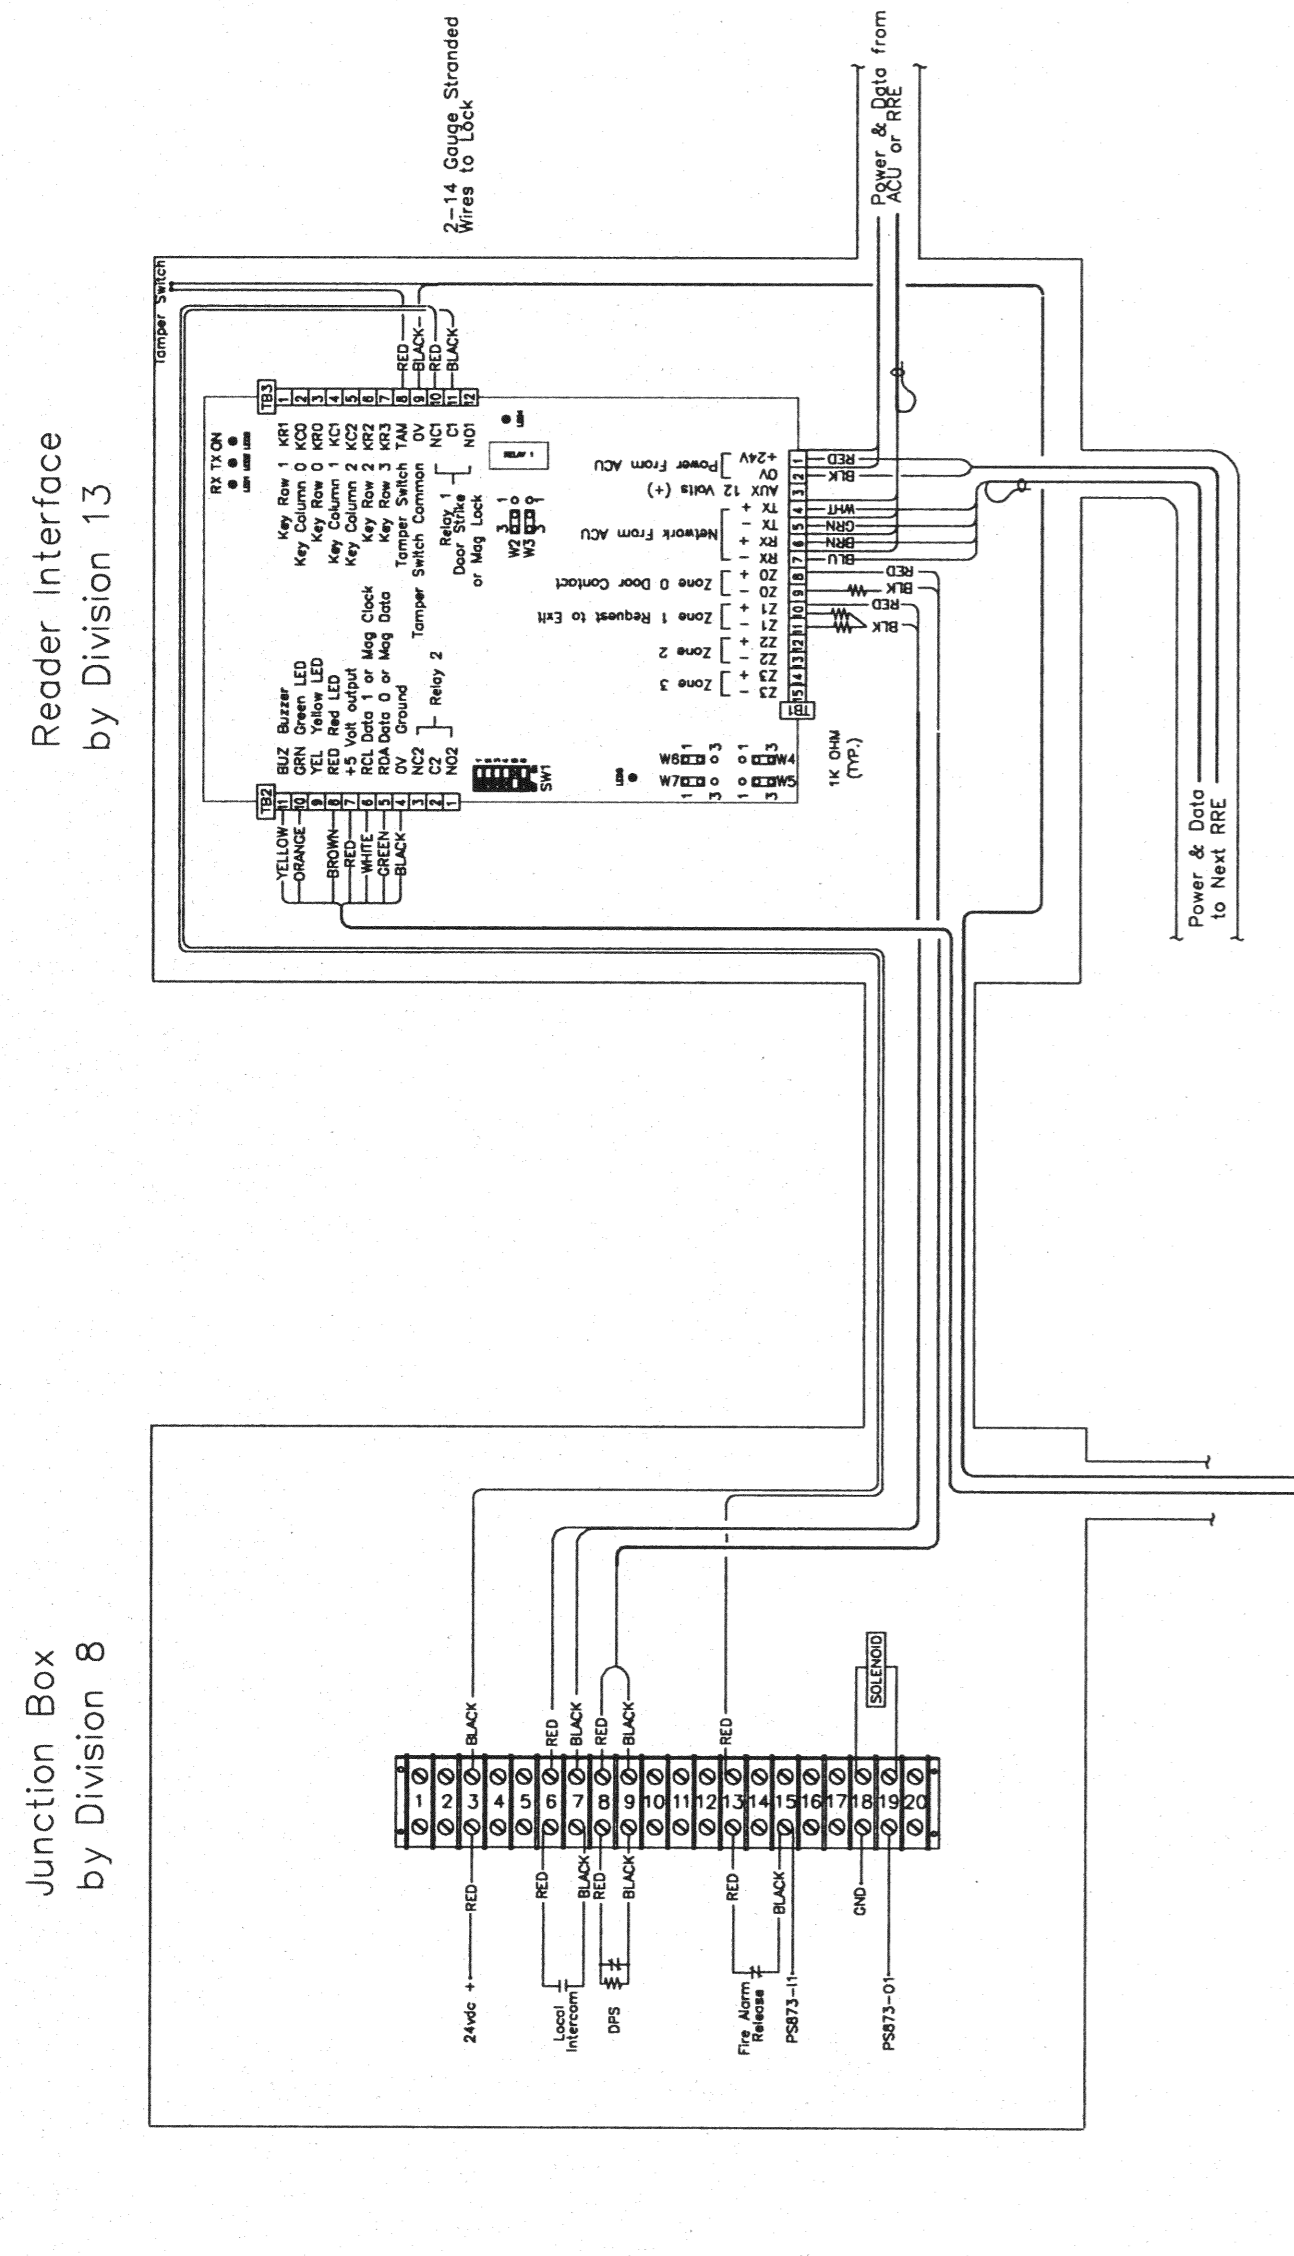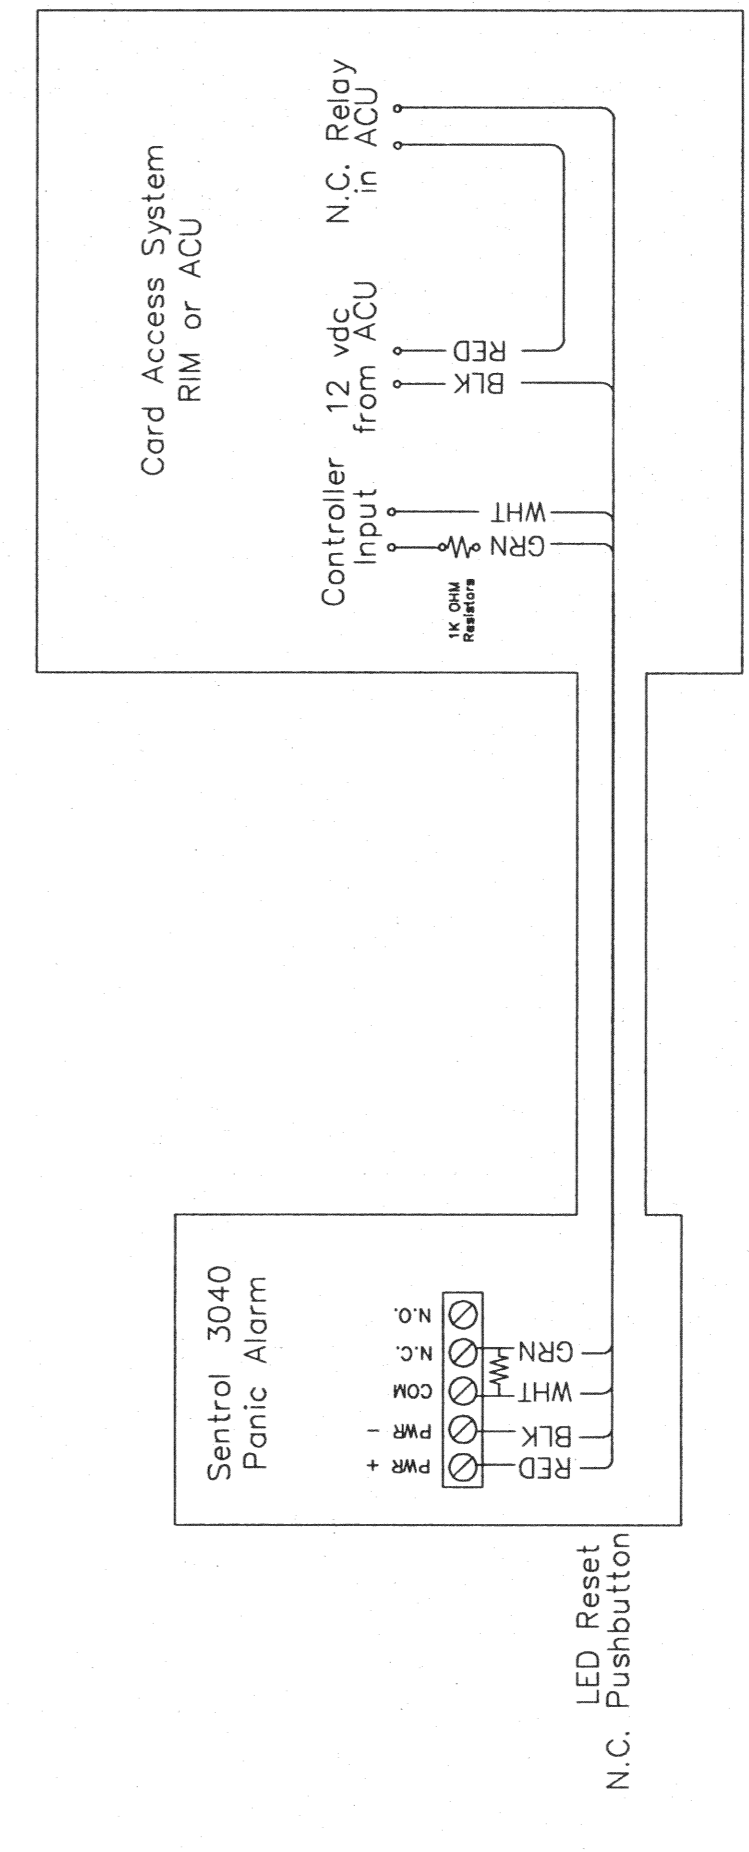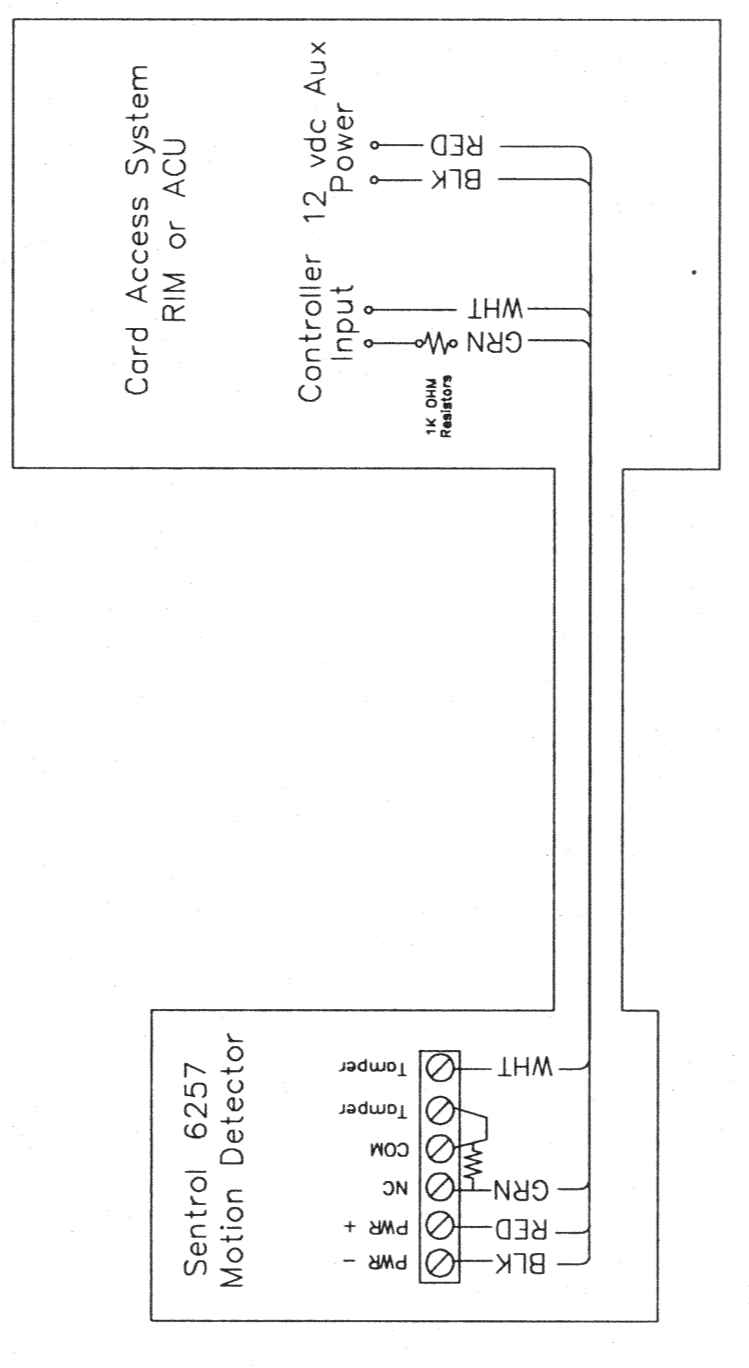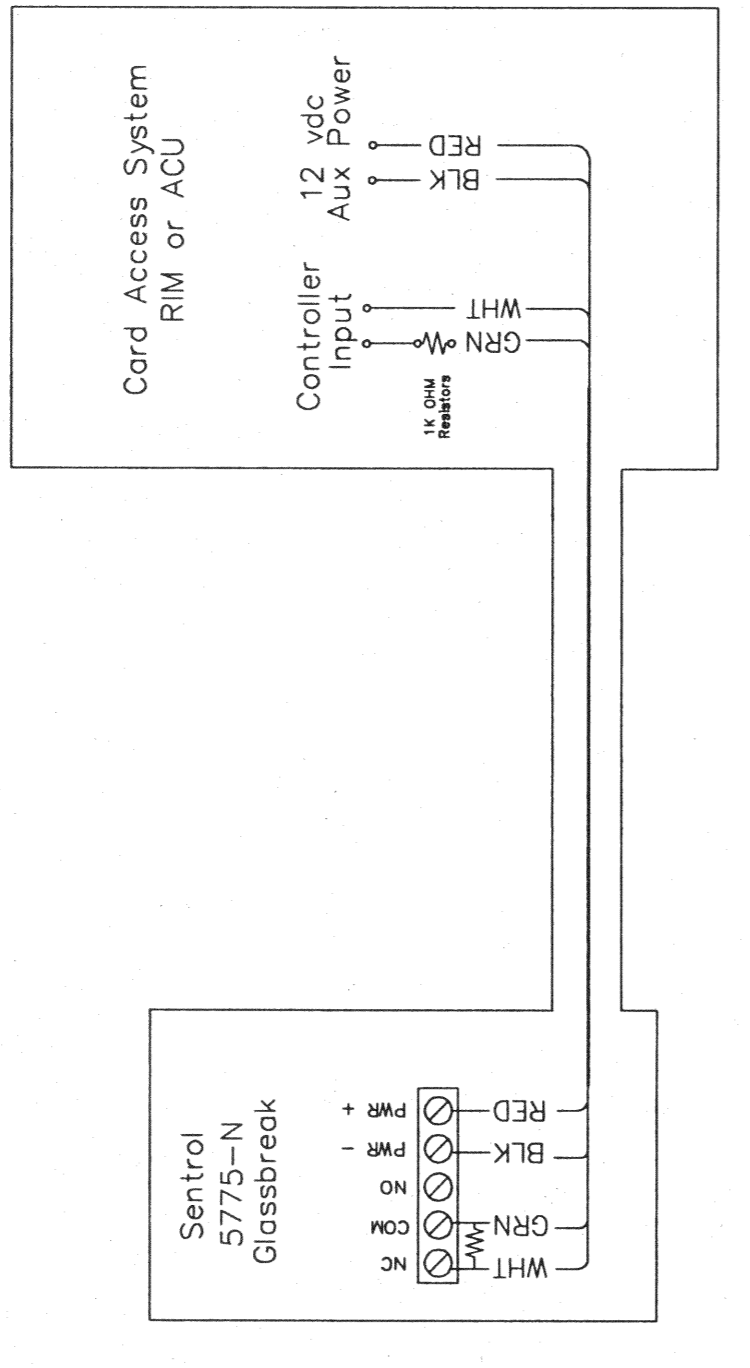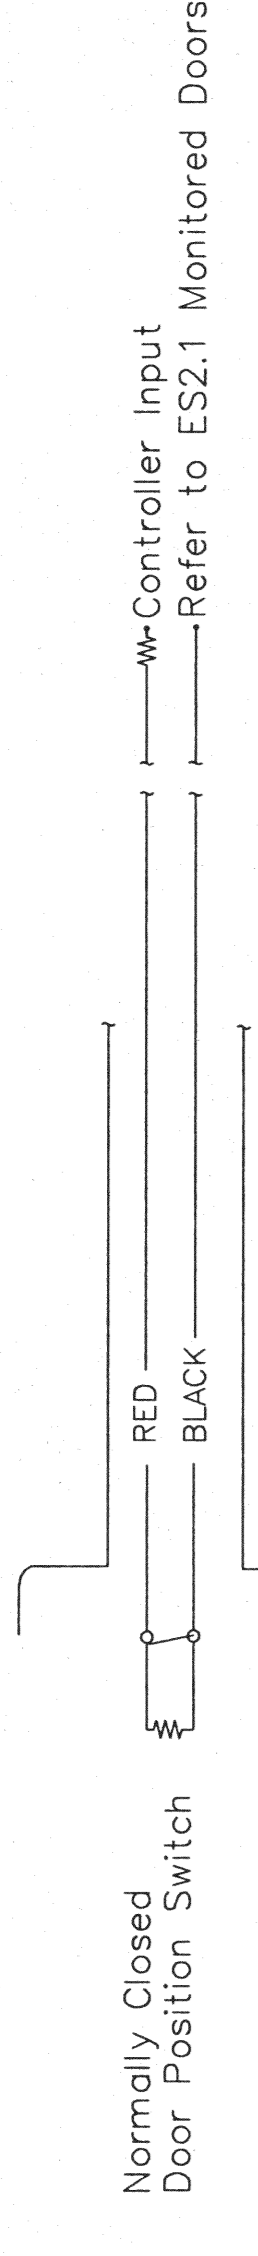

Function	Card Reader	Wire Color	Junction Box
Lock	TB3-11	Black	3
	TB3-12	Red	13
DPS	TB1-9	Black	9
	TB1-8	Red	8
REX	TB1-11	Black	7
	TB1-10	Red	6
FACP		Black	13
		Red	15
Local	VY-10EM	Black	7
Intercom	VY-10EM	Red	6

Doors
1-1037
1-2063
1-3055
1-4050

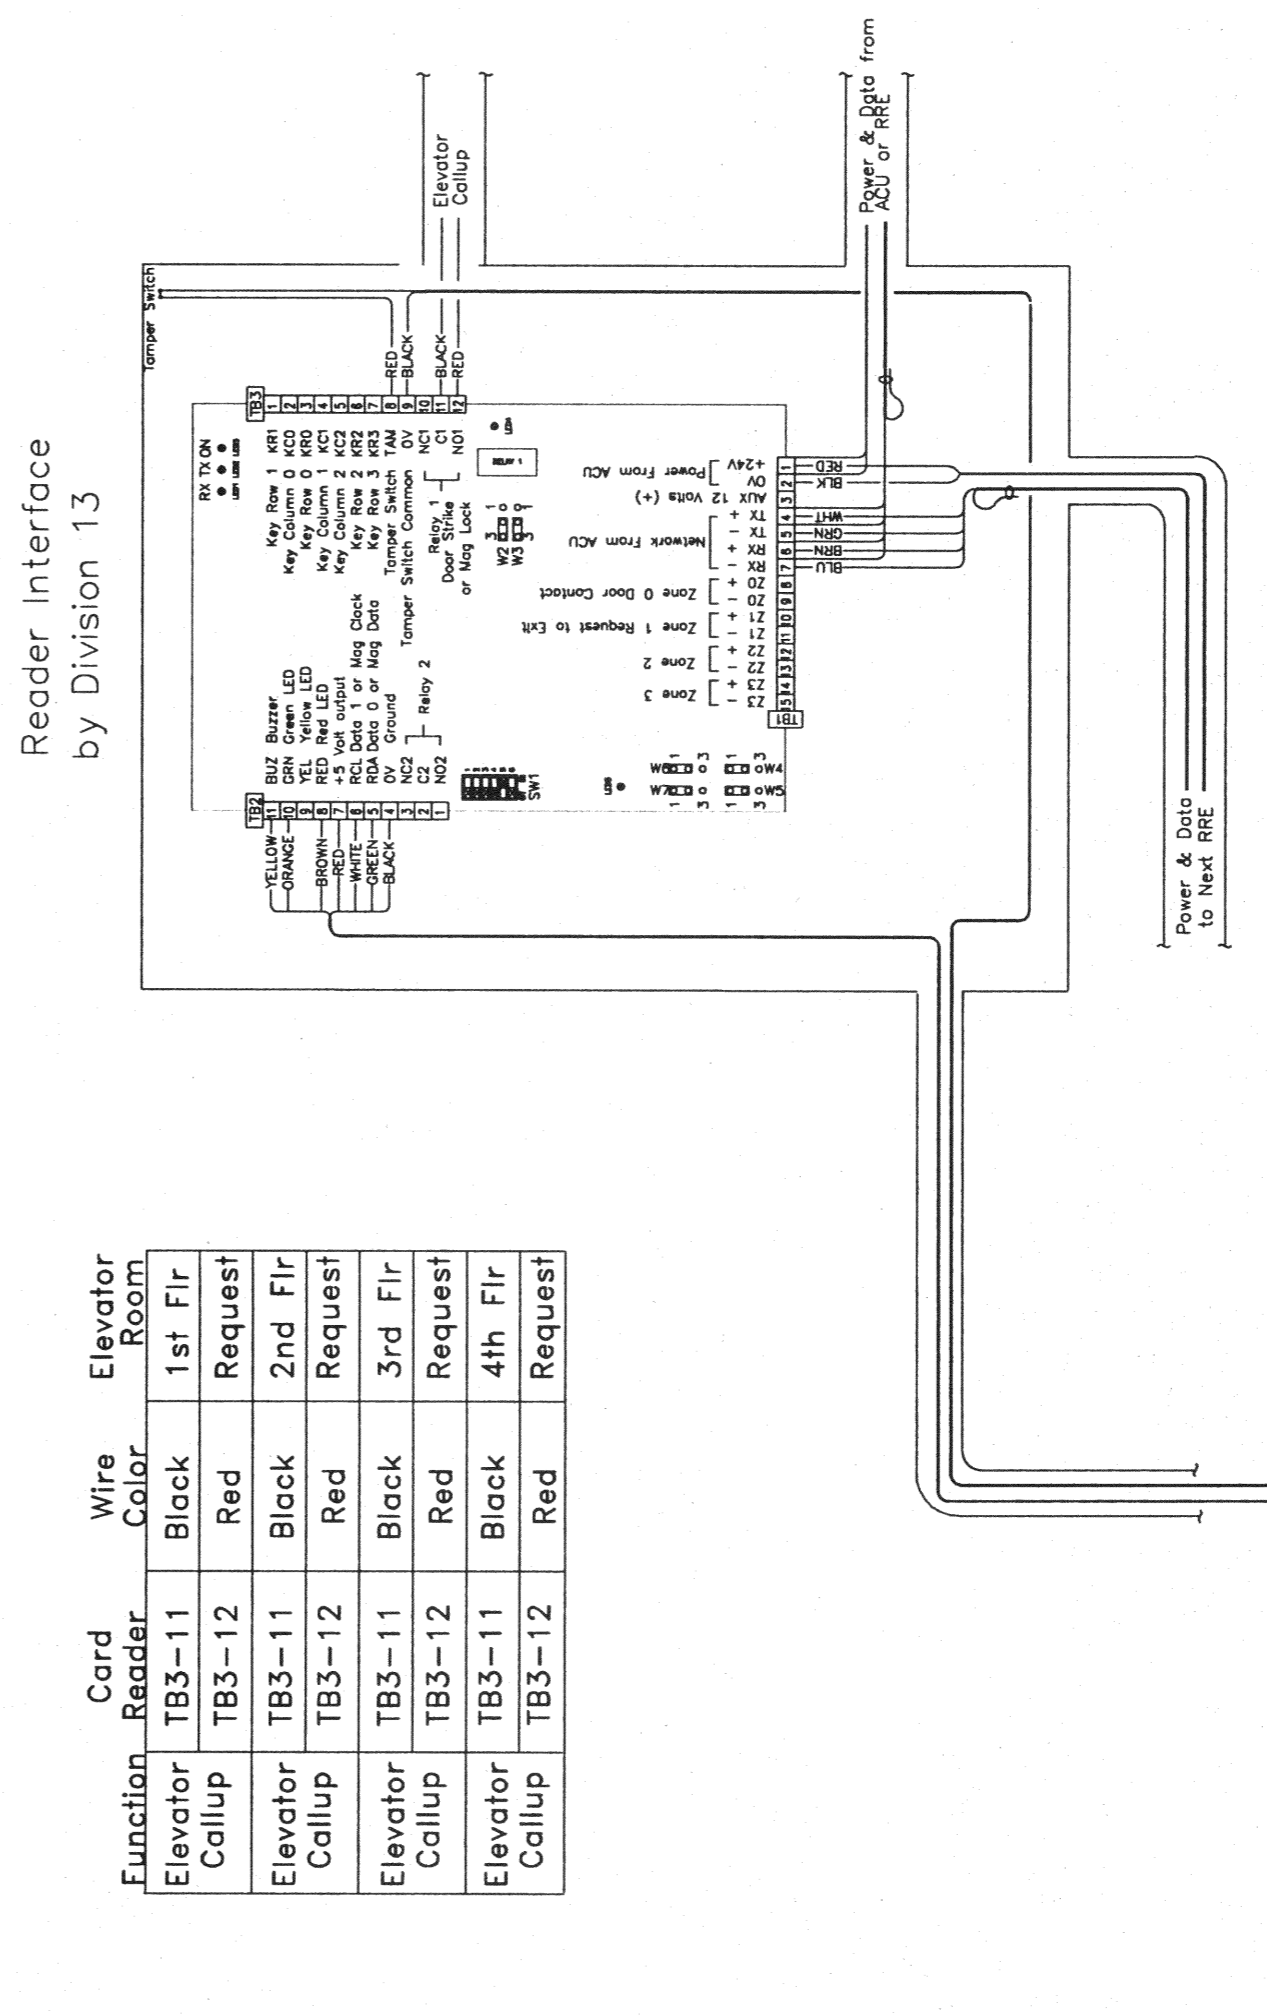

Function	Card Reader	Wire Color	Elevator Room
Elevator Callup	TB3-11	Black	1st Flr
	TB3-12	Red	Request
Elevator Callup	TB3-11	Black	2nd Flr
	TB3-12	Red	Request
Elevator Callup	TB3-11	Black	3rd Flr
	TB3-12	Red	Request
Elevator Callup	TB3-11	Black	4th Flr
	TB3-12	Red	Request

Doors
1-1034
1-2054
1-3044
1-4038

Detail # 11  
NO SCALE

Detail # 15  
NO SCALE