


Vents

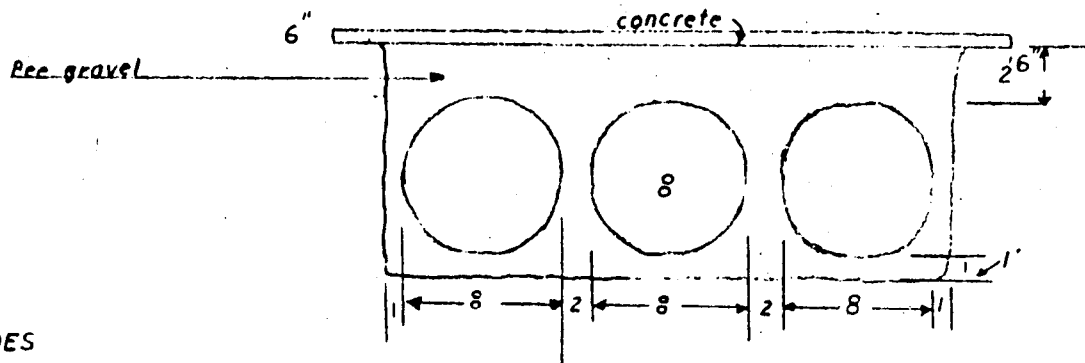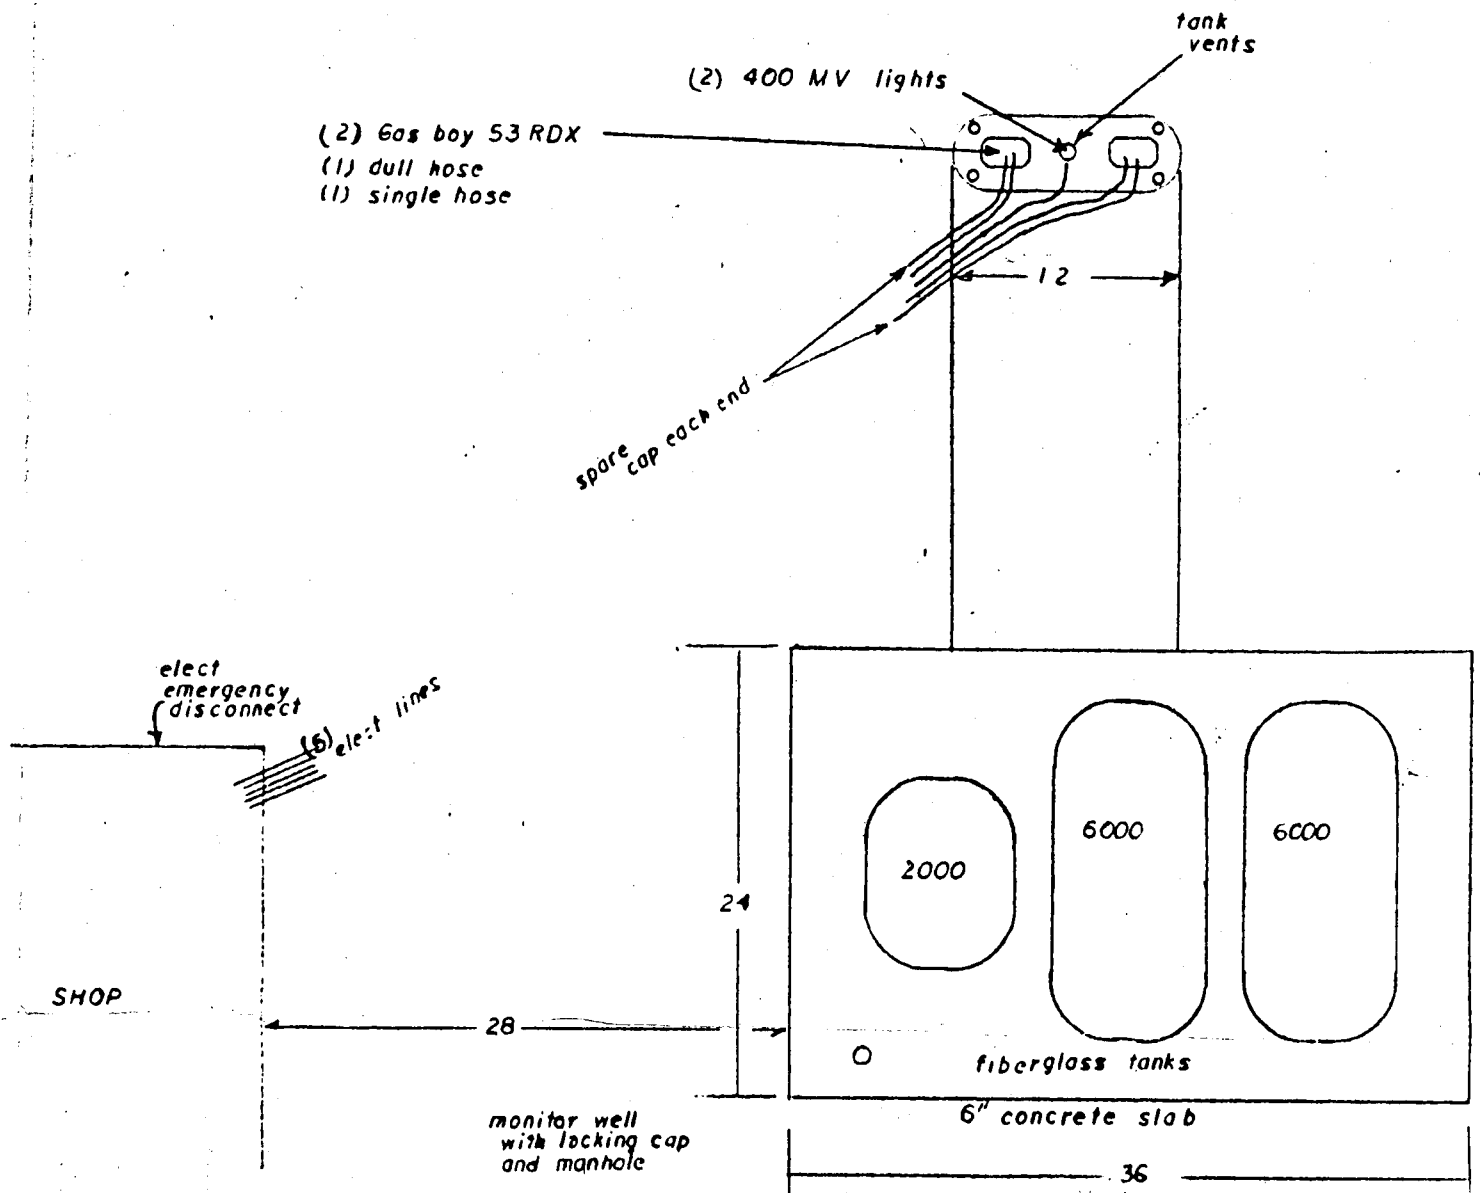

SCOPE OF WORK

furnish and install (2) 6000 gal,
1 2000 gal. fiberglass tanks Xerxes
OPW 1 spill cont., one each tank
OPW 6150 spill prev valves,
one each tank

VC011265 Gilbarco tank monitor
with printer

PA023096 Gilbarco tank probes

2 Gas boy 53 RDX pumps

1 dull hose

1 single hose

2 400 wt MV lights with pole



wire to ext card reader

to meet ALL EPA, STATE, and LOCAL CODES



Mesa County School Dist

1/8 scale

ACCEPTED *8/12/89 Klall*
ANY CHANGE OF SETBACKS MUST BE
APPROVED BY THE CITY PLANNING
DEPT. IT IS THE APPLICANT'S
RESPONSIBILITY TO PROPERLY
LOCATE AND IDENTIFY EASEMENTS
AND PROPERTY LINES.

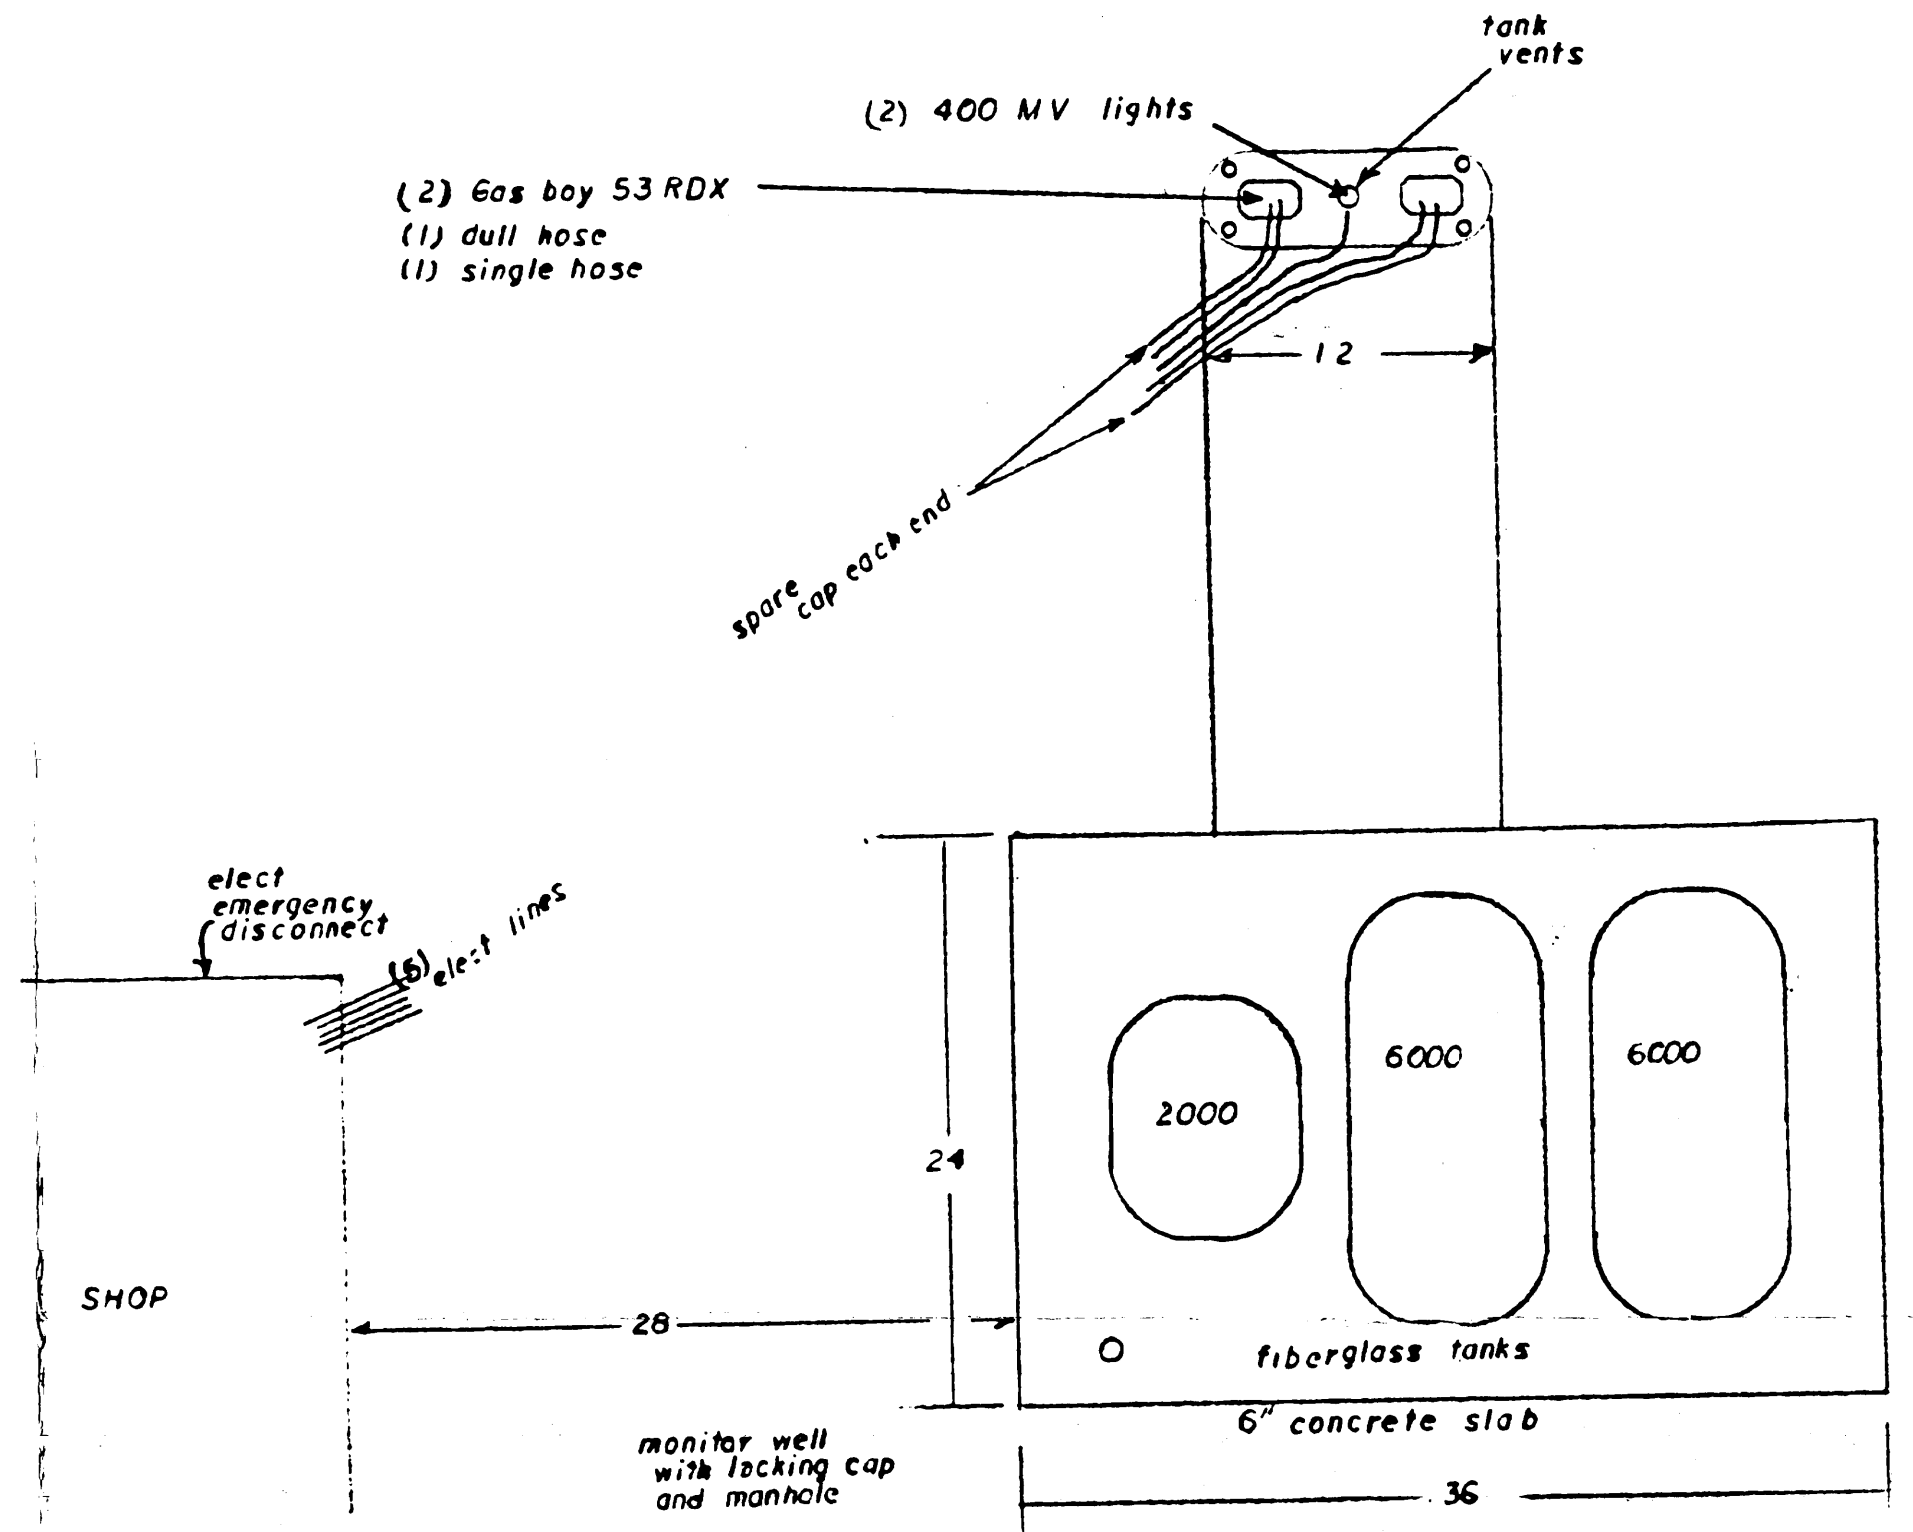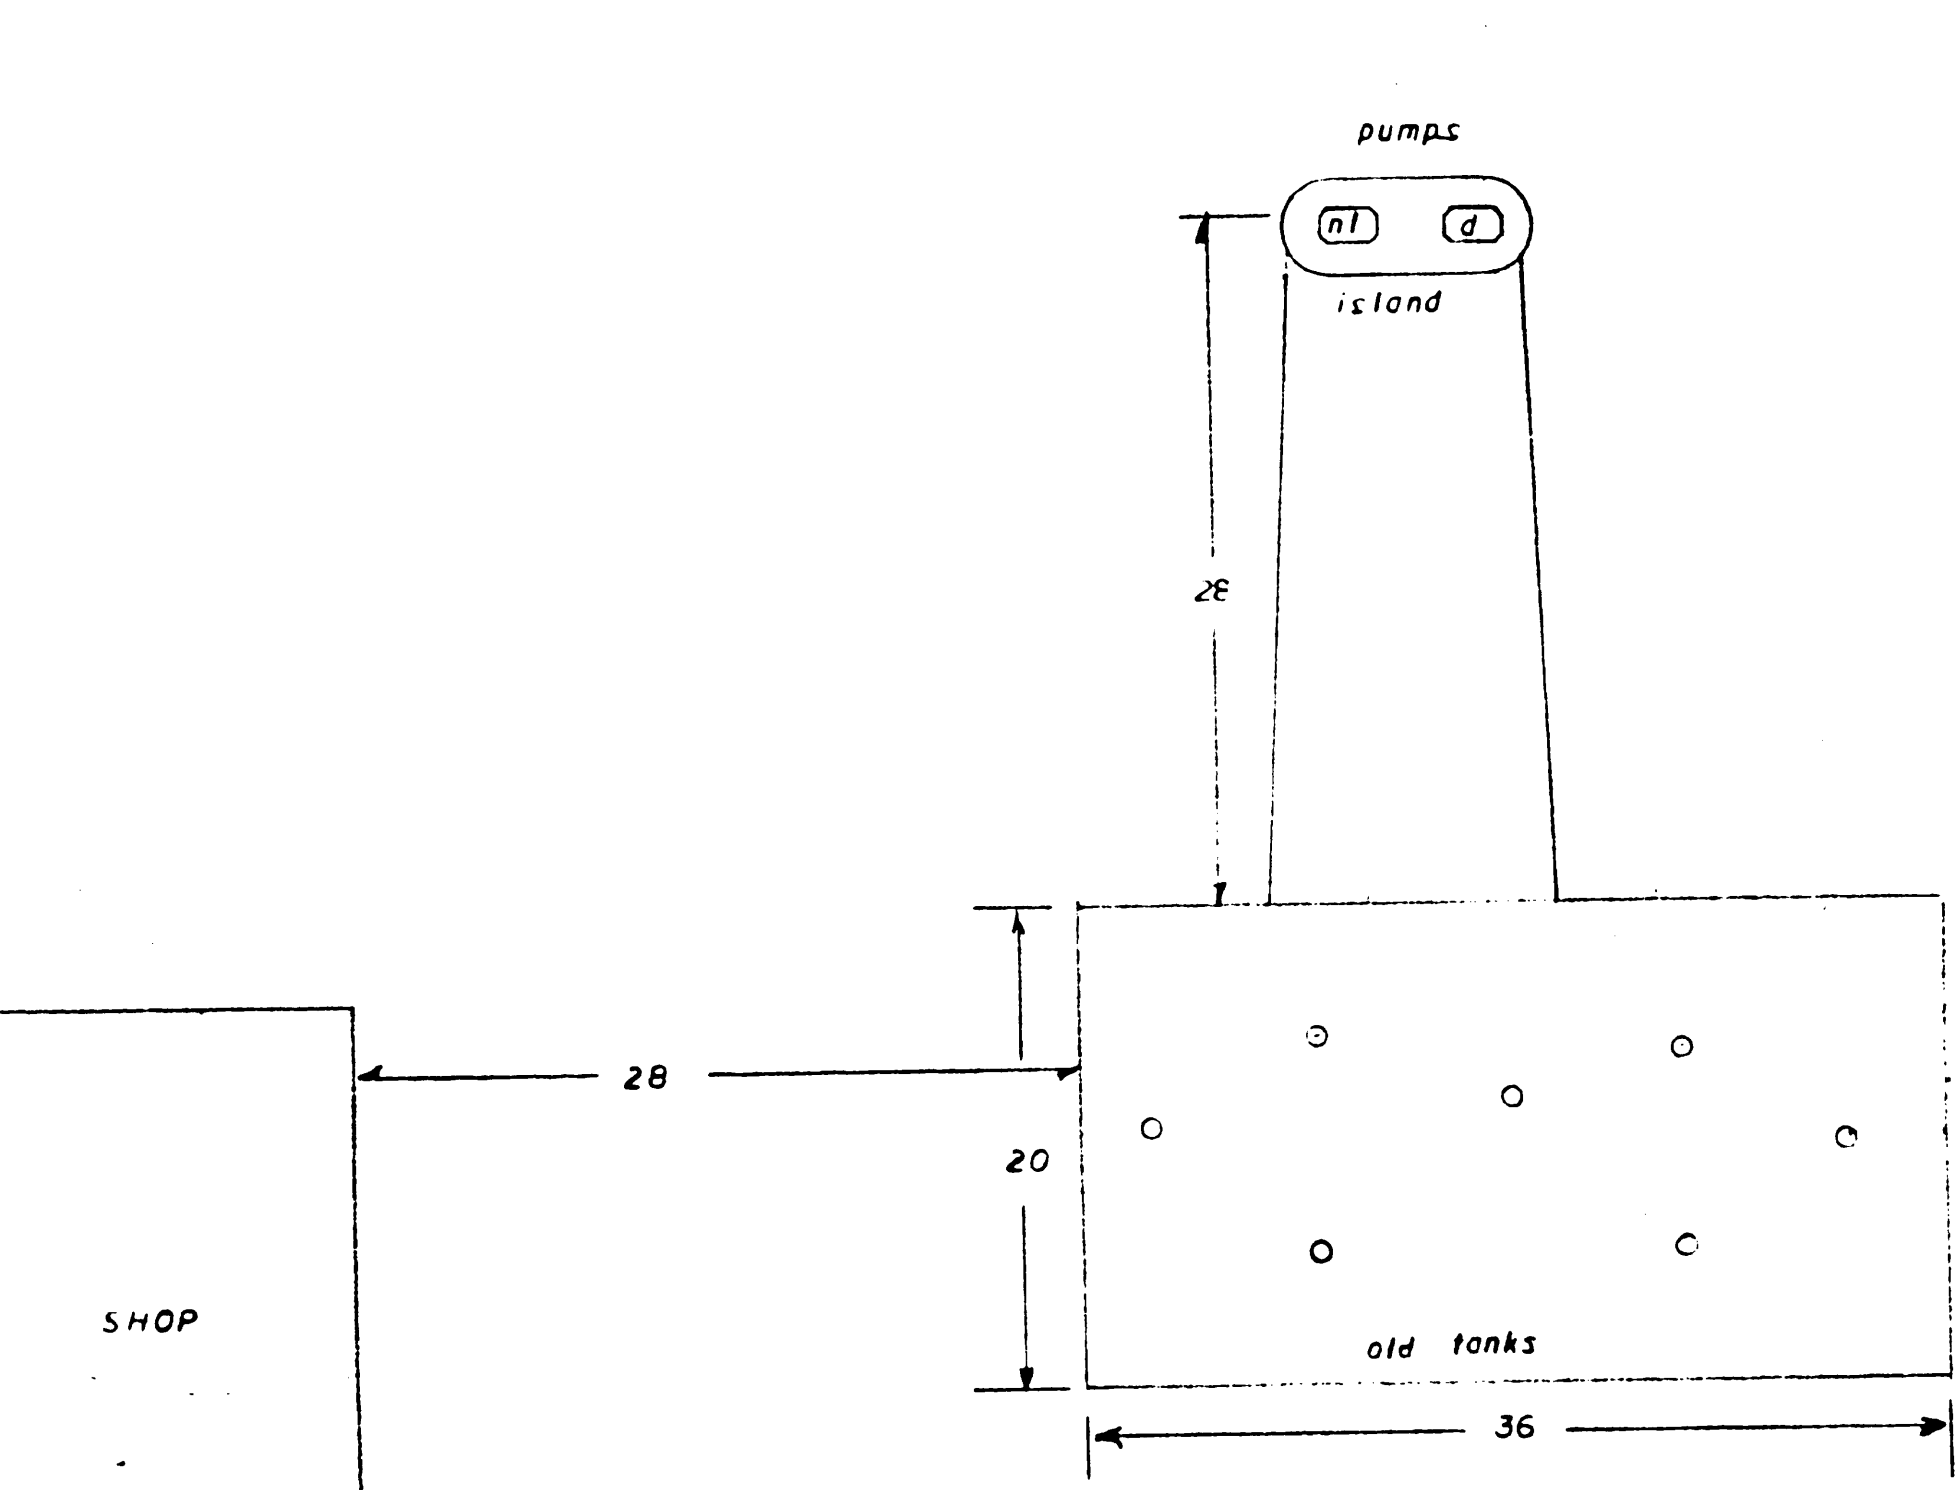

SCOPE OF WORK
 furnish and install (2) 6000 gal,
 1 2000 gal. fiberglass tanks Xerxes
 OPW 1 spill cont., one each tank
 OPW 6150 spill prev valves,
 one each tank
 VCO11265 Gilbarco tank monitor
 with printer
 PA023096 Gilbarco tank probes
 2 Gas boy 53 RDX pumps
 1 dull hose
 1 single hose
 2 400 wt MV lights with pole
 wire to ext card reader
 to meet ALL EPA, STATE, and LOCAL CODES
 Meigs County School DIST

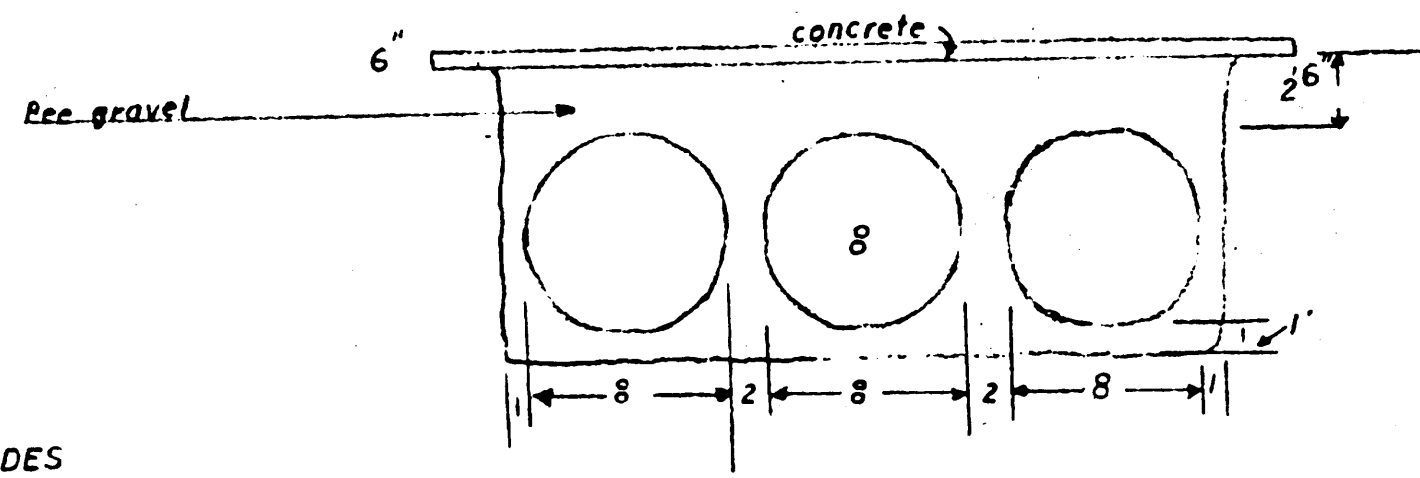

1/8 scale

ACCEPTED *8/2/89 Koll*
 ANY CHANGE OF SETBACKS MUST BE
 APPROVED BY THE CITY PLANNING
 DEPT. IT IS THE APPLICANT'S
 RESPONSIBILITY TO PROPERLY
 LOCATE AND IDENTIFY EASEMENTS
 AND PROPERTY LINES.