


VICINITY MAP

- CONSTRUCTION NOTES:**
- ① REMOVE EXISTING 8" CONCRETE SEWER LINE AND INSTALL 8" SDR 35, PVC SEWER LINE AT EXISTING LINE AND GRADE.
 - ② ASPHALT PATCH ONE FOOT (1') WIDER THAN TOP OF TRENCH ON BOTH SIDES. MAXIMUM PAY WIDTH 8'. EXTEND EDGES TO OBTAIN A RECTANGULAR PATCH. MAKE CUTS PERPENDICULAR TO EXISTING EDGES. 3" GRADE "C" HOT BITUMINOUS PAVEMENT 6" CLASS 6 AGGREGATE BASE COURSE
 - ③ CONNECT NEW SEWER LINE TO EXISTING MANHOLE. INSTALL WATERSTOP ON PIPE AND ENCASE IN CONCRETE.
 - ④ REPLACE 4" SERVICE LINE TO RIGHT-OF-WAY WITH 4" PVC CONNECT TO EXISTING LINE WITH CALDER COUPLING ENCASED IN CONCRETE.

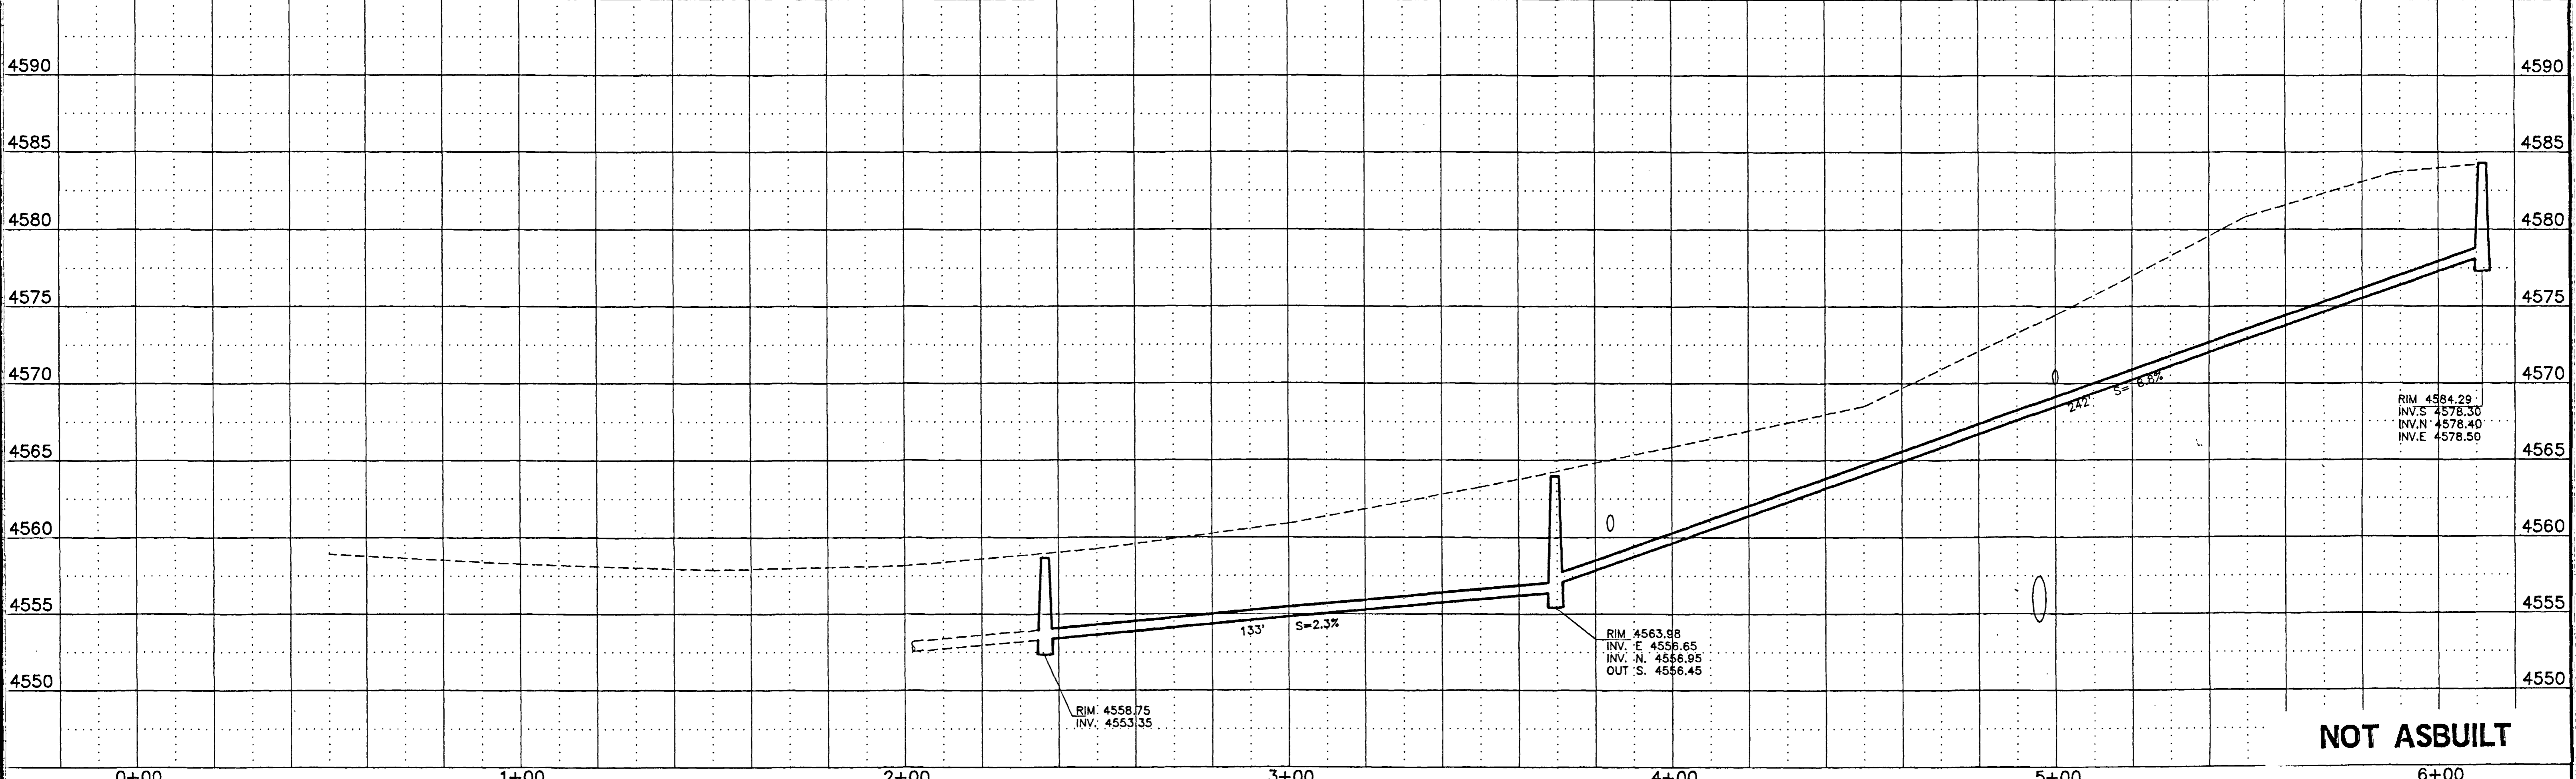

<p>0+00</p> <p>1+00</p> <p>2+00</p> <p>3+00</p> <p>4+00</p> <p>5+00</p> <p>6+00</p>	<p>DESCRIPTION</p> <p>DATE</p> <p>DRAWN BY L. MARTIN DATE 9/93</p> <p>CHECKED BY T.K.H. DATE 9/93</p> <p>APPROVED BY T.K.H. DATE 9/93</p> <p>FIELD BOOK NO. PAGE</p>	<p>SCALE</p> <p>PLAN 1"=20'</p> <p>PROFILE 1"=5'</p>	<p>DEPARTMENT OF PUBLIC WORKS AND UTILITIES</p> <p>ENGINEERING DIVISION</p> <p>CITY OF GRAND JUNCTION, COLORADO</p>	<p>1993 SEWER LINE REPLACEMENTS</p> <p>BASS ST, W.HALL AVE to LAKESHORE DR</p> <p>Plan & Profile</p>	<p>SHEET NO. ?</p> <p>OF ?</p> <p>FILE NO. BASSN.DWG</p>
---	--	--	---	--	--